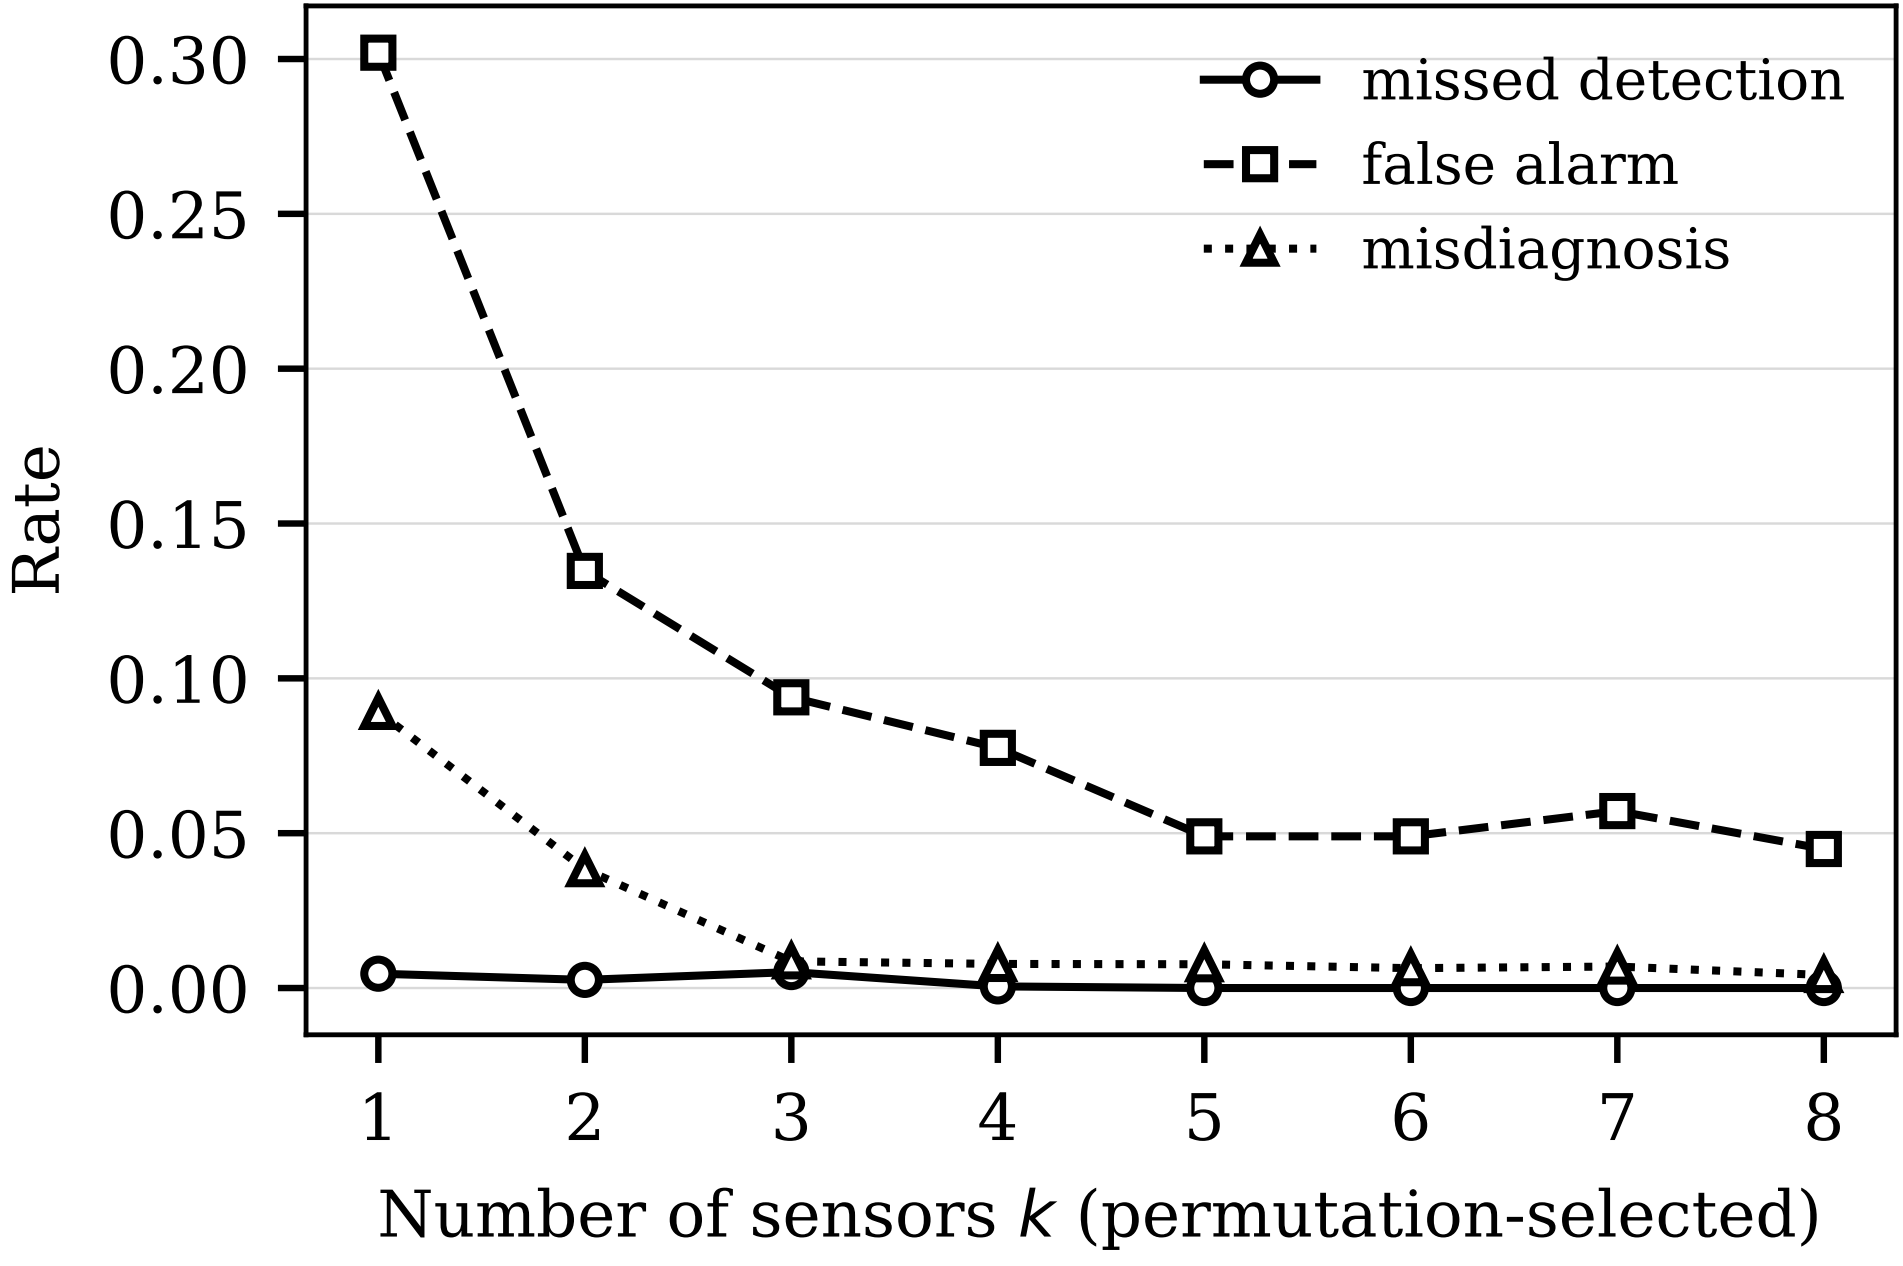
0.30
0.25
0.20
0.15
0.10
0.05
0.00
Rate
missed detection
false alarm
misdiagnosis
1
2
3
4
5
6
7
8
Number of sensors k (permutation-selected)