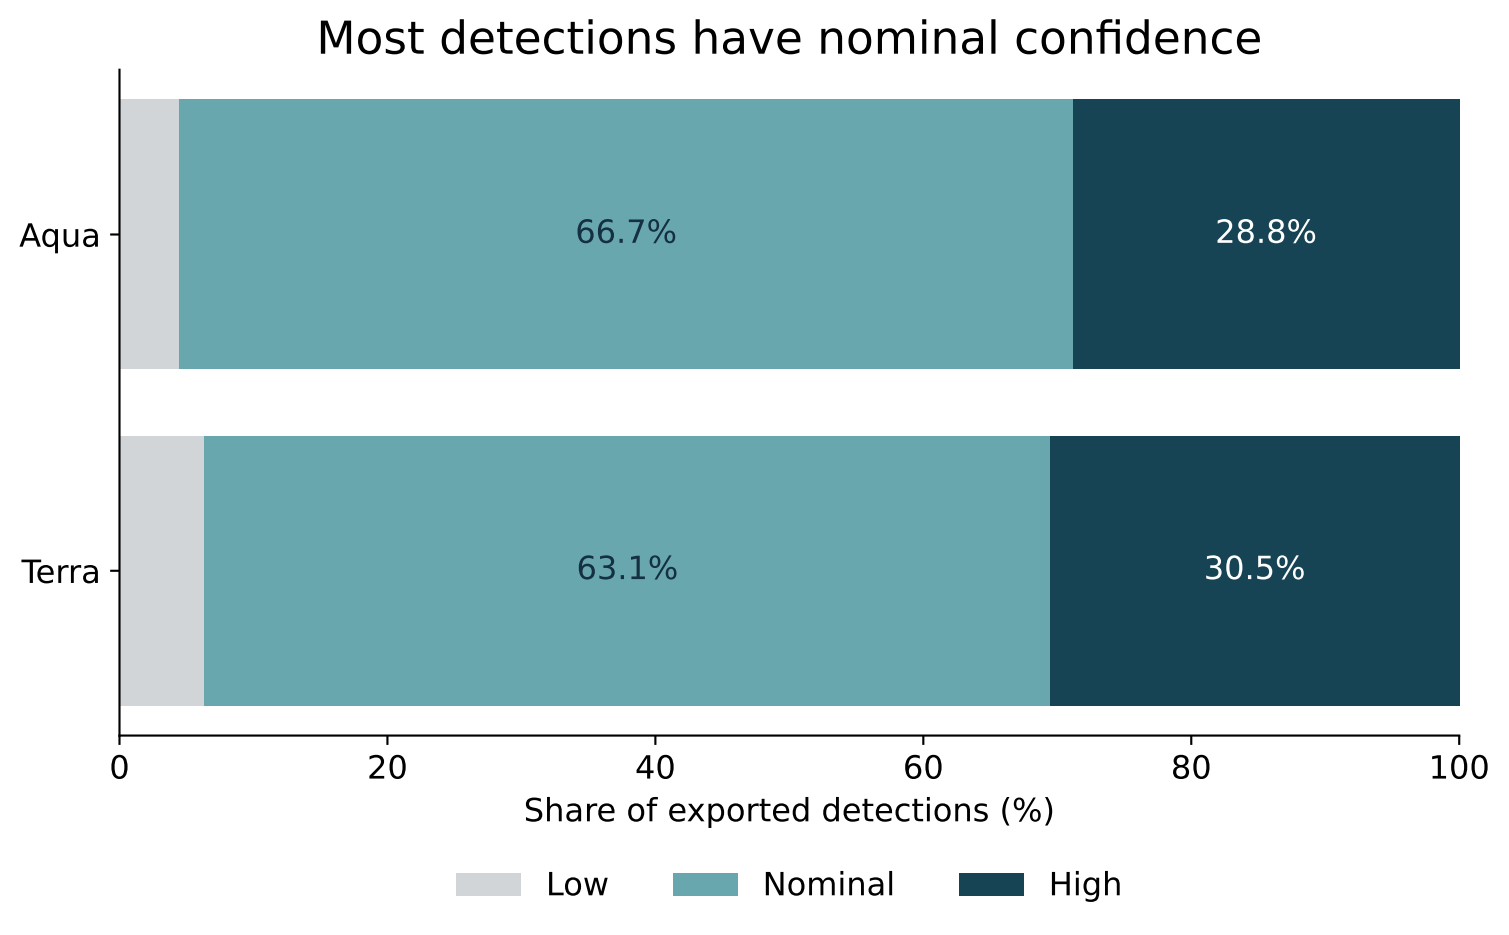
Most detections have nominal confidence
Aqua
Terra
66.7%
28.8%
63.1%
30.5%
0
20
40
60
80
100
Share of exported detections (%)
Low
Nominal
High