

54-121-250

 Precision Industries Testing Department	GENERATING-SET				Model No: PI 250 C		60 Hz	
	LOAD TEST				Type: Close		Job No: 10574	
					Color: Orange		Date: 15/01/2020	

Serial Number:								
PI Model No:	PI 250 C	Prime Power:	225	[kVA]	P.F (Load):	1	Voltage:	380

Generating Set Details:

Engine:	Cummins	Model No: QSB7 - G5	Serial No: 84908481
Alternator:	Stamford	Model No: UCI 274 H1	Serial No: C19D159180
Controller:	DSE	Model No: 6120	Serial No: 7309162
C. Breaker:	Metasol 400A	Model No: ABS 403 C	Serial No: N/A
C.Transformer:	VTEKE 400/5A	Model No: N/A	Serial No: N/A
AVR:	Stamford	Model No: SX 460	Serial No: 110062 - 1143
Cooling System:	Water cool	Enclosure Type: Canopy	Protection Class: IP23

Load Test Ambient Conditions:

Temperature	24	[°C]	Altitude:	0	[m]	Humidity:	49	%
-------------	----	------	-----------	---	-----	-----------	----	---

Generating Set Rating:

Testing Full Load Current:	273.48	Amps	Nominal Current:	341.9	Amps
Power Correction Factor (De-rating):	0.00	%	Corrected Prime Power:	0.0	[kVA]

LOAD TEST

Load	Run Time	Freq	Speed	VOLTAGE L-L			CURRENT			Power	Coolant Temp	Oil Pressure	Charg-Alt.
				L1	L2	L3	L1	L2	L3				
%	min	Hz	RPM	V	V	V	A	A	A	kW	C	bar	VDC
0 %	5	60.0	1800	380	380	380	0	0	0	-	55	4.96	14.2
25 %	5	60.0	1800	380	380	380	71	71	70	46.0	72	4.40	14.2
50 %	5	60.0	1800	380	380	380	135	135	134	88.0	77	4.12	14.3
75 %	5	60.0	1800	380	380	380	204	204	204	134.0	85	3.72	14.3
100 %	10	60.0	1800	380	381	382	275	275	274	181.0	88	3.48	14.2
110%	10	60.0	1800	380	381	382	302	302	302	199.0	92	3.28	14.2


LOAD ACCEPTANCE TEST

Suddenly Block Load %	Voltage [V]	Frequency [Hz]	Current [A]	Response Time [sec]
50%	380	60.0	135	0
0%	395 - 380	61.9 - 60.0	0	2
50%	372 - 380	57.6 - 60.0	140	2

PROTECTION SYSTEM TEST

Over Frequency Warning / SD	Under Frequency Warning / SD	Over Voltage Warning / SD	Under Voltage Warning / SD	Oil Pressure SD	Coolant Level Warning / SD	Coolant Temp Warning / SD
65 / 67	55 / 53	440 / 460	360 / 340	1.0	ECM OK	103/108 °C

ACCESSORIES DETAILS

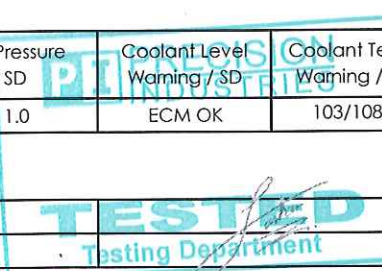

PI Document no.	PI-TST-LT-01	Rev.	00
-----------------	--------------	------	----