

VARADA ENERGIES PVT LTD.

Works: Land+Building/Shed No-10, Grampanchayat Milkat No-1072, Survey No- 79/2, NDA Road, Shivane., Pune- 411 023 . MAHARASHTRA (INDIA)

TEST CERTIFICATE

FOR

SALIENT POLE,SELF EXCITED/ PMG EXCITED AND SELF REGULATED AC GENERATOR

Machine No - G17E228596

Frame Size- UCI1224V1

Engine Model- AL4DTIG3

Engine Sr. No- HGHM 403209

Type Test has been conducted on simillar design machine

STANDARDS- Generator conforms to BS 5000 : Part-3, IS 4722

Tested in accordance with BS EN 60034-1

Rotor dyanamically balanced to BS ISO 1940-1

ROUTINE TEST CERTIFICATE FOR BRUSHLESS AC GENERATOR

FRAME- UCI1224V1	AVR : SX460	AVR Make : Stamford	ENCLOSURE : IP 23	PHASE : 3
RATED Kva- 62.5	RATED VOLTS : 400		FREQUENCY : 60	WIRE : 4- wire
POWER FACTOR- 0.8	STR CONN : Star	STAR WINDING : 311	RATING : CONTINUOUS	
EXC. VOLTS- 58	EXC. AMPS : 2.3	AMB TEMP : 40		

FOR 3 PHASE SEQUENCE LOOKING FROM DRIVE END FOR CLOCKWISE ROTATION : U-V-W

WINDING	COLD RESISTANCE Ohm (+/-10) AT 20 DEG CEN (MAX VALUES)	IN	INSULATION RESISTANCE (M-Ohm)	HV TEST 2 KV FOR 1 MIN	INSULATION CLASS
STATOR	0.219		2+	OK	H
ROTOR	0.789		2+	OK	H

REGULATION TEST

REQ	VOLTS	AMPS	kVA	PF	KW	EXC VOLT	EXC AMP	% LOAD
12	401.8	0	0	0	0	11	0.45	0
10.00	401	69	62.5	0.8	50	58.0	2.3	100

REGULATION + (N.L. VOLTAGE -F.L. VOLTAGE / RATED VOLTAGE) * 100=0.34 %

ITEM DESCRIPTION : AC GENERATOR UC22.4.V.1.311.3..10.5..SX-460. BLACK RAL9011

DATE	DG SR.NO-	AUTHORISED SIGNATORY
------	-----------	----------------------

FINAL INSPECTION -



VARADA ENERGIES PVT LTD.

ENGINE TEST CERTIFICATE

This is to certify that Engine Model... AL4DTIG3


Serial Number HGHM 403209 was tested using

Diesel as Per ISO-3046 Standard.

Corrected Full Load B.H.P. to N.T.P. conditions as per the

Test standard is 76.5 H.P. @ 1800 R.P.M.

Date -

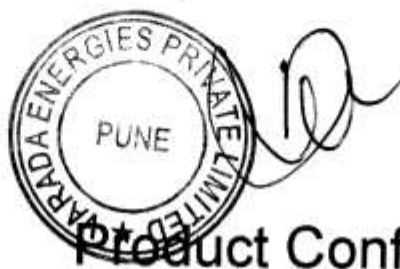

Product Conformance