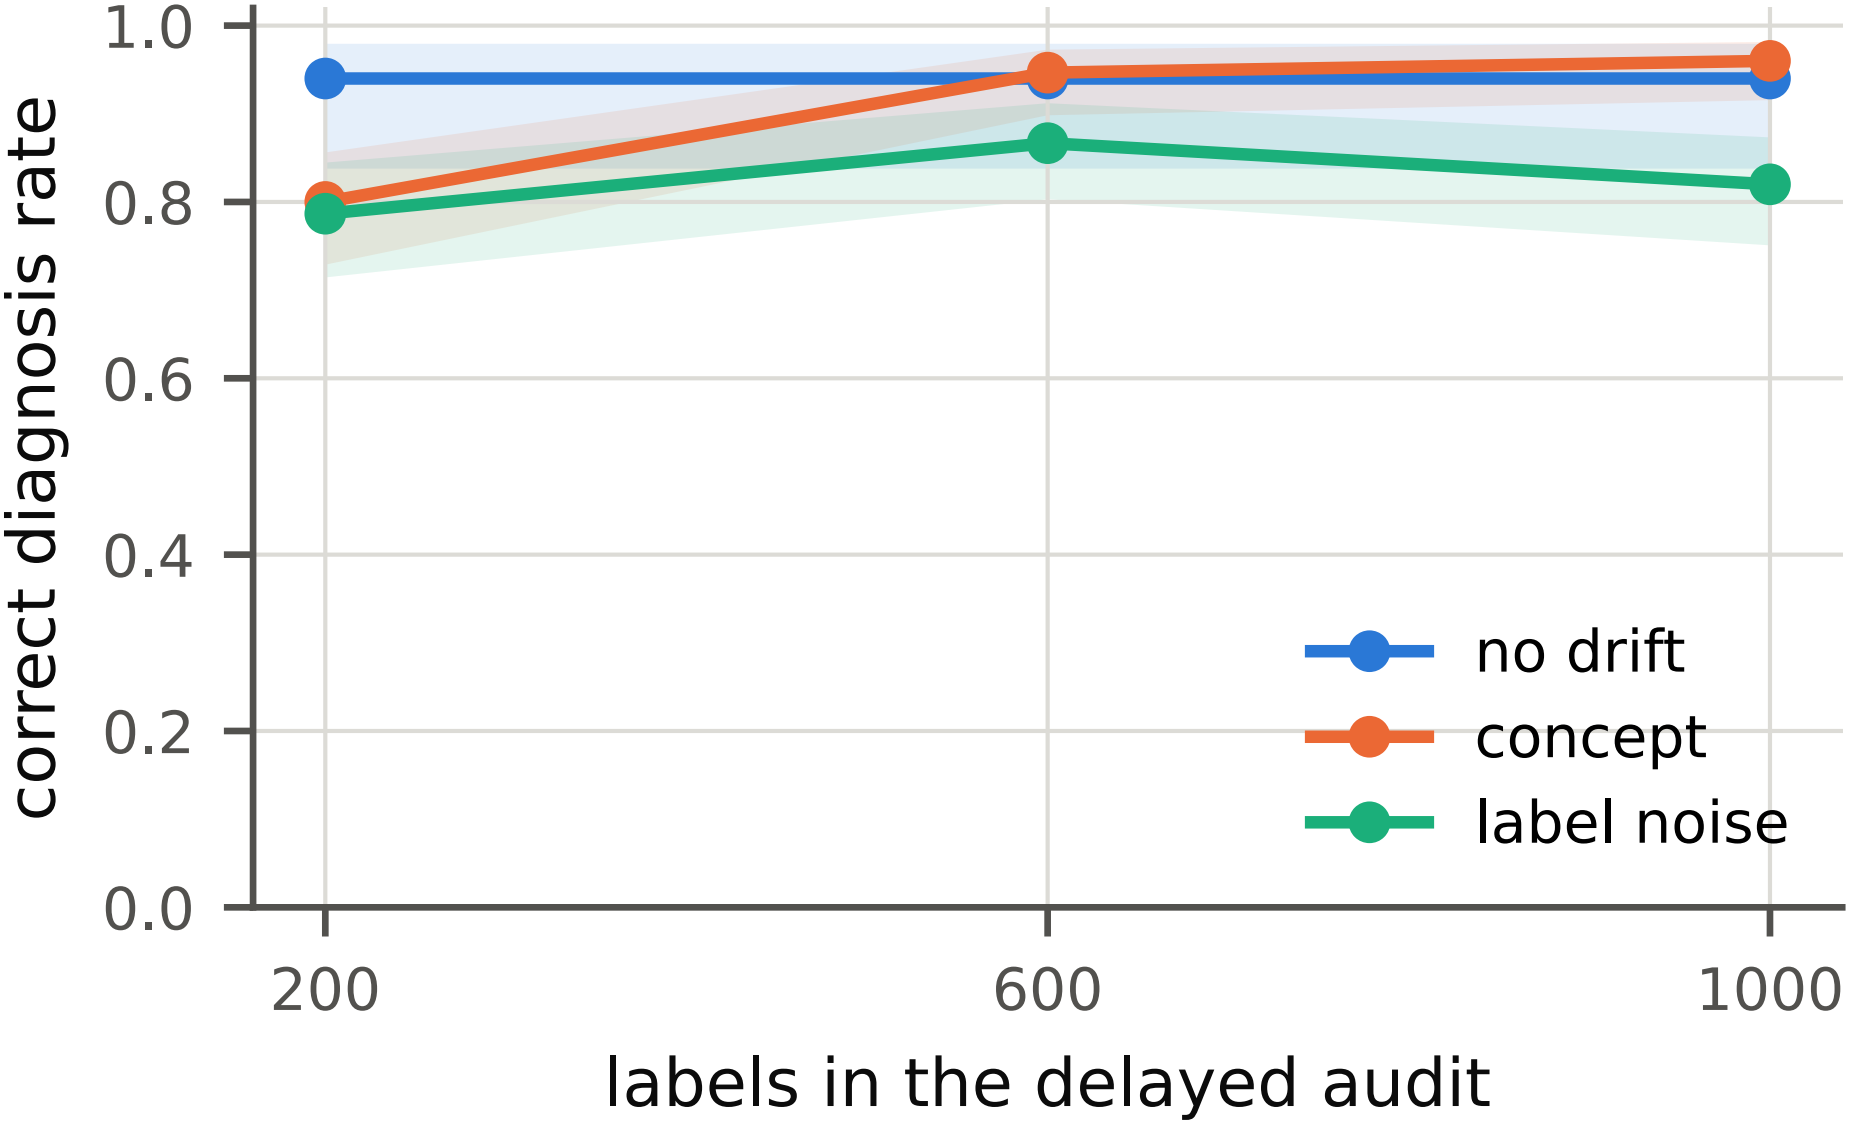
1.0
0.8
0.6
0.4
0.2
0.0
correct diagnosis rate
200
600
1000
labels in the delayed audit
no drift
concept
label noise