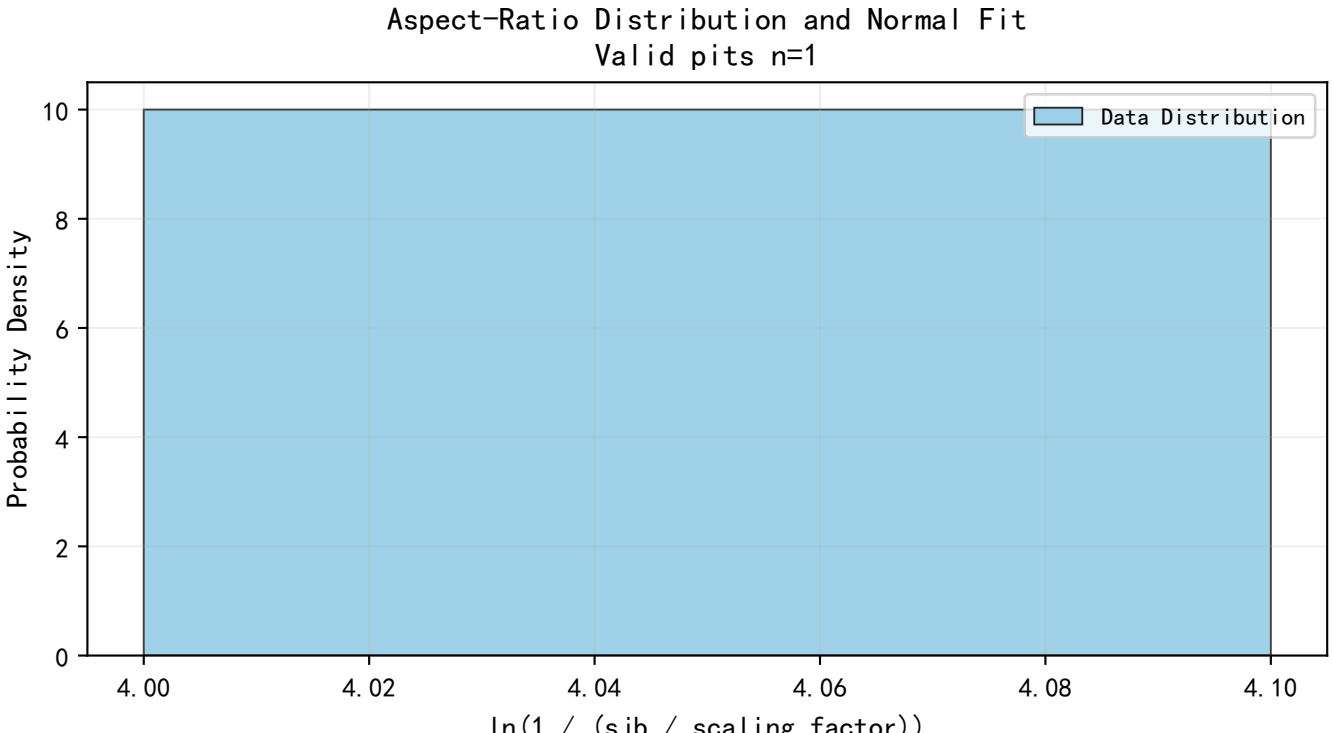

GA 同口径验收 | n=1 | window=15, sigma=2, prom=0.05, distance=15, neighborhood=15, threshold=0.3
XY/Z=25/25 μm | expand=1 | ratio divisor=10 | bins=0.1 | boundary fallback=0 | acceptance.npz
常数样本，不拟合正态曲线、不做正态检验