


ONE AND ONE-HALF INCH = ONE FOOT
THREE-QUARTERS INCH = ONE FOOT
ONE-HALF INCH = ONE FOOT
ONE-QUARTER INCH = ONE FOOT
ONE-EIGHTH INCH = ONE FOOT
ONE-SIXTEENTH INCH = ONE FOOT
ONE INCH = TWENTY FEET

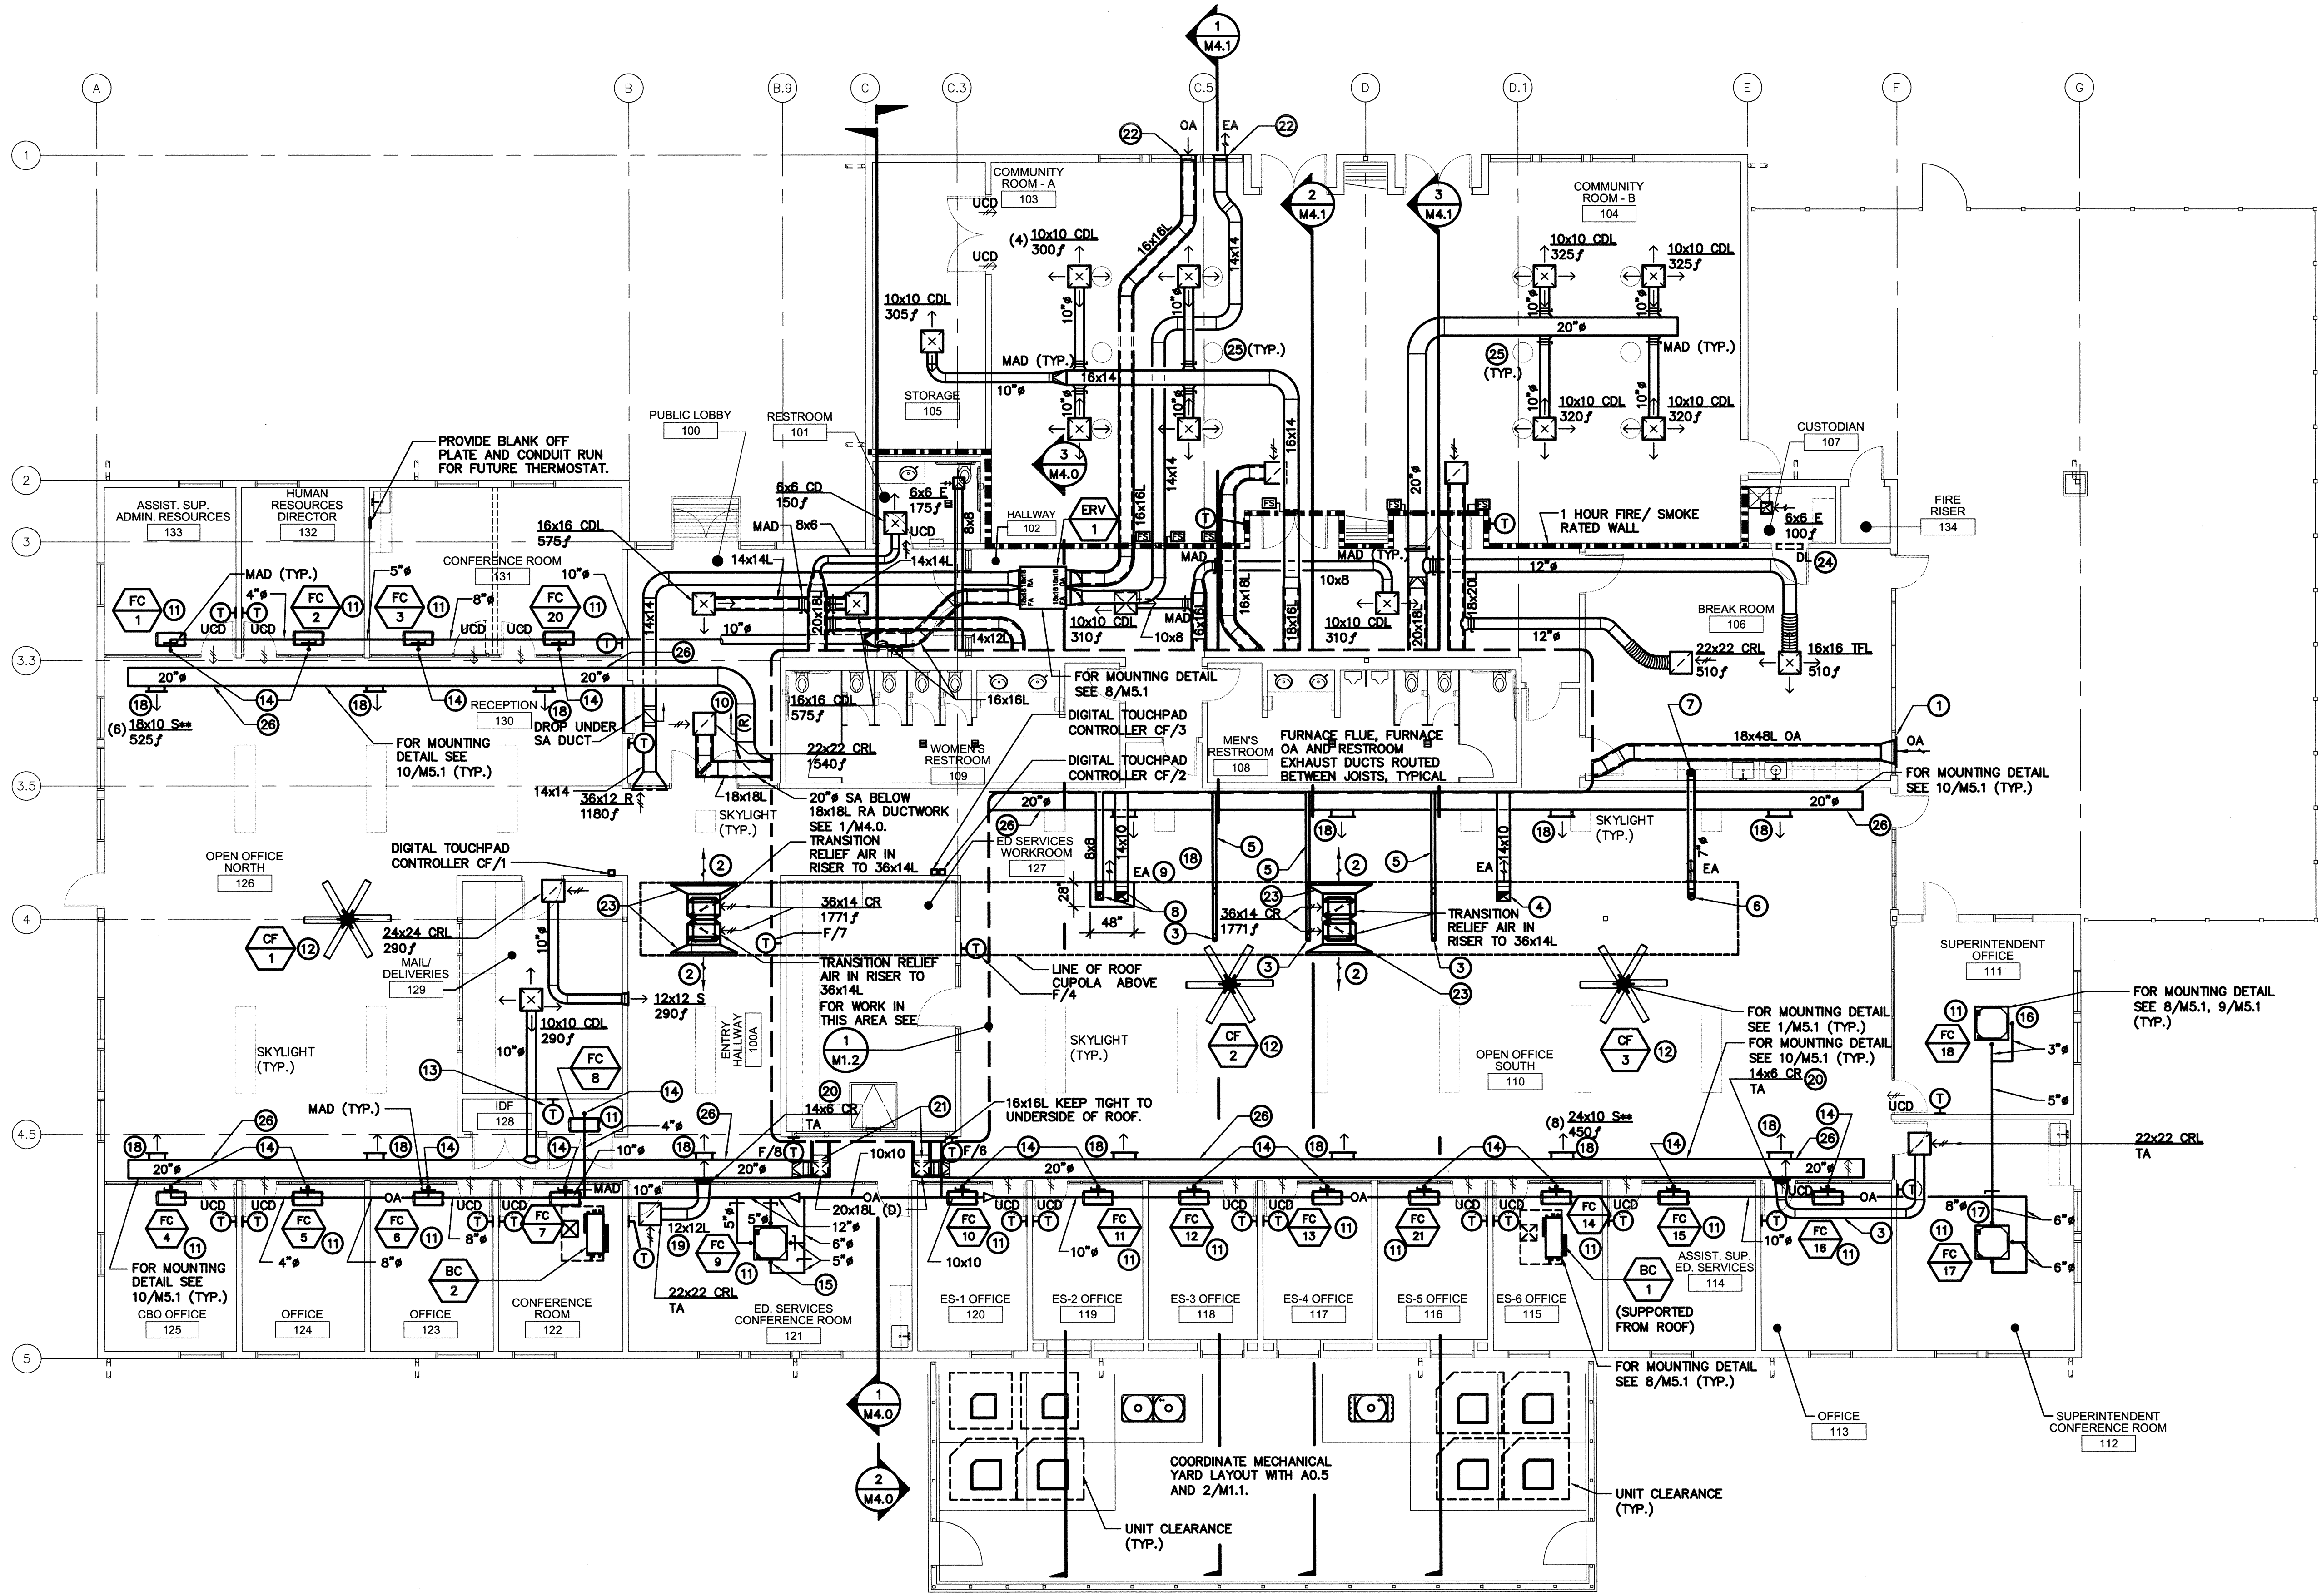

MECHANICAL FLOOR PLAN
SCALE : 1/8"=1'-0"
1
M1.0

- GENERAL NOTES**
- PER THE MANUFACTURER ALL REFRIGERANT PIPING RUNS BETWEEN HP-UNITS AND BC-EQUIPMENT SHALL BE RIGID, NO LINESETS.
 - PER THE MANUFACTURER ALL REFRIGERANT PIPING RUNS BETWEEN BC-EQUIPMENT AND FC-EQUIPMENT SHALL BE MANUFACTURED, PRE-CHARGED AND PRE-INSULATED REFRIGERANT LINE-SET REFRIGERANT PIPING.
 - PER THE MANUFACTURER ALL REFRIGERANT PIPING RUNS BETWEEN CU-EQUIPMENT AND F-EQUIPMENT SHALL BE MANUFACTURED, PRE-CHARGED AND PRE-INSULATED REFRIGERANT LINE-SET REFRIGERANT PIPING.
 - ALL HORIZONTAL PIPING RUNS SHALL BE ORGANIZED AND NEATLY ROUTED WITHIN A WIRE TRAY.
 - ALL VERTICAL STACKED PIPING RUNS SHALL BE ORGANIZED AND NEATLY ROUTED AND SECURED WITH THE UNISTRUT PIPE MOUNTING SYSTEMS.
 - ALL EXTERIOR REFRIGERANT PIPING SHALL BE MOUNTED PER DETAILS 2,3,4/M5.2. PIPING SHALL HAVE END CAPS AND BE SEALED WATER AND VERMIN TIGHT.
 - COORDINATE THE LOCATIONS OF GRILLES AND LOUVERS WITH THE ARCHITECTURAL ROP AND ELEVATION PLANS.
 - MAINTAIN ALL CLEARANCE REQUIREMENTS BETWEEN OUTSIDE AIR, EXHAUST AIR AND FLUE EXHAUST.
 - FOR TYPICAL COMBINATION FIRE/ SMOKE DAMPER (FS) THRU WALL MOUNTING DETAIL SEE 6/M5.3.
 - COORDINATE THE INDOOR SPLITS PLFY AND PMFY TRIM PANELS WITH ARCHITECTURAL CEILINGS.
 - COORDINATE DIGITAL TOUCHPAD CONTROLLER(S) FOR THE CF/1, CF/2 AND CF/3 WITH LIGHT SWITCH LOCATIONS.
 - THERMOSTAT(S) TO BE PERMANENTLY MOUNTED.
 - PROVIDE INSULATED PANELS AT CEILING WHERE BC CONTROLLERS ARE LOCATED.

- SHEET NOTES:**
- OUTSIDE AIR WALL LOUVER, MIN. 31.2 SQ. FT. FREE AREA WITH A MINIMUM OF 42% FREE AREA. REFER TO ARCHITECTURAL PLANS FOR LOUVER DETAILS.
 - RELIEF AIR WALL LOUVER, MIN. 12.0 SQ. FT. FREE AREA WITH A MINIMUM OF 42% FREE AREA. REFER TO ARCHITECTURAL PLANS FOR LOUVER DETAILS.
 - COORDINATE 14x10L TRANSFER AIR DUCT WITH OTHER SERVICES IN CEILING SPACE. TRANSITION 14x12L DUCT INTO 14x6 SIDEWALL TRANSFER AIR GRILLE.
 - 14x10 RISER UP INTO CUPOLA AND EXHAUST THRU WALL LOUVER, MIN. LOUVER SIZE IS 2.1 SQ. FT. WITH A MINIMUM OF 42% FREE AREA. REFER TO ARCHITECTURAL PLANS FOR LOUVER DETAILS.
 - FURNACE FLUE AND OA ROUTE BETWEEN JOISTS.
 - 7" RISE UP INTO CUPOLA AND SIDE WALL DISCHARGE THRU MANUFACTURERS WALL CAP W/ DAMPER.
 - 3-1/4"x10" EA RISER FROM KITCHEN HOOD, TRANSITION TO 7" DUCT AND ROUTE BETWEEN JOISTS.
 - RISE 8x8 AND 14x10 EA DUCT INTO 48"x28"Dx30" HIGH EXHAUST PLENUM WITHIN CUPOLA AND SIDE WALL DISCHARGE THRU WALL. SEE SHEET NOTE #9 FOR LOUVER.
 - EXHAUST AIR WALL LOUVER, MIN. 2.2 SQ. FT. FREE AREA WITH A MINIMUM OF 42% FREE AREA. REFER TO ARCHITECTURAL PLANS FOR LOUVER DETAILS.
 - RISE SUPPLY AIR DUCT TO BOTTOM OF DUCT ELEVATION AT 10'-0".
 - SEE ARCHITECTURAL PLANS FOR FINAL PLACEMENT AND COORDINATION OF UNIT(S).
 - COORDINATE THE LOCATION OF THE FANS WITH THE ARCHITECTURAL AND ELECTRICAL LIGHTING PLAN(S). MOUNT WITH BOTTOM OF BLADES AT 14'-0" ABOVE FINISHED FLOOR.
 - COORDINATE T-STAT LOCATION WITH ARCHITECT, ELECTRICAL PLANS AND FINAL EQUIPMENT PLACEMENT WITHIN THE IDF-128.
 - 4" OUTSIDE AIR DROP AND CONNECT TO FAN COIL OA INLET.
 - 5" OUTSIDE AIR DROP AND CONNECT TO FAN COIL OA INLET. FC HAS (4) INLET CONNECTIONS.
 - 3" OUTSIDE AIR DROP AND CONNECT TO FAN COIL OA INLET. FC HAS (2) INLET CONNECTIONS.
 - 5" OUTSIDE AIR DROP AND CONNECT TO FAN COIL OA INLET. FC HAS (3) INLET CONNECTIONS.
 - EXPOSED SIDEWALL SUPPLY AIR GRILLES LOCATED ON THE 20" DUCT SHALL BE ROTATED DOWN 22.5°.
 - COORDINATE 12x12L TRANSFER AIR DUCT WITH OTHER SERVICES IN CEILING SPACE. TRANSITION 12x12L DUCT INTO 14x6 SIDEWALL TRANSFER AIR GRILLE. TRANSFER GRILLE LOCATED BEHIND SUPPLY AIR DUCT.
 - SUPPLY AIR DUCT DROP TO BOTTOM OF DUCT ELEVATION AT 10'-0".
 - EXHAUST/ OUTSIDE AIR WALL LOUVER, MIN. 7.0 SQ. FT. FREE AREA WITH A MINIMUM OF 42% FREE AREA. REFER TO ARCHITECTURAL PLANS FOR LOUVER DETAILS.
 - TRANSITION 36x14 GRILLE TO 36x14 DUCT. TRANSITION (ABOVE JOISTS) 36x14L TO 24x20L AND PROVIDE EACH DUCT WITH A MOTORIZED DAMPER. COORDINATE FINAL DUCT RISER SIZE WITH ARCHITECTURAL LOUVER SIZE AND CONNECT INTO SIDEWALL EA LOUVER. COORDINATE WITH ARCHITECTURAL LOUVER SIZE. THE DAMPERS SHALL BE OPEN WHEN ANY F/4, F/6, F/7 OR F/8 ARE OPERATING.
 - DOOR LOUVER, MIN. 10x10. REFER TO ARCHITECTURAL PLANS FOR LOUVER DETAILS.
 - SOLAR TUBE(S) SHOWN FOR THE COORDINATION OF GRILLE(S) AND DUCTWORK.
 - EXPOSED ROUND DUCTWORK TO BE CLEANED AND LEFT UNPAINTED. SEE SPECIFICATIONS FOR CLEANING REQUIREMENTS. GRILLES ATTACHED TO THE ROUND EXPOSED DUCTWORK SHALL HAVE THE MILL FINISH OF ALUMINUM FINISH.

UNDERCUT DOOR SCHEDULE

1. UNDERCUT THE FOLLOWING DOORS 0.5": ROOM NUMBERS 101, 111, 113, 114, 115, 116, 117, 118, 119, 120, 125, 131, 132 AND 133.
--


Dry Creek Joint Elementary School District
District Education Center
8849 Cook Riolo Road, Roseville, CA 95747
Dry Creek Joint Elementary School District

FILE NO. 31-15
IDENTIFICATION STAMP DIV. OF THE
STATE ARCHITECT OFFICE OF
REGULATION SERVICES
APPLICATION NO.
02-115496
AC TM FLS JMC SS JBC
DATE 2/23/17
DIVISION OF THE STATE ARCHITECT
revision date: _____ by: _____



CAPITAL ENGINEERING CONSULTANTS, INC.
RANCHO CORDOVA, CALIFORNIA
CONSULTANT
DATE SIGNED: 2/15/2017

nacht&lewis
600 Q Street, Suite 100
Sacramento, CA 95811
www.nachtandlewis.com
916.529.4000

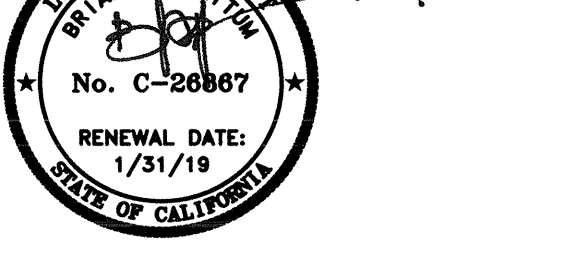

ARCHITECT

INITIAL BOX			
NO.	DWG BY	DATE	REVIEWED

REVISIONS


NO.	DESCRIPTION	DATE	REV'D

DATE February 23, 2017
JOB NO. Y1538.00
SHEET TITLE


Mechanical Floor Plan

SHEET NO.
M1.0
SHEET ____ OF ____ TOTAL

ONE INCH = TWENTY FEET
ONE-SIXTEENTH INCH = ONE FOOT
ONE-EIGHTH INCH = ONE FOOT
ONE-FOURTH INCH = ONE FOOT
ONE-HALF INCH = ONE FOOT
THREE-QUARTERS INCH = ONE FOOT
ONE INCH = ONE FOOT
ONE AND ONE-HALF INCH = ONE FOOT

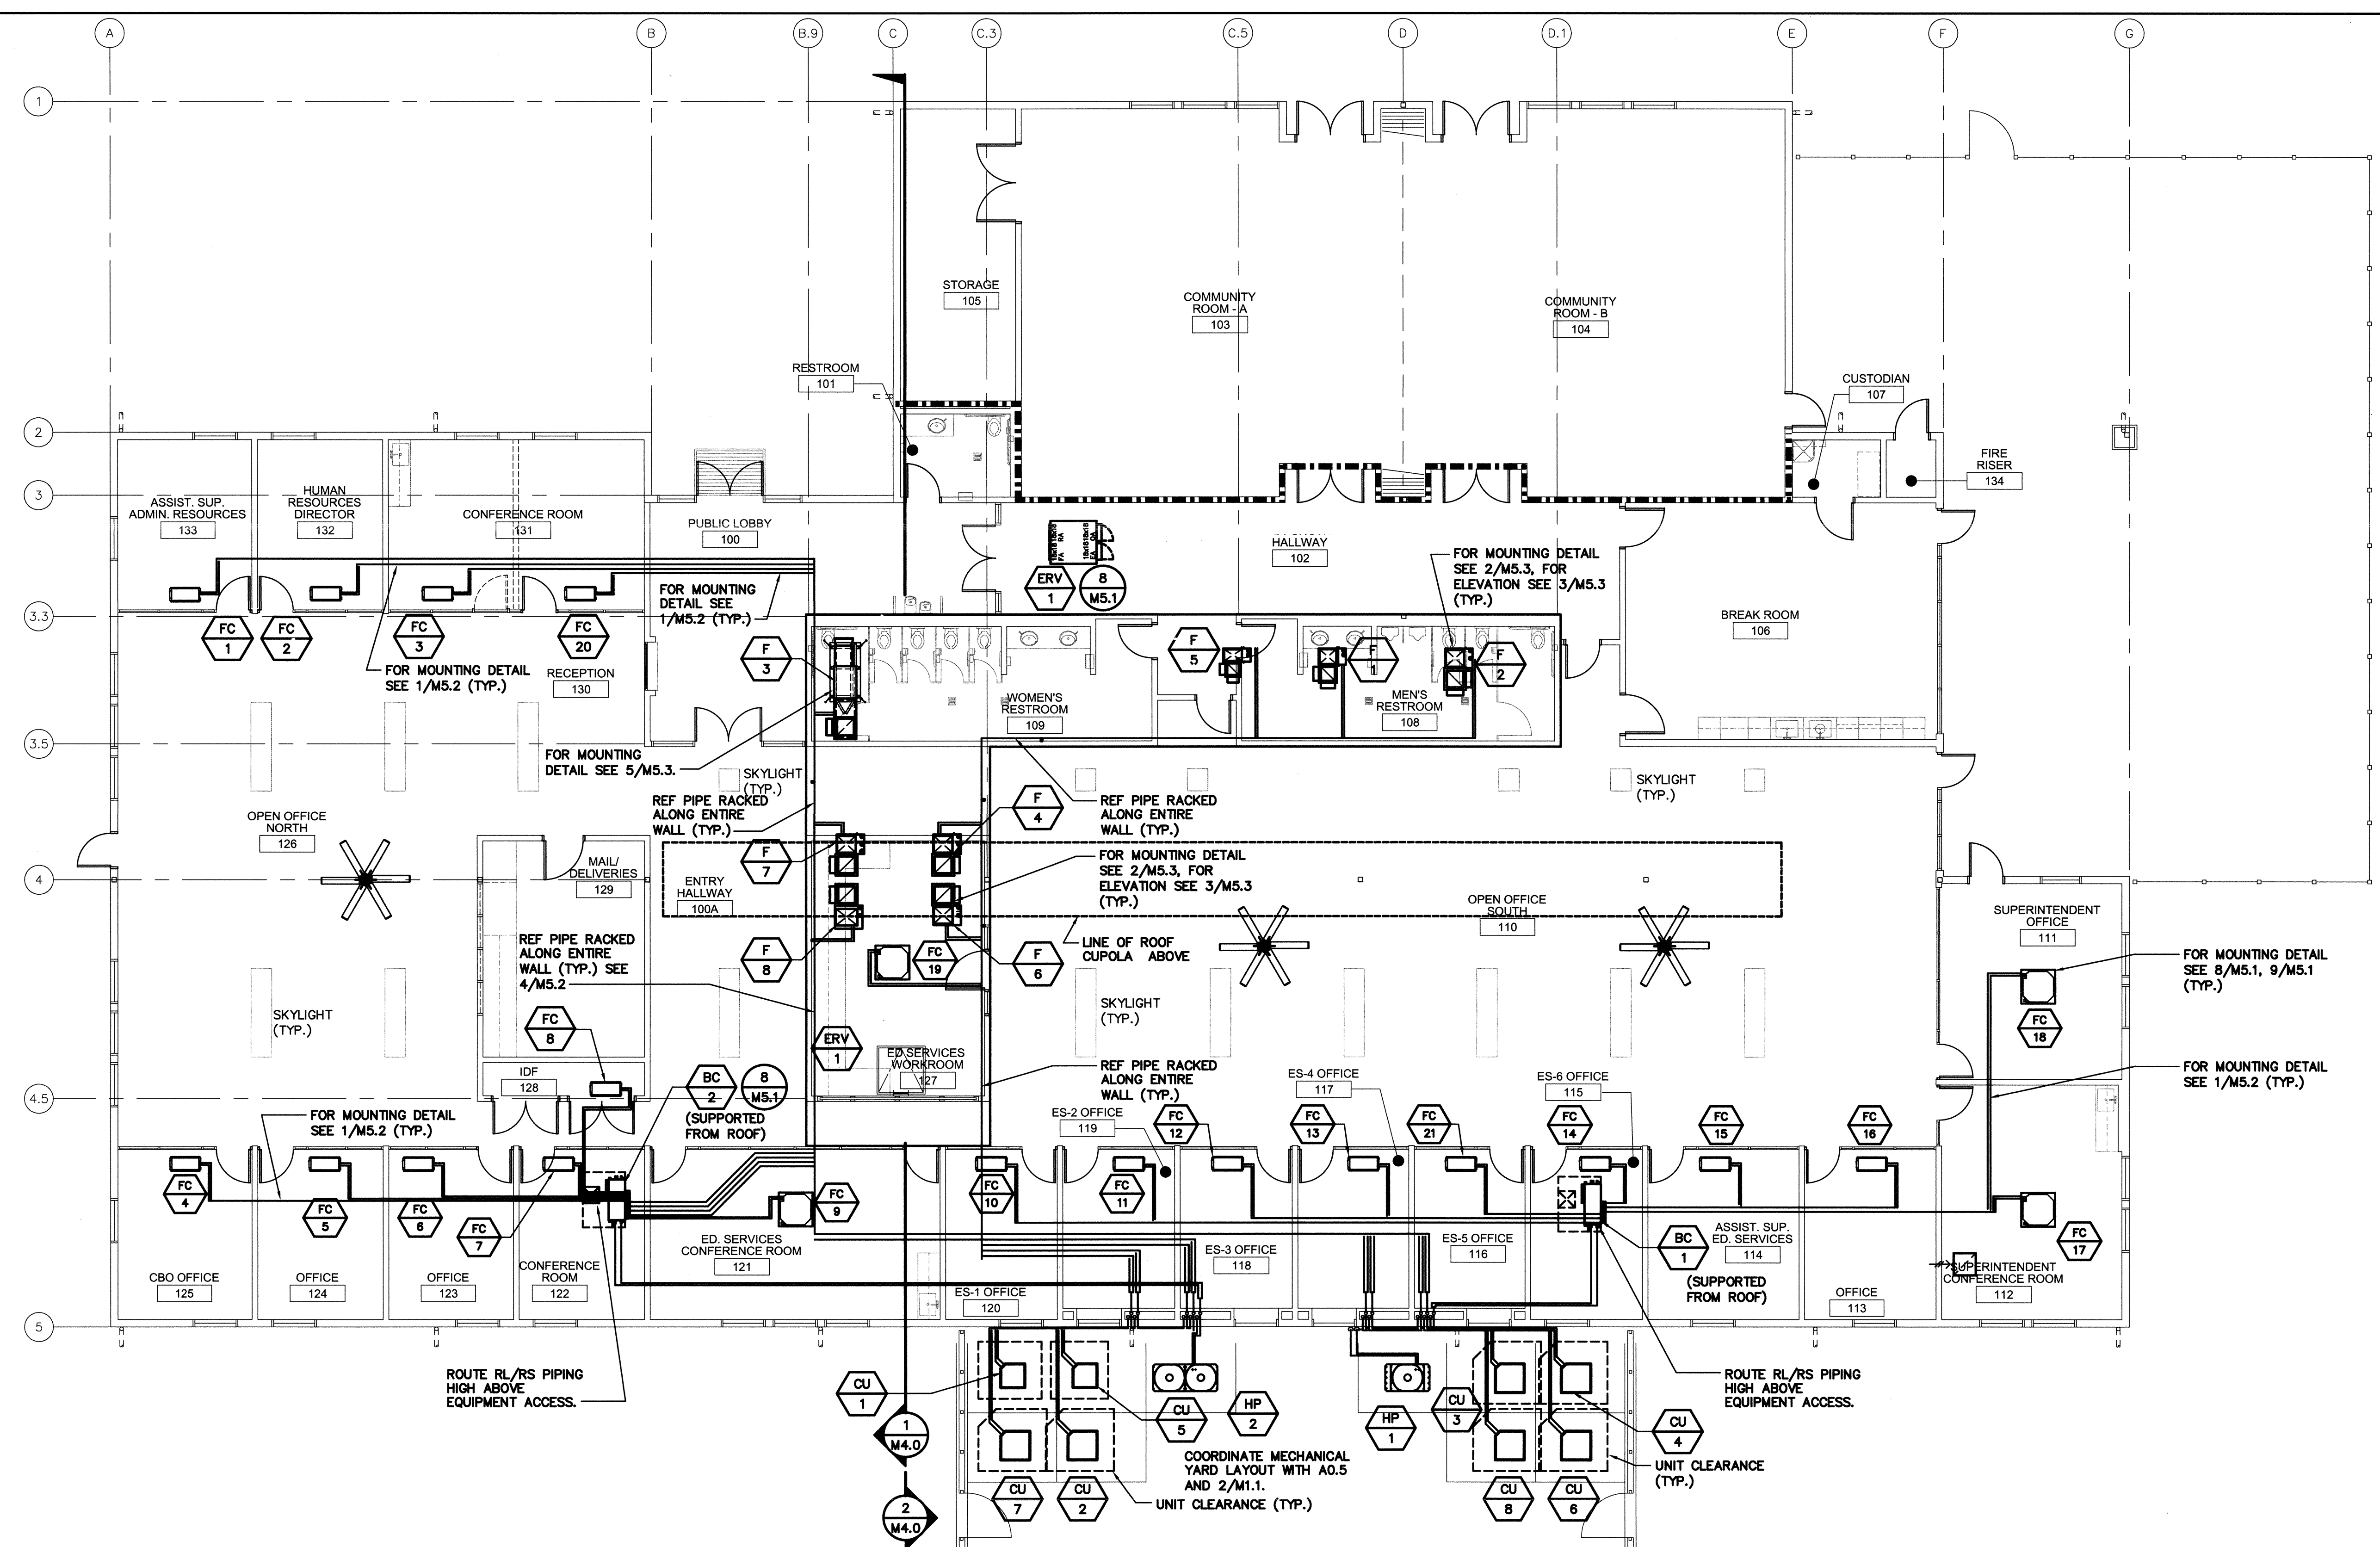

MECHANICAL REFRIGERANT PIPING FLOOR PLAN
SCALE : 1/8"=1'-0"

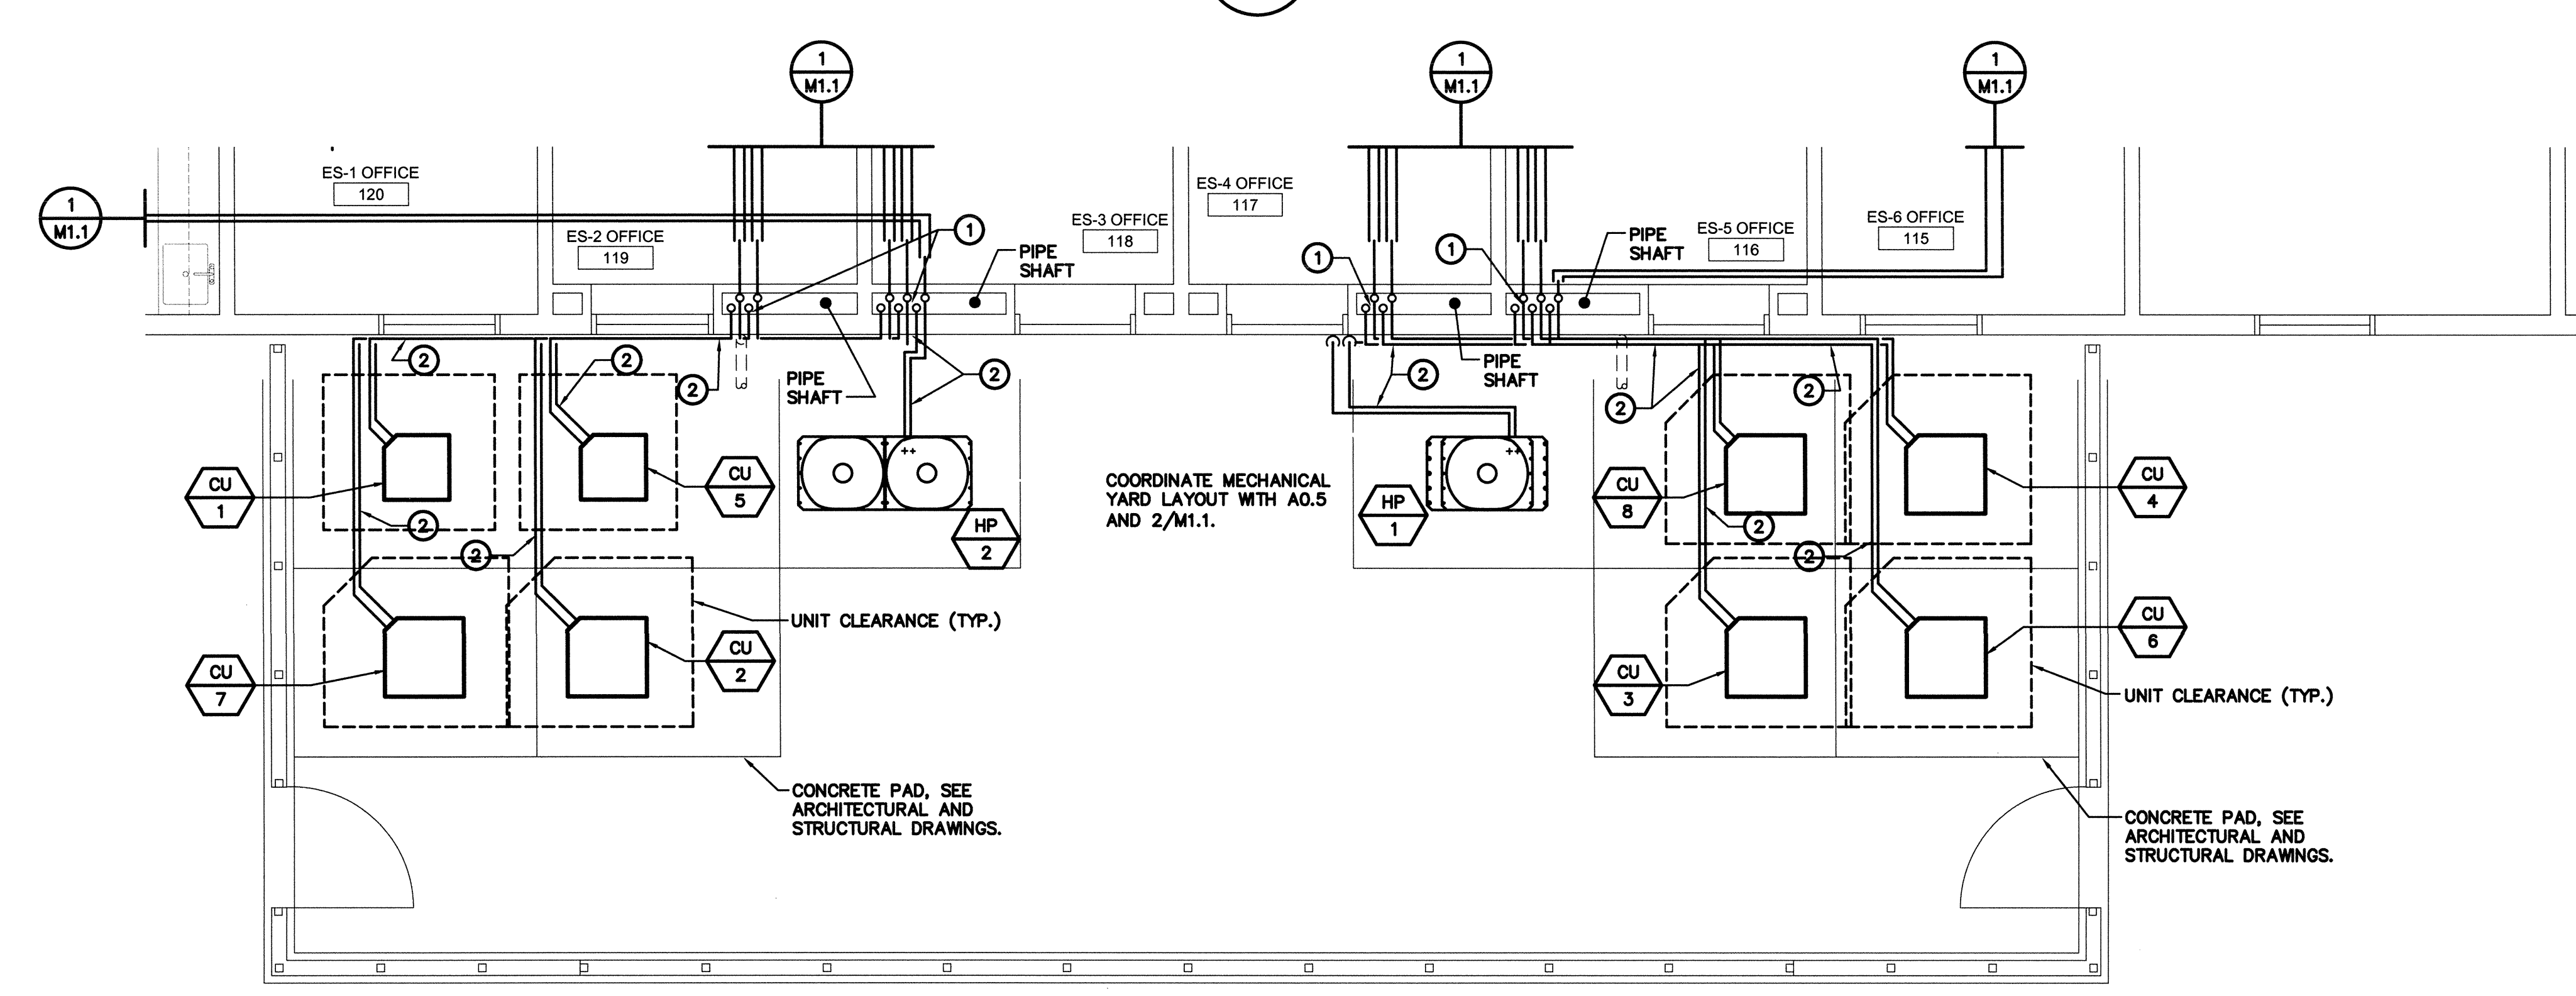

MECHANICAL ENLARGED REFRIGERANT PIPING SHAFT PLAN
SCALE : 1/4"=1'-0"

- GENERAL NOTES**
- PER THE MANUFACTURER ALL REFRIGERANT PIPING RUNS BETWEEN HP-UNITS AND BC-EQUIPMENT SHALL BE RIGID, NO LINESETS.
 - PER THE MANUFACTURER ALL REFRIGERANT PIPING RUNS BETWEEN BC-EQUIPMENT AND FC-EQUIPMENT SHALL BE MANUFACTURED, PRE-CHARGED AND PRE-INSULATED REFRIGERANT LINE-SET REFRIGERANT PIPING
 - PER THE MANUFACTURER ALL REFRIGERANT PIPING RUNS BETWEEN CU-EQUIPMENT AND F-EQUIPMENT SHALL BE MANUFACTURED, PRE-CHARGED AND PRE-INSULATED REFRIGERANT LINE-SET REFRIGERANT PIPING
 - ALL HORIZONTAL PIPING RUNS SHALL BE ORGANIZED AND NEATLY ROUTED WITHIN A WIRE TRAY.
 - ALL VERTICAL STACKED PIPING RUNS SHALL BE ORGANIZED AND NEATLY ROUTED AND SECURED WITH THE UNISTRUT PIPE MOUNTING SYSTEMS.
 - ALL EXTERIOR REFRIGERANT PIPING SHALL BE MOUNTED PER DETAILS 2.3/M5.2. PIPING SHALL HAVE END CAPS AND BE SEALED WATER AND VERMIN TIGHT.
 - FOR REFRIGERANT PIPING SIZES FOR FAN COIL UNITS SEE DRAWINGS M7.2 AND M7.3.
 - FOR MOUNTING DETAILS SEE SHEETS M5.1, M5.2 AND M5.3.
 - MAINTAIN ALL CLEARANCE REQUIREMENTS BETWEEN OUTSIDE AIR, EXHAUST AIR AND FLUE EXHAUST.
- SHEET NOTES:**
- COORDINATE WITH ARCHITECTURAL DRAWINGS TO ENSURE WATER TIGHT PIPE PENETRATIONS THRU THE EXTERIOR WALL TYPICAL.
 - FOR REFRIGERANT PIPE COVERS SEE DETAILS 2 AND 3/M5.2 TYPICAL.

Dry Creek Joint Elementary School District
District Education Center
8849 Cook Riolo Road, Roseville, CA 95747
Dry Creek Joint Elementary School District

FILE NO. 31-15
IDENTIFICATION STAMP DIV. OF THE
STATE ARCHITECT OFFICE OF
REGULATION SERVICES
APPLICATION NO.
02-115496
AC 111 FL 111 SS 62
DATE 2/23/17 CAP

DIVISION OF THE STATE ARCHITECT
revision date: _____ by: _____

CONSULTANT

PROFESSIONAL ENGINEER
M 22836
EXPIRES 9/30/19
RENEWAL
DATE 2/15/2017

CAPITAL ENGINEERING CONSULTANTS, INC.
RANCHO CORDOVA, CALIFORNIA
FL - DESIGN TEAM ES010.00 PROJECT NO.

nacht&lewis
600 Q Street, Suite 100
Sacramento, CA 95811
www.nachtandlewis.com
916.929.4000

REGISTERED ARCHITECT
No. C-20887
RENEWAL DATE: 1/31/18
STATE OF CALIFORNIA


ARCHITECT

INITIAL BOX			
NO.	DWG BY	DATE	REVIEWED

REVISIONS			
NO.	DESCRIPTION	DATE	REV'D

DATE February 23, 2017
JOB NO. Y1538.00
SHEET TITLE
Mechanical Refrigerant Piping Floor Plan
SHEET NO.
M1.1
SHEET ____ OF ____ TOTAL

ONE AND ONE-HALF INCH = ONE FOOT
THREE-QUARTERS INCH = ONE FOOT
ONE INCH = ONE FOOT
ONE-HALF INCH = ONE FOOT
ONE-QUARTER INCH = ONE FOOT
ONE-EIGHTH INCH = ONE FOOT
ONE-SIXTEENTH INCH = ONE FOOT
ONE INCH = TWENTY FEET

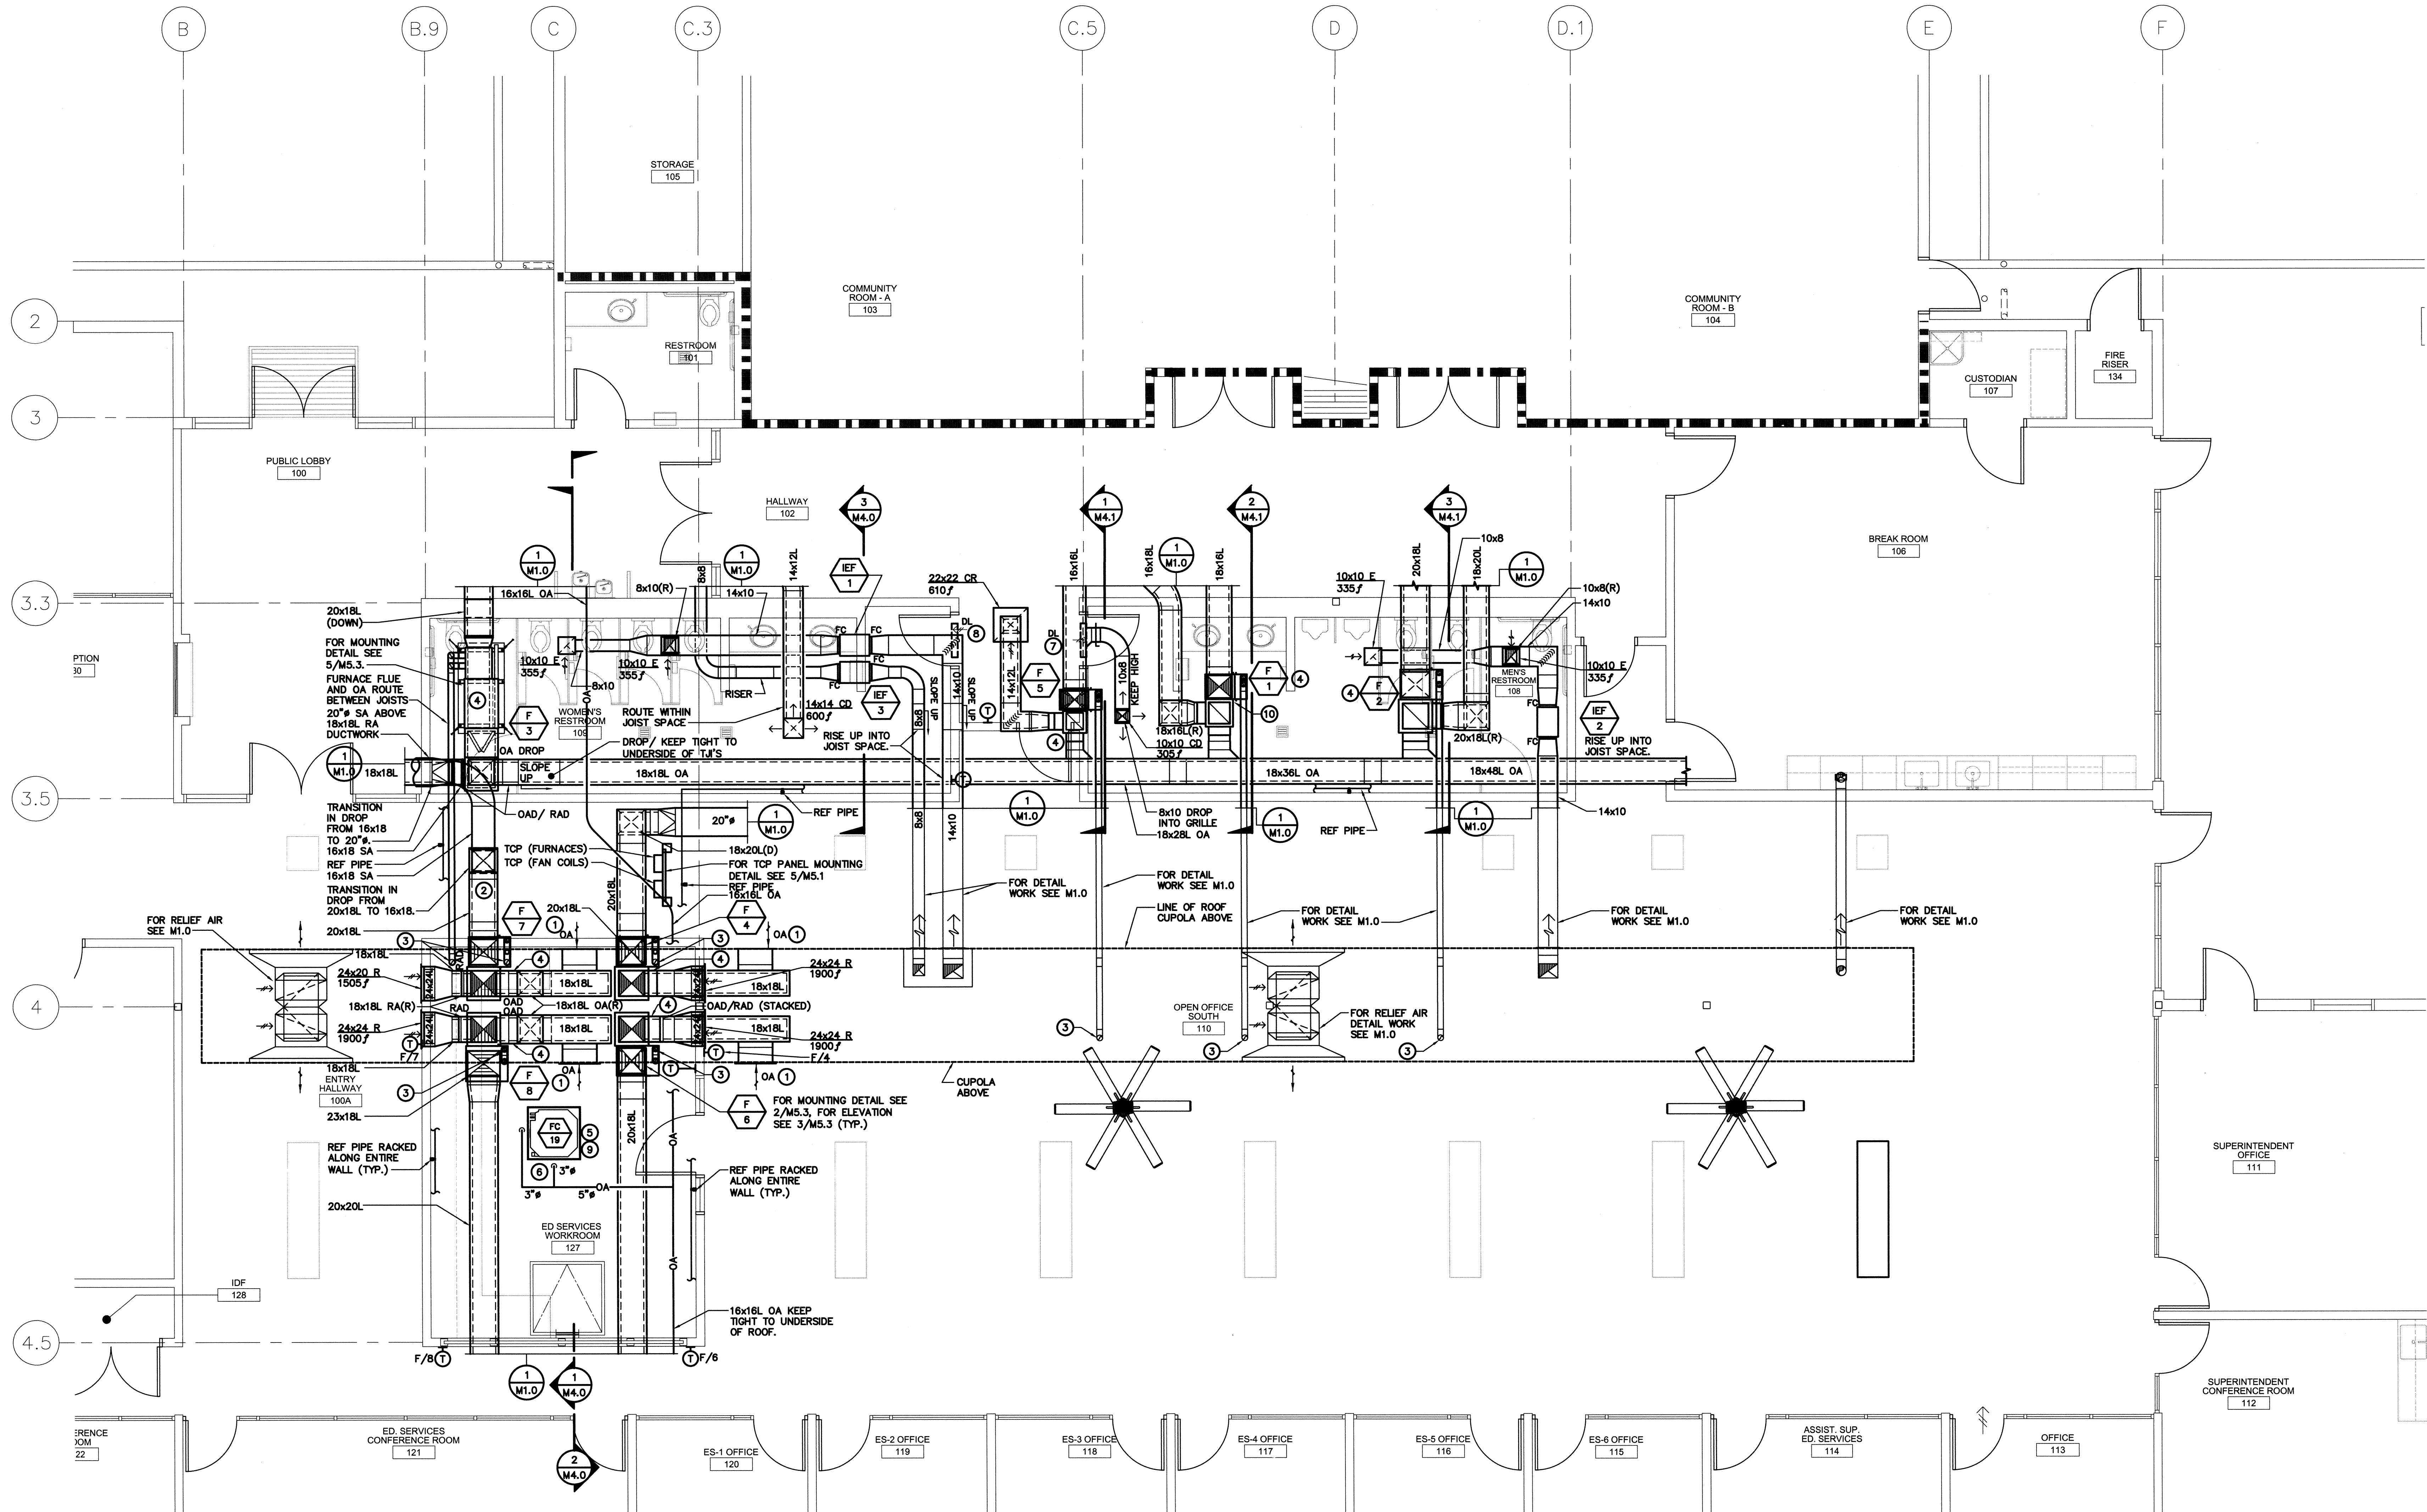

MECHANICAL PARTIAL FLOOR PLAN
SCALE : 1/4"=1'-0"

UNDERCUT DOOR SCHEDULE

1. UNDERCUT THE FOLLOWING DOORS 0.5":
ROOM NUMBERS 101, 111, 113, 114, 15, 116, 117, 118, 119, 120, 125, 131, 132 AND 133.

GENERAL NOTES

- PER THE MANUFACTURER ALL REFRIGERANT PIPING RUNS BETWEEN HP-UNITS AND BC-EQUIPMENT SHALL BE RIGID, NO LINESETS.
- PER THE MANUFACTURER ALL REFRIGERANT PIPING RUNS BETWEEN BC-EQUIPMENT AND FC-EQUIPMENT SHALL BE MANUFACTURED, PRE-CHARGED AND PRE-INSULATED REFRIGERANT LINE-SET REFRIGERANT PIPING
- PER THE MANUFACTURER ALL REFRIGERANT PIPING RUNS BETWEEN CU-EQUIPMENT AND F-EQUIPMENT SHALL BE MANUFACTURED, PRE-CHARGED AND PRE-INSULATED REFRIGERANT LINE-SET REFRIGERANT PIPING
- ALL HORIZONTAL PIPING RUNS SHALL BE ORGANIZED AND NEATLY ROUTED WITHIN A WIRE TRAY.
- ALL VERTICAL STACKED PIPING RUNS SHALL BE ORGANIZED AND NEATLY ROUTED AND SECURED WITH THE UNISTRUT PIPE MOUNTING SYSTEMS.
- ALL EXTERIOR REFRIGERANT PIPING SHALL BE MOUNTED PER DETAILS 2.3.4/M5.2. PIPING SHALL HAVE END CAPS AND BE SEALED WATER AND VERMIN TIGHT.
- MAINTAIN ALL CLEARANCE REQUIREMENTS BETWEEN OUTSIDE AIR, EXHAUST AIR AND FLUE EXHAUST.
- THERMOSTAT(S) TO BE PERMANENTLY MOUNTED.


SHEET NOTES:

- OUTSIDE AIR WALL LOUVER, MIN. 12.0 SQ. FT. FREE AREA FREE AREA WITH A MINIMUM OF 42% FREE AREA. REFER TO ARCHITECTURAL PLANS FOR LOUVER DETAILS.
- SLOPE SA DUCT WITH ROOF JOIST.
- MANUFACTURERS CONCENTRIC FLUE THRU ROOF. ROUTE BETWEEN JOISTS.
- EACH FURNACE SHALL HAVE A MOTORIZED OUTSIDE AIR DAMPER AND A MOTORIZED RETURN AIR DAMPER.
- SEE ARCHITECTURAL PLANS FOR FINAL PLACEMENT AND COORDINATION OF UNIT(S).
- 3" OUTSIDE AIR (OA) DROP AND CONNECT TO FAN COIL (FC) OA INLET. FC HAS (2) INLET CONNECTIONS.
- DOOR LOUVER, MIN. 20x20. REFER TO ARCHITECTURAL PLANS FOR LOUVER DETAILS.
- DOOR LOUVER, MIN. 10x10. REFER TO ARCHITECTURAL PLANS FOR LOUVER DETAILS.
- FAN COIL (FC) MOUNTED WITHIN CEILING OF ED SERVICES WORKROOM 127.
- FOR MOUNTING DETAIL SEE 2/M5.3, FOR ELEVATION SEE 3/M5.3 (TYP.)

Dry Creek Joint Elementary School District
District Education Center
8849 Cook Riolo Road, Roseville, CA 95747
Dry Creek Joint Elementary School District

FILE NO. 31-15
IDENTIFICATION STAMP DIV. OF THE
STATE ARCHITECT OFFICE OF
REGULATION SERVICES
APPLICATION NO.
02-115496
AC. TM. FLS. H. M. SS. BR.
DATE 2/23/19 CCR


DIVISION OF THE STATE ARCHITECT
revision date: by:

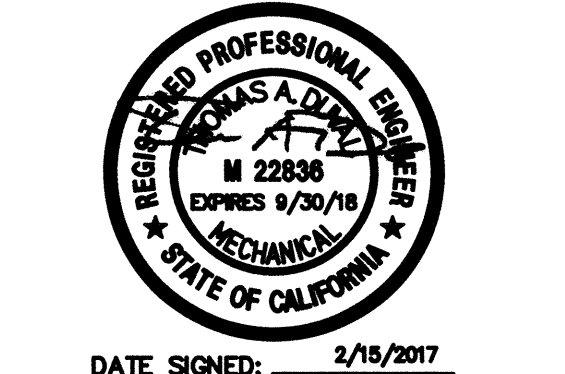

**CAPITAL ENGINEERING
CONSULTANTS, INC.**
RANCHO CORDOVA, CALIFORNIA
FL 95700
PM - DESIGN TEAM PROJECT NO.

CONSULTANT

nacht&lewis
600 Q Street, Suite 100
Sacramento, CA 95811
www.nachtandlewis.com
916.529.4000

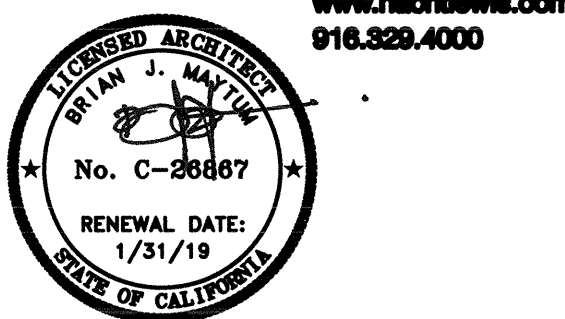

ARCHITECT

INITIAL BOX

NO.	DWG BY	DATE	REVIEWED

REVISIONS

NO.	DESCRIPTION	DATE	REV'D
	100% design development	7/9/16	
	75% construction documents	9/20/16	
	DSA submittal	12/31/16	
	DSA approval	02/23/17	

DATE February 23, 2017

JOB NO. Y1538.00


SHEET TITLE

Mechanical Partial
Floor Plan

SHEET NO.

M1.2


SHEET ___ OF ___ TOTAL

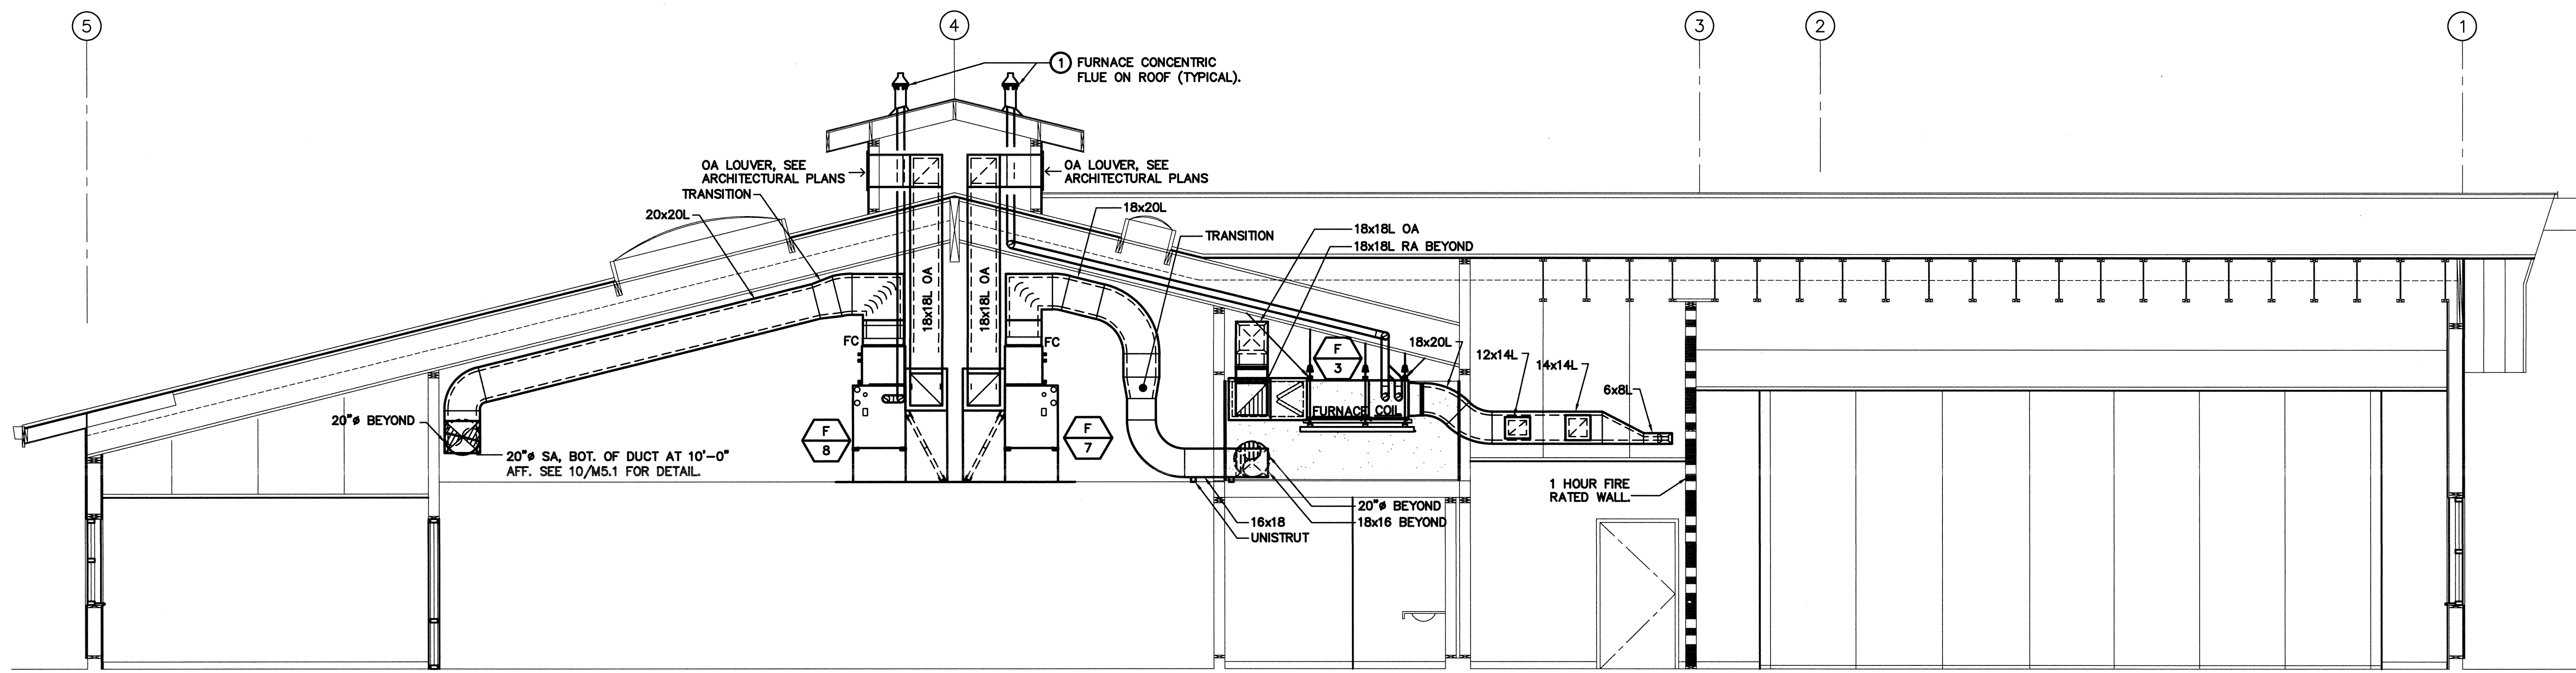

MECHANICAL SECTION

SCALE : 1/4"=1'-0" (SECTION WEST TO EAST, LOOKING NORTH)


1
M4.0

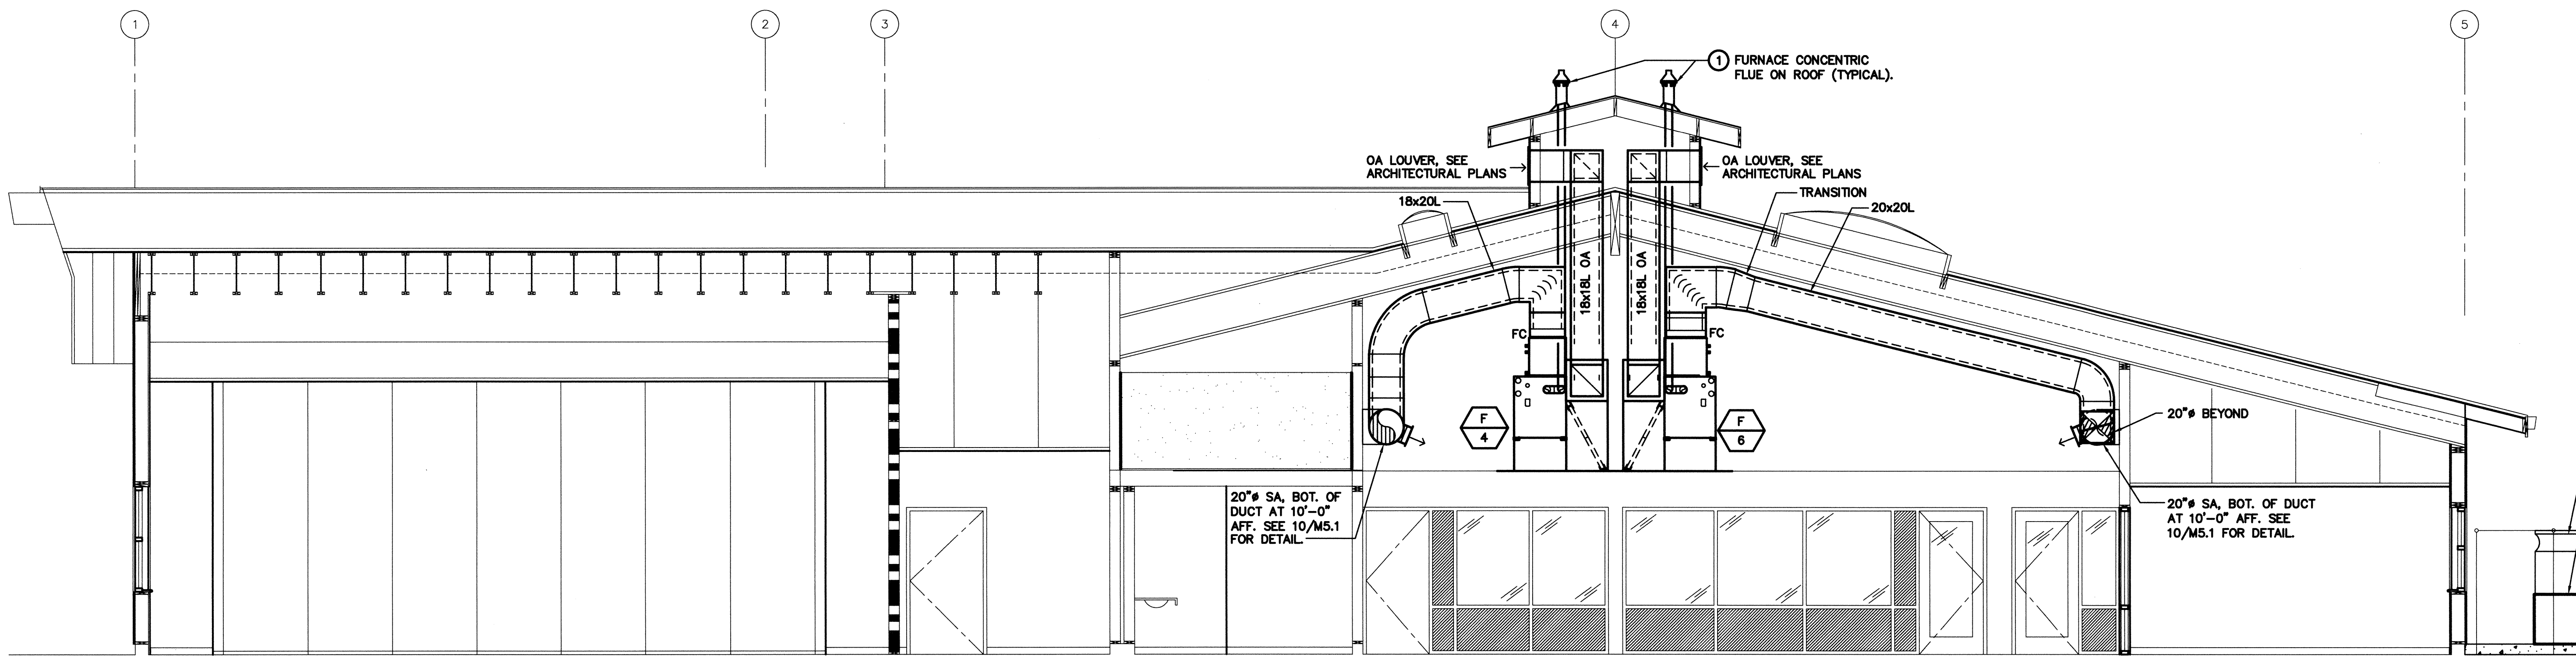

MECHANICAL SECTION

SCALE : 1/4"=1'-0" (SECTION EAST TO WEST, LOOKING SOUTH)

2
M4.0

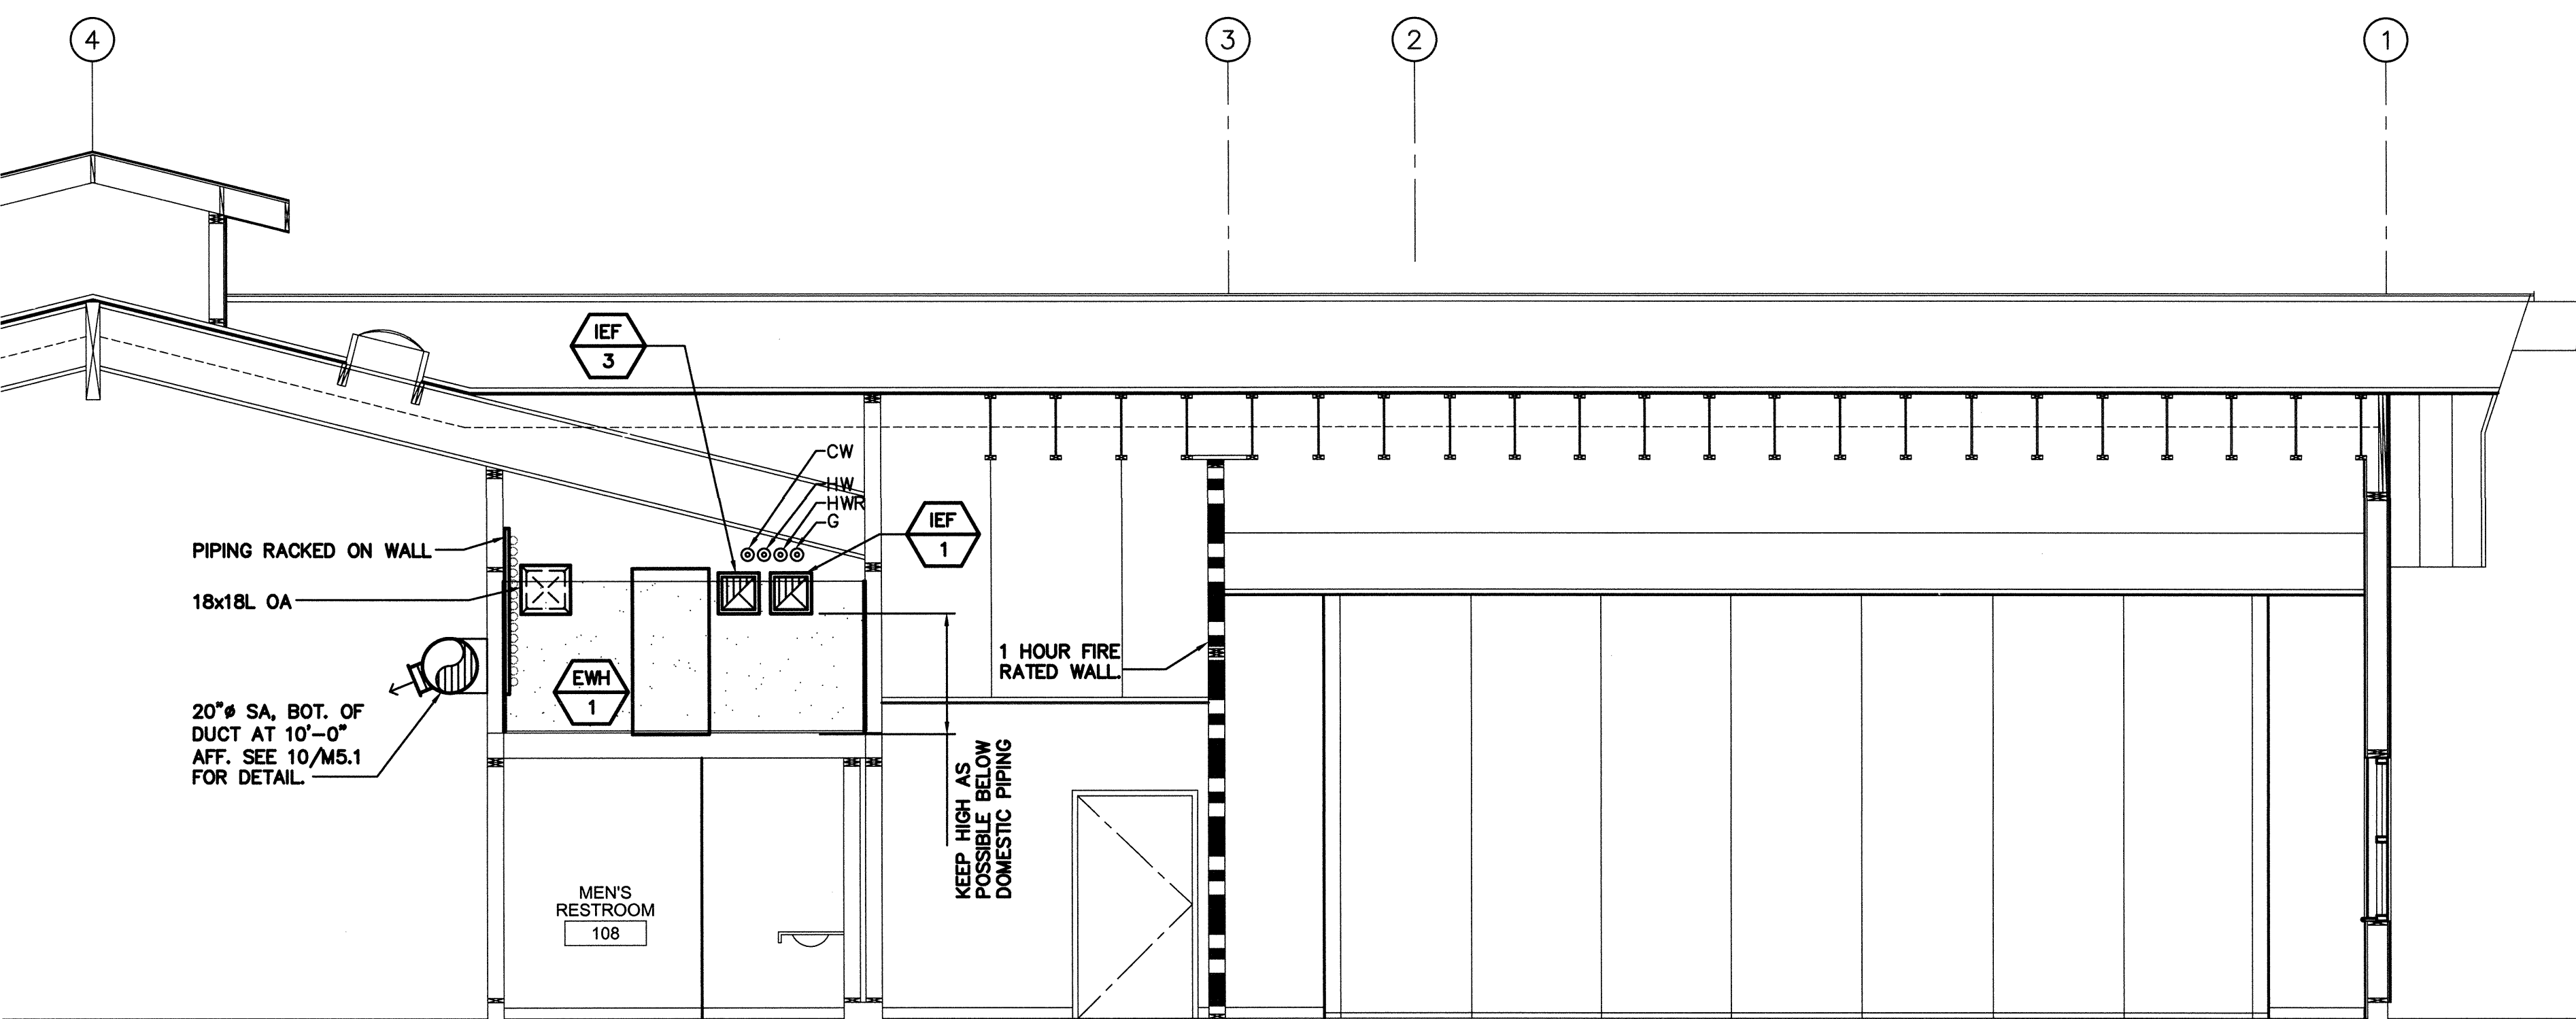

MECHANICAL SECTION

SCALE : 1/4"=1'-0" (SECTION EAST TO WEST, LOOKING NORTH)

3
M4.0

GENERAL NOTES

1. MAINTAIN MINIMUM 10'-0" CLEARANCES BETWEEN ALL OUTSIDE AIR LOUVERS AND EXHAUST AIR TERMINATIONS. SEE M1.0 FOR THE OA LOUVER AND EXHAUST LOCATIONS.

SHEET NOTES:

- ① MANUFACTURERS CONCENTRIC FLUE THRU ROOF FROM FURNACE UNITS. PAINT COLOR AS DIRECTED BY ARCHITECT (TYP. OF 8 LOCATIONS).

Dry Creek Joint Elementary School District
District Education Center

8849 Cook Riolo Road, Roseville, CA 95747

Dry Creek Joint Elementary School District

FILE NO. 31-15
IDENTIFICATION STAMP DIV. OF THE
STATE ARCHITECT OFFICE OF
REGULATION SERVICES
APPLICATION NO.
02-115496
AC TM FLS RMC SS BR
DATE 2/23/19 CEA

DIVISION OF THE STATE ARCHITECT
revision date: by:




DATE SIGNED: 2/15/2017



CONSULTANT

nacht&lewis

600 Q Street, Suite 100
Sacramento, CA 95811
www.nachtandlewis.com
916.529.4000

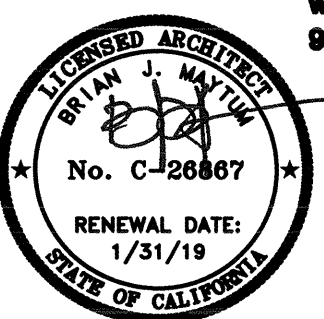

ARCHITECT

INITIAL BOX			
NO.	DWG BY	DATE	REVIEWED

REVISIONS			
NO.	DESCRIPTION	DATE	REV'D


DATE February 23, 2017
JOB NO. Y1538.00
SHEET TITLE

Mechanical
Sections

SHEET NO.

M4.0


SHEET ___ OF ___ TOTAL

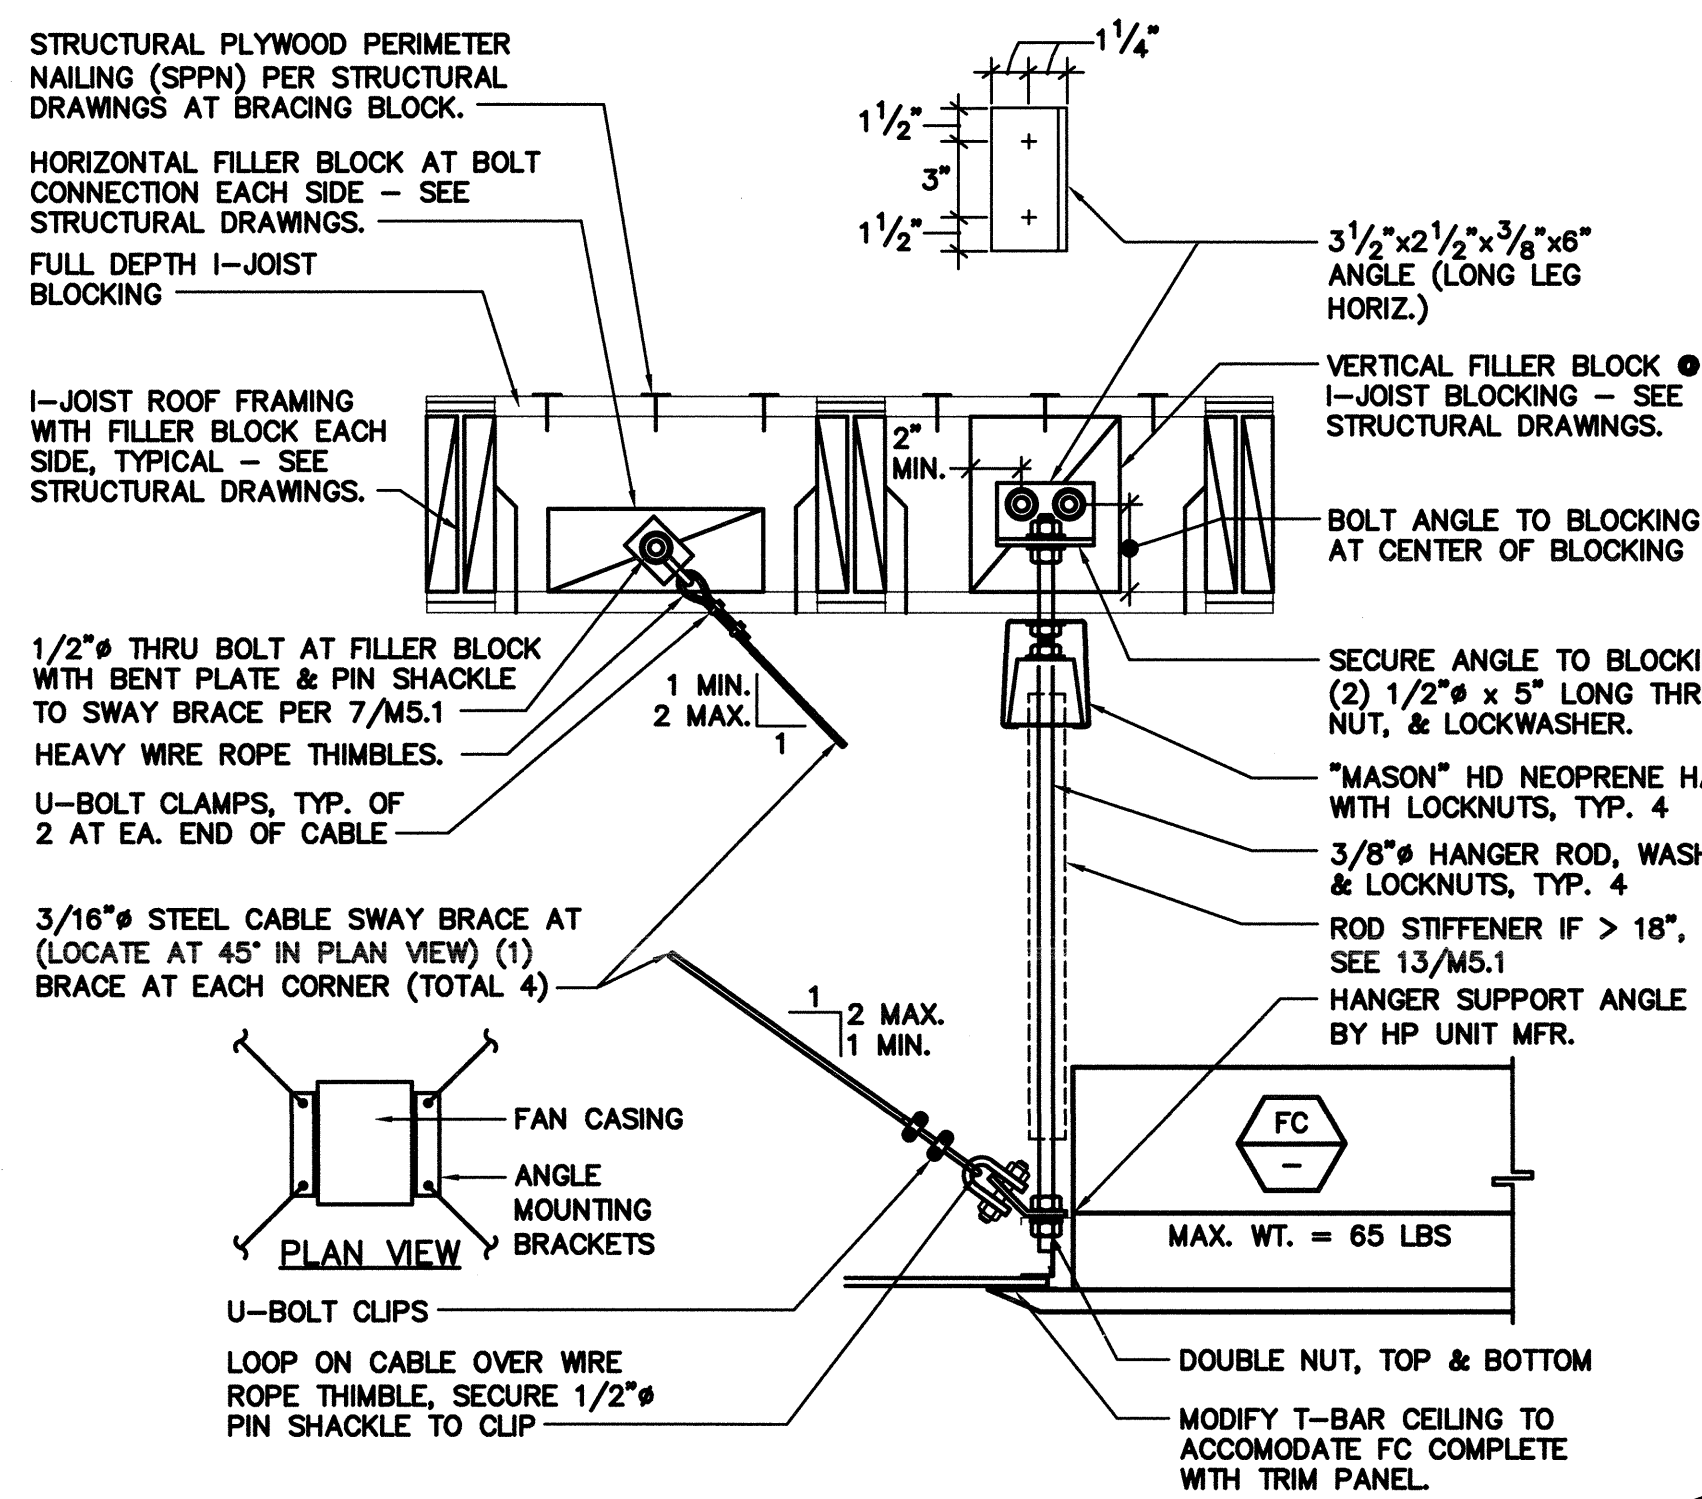

FC MOUNTING

SCALE : NONE

9
M5.1

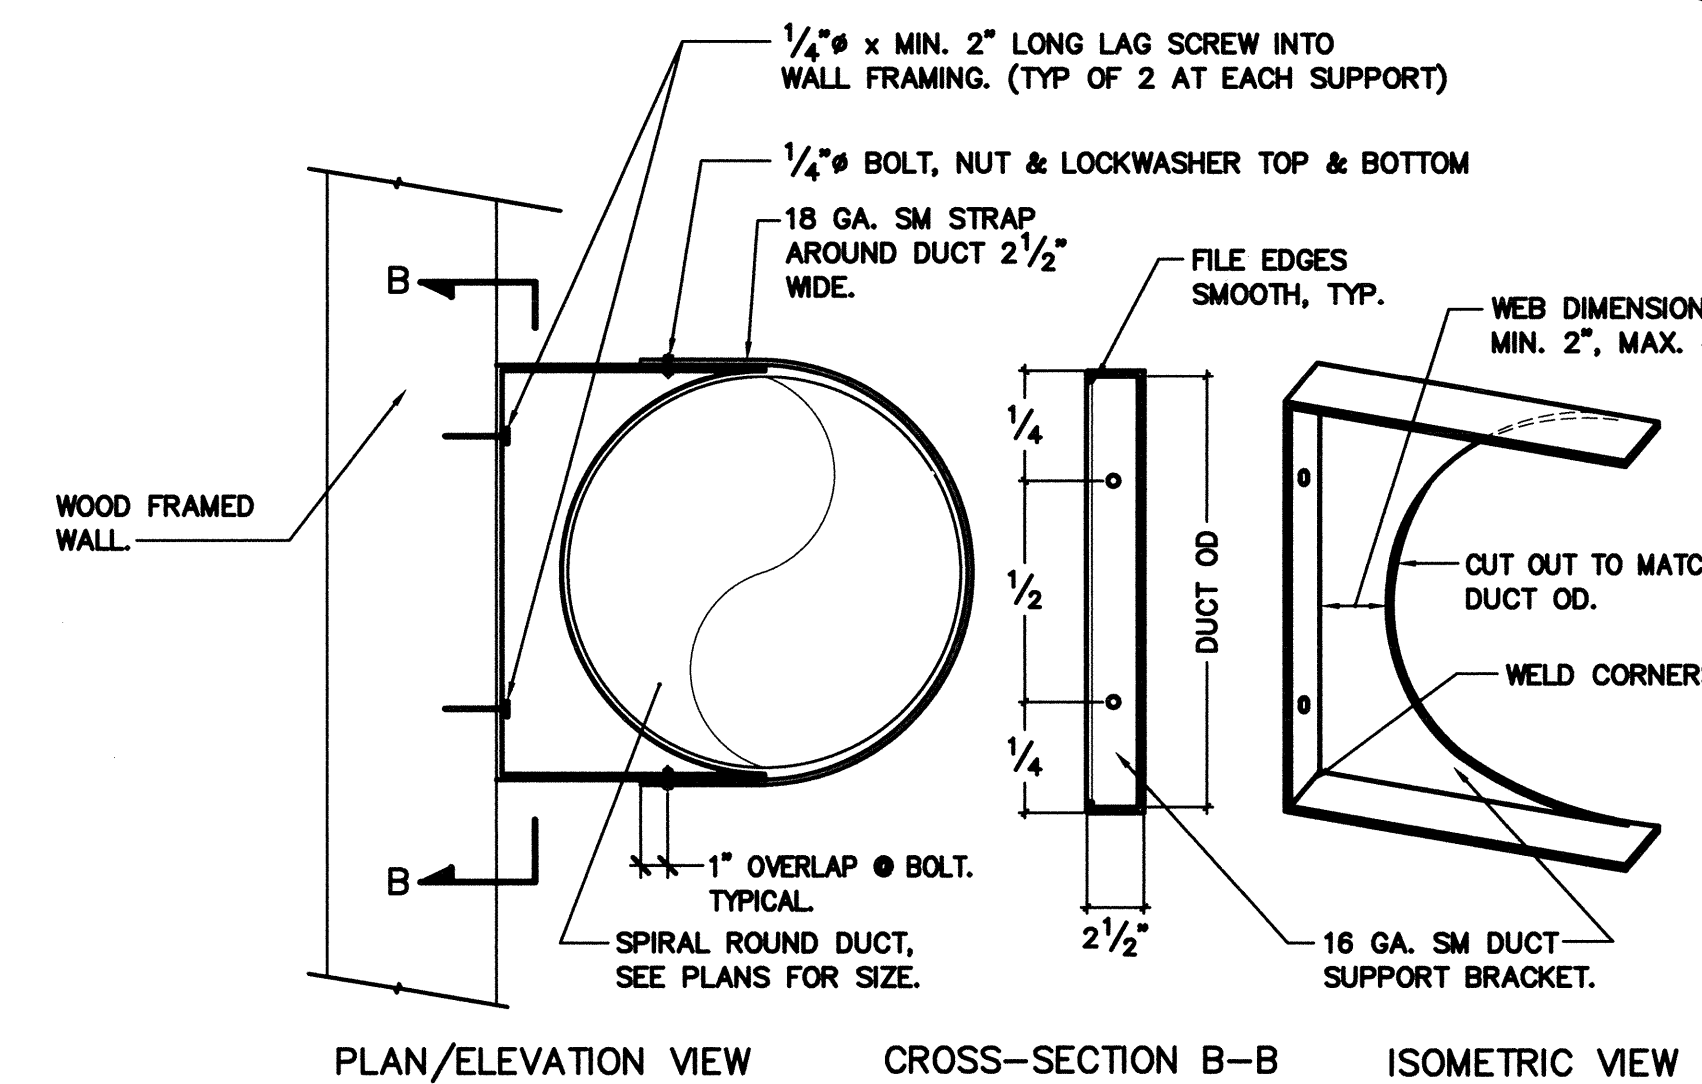


NOTE: SPACING OF BRACKETS AT MAX. 8'-0" O.C., MAX. 18" FROM ELBOWS, MAX. 6" FROM ENDS.

EXPOSED ROUND DUCT SUPPORT AT WALL

SCALE : NONE

10
M5.1

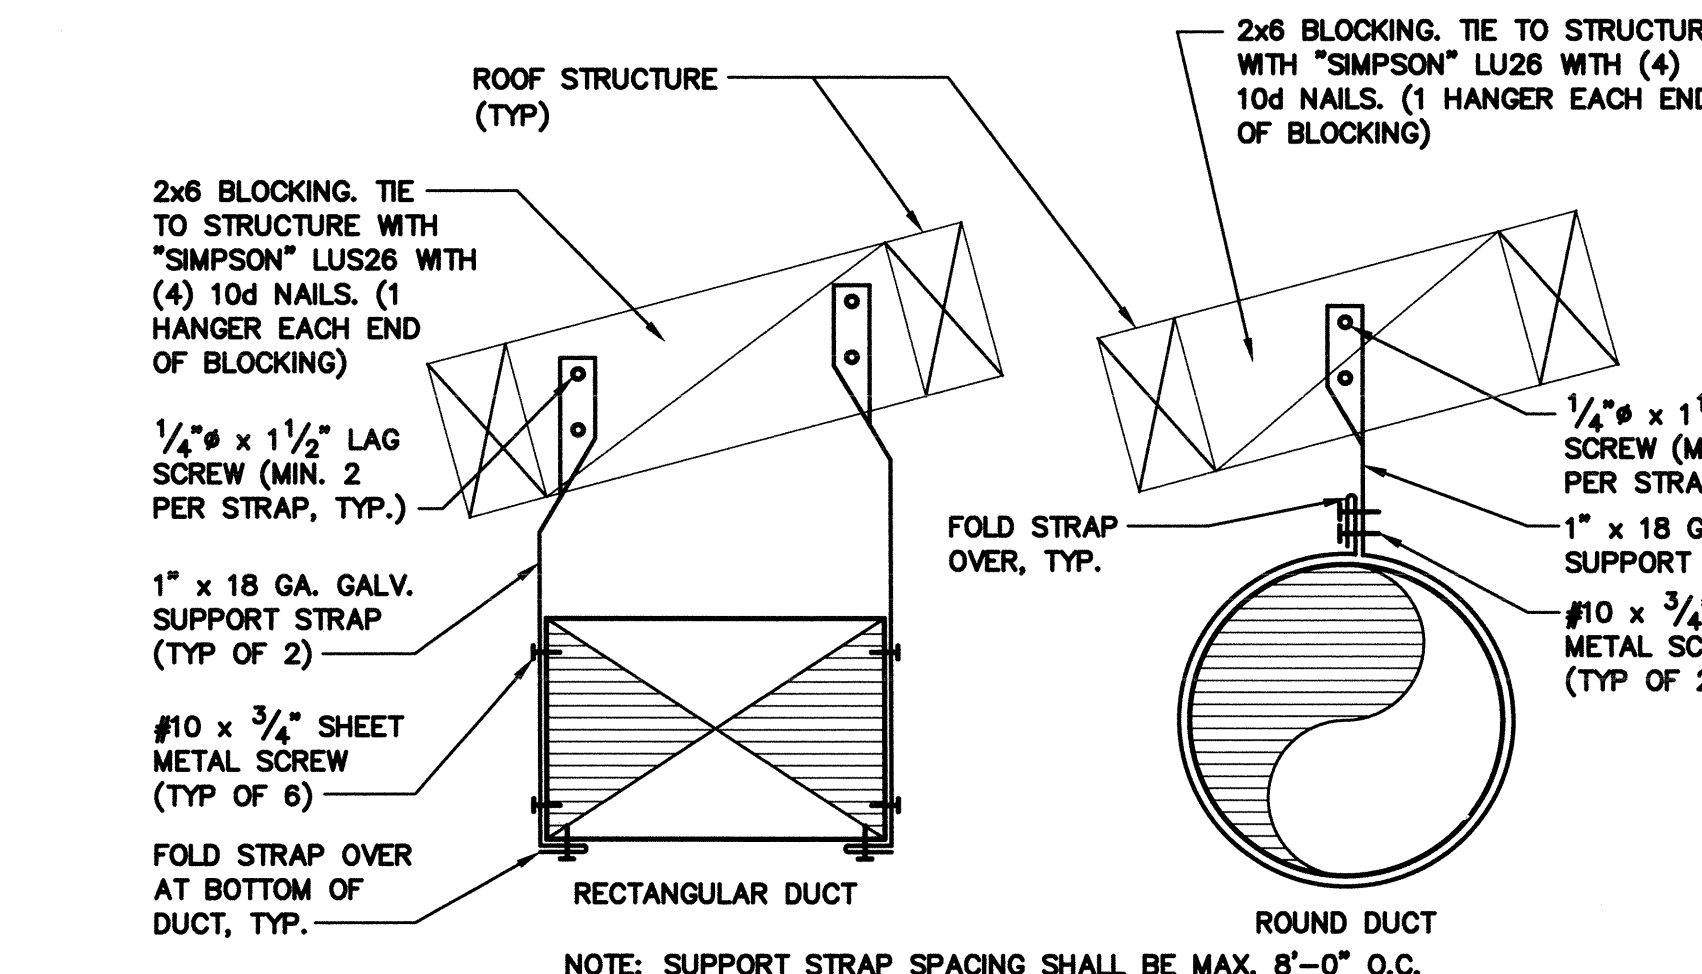


NOTE: SUPPORT STRAP SPACING SHALL BE MAX. 8'-0" O.C.

TYPICAL CONCEALED DUCT SUPPORT

SCALE : NONE

11
M5.1

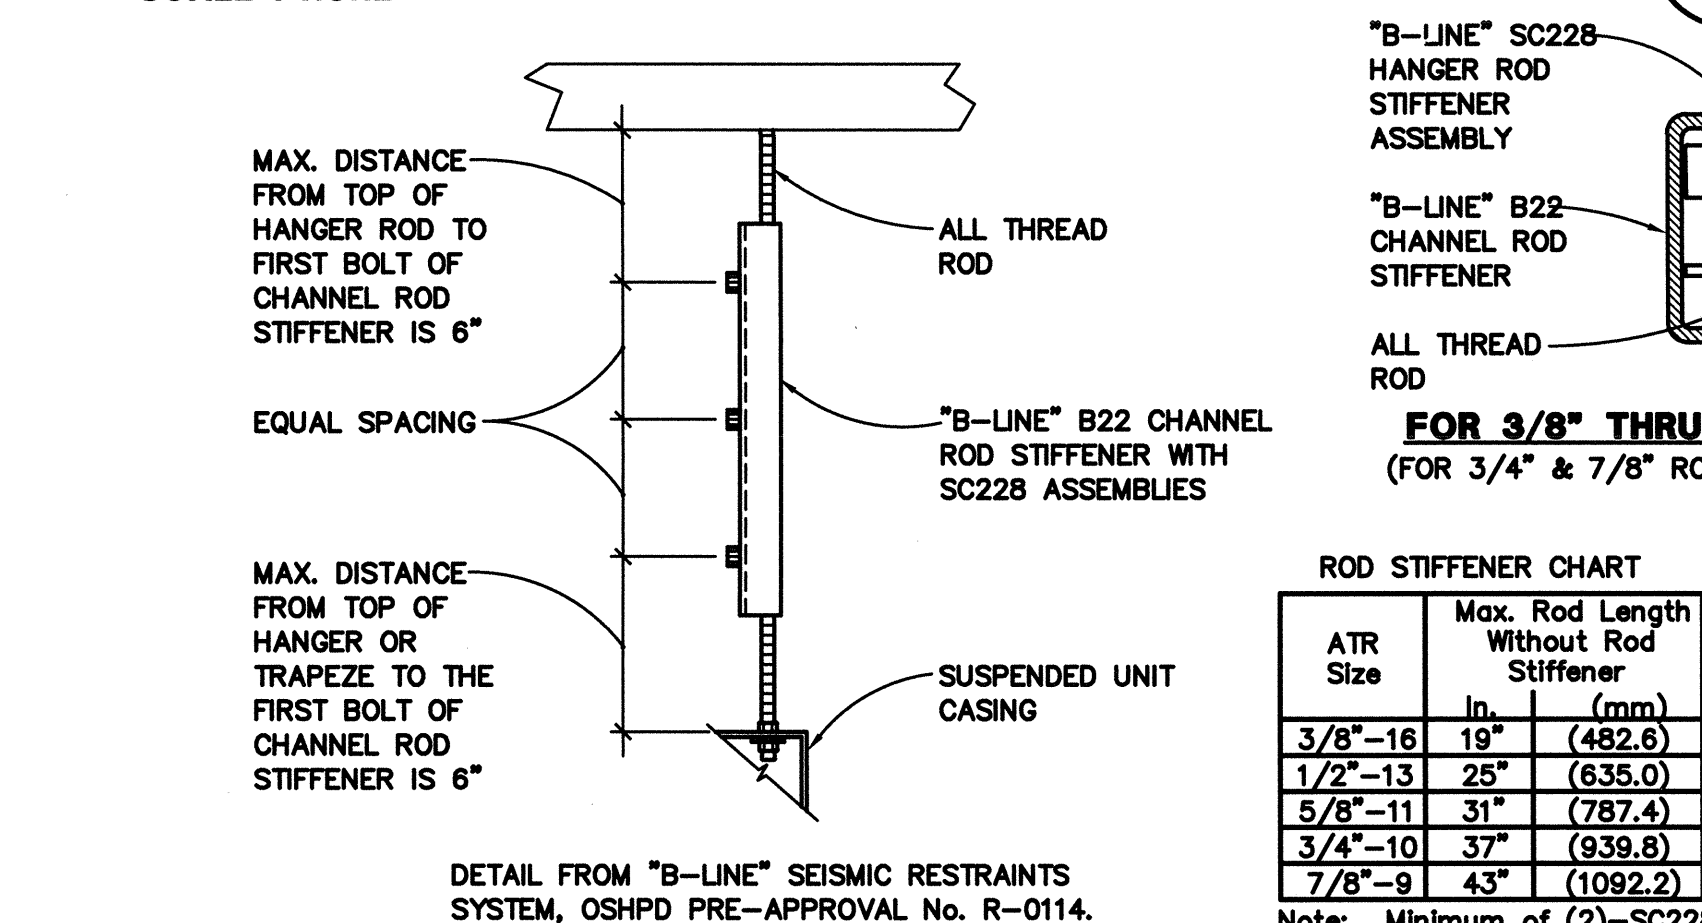


ROD STIFFENER DETAIL

SCALE : NONE

13
M5.1

ATR Size	Max. Rod Length Without Rod Stiffener	In.	(mm)
3/8"-18	18"	(457.2)	
1/2"-13	25"	(635.0)	
5/8"-11	34"	(863.6)	
3/4"-10	37"	(939.8)	
7/8"-9	43"	(1092.2)	


Note: Minimum of (2) SC228 or SC-UB are required per rod.

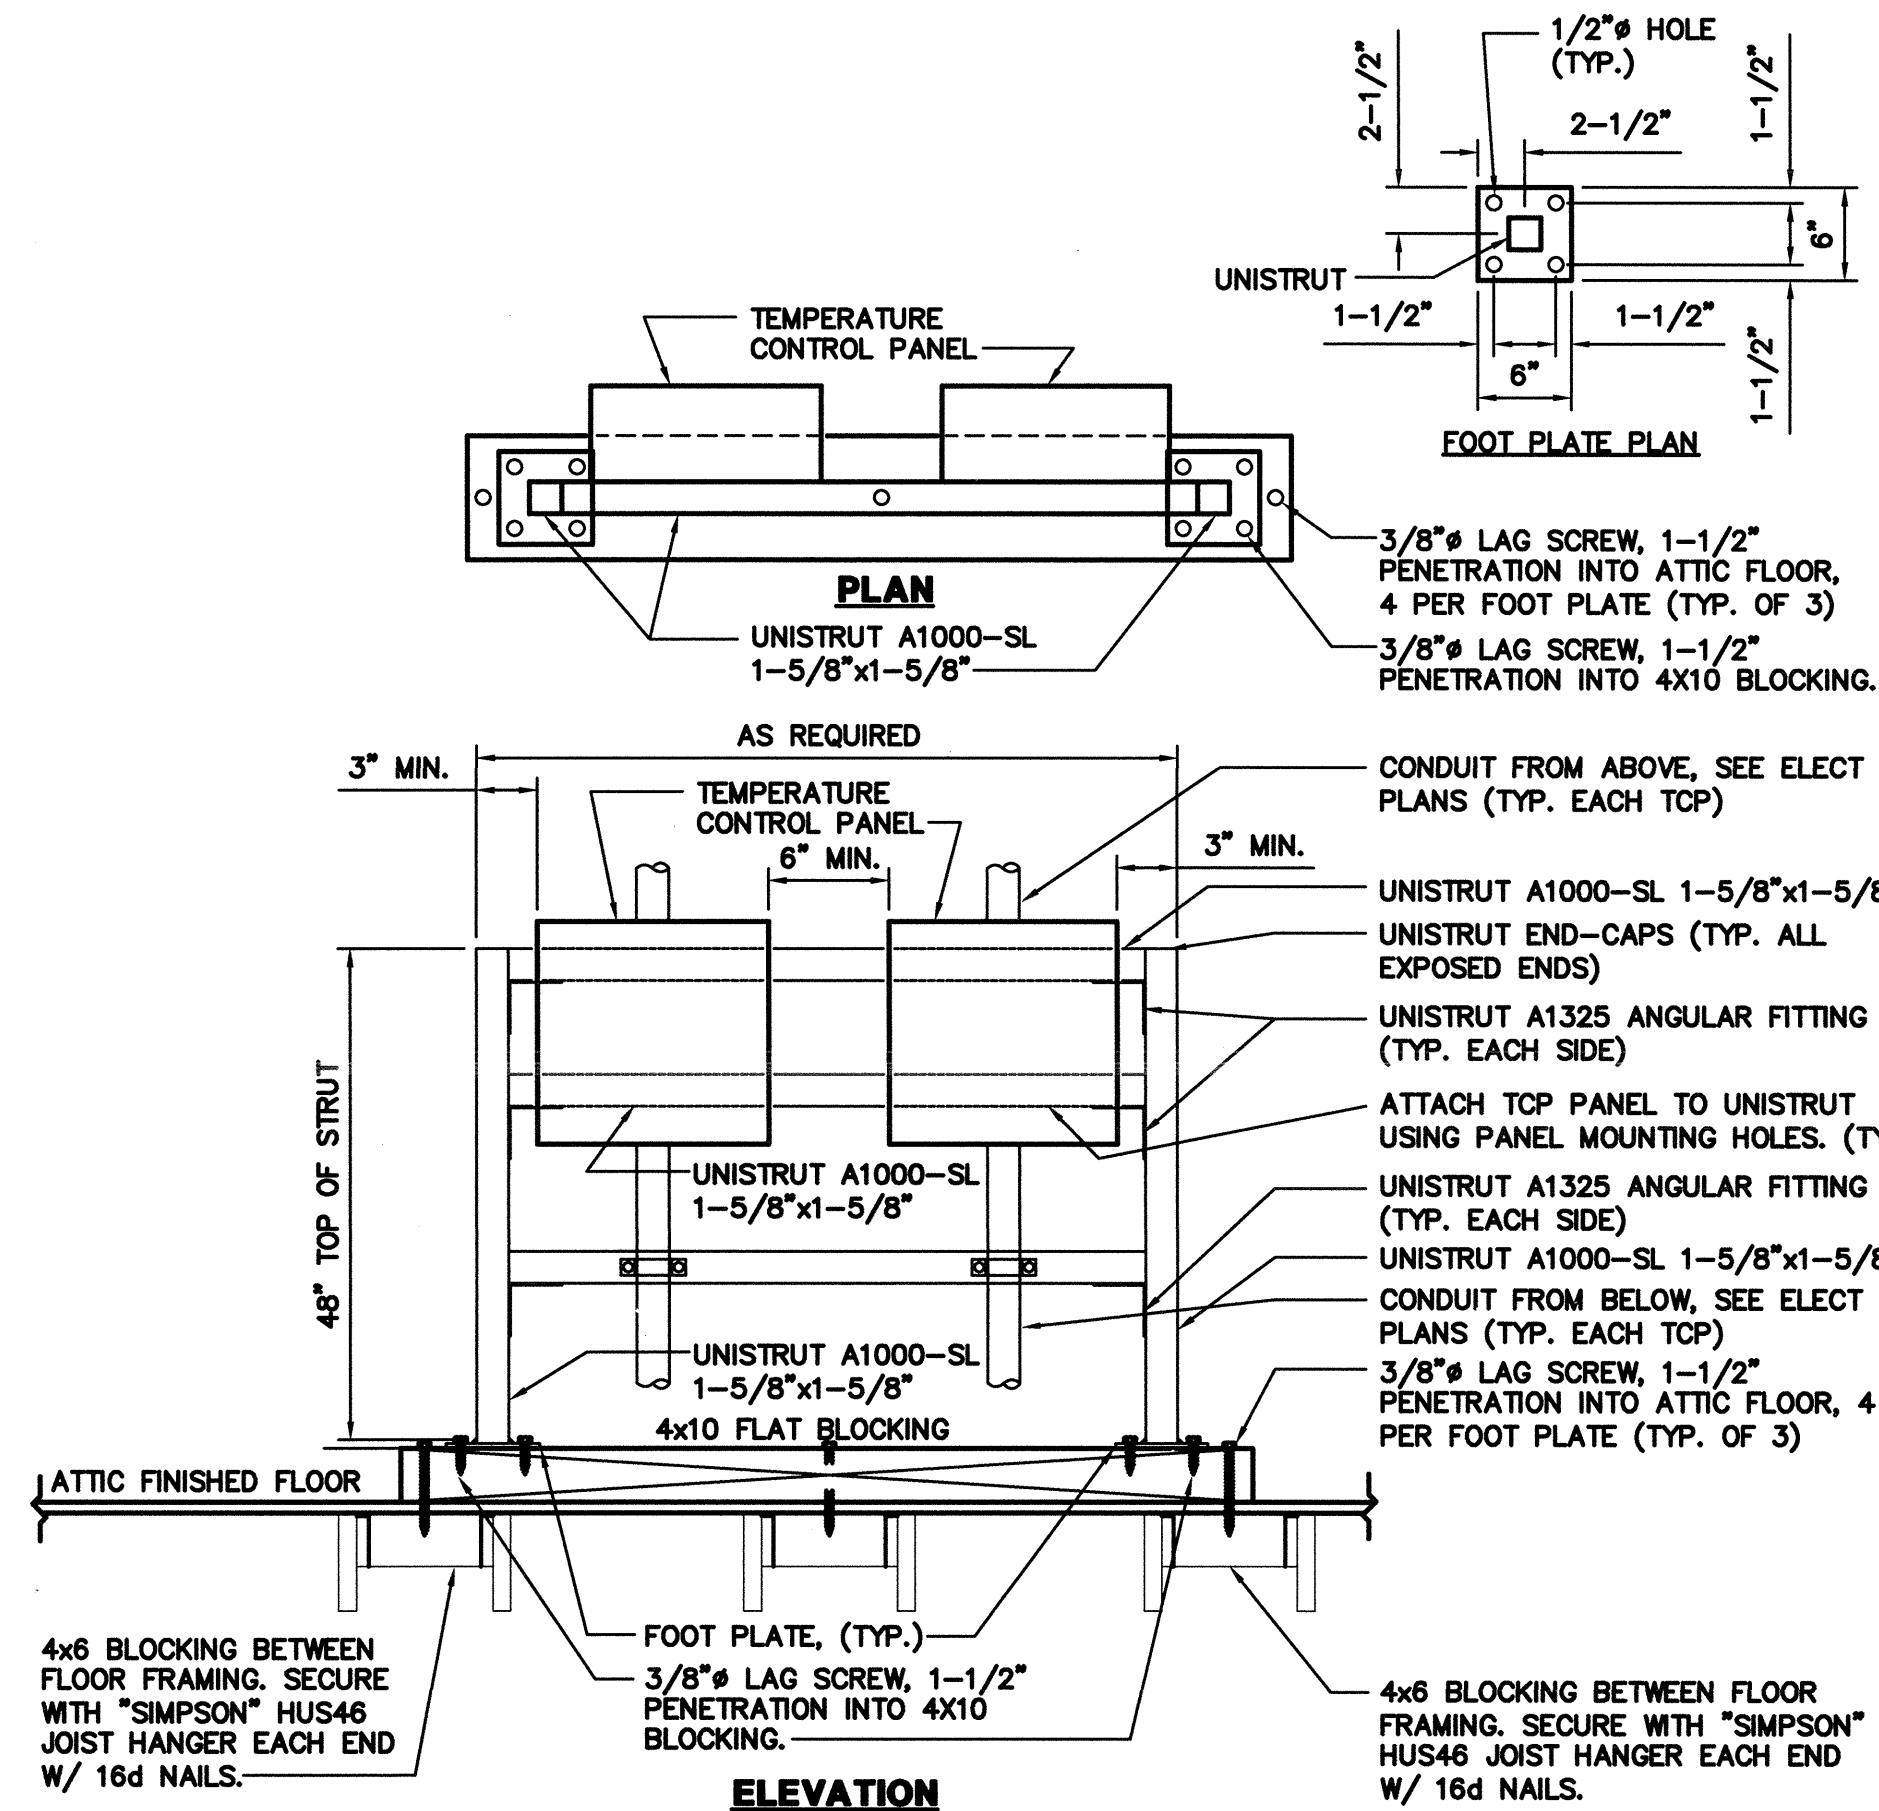

TEMPERATURE CONTROL PANEL SUPPORT/ MOUNTING

SCALE : NONE

5
M5.1

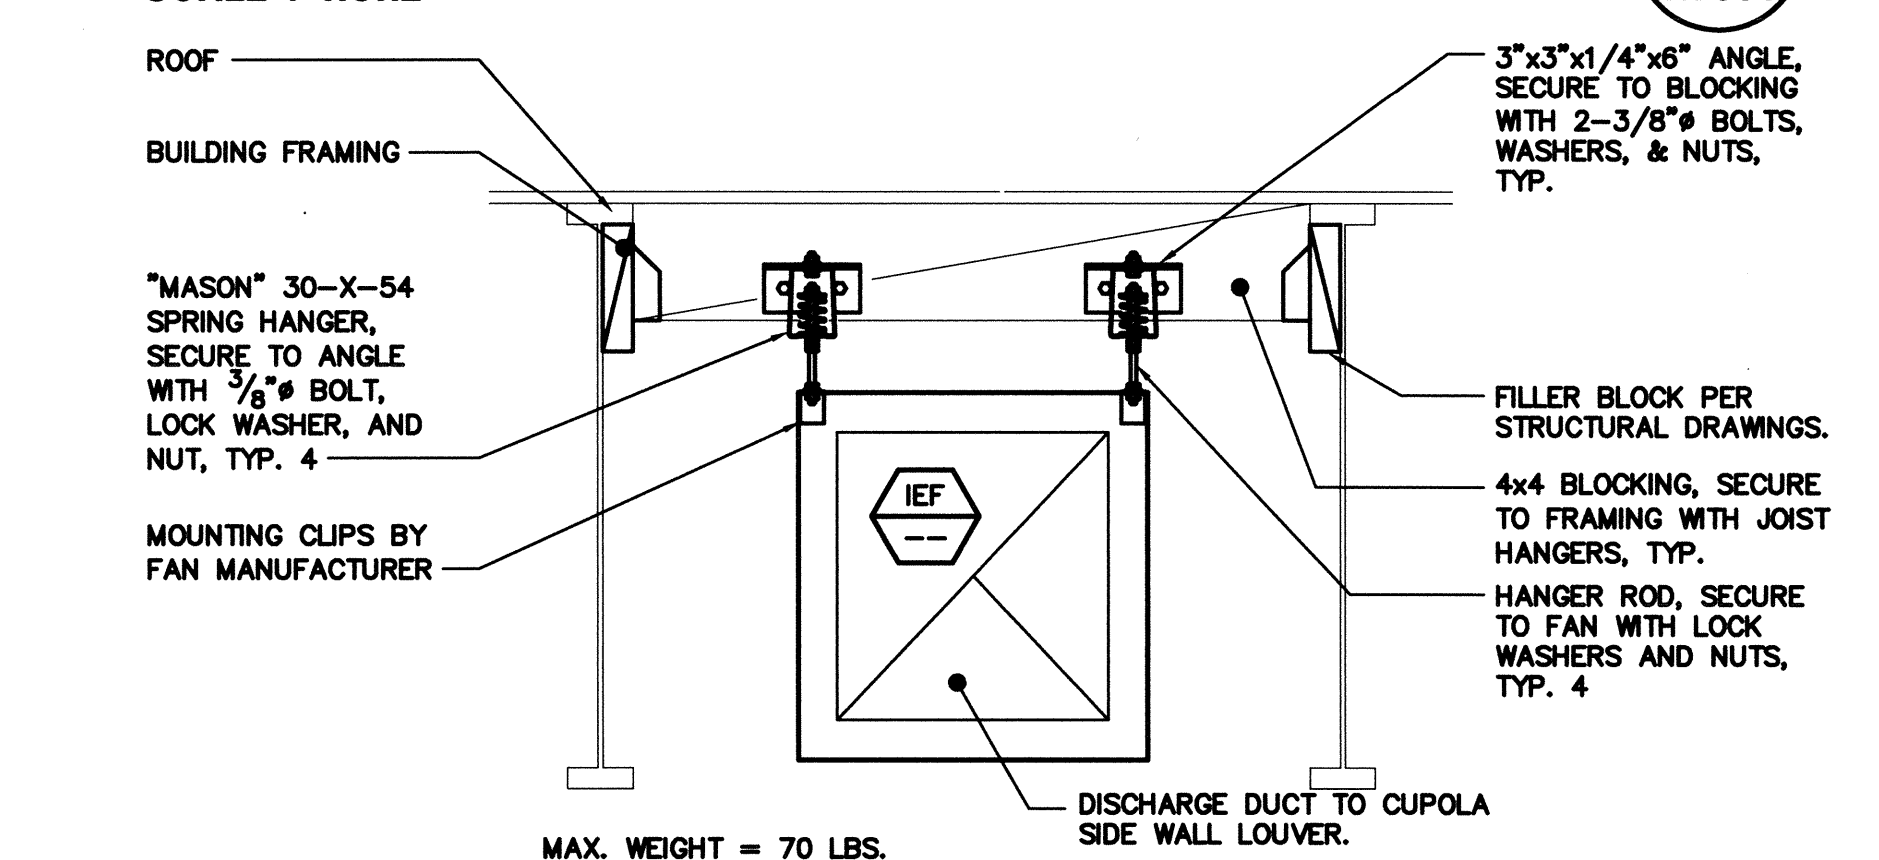


MAX. WEIGHT = 70 LBS.

INLINE EXHAUST FAN MOUNTING DETAIL

SCALE : NONE

6
M5.1

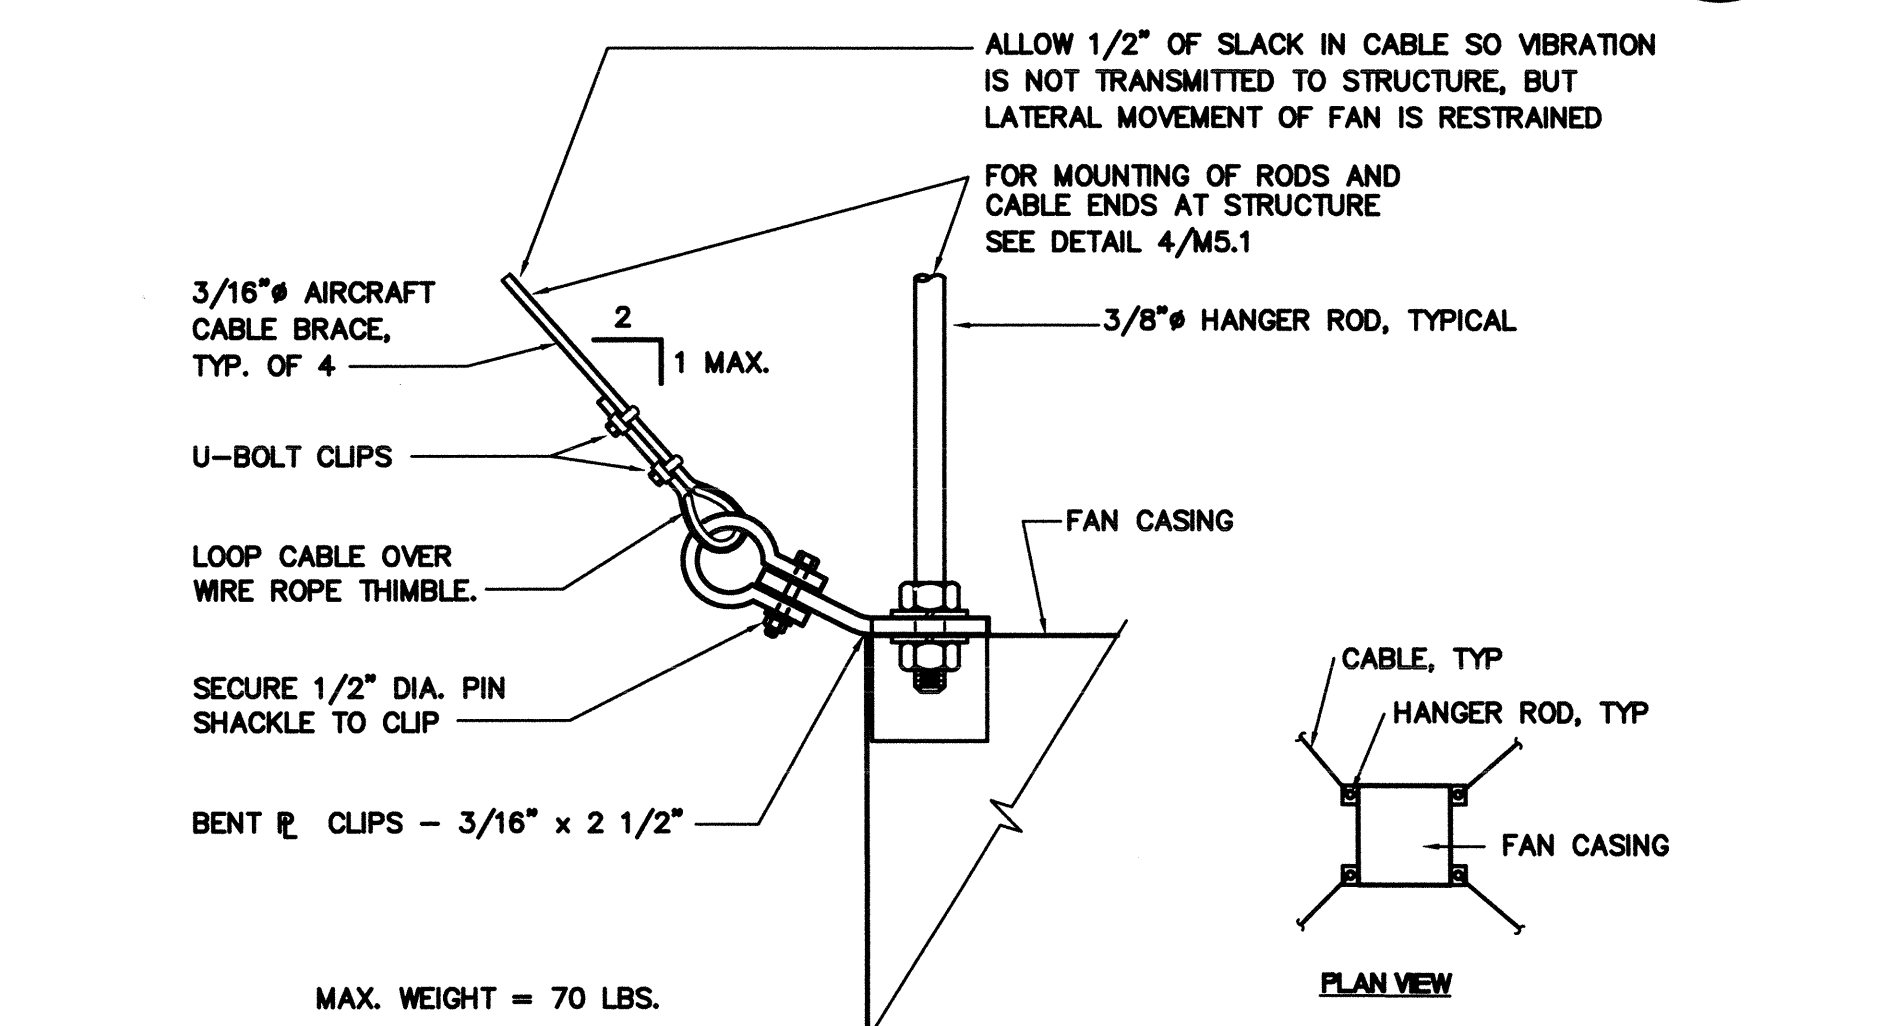


MAX. WEIGHT = 70 LBS.

IEF MOUNTING DETAIL

SCALE : NONE


7
M5.1

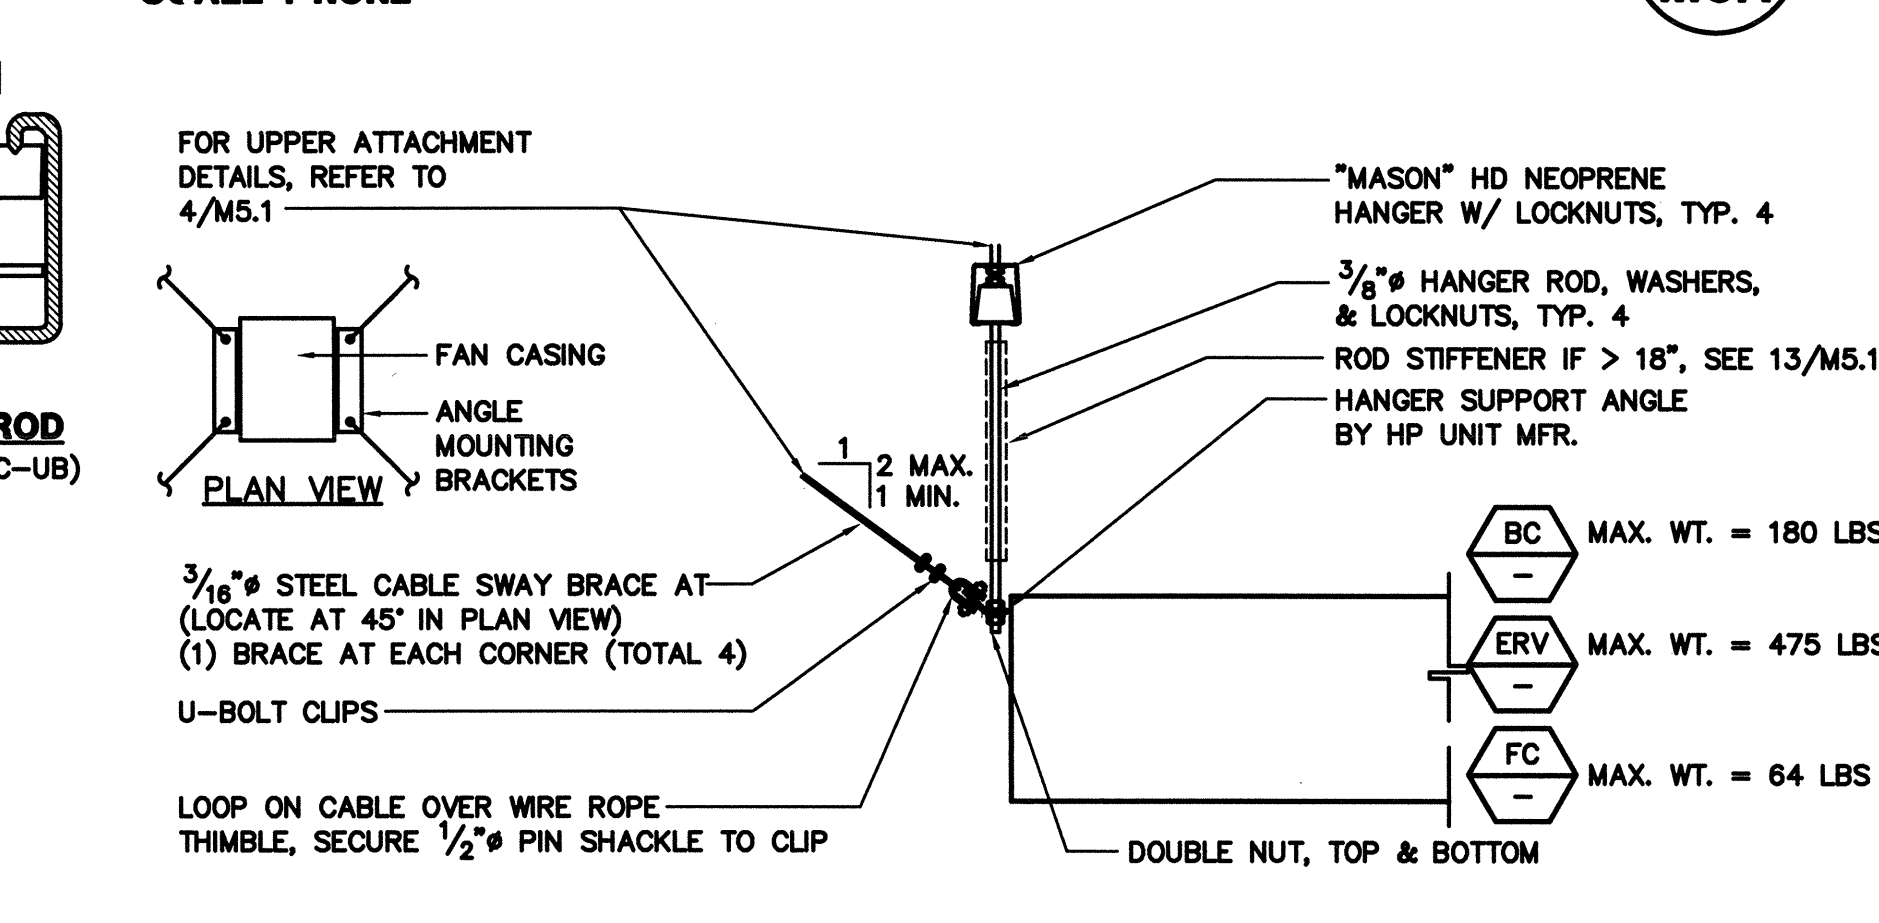

BC CONTROLLER, ERV & DUCTED FC MOUNTING

SCALE : NONE


8
M5.1

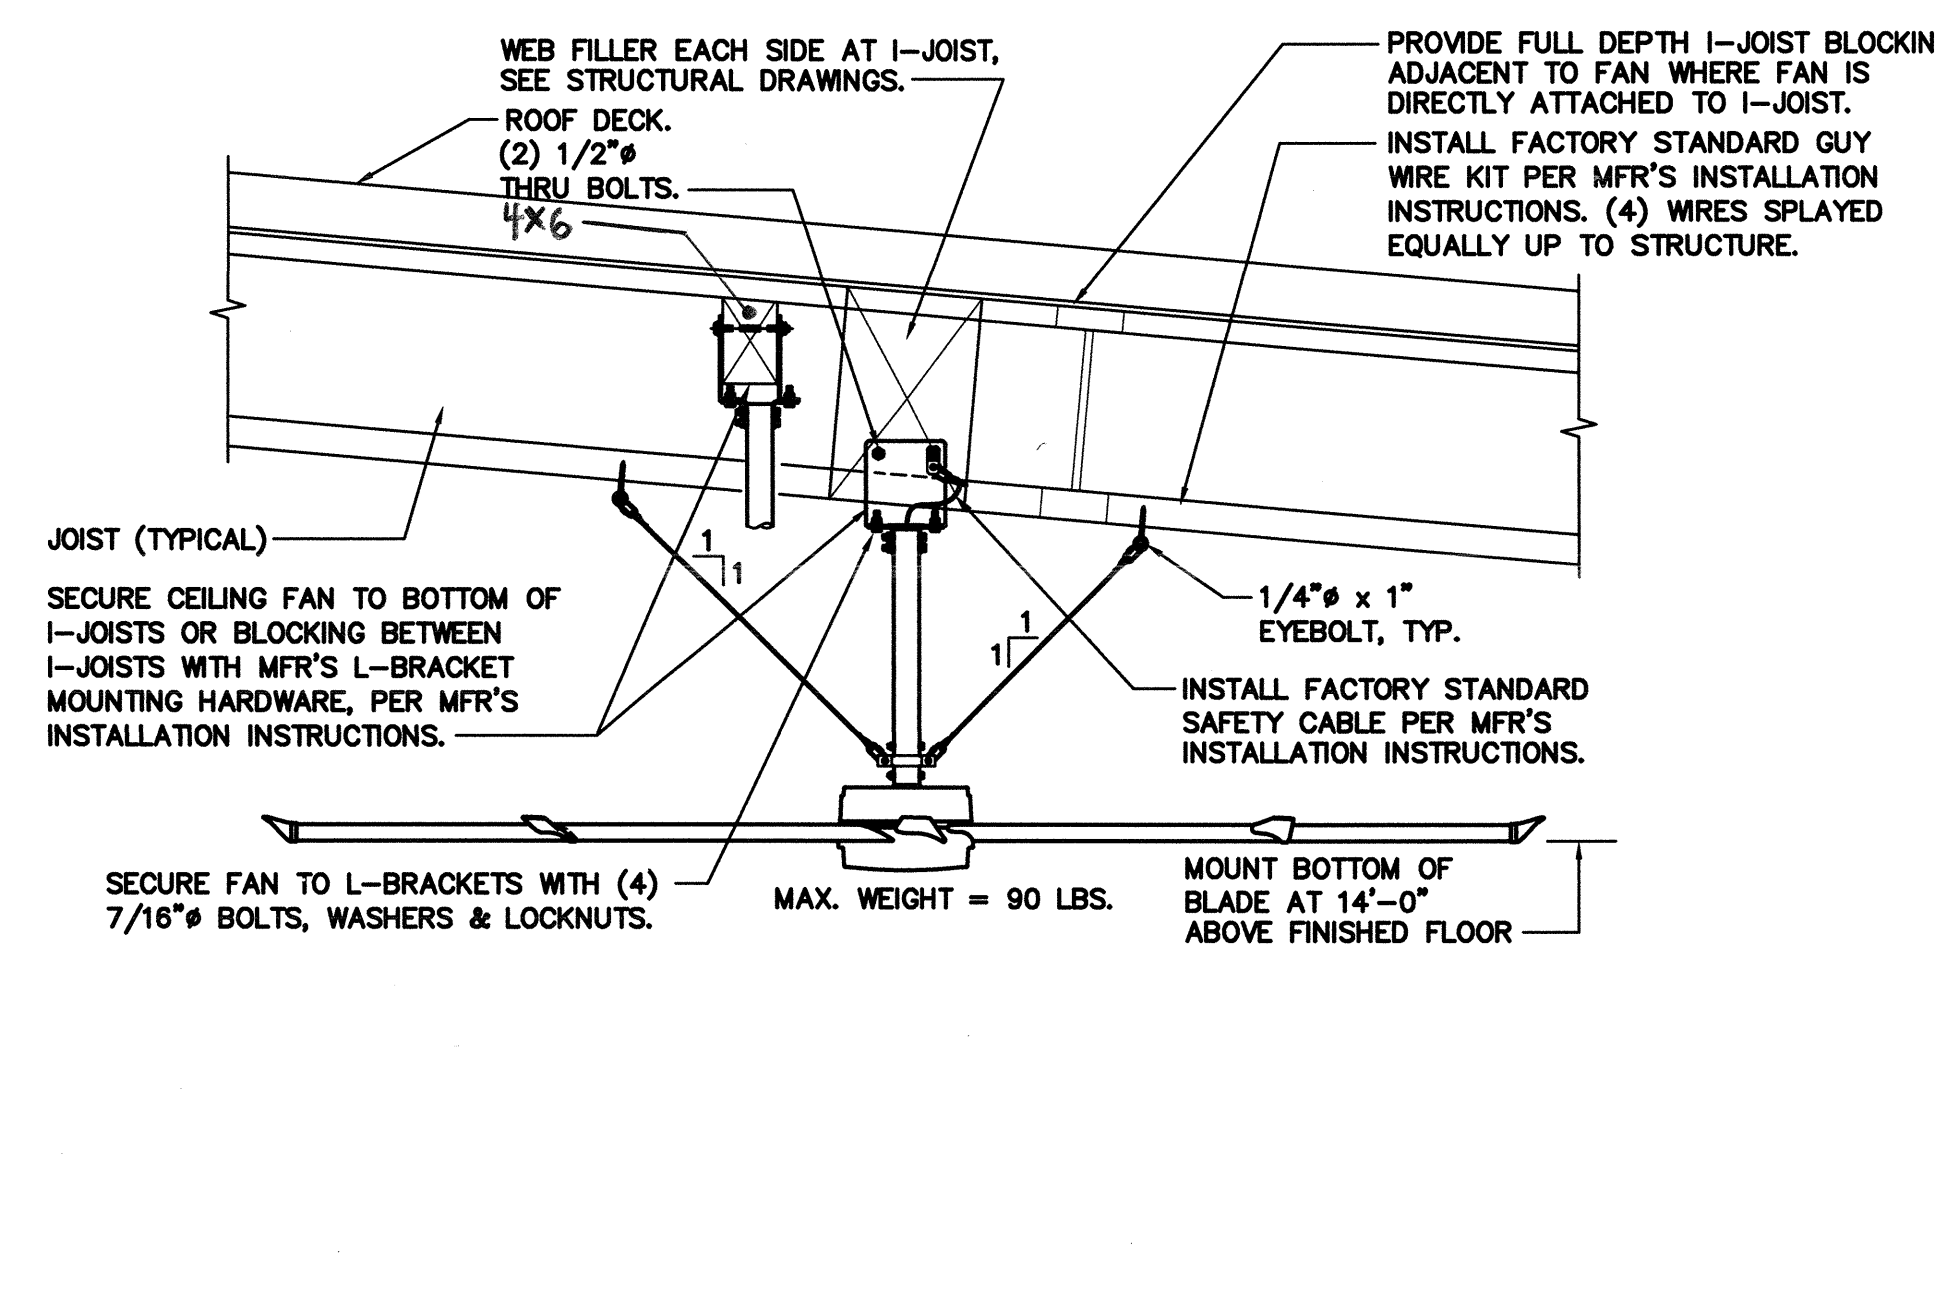

CEILING FAN MOUNTING DETAIL

SCALE : NONE


1
M5.1

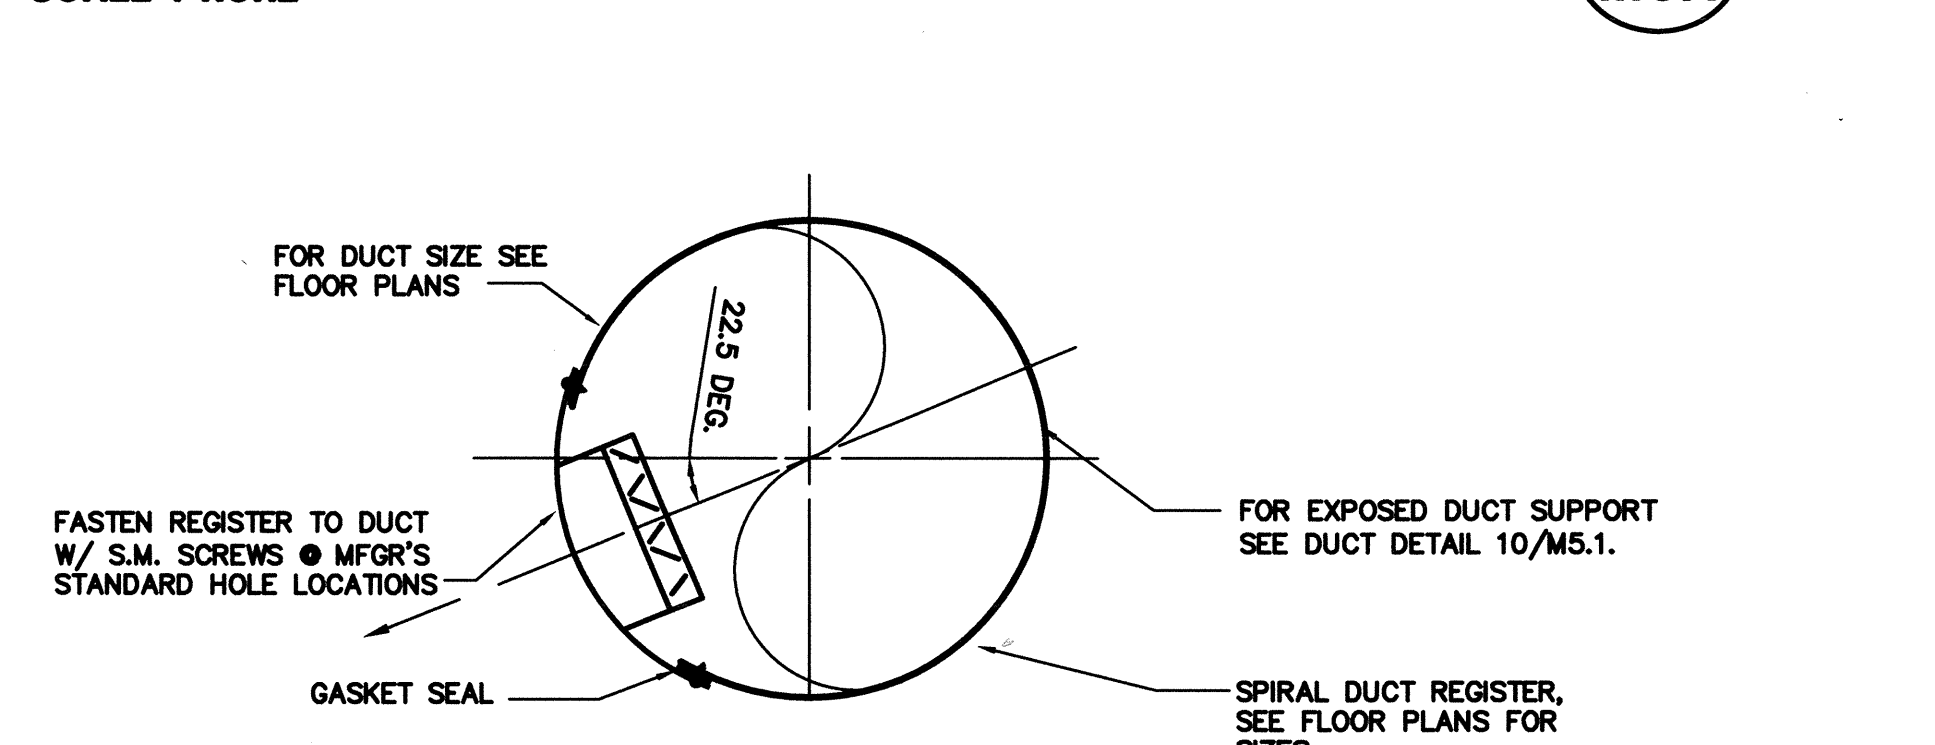

EXPOSED DUCT REGISTER MOUNTING DETAIL

SCALE : NONE


2
M5.1

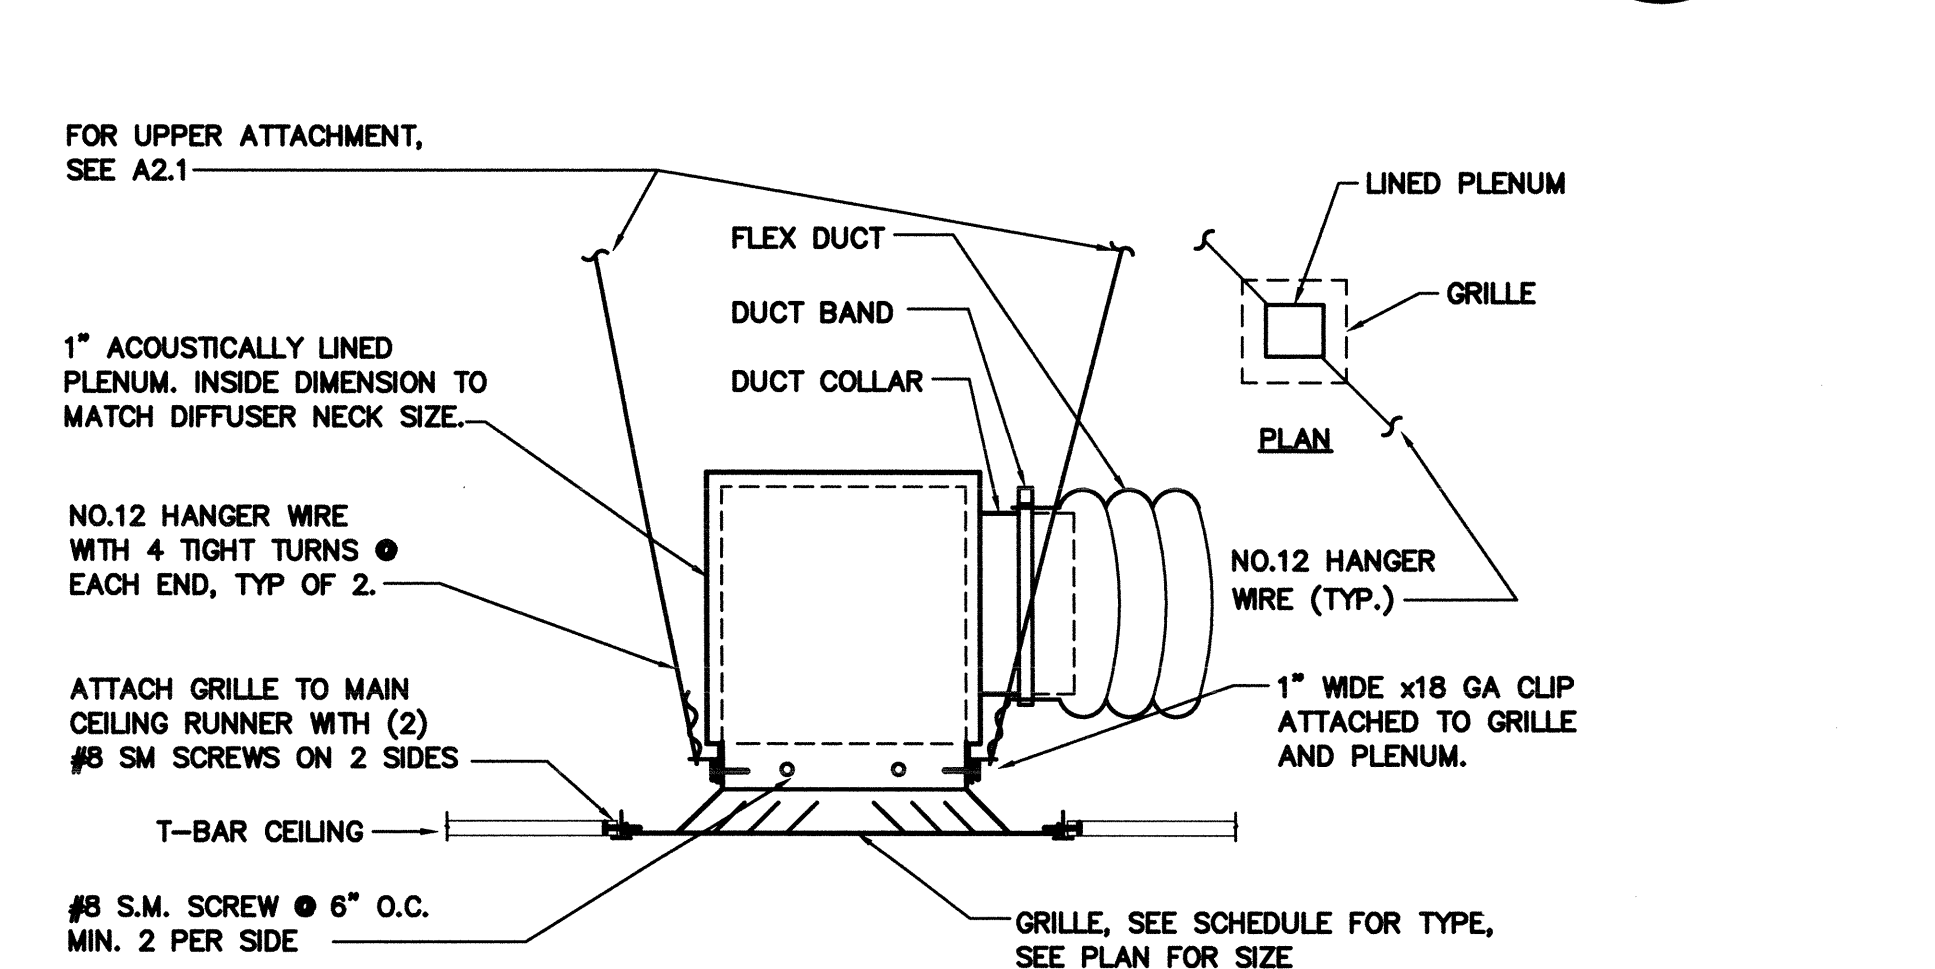

TYP. LAY-IN DIFFUSER/GRILLE MOUNTING

SCALE : NONE

3
M5.1

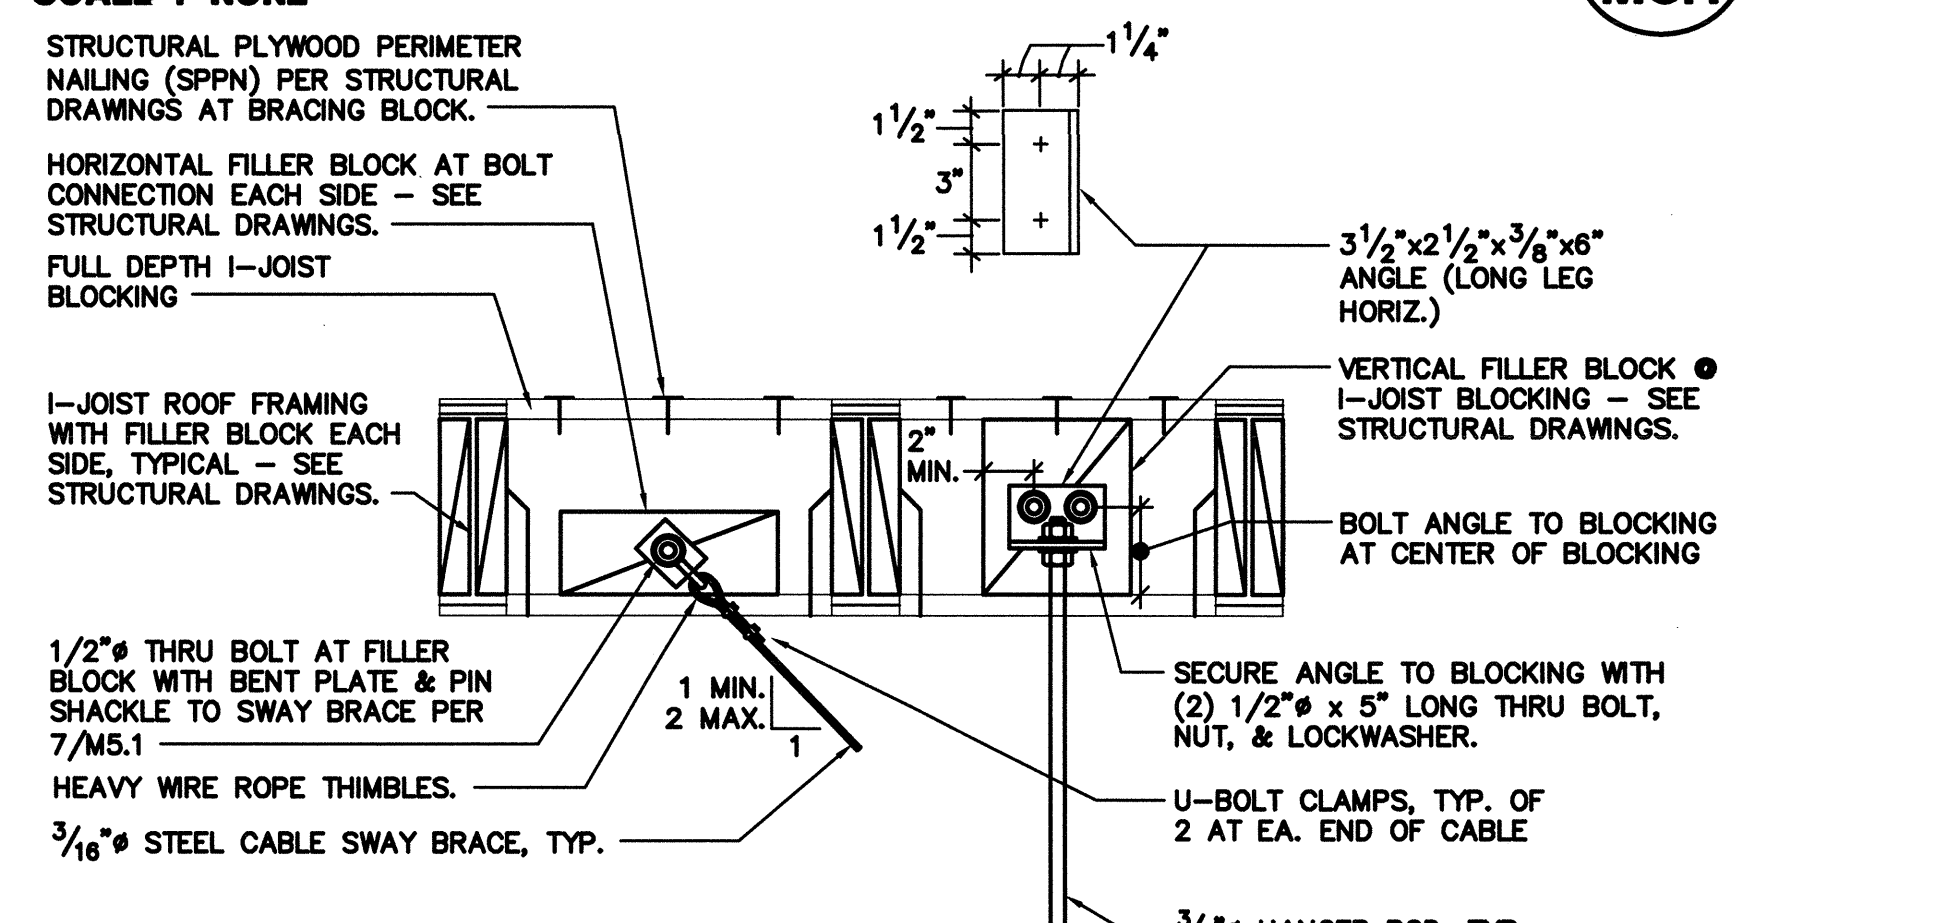

HANGER ROD/CABLE UPPER ATTACHMENT

SCALE : NONE

4
M5.1

Dry Creek Joint Elementary School District
District Education Center

8849 Cook Riolo Road, Roseville, CA 95747

Dry Creek Joint Elementary School District

FILE NO. 31-15
IDENTIFICATION STAMP DIV. OF THE
STATE ARCHITECT OFFICE OF
REGULATION SERVICES
APPLICATION NO.
02-115496
AC. TM FLS. HRS. SS. EIR
DATE 7/22/13 CCE

DIVISION OF THE STATE ARCHITECT
revision date: _____ by: _____




DATE SIGNED: 2/15/2017



CONSULTANT

nacht&lewis
600 Q Street, Suite 100
Sacramento, CA 95811
www.nachtandlewis.com
916.329.4000

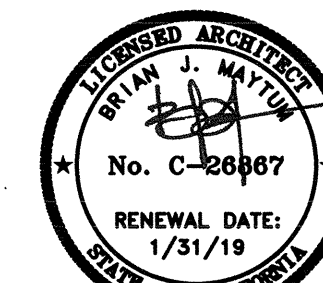

ARCHITECT

INITIAL BOX			
NO.	DWG BY	DATE	REVIEWED
REVISIONS			
NO.	DESCRIPTION	DATE	REV'D

DATE February 23, 2017

JOB NO. Y1538.00

SHEET TITLE

Mechanical
Details

SHEET NO.


M5.1

SHEET ____ OF ____ TOTAL




HORIZONTAL FURNACE MOUNTING - F/3

SCALE : NONE

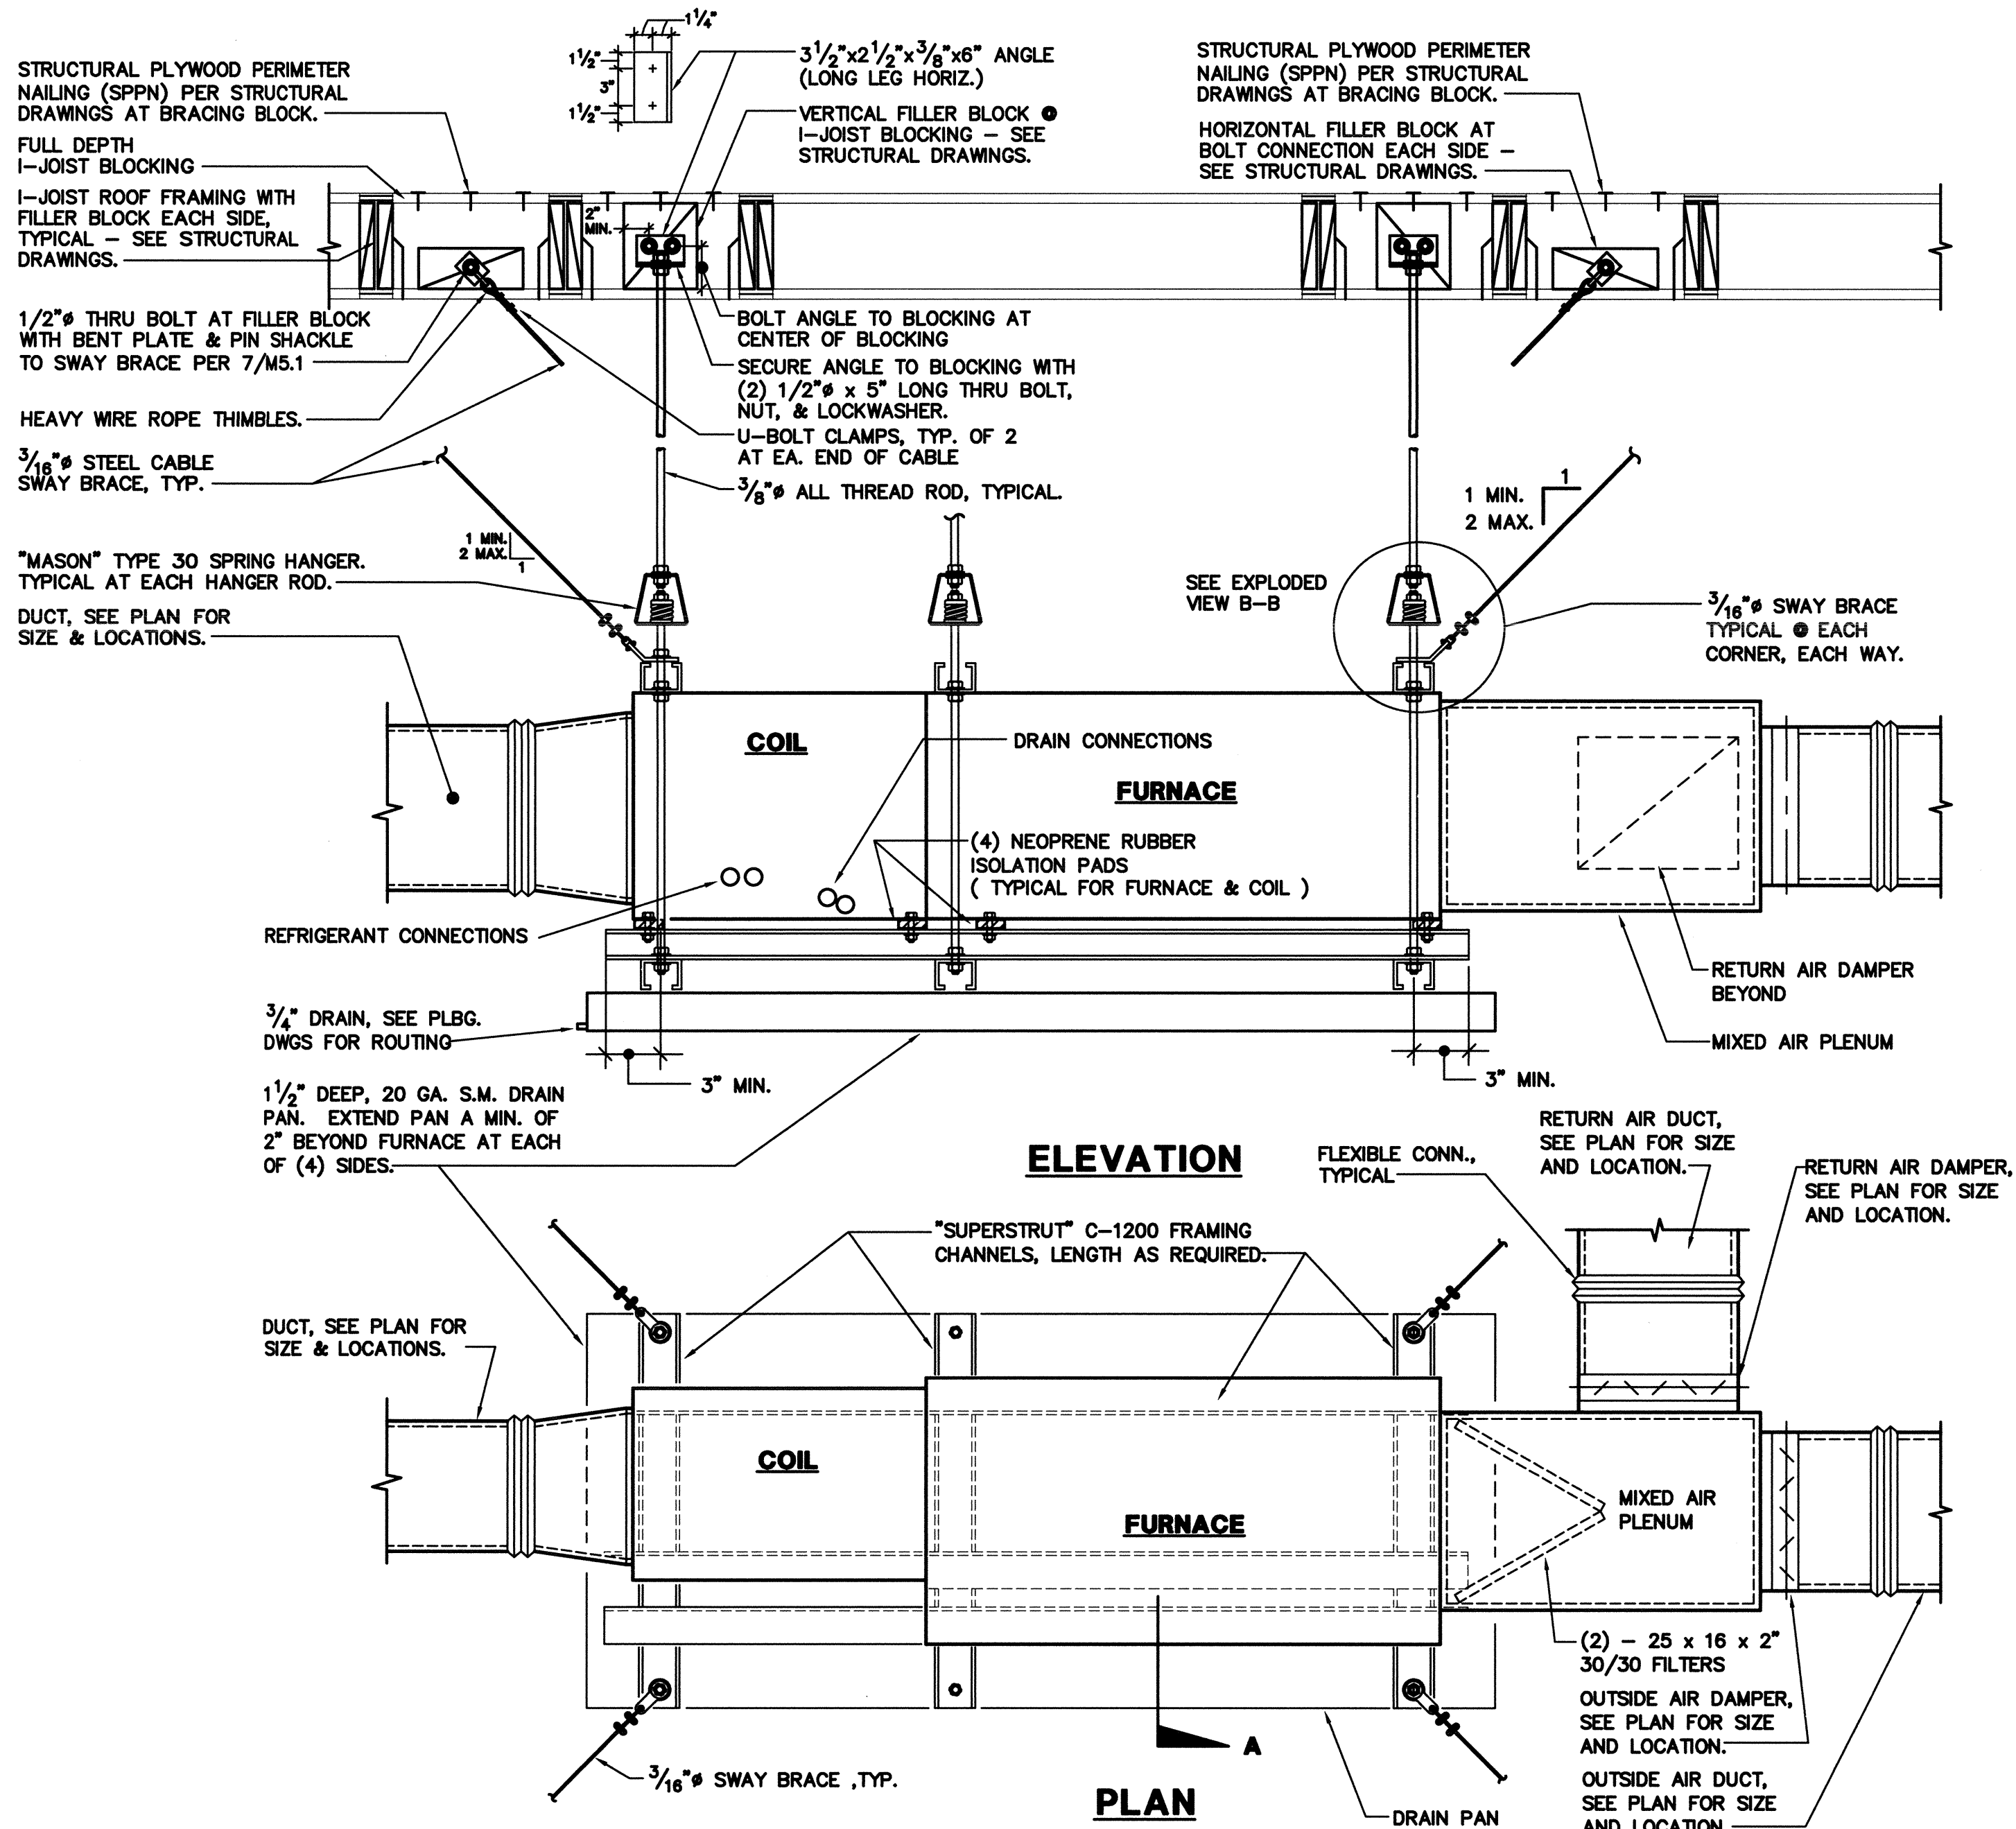


EXPLODED VIEW B-B

SCALE : NONE

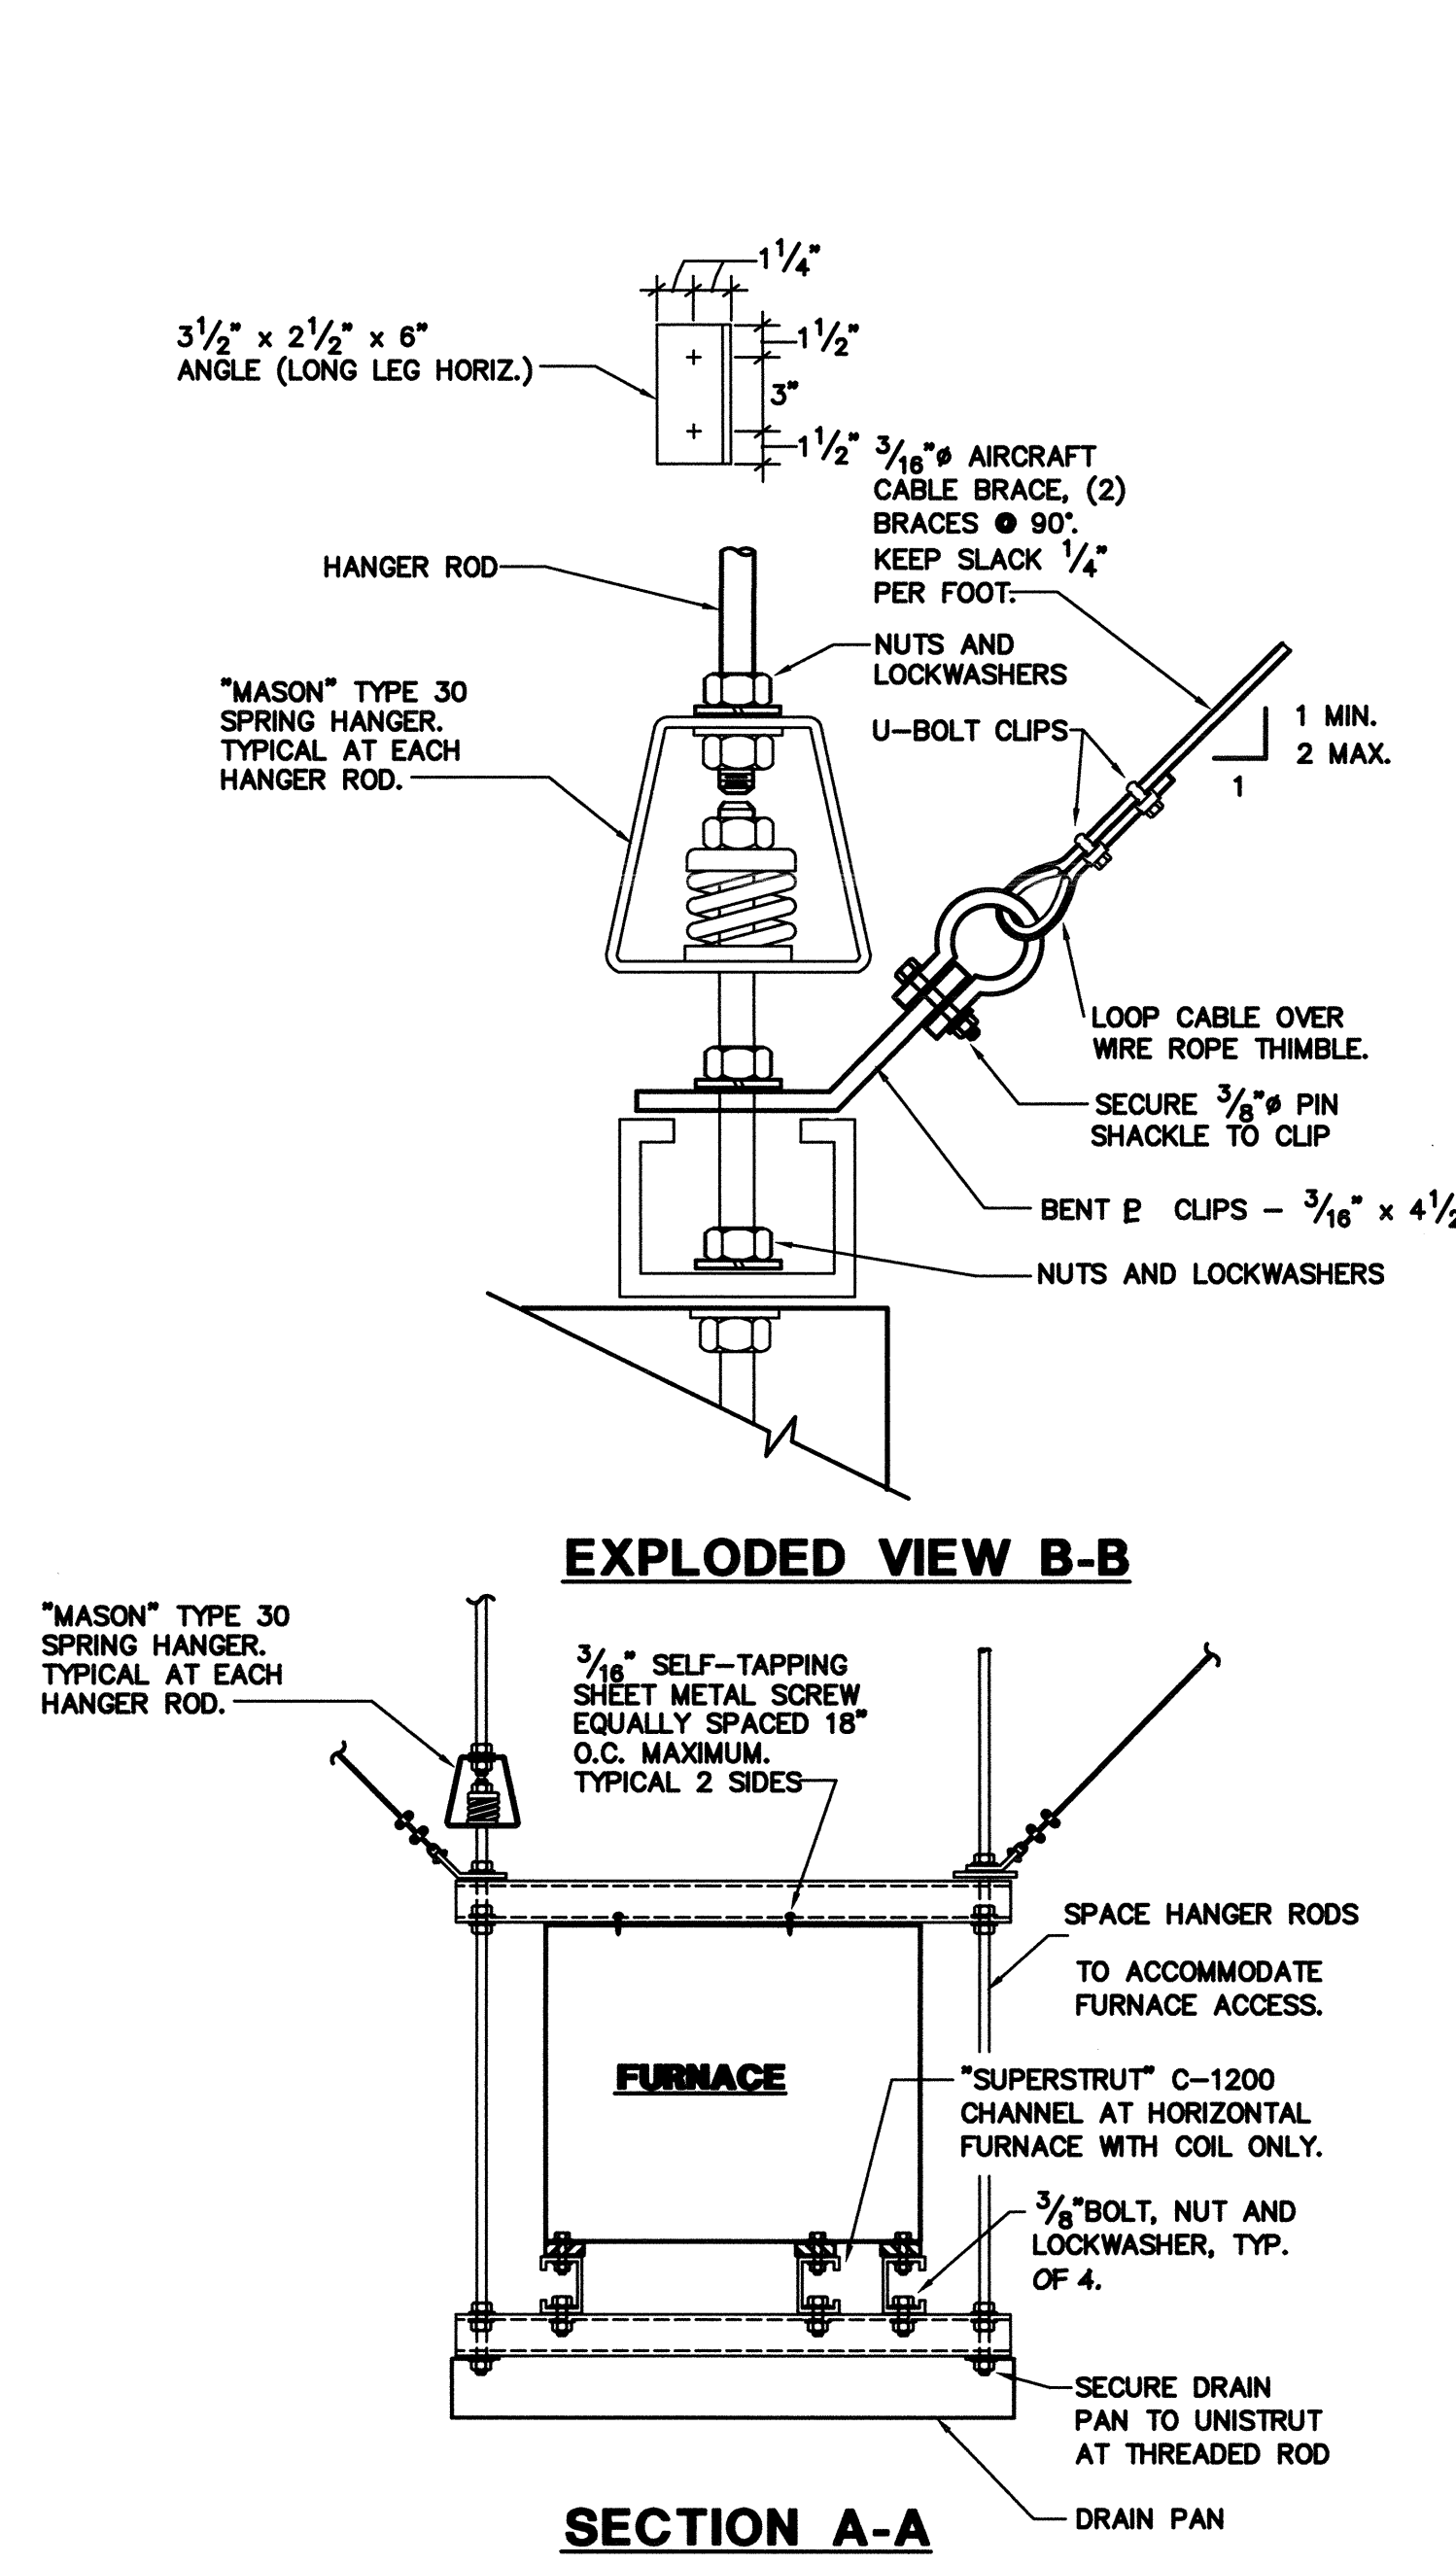

SECTION A-A

SCALE : NONE

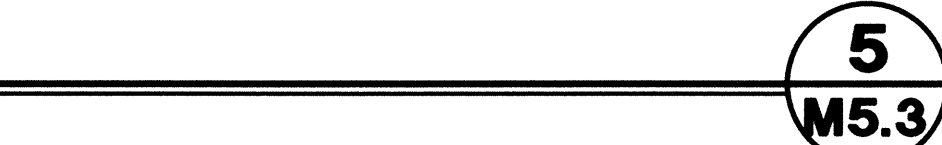


FURNACE MTG. AT RAISED FLOOR

SCALE : NONE




FURNACE ELEVATION

SCALE : NONE

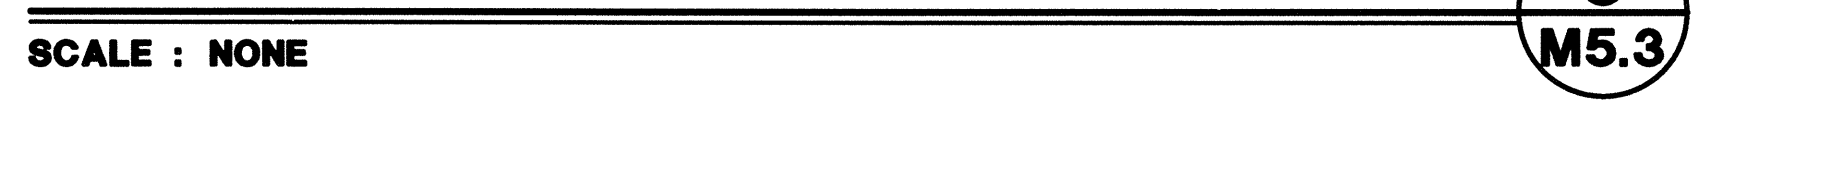


CONDENSATE PUMP @ FC AND FURNACE UNITS

SCALE : NONE

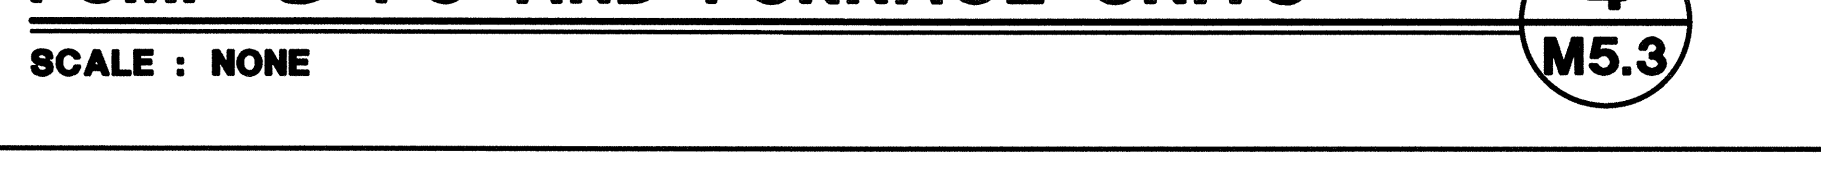

WIRING DIAGRAM


SCALE : NONE

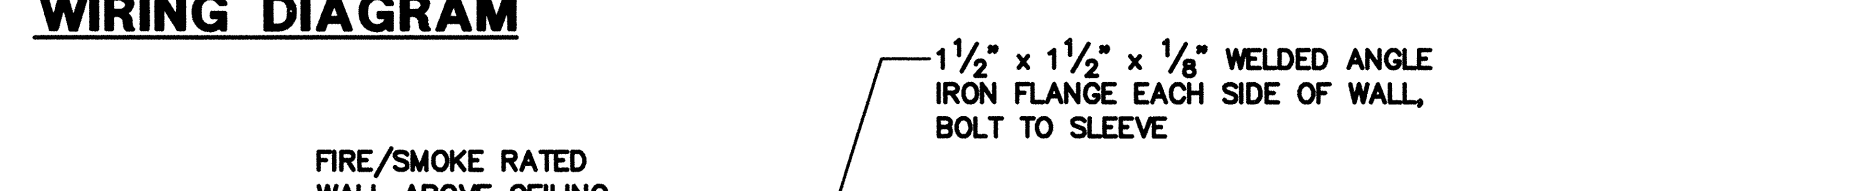

MOUNTING DETAIL

COMBINATION FIRE/SMOKE DAMPER THRU WALL MOUNTING

SCALE : NONE

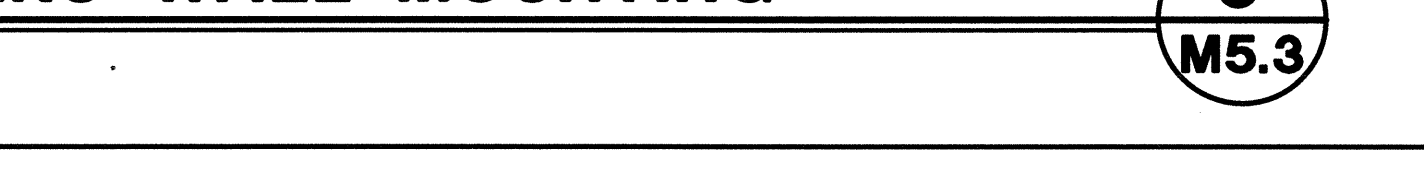

Dry Creek Joint Elementary School District
District Education Center

8849 Cook Riolo Road, Roseville, CA 95747

Dry Creek Joint Elementary School District

FILE NO. 31-15

IDENTIFICATION STAMP DIV. OF THE
STATE ARCHITECT OFFICE OF
REGULATION SERVICES

APPLICATION NO.
02-115496

AC TM FLS DATE SS BY
DATE 1/23/17 CEN

DIVISION OF THE STATE ARCHITECT

revision date: _____ by: _____

REGISTERED PROFESSIONAL ENGINEER

M 22836

EXPIRES 1/31/18

STATE OF CALIFORNIA

DATE SIGNED: 2/15/2017

CAPITAL ENGINEERING
CONSULTANTS, INC.

RANCHO CORDOVA, CALIFORNIA

FL 2800.00

PM - DESIGN TEAM PROJECT NO.

CONSULTANT

nacht&lewis

600 Q Street, Suite 100
Sacramento, CA 95811
www.nachtandlewis.com
916.829.4000

REGISTERED ARCHITECT

No. C-26887

RENEWAL DATE: 1/31/18

STATE OF CALIFORNIA

ARCHITECT

INITIAL BOX

NO.	DWG BY	DATE	REVIEWED

REVISIONS

NO.	DESCRIPTION	DATE	REV'D
	100% design development	7/9/16	
	75% construction documents	9/20/16	
	DSA submittal	12/31/16	
	DSA approval	02/23/17	

DATE February 23, 2017

JOB NO. Y1538.00

SHEET TITLE

Mechanical
Details

SHEET NO.

M5.3

SHEET ____ OF ____ TOTAL