


ONE AND ONE-HALF INCH = ONE FOOT
THREE-QUARTERS INCH = ONE FOOT
ONE-QUARTER INCH = ONE FOOT
ONE-HALF INCH = ONE FOOT
ONE-QUARTER INCH = ONE FOOT
ONE-EIGHTH INCH = ONE FOOT
ONE-SIXTEENTH INCH = ONE FOOT
ONE INCH = TWENTY FEET

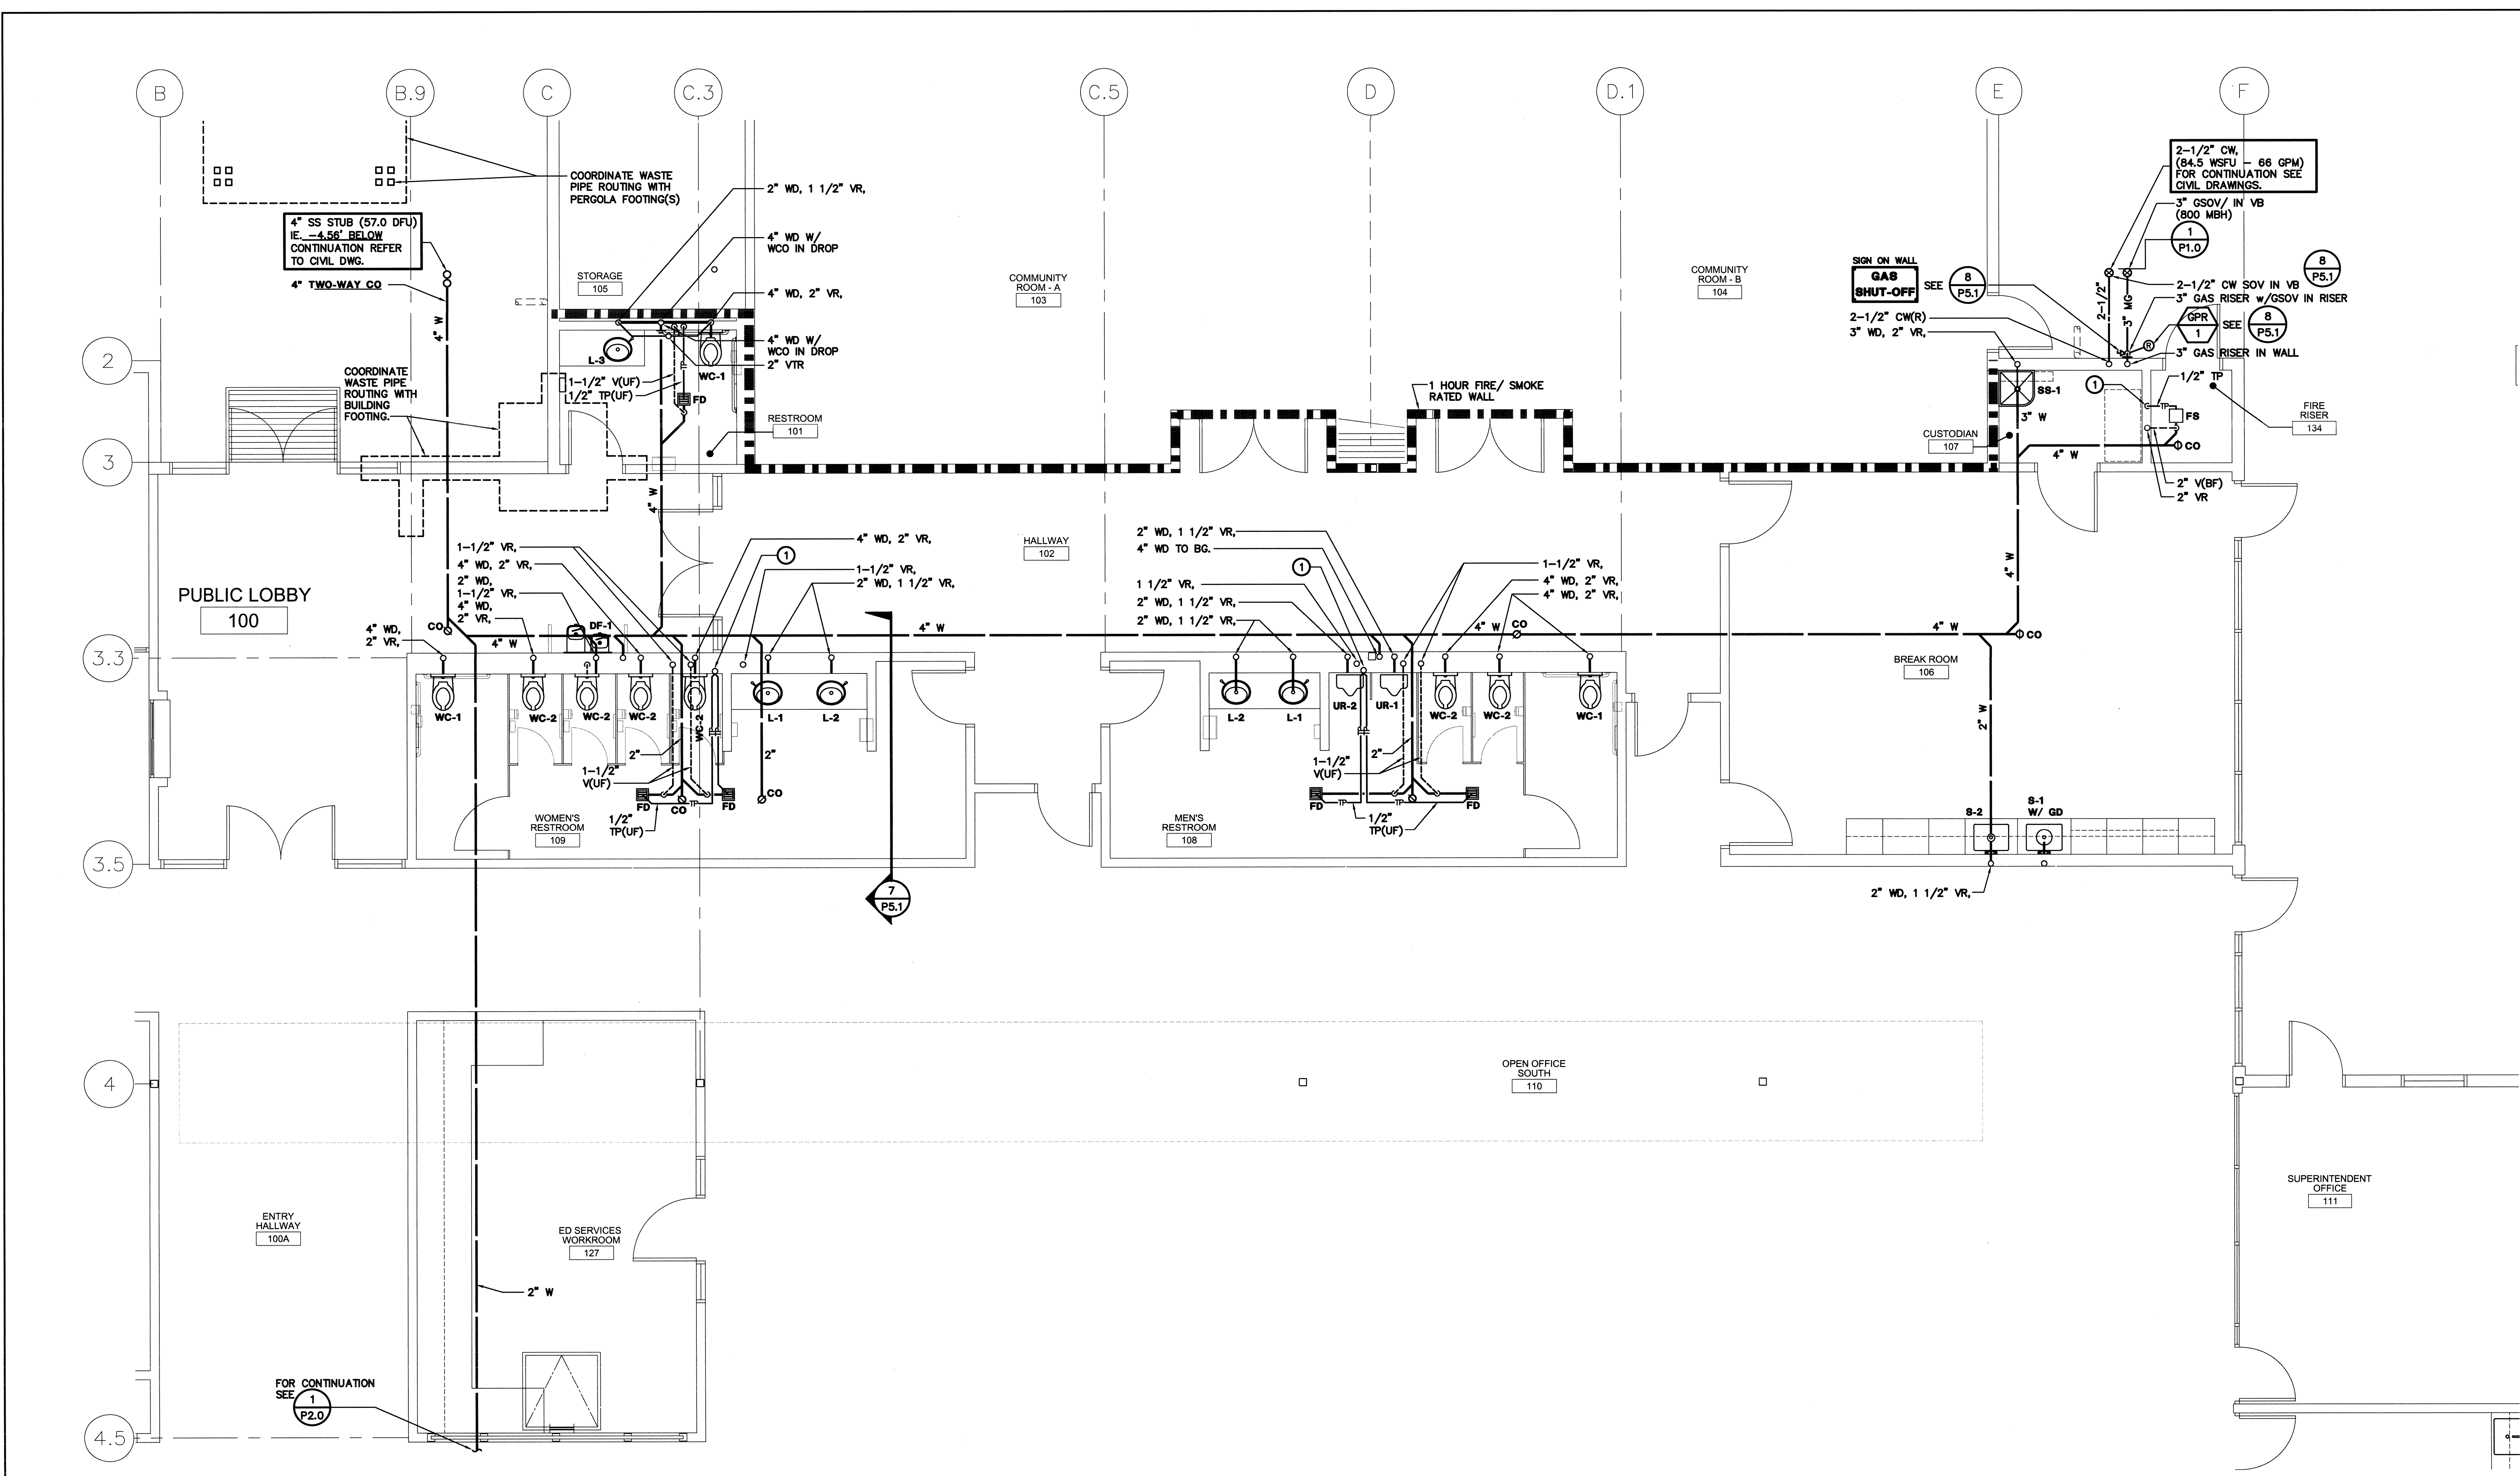

PLUMBING PARTIAL BELOW FLOOR PIPING PLAN
SCALE : 1/4"=1'-0"
1
P2.1

GENERAL NOTES

1. NOT ALL BUILDING FOOTINGS ARE SHOWN. FOR FOOTINGS SEE STRUCTURAL DRAWINGS.
2. NOT ALL PERGOLA FOOTINGS ARE SHOWN. FOR FOOTINGS SEE ARCHITECTURAL AND STRUCTURAL DRAWINGS.

SHEET NOTES

- ① 3/4" CW(D) TO TP, 1/2"(D) TO (B.G.)/FD

**Dry Creek Joint Elementary School District
District Education Center**

8849 Cook Riolo Road, Roseville, CA 95747
Dry Creek Joint Elementary School District

FILE NO. 31-15
IDENTIFICATION STAMP DIV. OF THE
STATE ARCHITECT OFFICE OF
REGULATION SERVICES
APPLICATION NO.
02-115496
AC. TM. FLS. DATE SS. *[Signature]*
DATE *2/23/17* *CEAS*

DIVISION OF THE STATE ARCHITECT
revision date: _____ by: _____

REGISTERED PROFESSIONAL ENGINEER
M 22836
EXPIRES 9/30/19
RESIDENCE
STATE OF CALIFORNIA
DATE SIGNED: 2/15/2017

**CAPITAL ENGINEERING
CONSULTANTS, INC.**
RANCHO CONDOVA, CALIFORNIA
FL. 15010.00
PM - DESIGN TEAM PROJECT NO.

CONSULTANT

nacht&lewis
600 Q Street, Suite 100
Sacramento, CA 95811
www.nachtandlewis.com
916.929.4000

REGISTERED ARCHITECT
No. C-158687
RENEWAL DATE:
1/31/19
STATE OF CALIFORNIA

ARCHITECT

INITIAL BOX			
NO.	DWG BY	DATE	REVIEWED


REVISIONS			
NO.	DESCRIPTION	DATE	REV'D

DATE February 23, 2017
JOB NO. Y1538.00
SHEET TITLE

Plumbing
Partial Below Floor
Piping Plan

SHEET NO.
P2.1
SHEET ____ OF ____ TOTAL

ONE AND ONE-HALF INCH = ONE FOOT
THREE-QUARTERS INCH = ONE FOOT
ONE-HALF INCH = ONE FOOT
ONE-QUARTER INCH = ONE FOOT
ONE-EIGHTH INCH = ONE FOOT
ONE-SIXTEENTH INCH = ONE FOOT
ONE INCH = TWENTY FEET

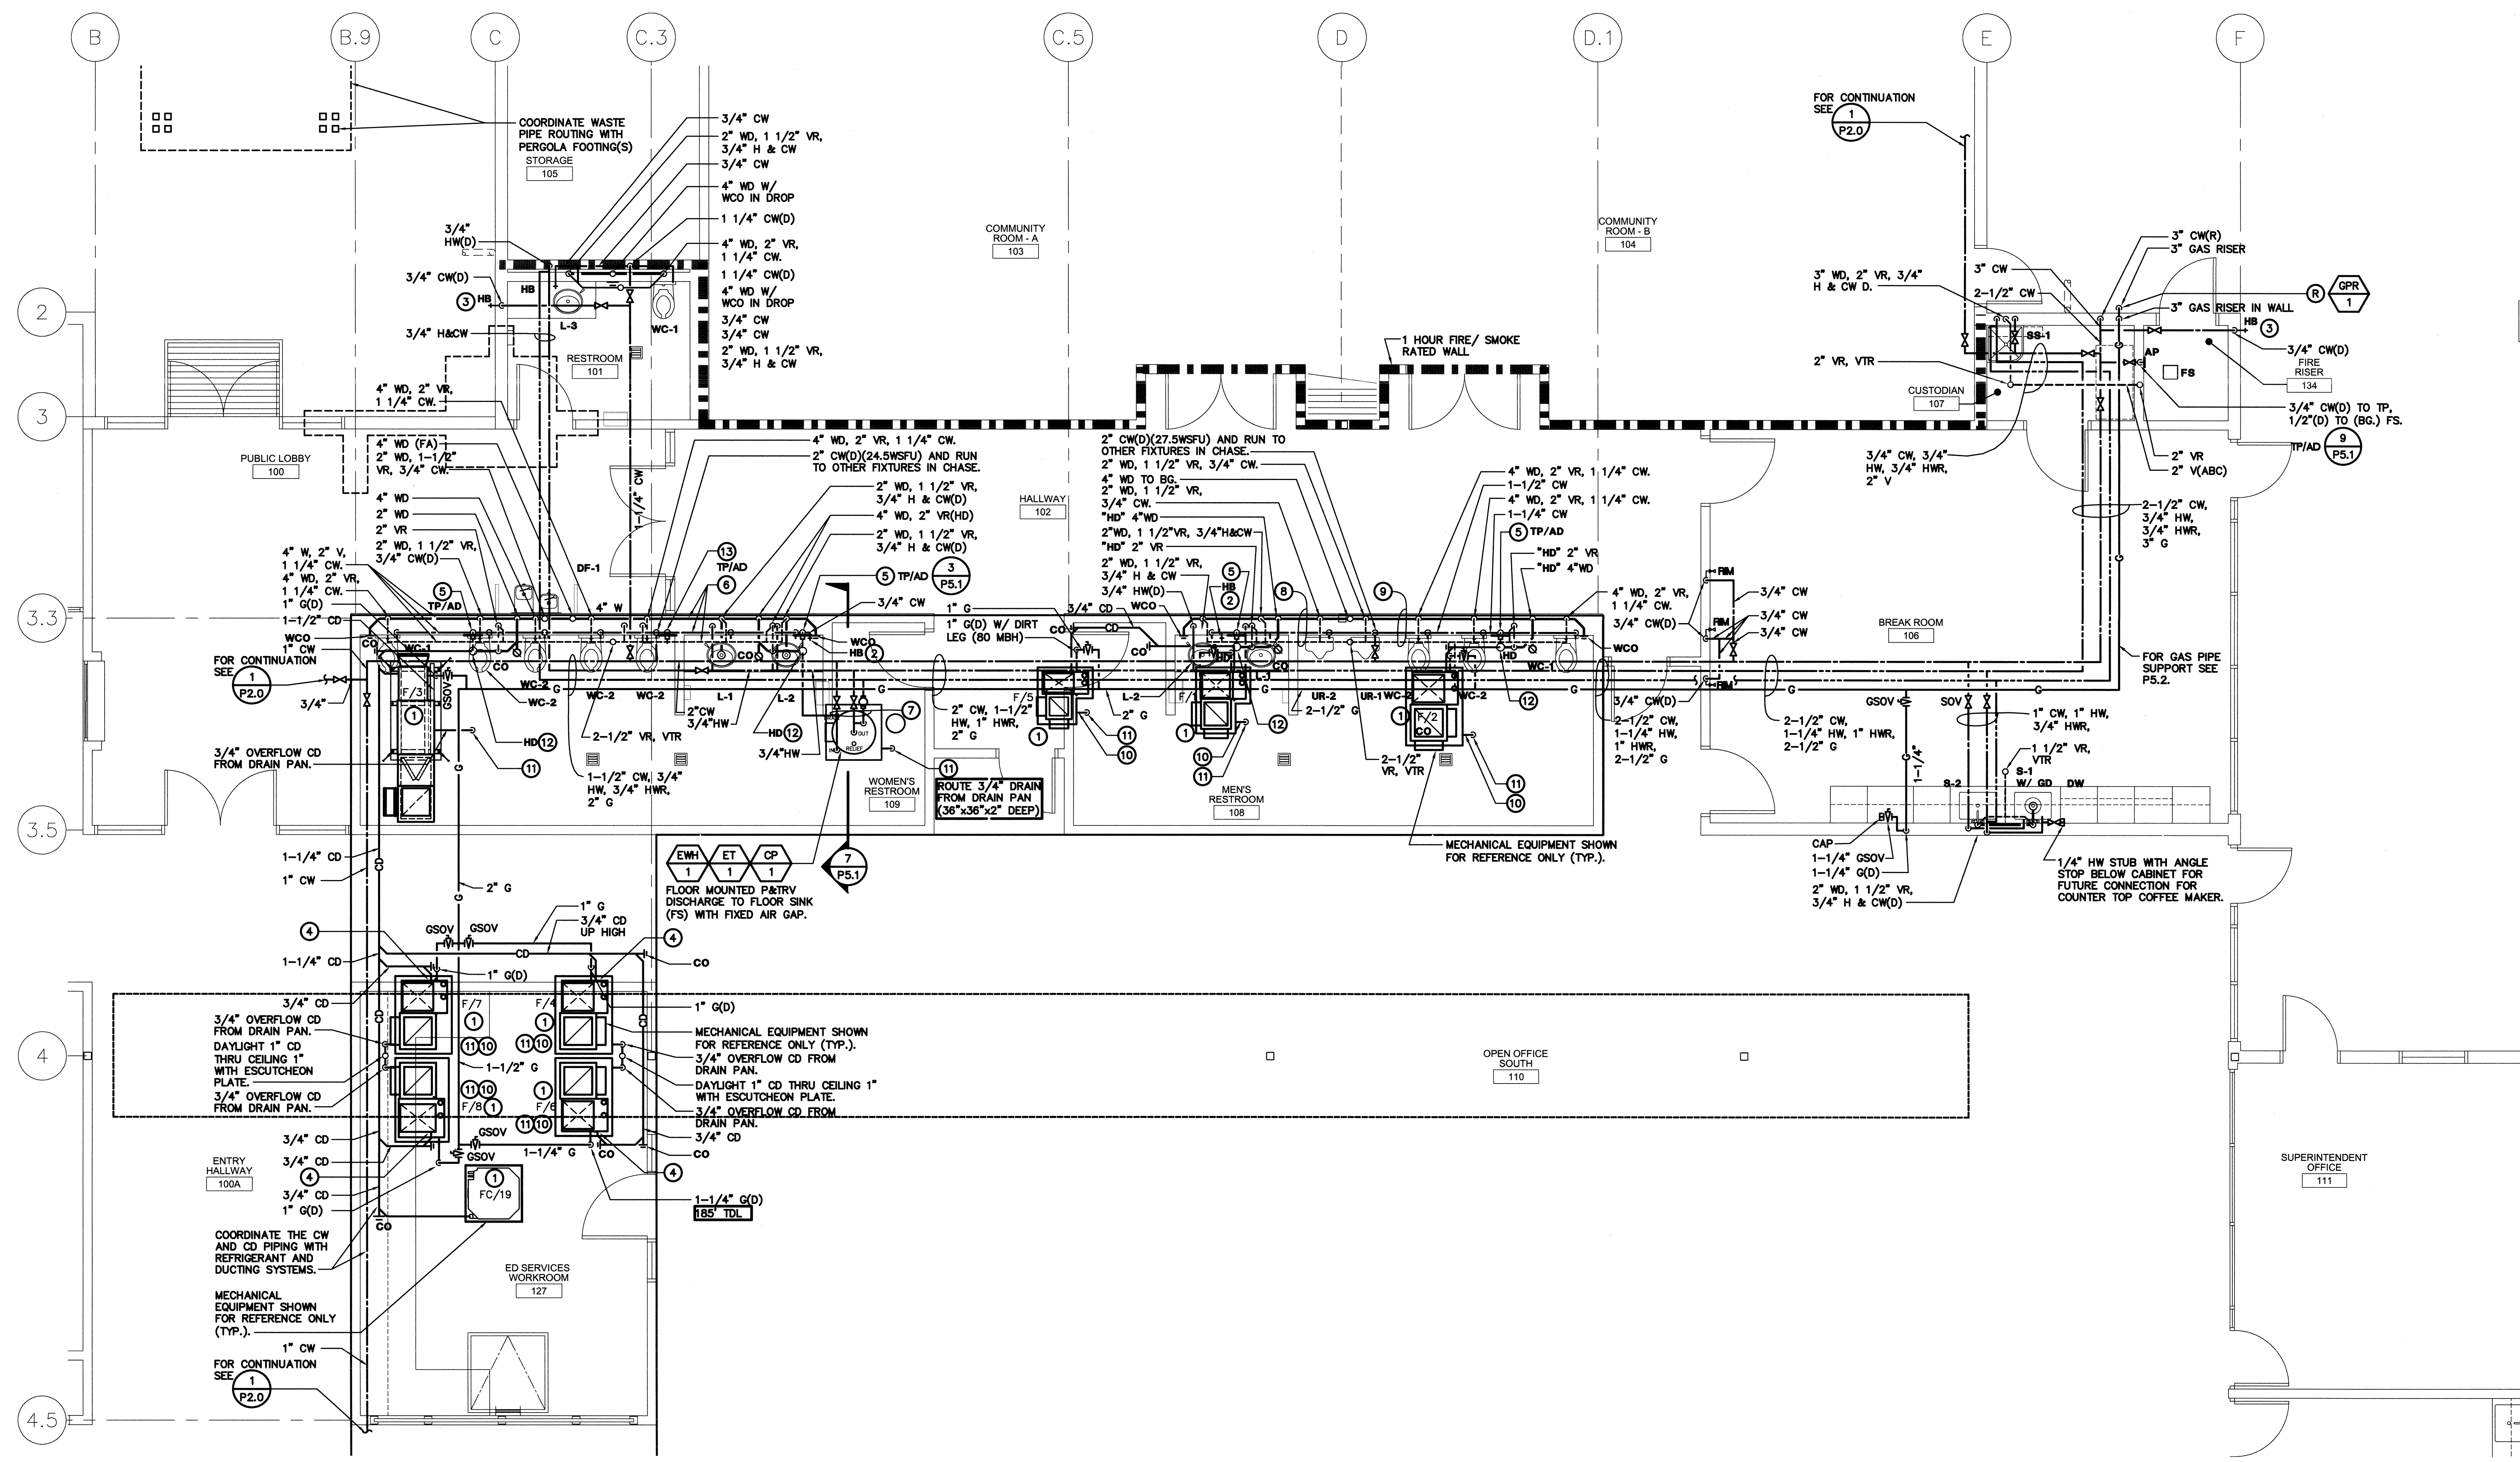

PLUMBING PARTIAL MECHANICAL ATTIC PLAN

SCALE : 1/4"=1'-0"

1
P2.2

GENERAL NOTES

- NOT ALL BUILDING FOOTINGS ARE SHOWN. FOR FOOTINGS SEE STRUCTURAL DRAWINGS.
- NOT ALL PERGOLA FOOTINGS ARE SHOWN. FOR FOOTINGS SEE ARCHITECTURAL AND STRUCTURAL DRAWINGS.
- PROVIDE LINE SIZE SHUT OFF VALVE (SOV) AT ALL BRANCH TAKE-OFFS.
- PROVIDE ALL CONDENSATE DRAINS FROM EQUIPMENT WITH LINE SIZE DIRT LEG.
- PROVIDE ALL GAS CONNECTION TO EQUIPMENT WITH LINE SIZE DIRT LEG.
- ALL CONDENSATE DRAINS SPILLING TO FLOOR SINK (FS) TO SPILL TO FS WITH FIXED AIR GAP.

SHEET NOTES

- PROVIDE LINE SIZE CD AND HEAT EXCHANGER CD LINE(S) WITH CLEANOUT AND P-TRAP AT UNIT AND SPILL TO HOPPER DRAIN.
- 3/4" CW LINE (D) AND TERMINATE WITH A HOSE BIBB (HB) AT +12" ABOVE FINISHED FLOOR.
- 3/4" CW LINE (D) AND TERMINATE WITH A HOSE BIBB (HB) AT +12" ABOVE FINISHED GRADE.
- ROUTE (3) FULL SIZE CD LINES FROM FURNACE AND FURNACE COIL TO A SINGLE PUMP. TAKE CD LINE THRU TO UNDERSIDE OF ROOF BETWEEN THE JOISTS.
- TP/AD 3/4" CW(D) TO TP, 1/2"(D) TO (BG.)/FD AND 1/2"(D) TO HD IN ATTIC.
- 2" W, 1-1/2" V, 1" CW
- 2" CW, 1-1/2" HW, 1" HWR
- 2" WD, 1-1/2" V, 3/4" CW
- 4" WD, 2" V, 1-1/2" CW
- 3/4" OVERFLOW D FROM DRAIN PAN. DRAIN PAN SHALL EXTEND 2" ALL AROUND THE FOOT PRINT OF THE FURNACES MIXED AIR PLENUM AND FILTER BOX FOOT PRINT.
- DAYLIGHT 3/4" CD THRU CEILING 1" WITH ESCUTCHEON PLATE.
- SPILL DRAIN(S) TO HD (IN ATTIC) WITH FIXED AIR GAP & TP. OFFSET WASTE TO WALL AND DROP.
- TP/AD 3/4" CW(D) TO TP, 1/2"(D) TO (BG.)/FD

Dry Creek Joint Elementary School District
District Education Center
8849 Cook Riolo Road, Roseville, CA 95747
Dry Creek Joint Elementary School District

FILE NO. 31-15
IDENTIFICATION STAMP DIV. OF THE
STATE ARCHITECT OFFICE OF
REGULATION SERVICES
APPLICATION NO.
02-115486
AC TLM FLS JMS SS
DATE 2/23/17 CEA

DIVISION OF THE STATE ARCHITECT
revision date: by:

REGISTERED PROFESSIONAL ENGINEER
N 22836
EXPIRES 1/30/19
STATE OF CALIFORNIA
DATE SIGNED: 2/15/2017

CAPITAL ENGINEERING
CONSULTANTS, INC.
RANCHO CORDOVA, CALIFORNIA
FL 8010.00
PM - DESIGN TEAM PROJECT NO.

CONSULTANT

nacht&lewis
600 Q Street, Suite 100
Sacramento, CA 95811
www.nachtandlewis.com
916.329.4000

REGISTERED ARCHITECT
No. C-28867
RENEWAL DATE: 1/31/18
STATE OF CALIFORNIA

ARCHITECT

INITIAL BOX			
NO.	DWG BY	DATE	REVIEWED

REVISIONS			
NO.	DESCRIPTION	DATE	REV'D

DATE February 23, 2017
JOB NO. Y1538.00


SHEET TITLE

Plumbing
Partial Mechanical
Attic Plan

SHEET NO.

P2.2

SHEET ____ OF ____ TOTAL

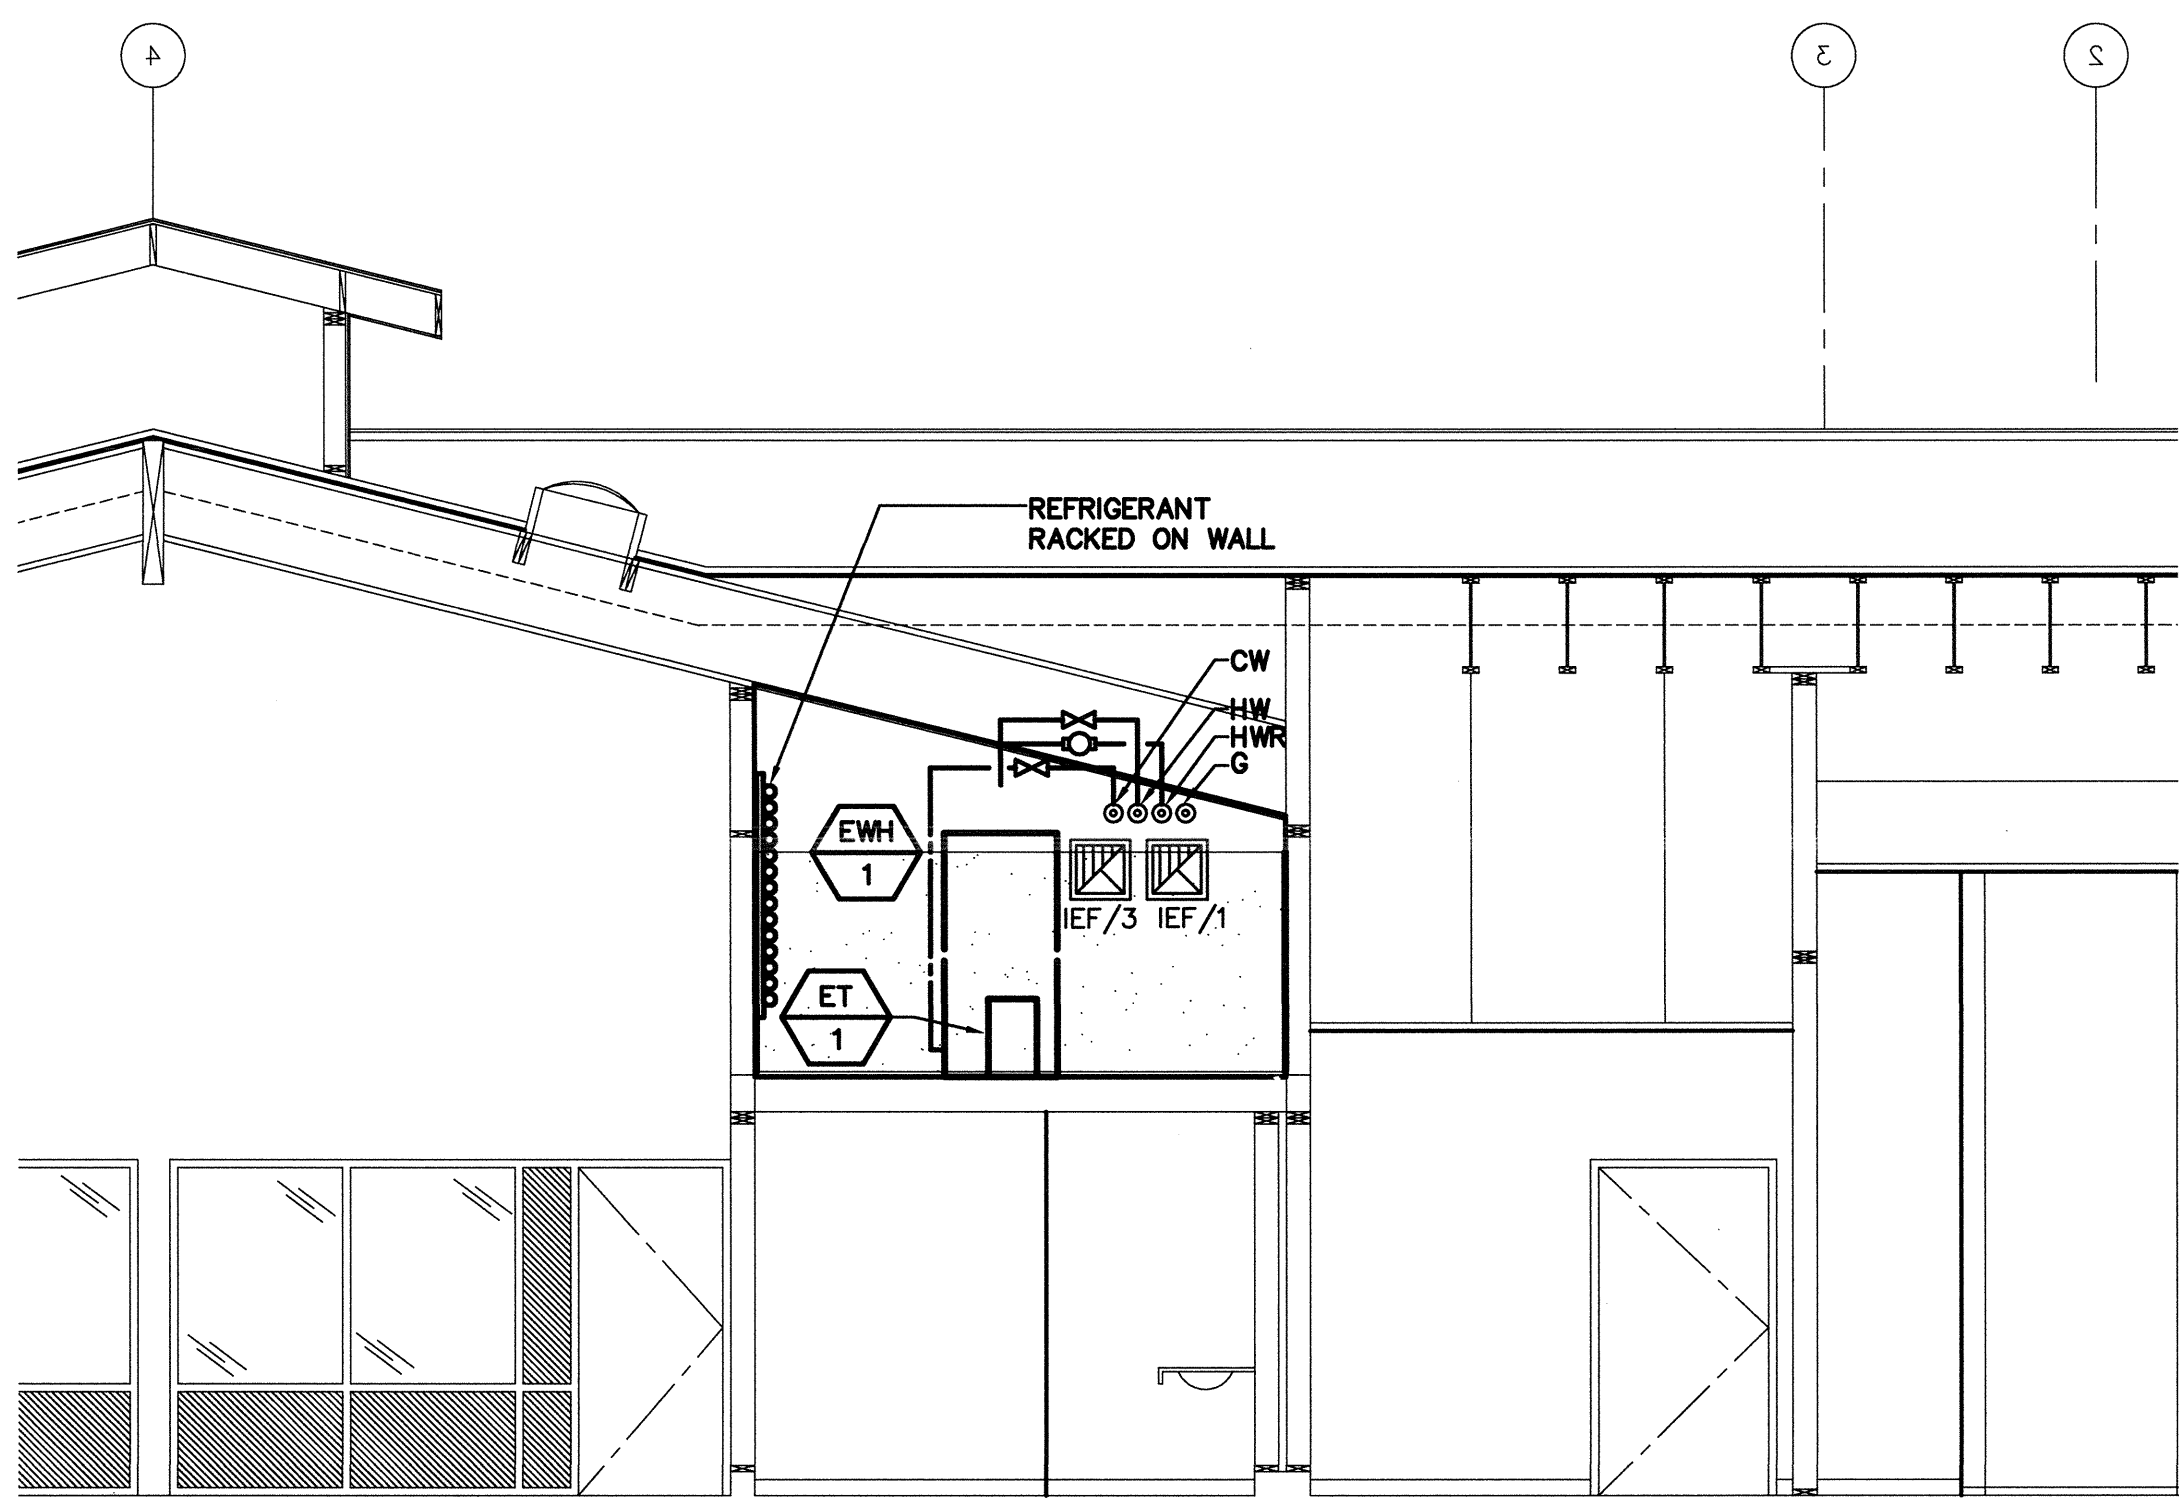


PLUMBING SECTION

SCALE : 1/4"=1'-0"

(SECTION EAST TO WEST, LOOKING NORTH)


7
P5.1

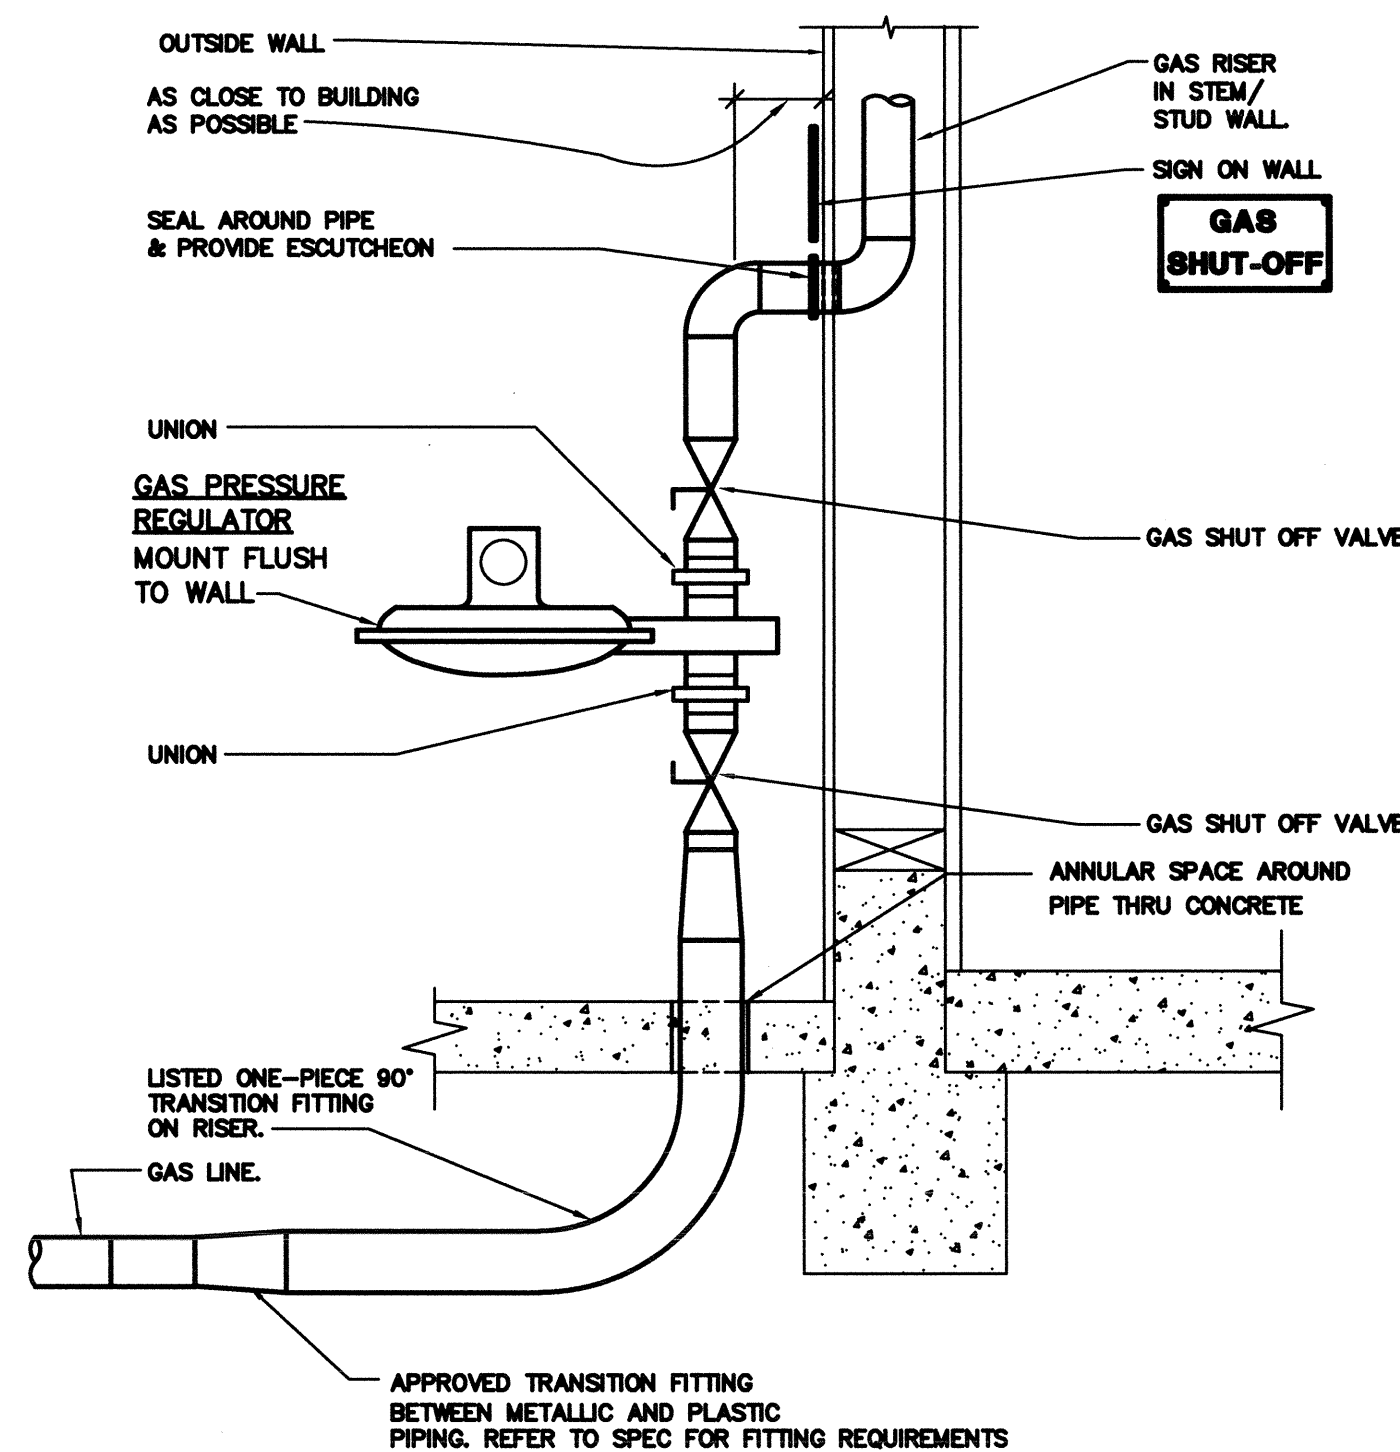

GAS PIPING

SCALE : NONE


8
P5.1

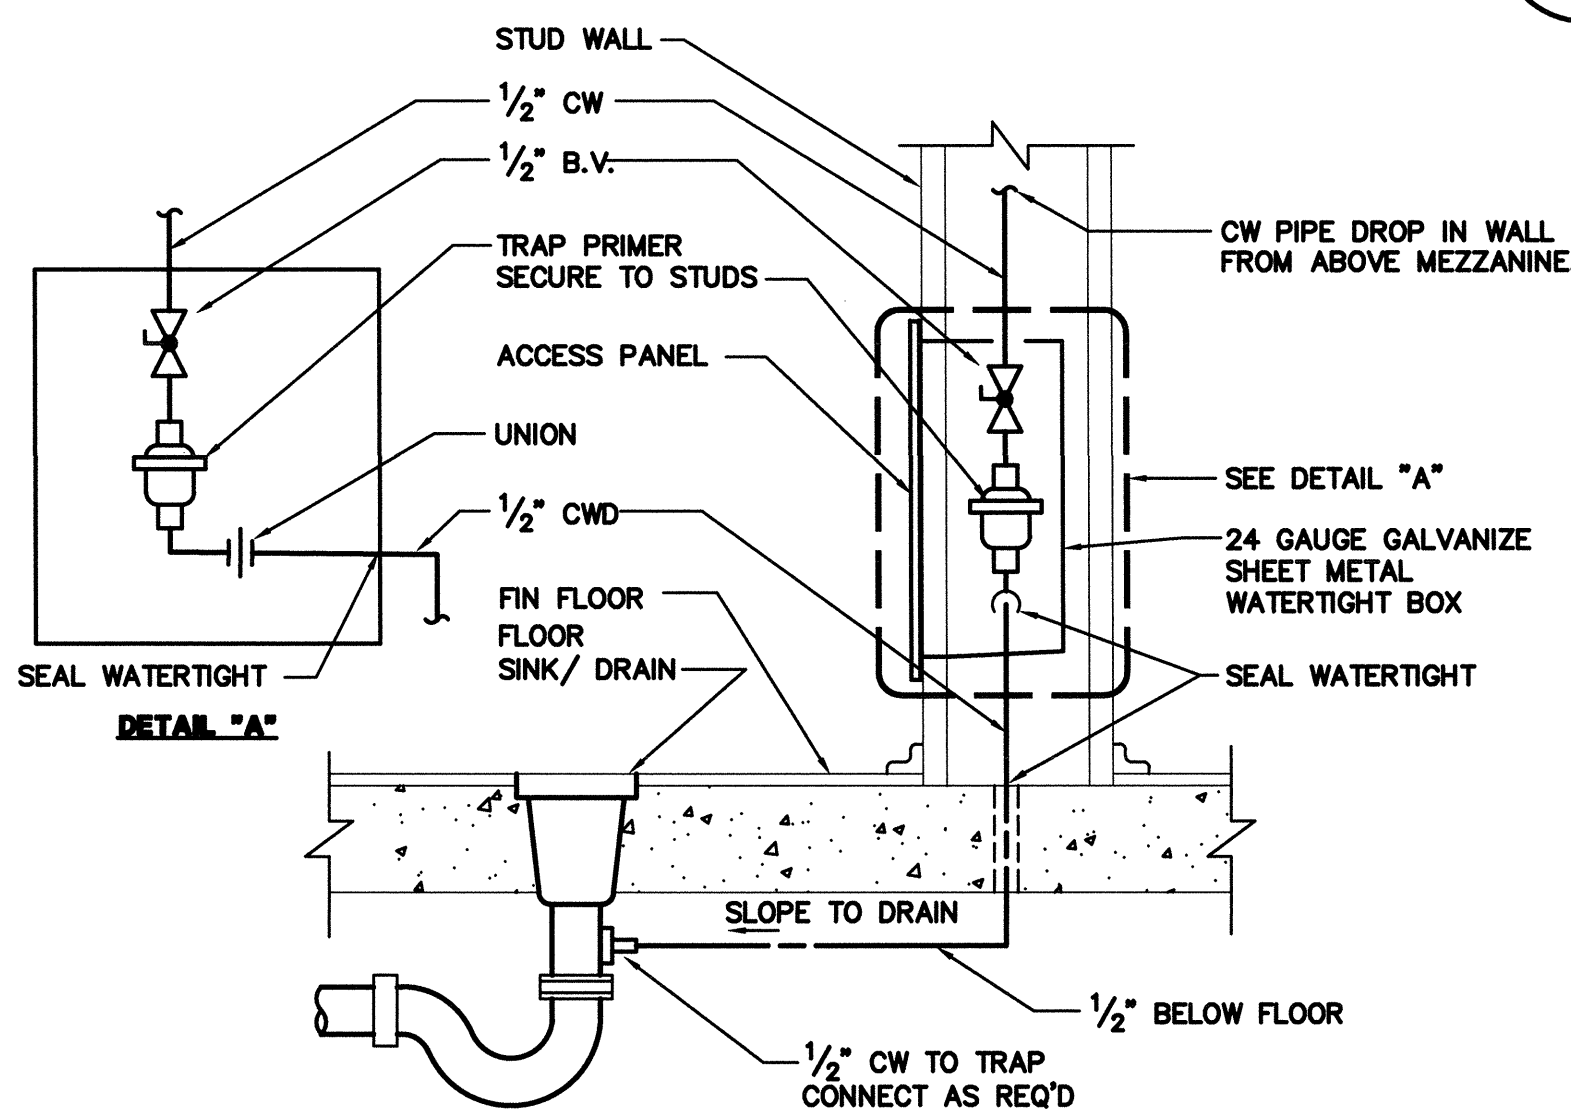

TRAP PRIMER TO FLOOR DRAIN

SCALE : NONE


9
P5.1

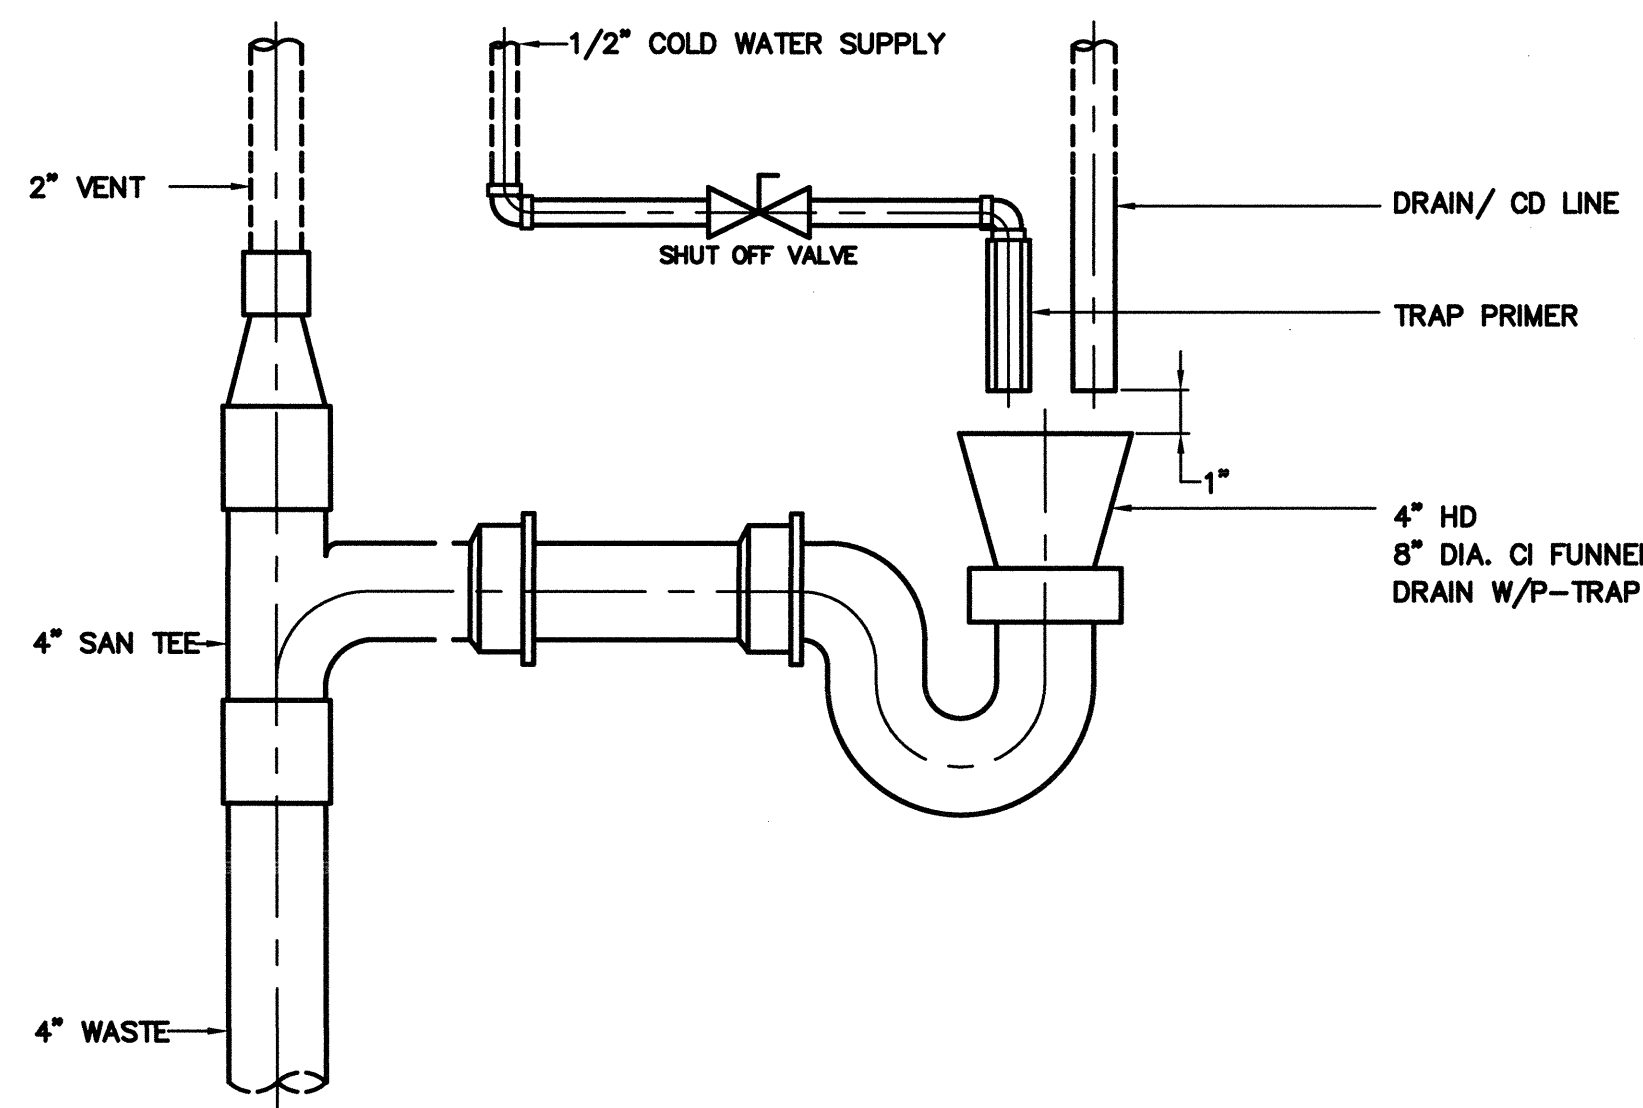

WALL HOPPER DRAIN

SCALE : NONE


4
P5.1

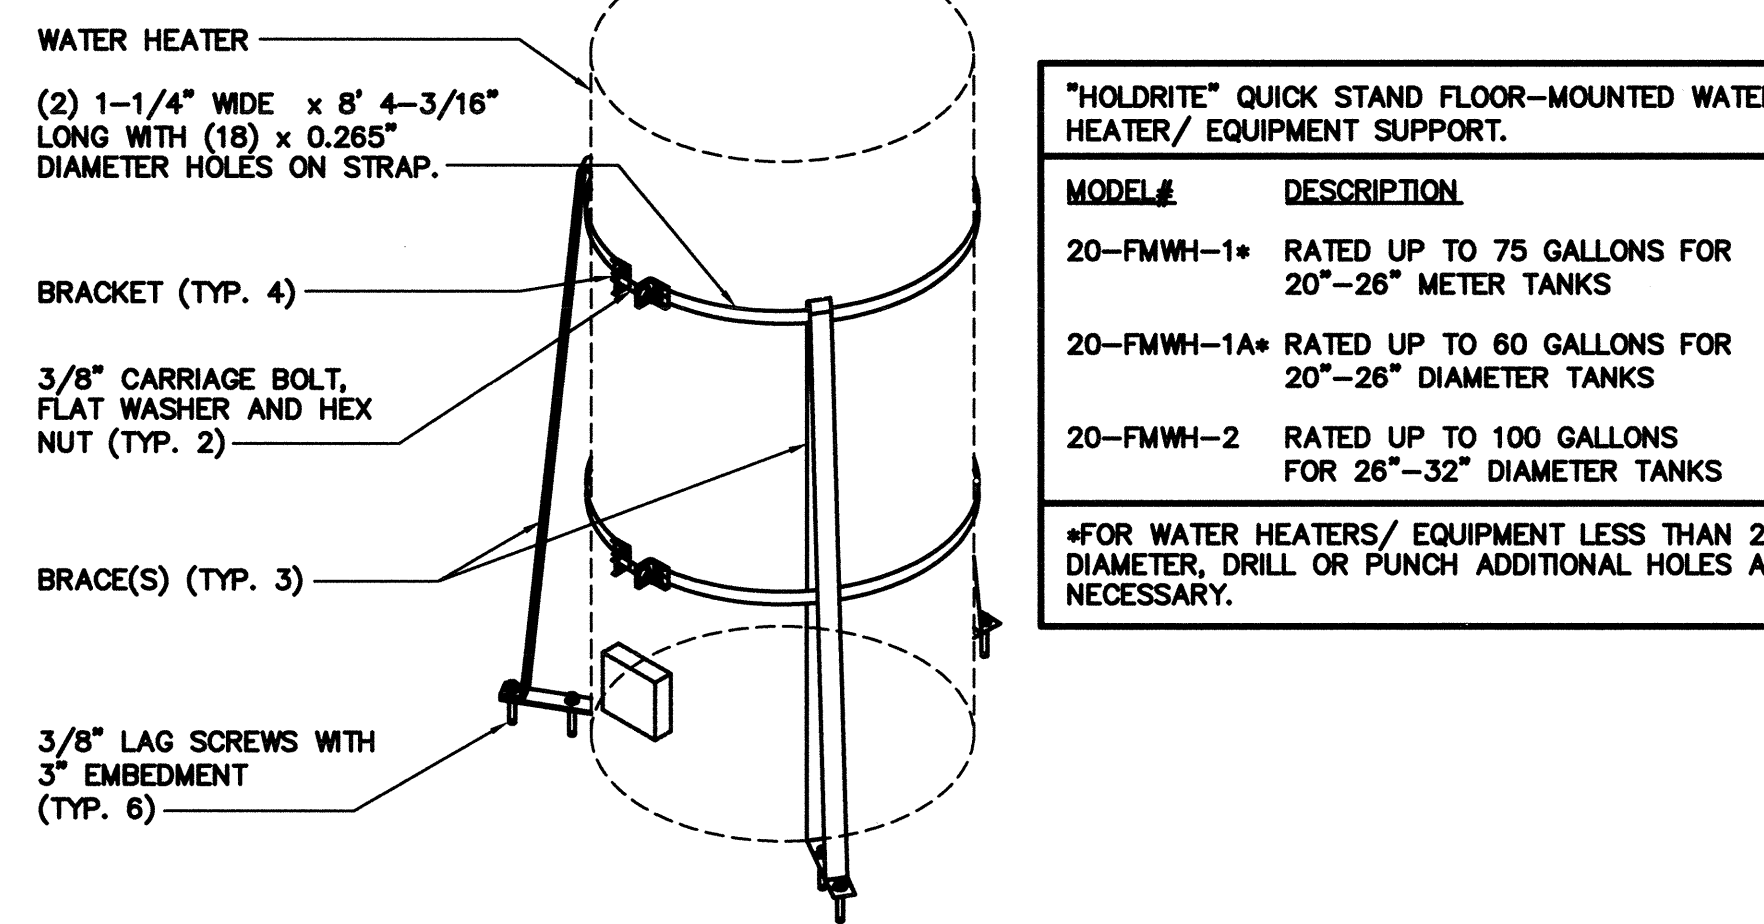

FREE STANDING WATER HEATER SUPPORT

SCALE : NONE


5
P5.1

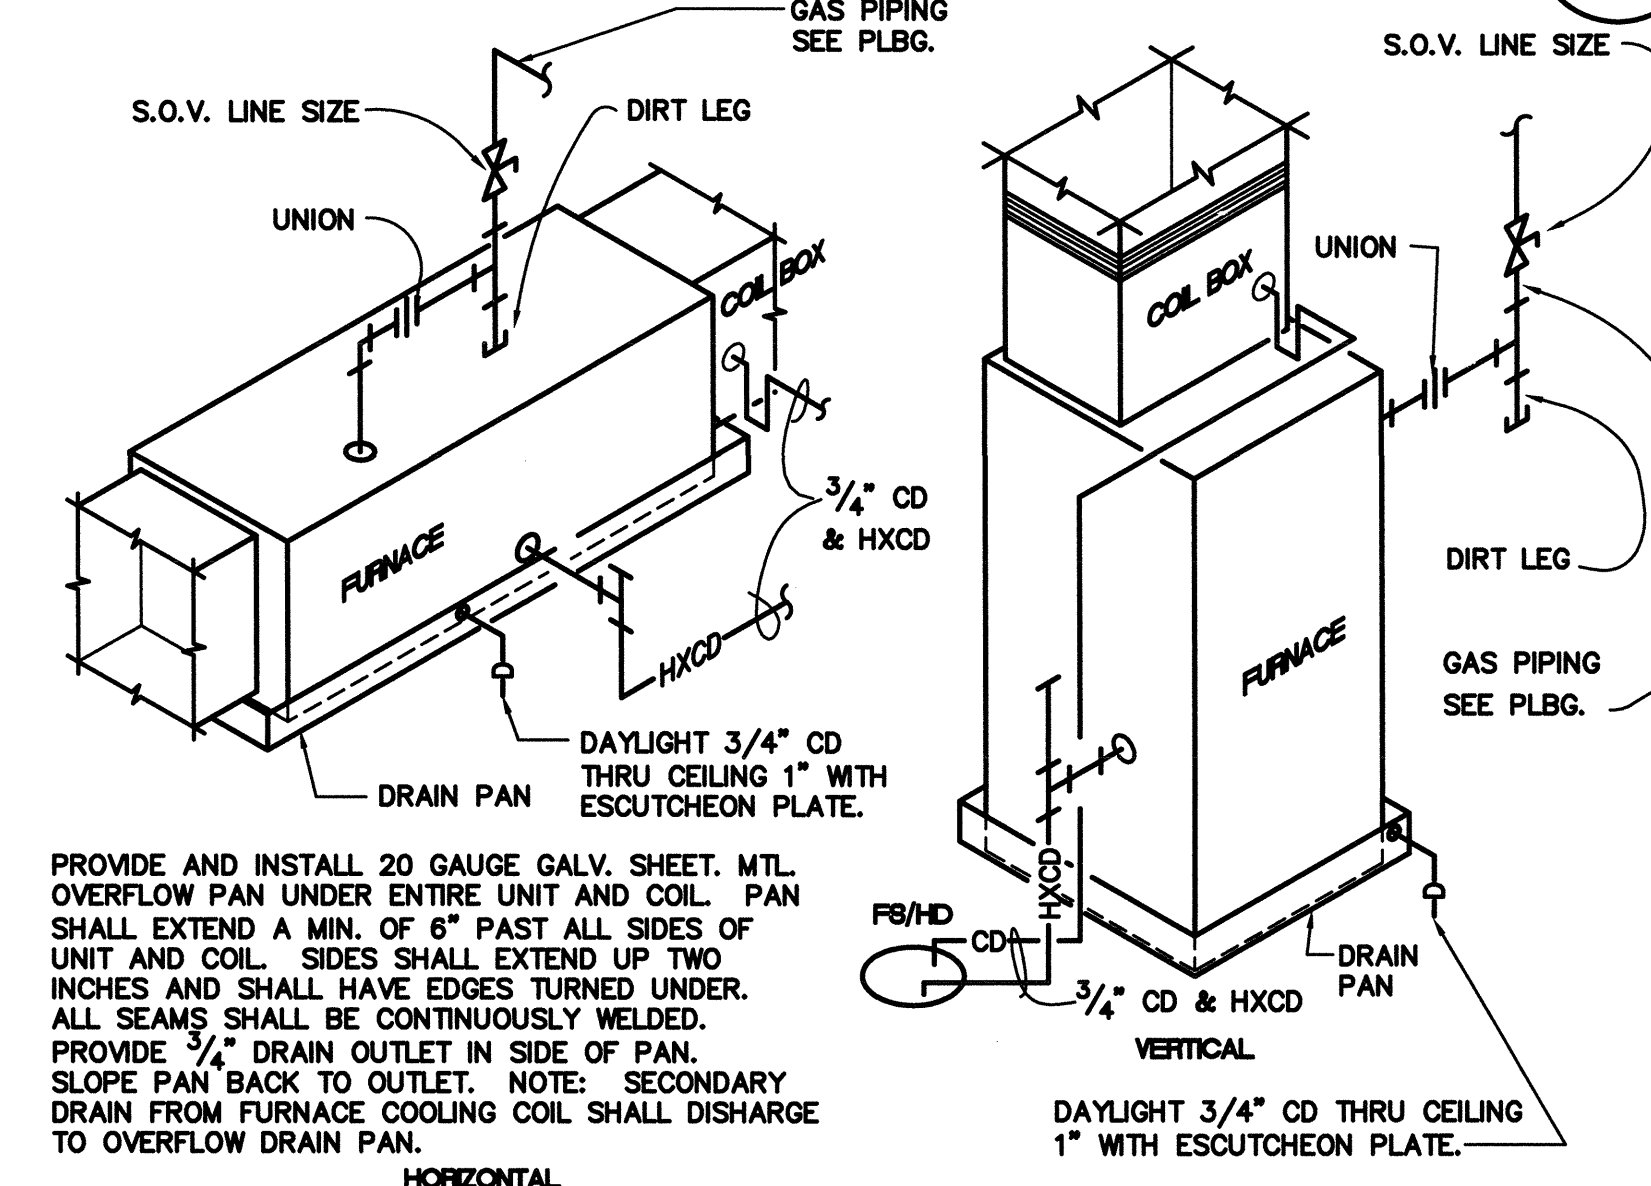

FURNACE PIPING

SCALE : NONE

6
P5.1

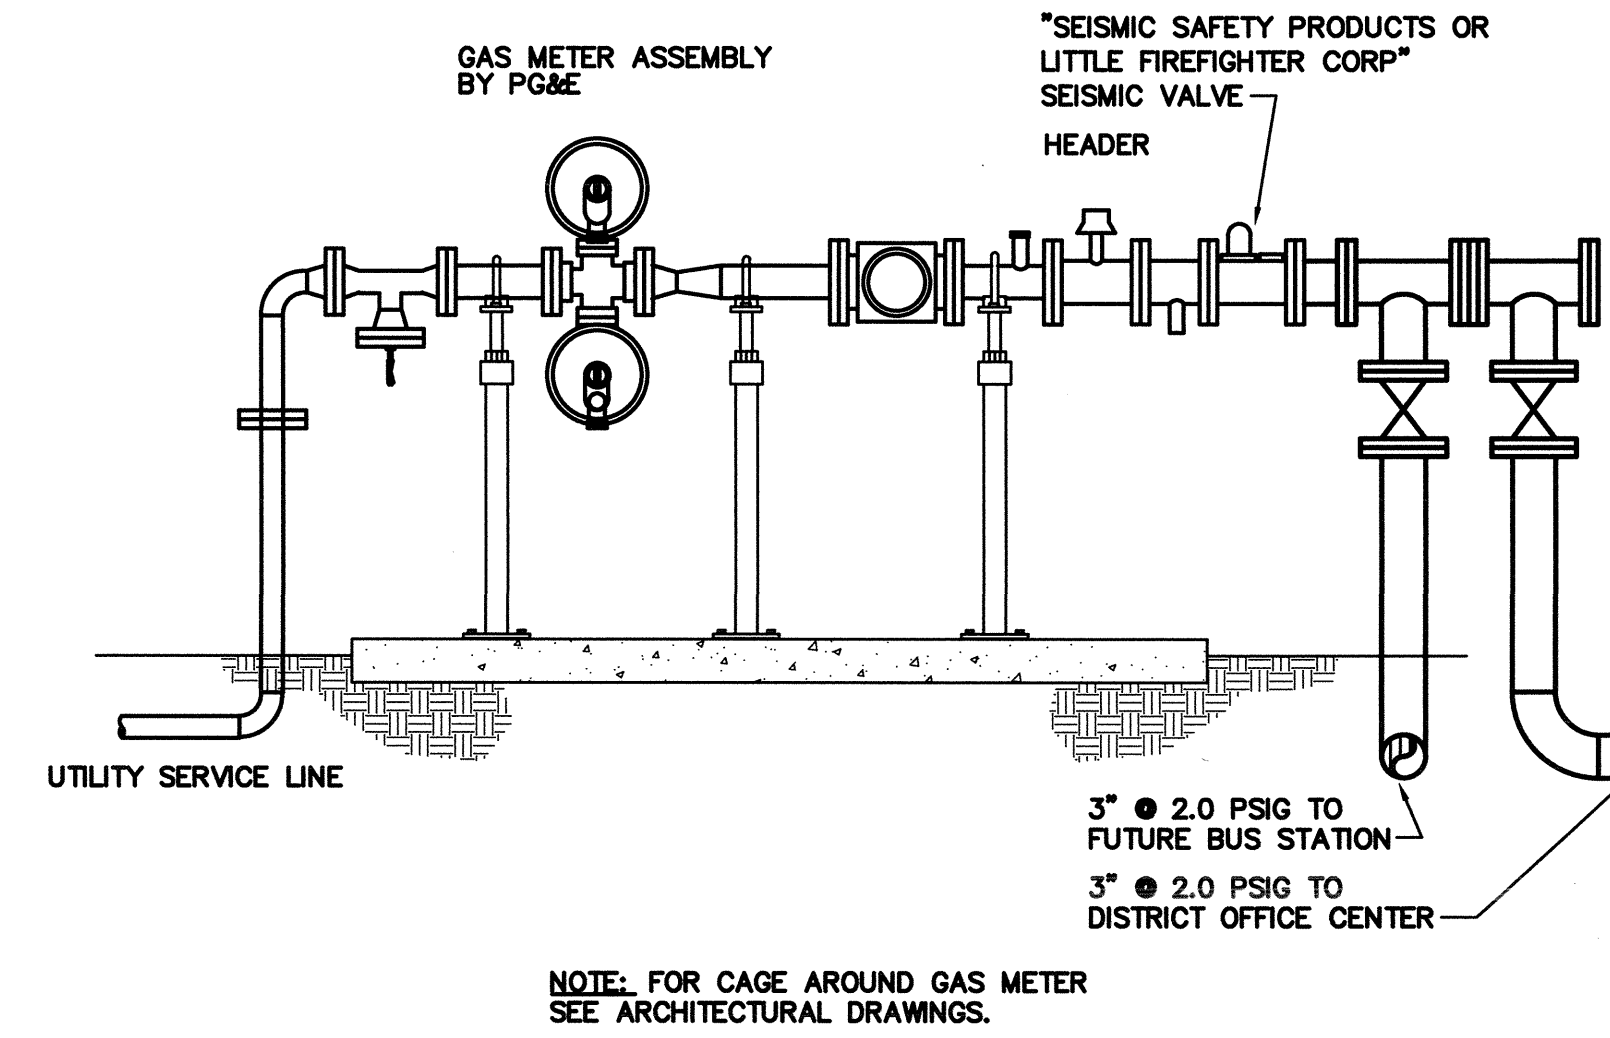


5m or 7M Rotary Gas Meter

GAS PIPING AT METER

SCALE : NONE


1
P5.1

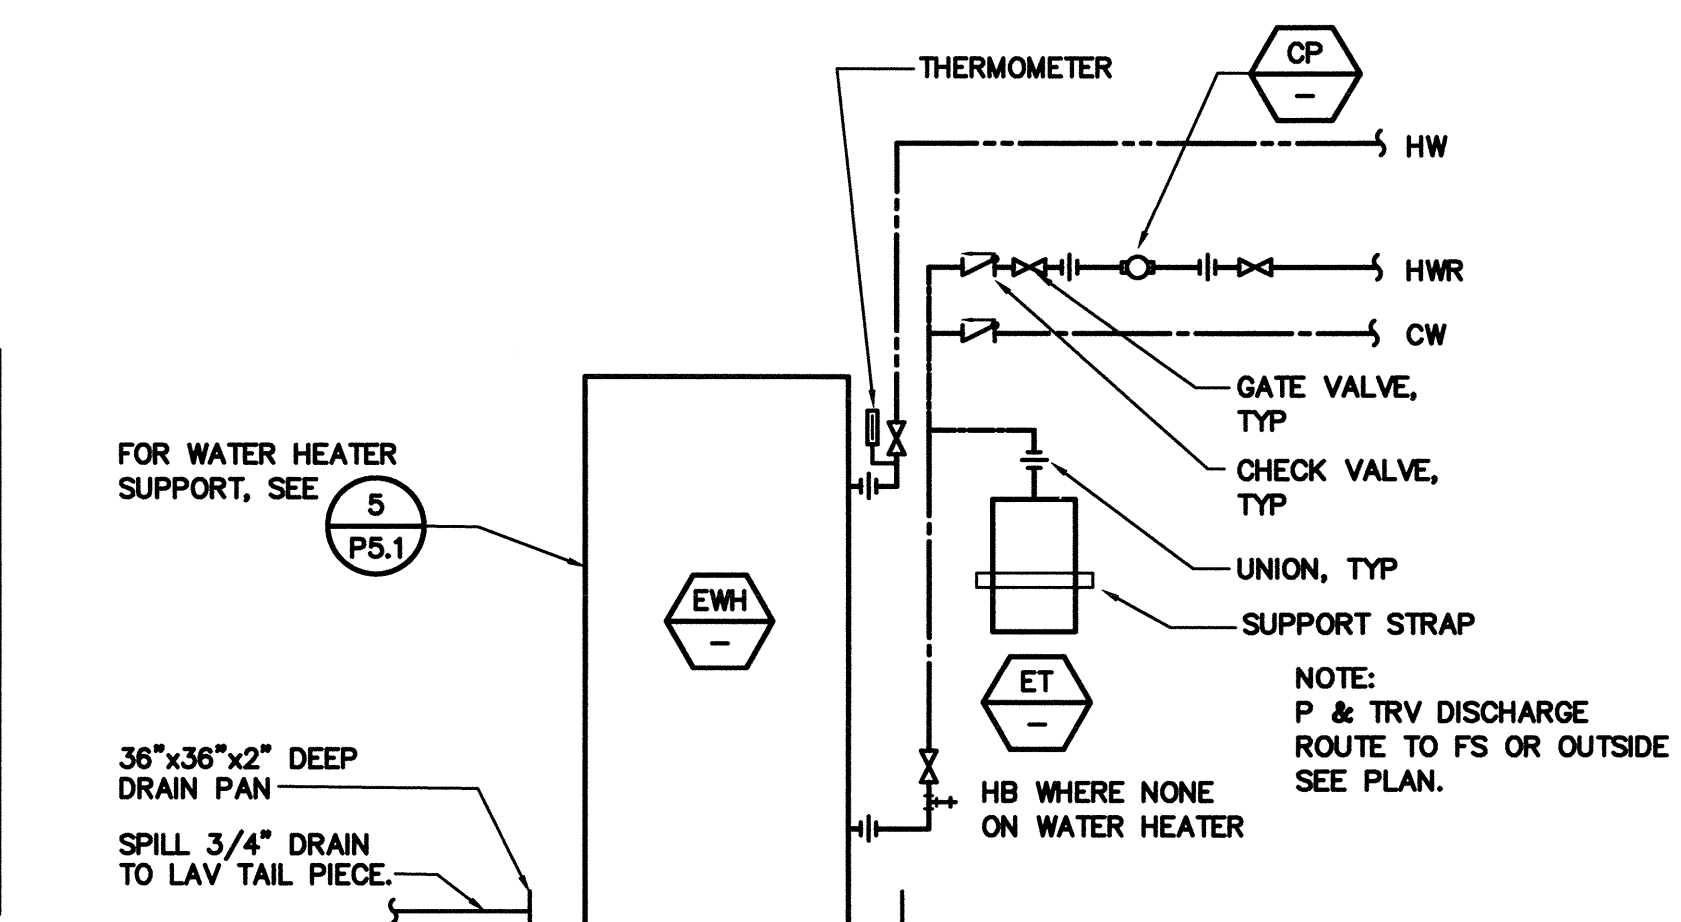

ELECTRIC WATER HEATER PIPING

SCALE : NONE

2
P5.1

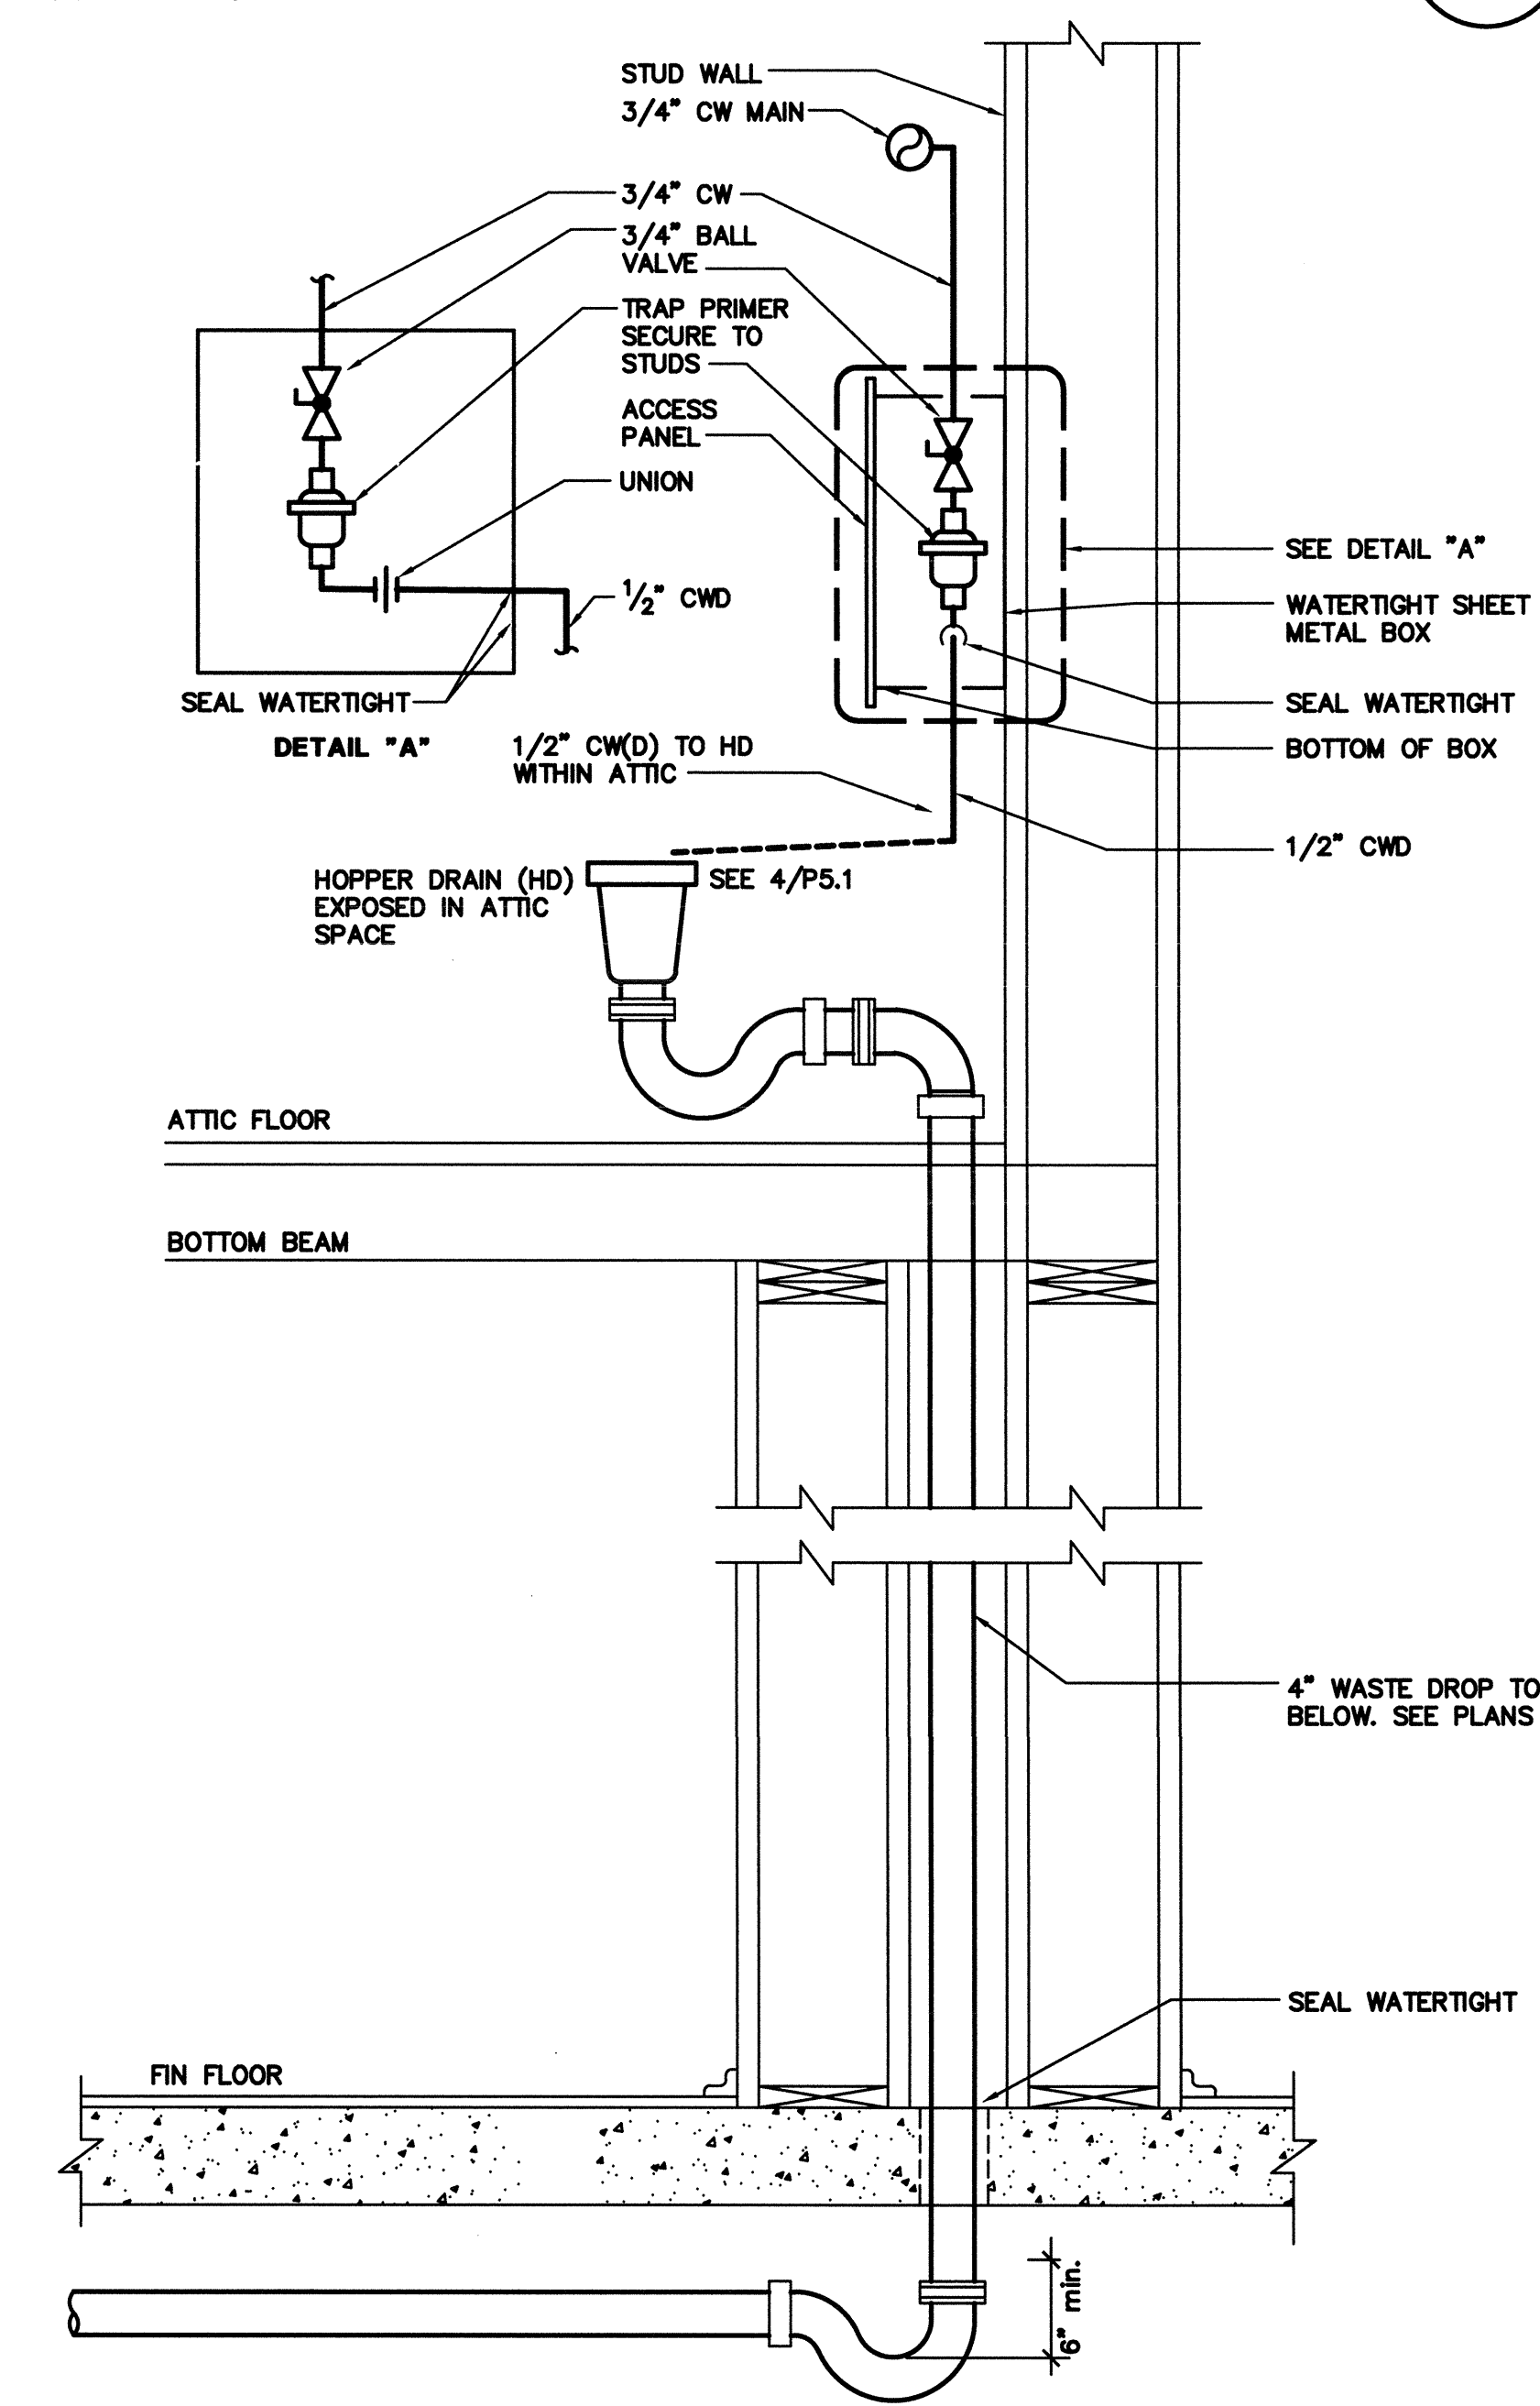

TRAP PRIMER TO HOPPER DRAIN

SCALE : NONE

3
P5.1

Dry Creek Joint Elementary School District
District Education Center

8849 Cook Riolo Road, Roseville, CA 95747

Dry Creek Joint Elementary School District

FILE NO. 31-15
IDENTIFICATION STAMP DIV. OF THE
STATE ARCHITECT OFFICE OF
REGULATION SERVICES
APPLICATION NO.
02-115496
AC. TM. FLS. KMS. SS. EJP
DATE 2/23/17 CEAE


DIVISION OF THE STATE ARCHITECT
revision date: by:



CAPITAL ENGINEERING
CONSULTANTS, INC.
RANCHO CORDOVA, CALIFORNIA
PL - DESIGN TEAM 18010.00
PROJECT NO.

CONSULTANT

nacht&lewis
600 Q Street, Suite 100
Sacramento, CA 95811
www.nachtandlewis.com
916.329.4000

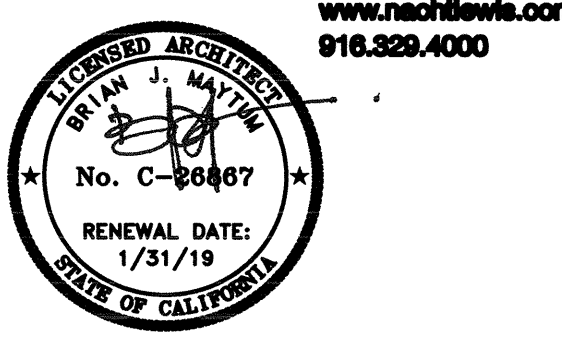

ARCHITECT

INITIAL BOX			
NO.	DWG BY	DATE	REVIEWED

REVISIONS			
NO.	DESCRIPTION	DATE	REV'D

DATE February 23, 2017

JOB NO. Y1538.00

SHEET TITLE



Plumbing
Details

SHEET NO.


P5.1

SHEET OF TOTAL






ONE AND ONE-HALF INCH = ONE FOOT
ONE INCH = ONE FOOT
THREE-QUARTERS INCH = ONE FOOT
ONE-QUARTER INCH = ONE FOOT
ONE-EIGHTH INCH = ONE FOOT
ONE-SIXTEENTH INCH = ONE FOOT
ONE INCH = TWENTY FEET

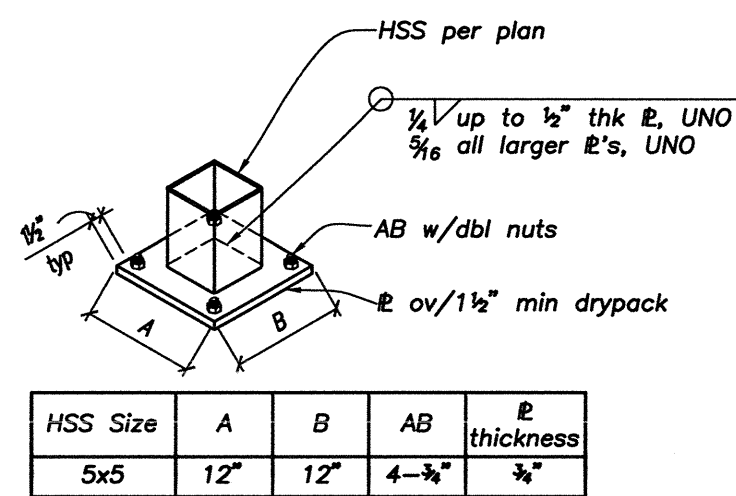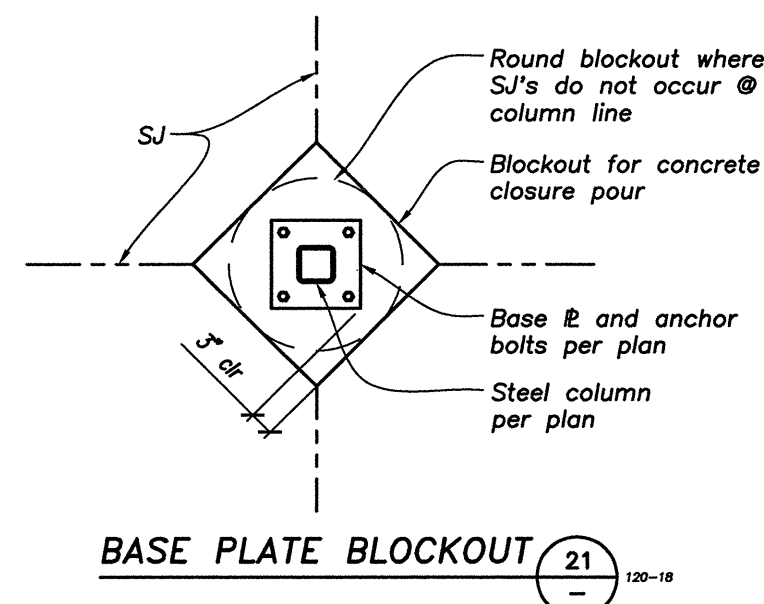

TYPICAL BASE PLATE DETAILS (22)

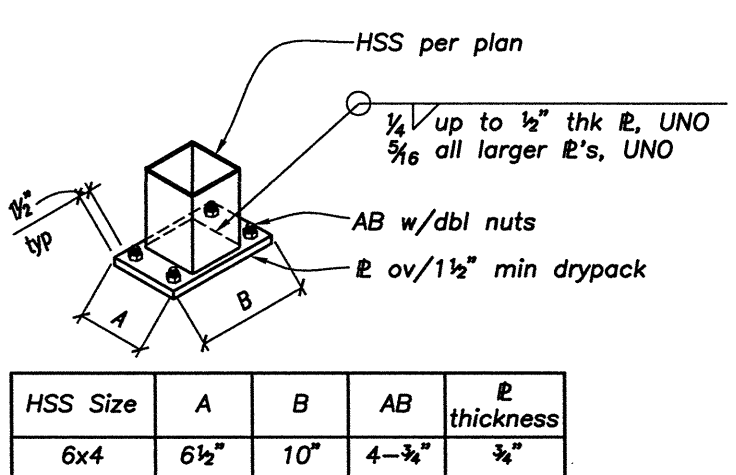


TYPICAL BASE PLATE DETAILS (23)

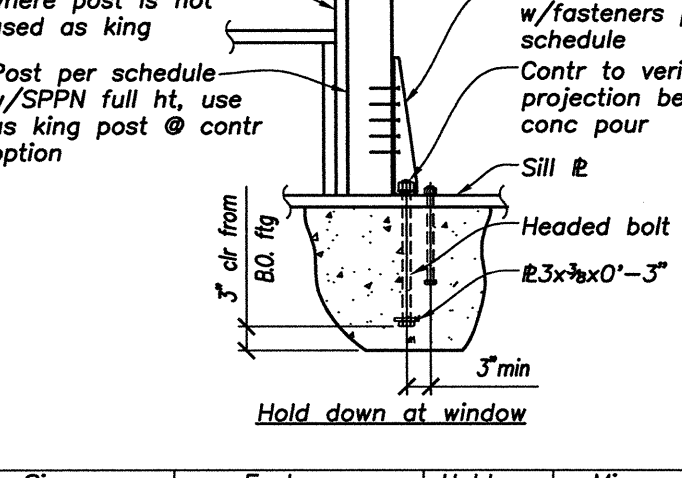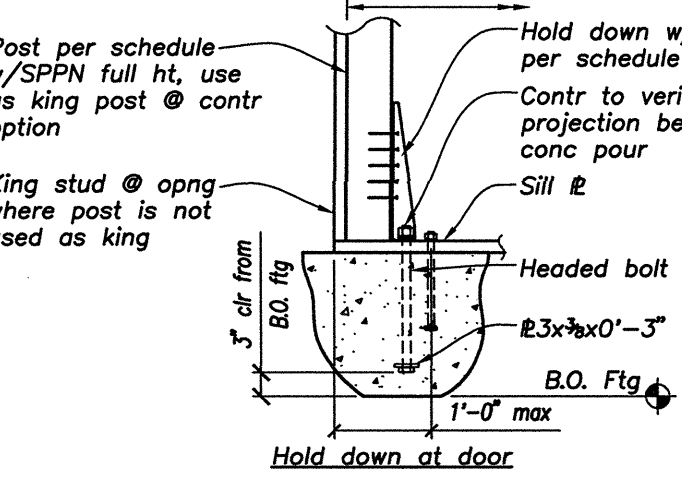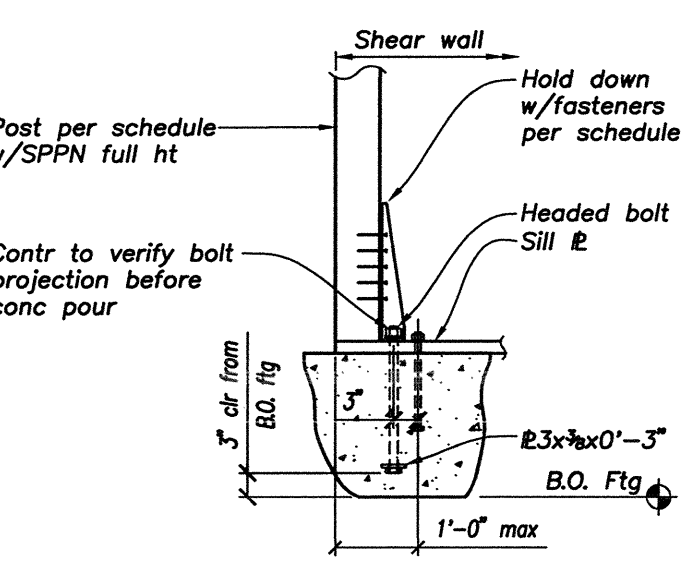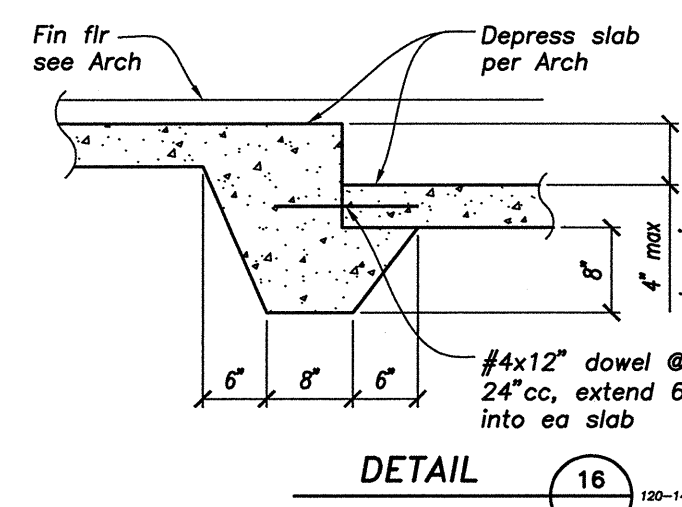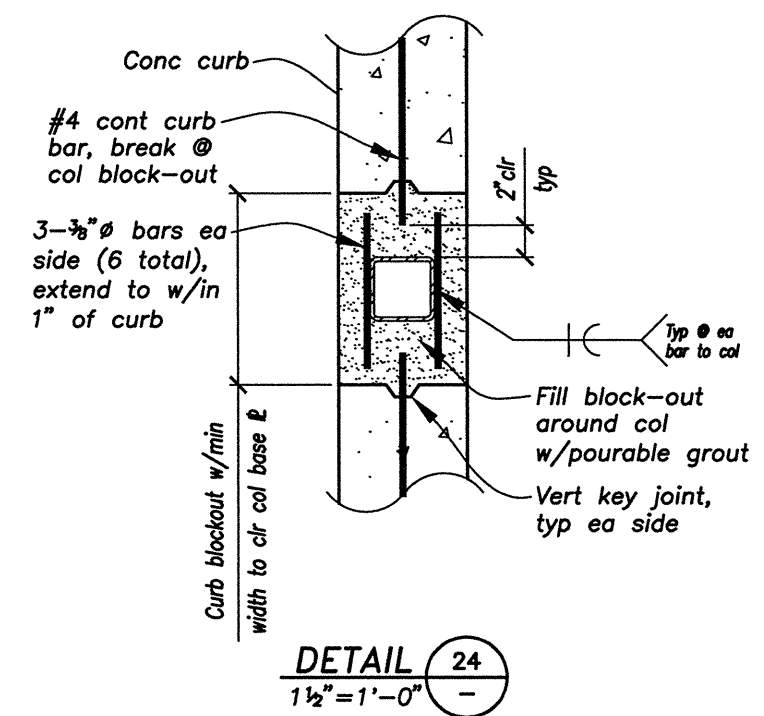


Simpson	Fastener	Holdown	Min post reqd
HD No.	(No. & Type)	bolt (dia)	(match stud width)
HDU2-SDS2.5	6-SDS#2 1/2 SCR	3/8"	4x
HDU4-SDS2.5	10-SDS#2 1/2 SCR	3/8"	4x
HDU8-SDS2.5	14-SDS#2 1/2 SCR	3/8"	4x
HDU11-SDS2.5	20-SDS#2 1/2 SCR	3/8"	6x
HDU14-SDS2.5	30-SDS#2 1/2 SCR	1"	6x
HDQ8-SDS3	20-SDS#3 SCR	3/8"	6x
HDQ11-SDS3	24-SDS#3 SCR	1"	6x
HDQ14-SDS3	30-SDS#3 SCR	1"	6x


NOTE: 1. HD's do not substitute for sill bolts. 2. Install HD's per Simpson's catalog except above detailed anchor bolts as req. 3. HD post may be used as king stud.

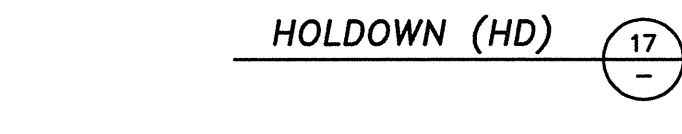


NOTE: Provide trim bars at all openings in walls as shown. Vertical bars shall be full story height and shall lap with bars above if openings occur at the same locations. Hook end of bars when unable to extend bars required amount. Provide wall reinforcing spreaders in double curtain walls. Spreaders should occur at every third intersection of wall bars in each direction and should be placed in vertical lines with form ties. No reinf if max dim is less than 6".

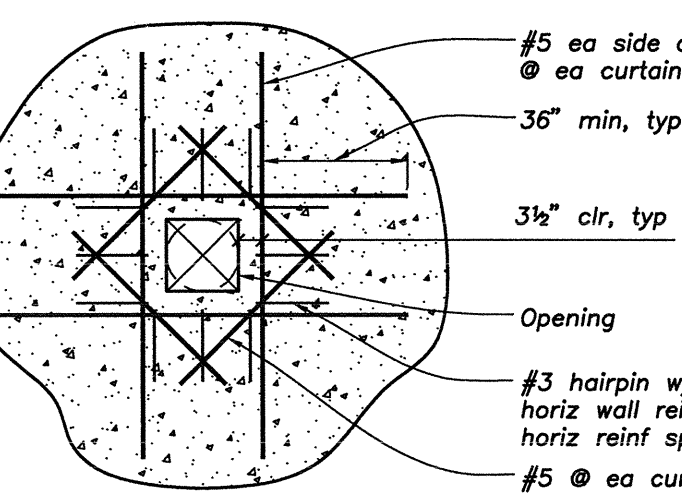


REIN'G FOR OPENING IN CONC WALLS OR SLAB (18)

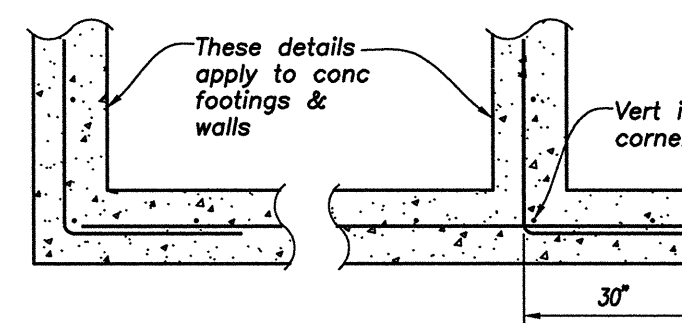


SINGLE CURTAIN REINFORCING (19)

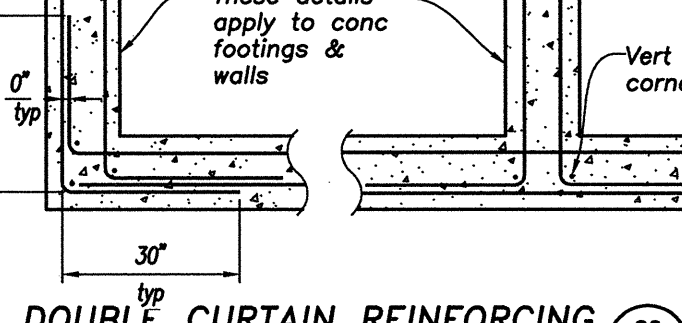


DOUBLE CURTAIN REINFORCING (20)

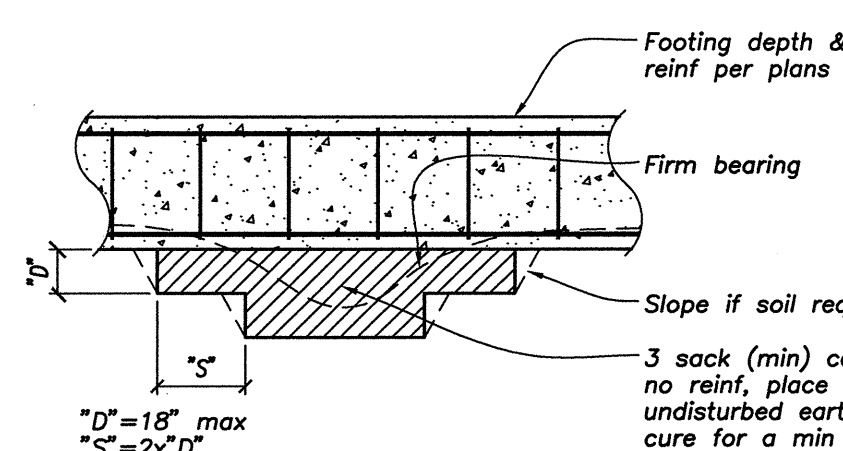


FTG @ SOFT BEARING POCKET & @ ADJACENT UTILITIES (9)

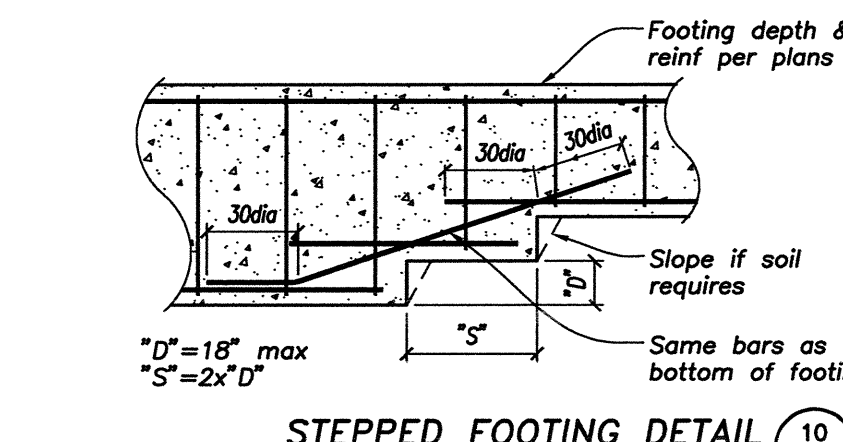


STEPPED FOOTING DETAIL (10)

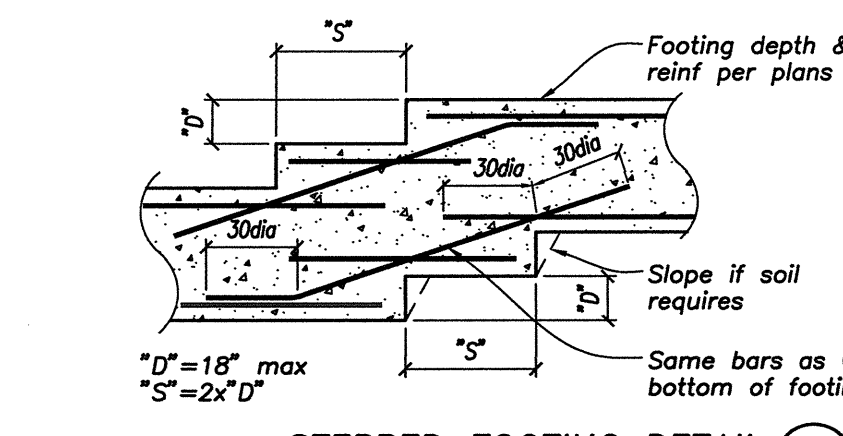


STEPPED FOOTING DETAIL (11)

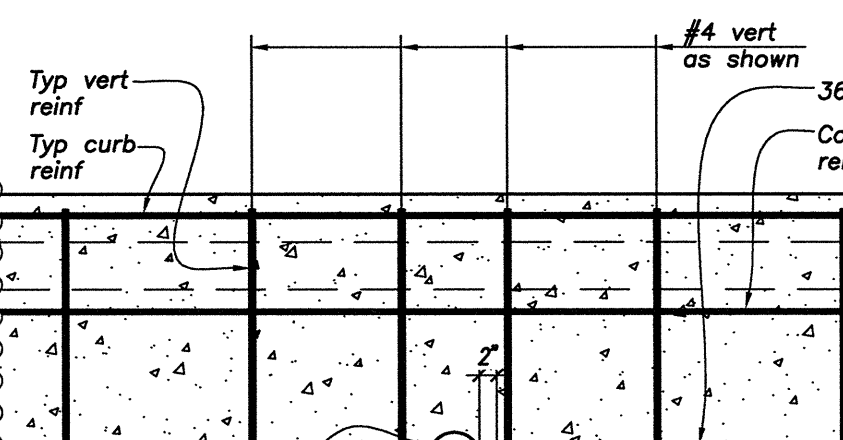


GRAVITY TIED UTILITY THRU FOOTING (12)

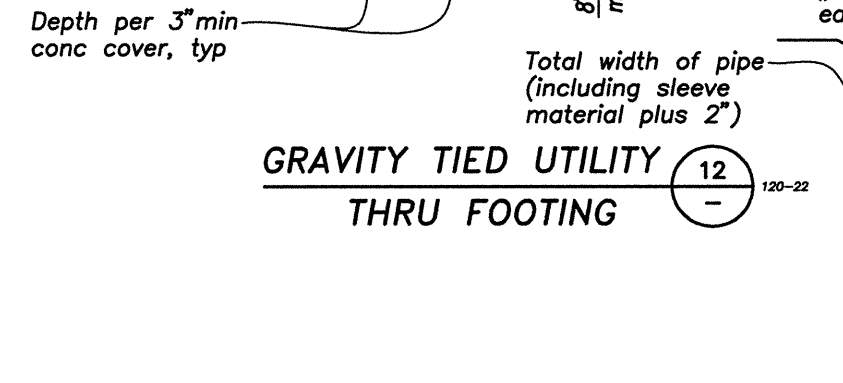


CURB DETAIL (13)

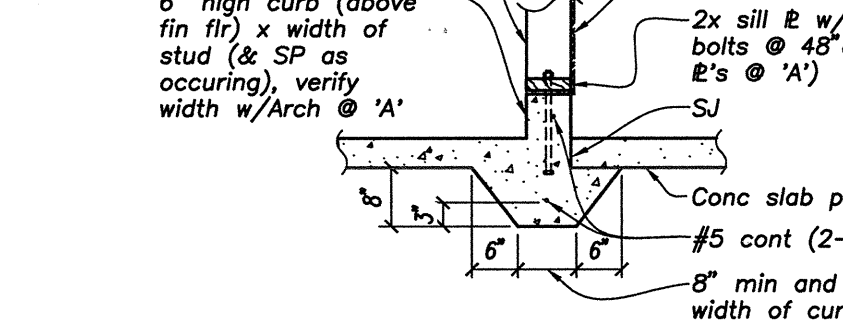


CURB DETAIL (13A)

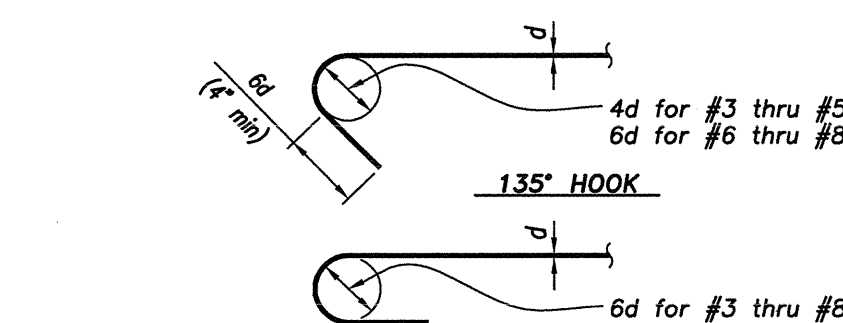


135° HOOK (14)

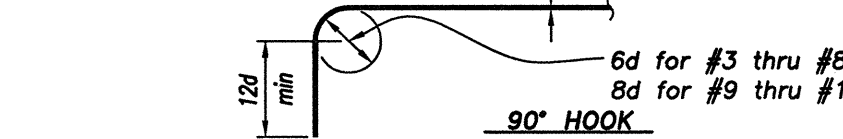


180° HOOK (15)

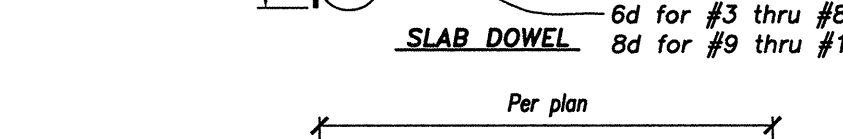

90° HOOK (16)

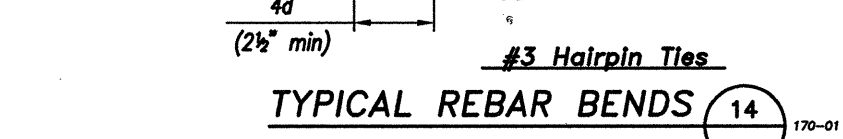

24" horiz leg (17)

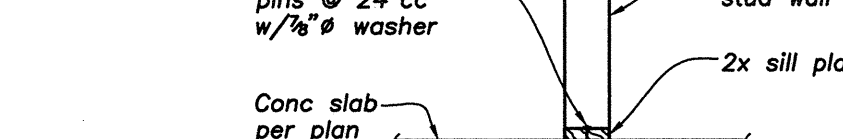


SLAB DOWEL (18)



TYPICAL REBAR BENDS (14)



"SHOT" SILL PLATE (15)

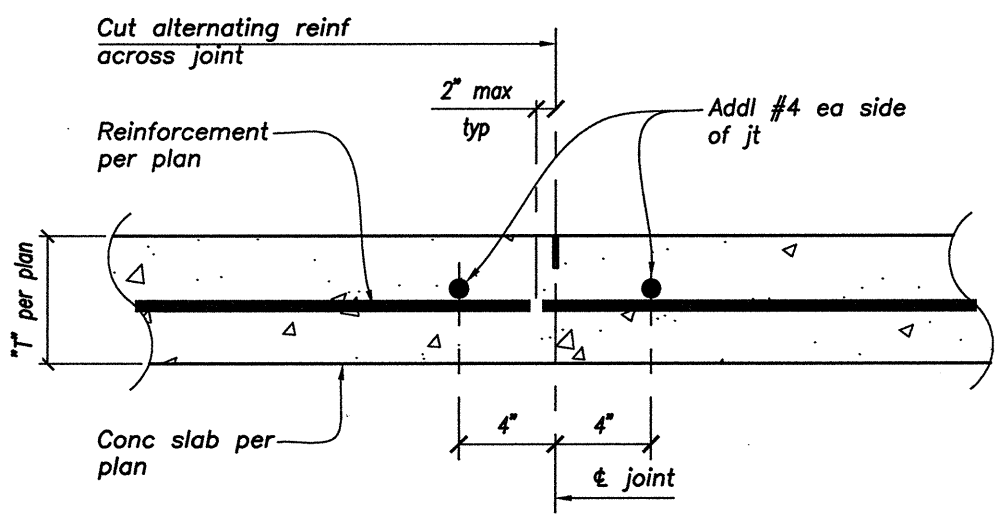


CONTRACTION JOINT IN SLAB (1)

1. Form weakened-plane contraction joints, sectioning concrete into areas as indicated (see specifications for area limitations). Construct contraction joints for a depth equal to at least one-fourth of concrete thickness (one-inch min). 2. Form contraction joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/4-inch wide joints into concrete when cutting action will not tear, abrade, or otherwise damage surface and before concrete develops random contraction cracks: time frame: one to four hours after last trowel is pulled off. Contractor shall schedule concrete placement so that cuts are made the same day. No saw cutting is permitted for slabs that have been allowed to sit overnight. When saw cutting slabs within the required time frame will not be possible, slab joints with 26 ga (min thickness) tongue-and-groove steel shape shall be provided.


CONTRACTION JOINT IN SLAB (1)



EXPANSION JOINT (EJ) (2)



EXTERIOR SLAB EDGE (3)




TRENCH PARALLEL TO FOOTINGS (4)




TRENCH PARALLEL TO FOOTINGS (4A)




TRENCH PARALLEL TO FOOTINGS (4B)




TRENCH PARALLEL TO FOOTINGS (4C)




TRENCH PARALLEL TO FOOTINGS (4D)




TRENCH PARALLEL TO FOOTINGS (4E)




TRENCH PARALLEL TO FOOTINGS (4F)




TRENCH PARALLEL TO FOOTINGS (4G)




TRENCH PARALLEL TO FOOTINGS (4H)




TRENCH PARALLEL TO FOOTINGS (4I)



TRENCH PARALLEL TO FOOTINGS (4J)

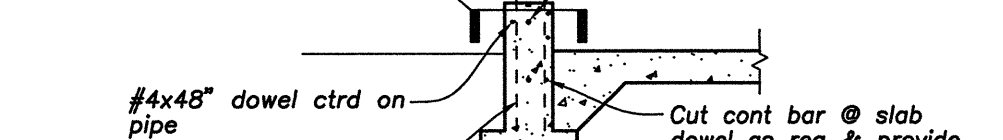

TRENCH PARALLEL TO FOOTINGS (4K)



TRENCH PARALLEL TO FOOTINGS (4L)



TRENCH PARALLEL TO FOOTINGS (4M)



TRENCH PARALLEL TO FOOTINGS (4N)

TRENCH PARALLEL TO FOOTINGS (4O)

TRENCH PARALLEL TO FOOTINGS (4P)

TRENCH PARALLEL TO FOOTINGS (4Q)

TRENCH PARALLEL TO FOOTINGS (4R)

TRENCH PARALLEL TO FOOTINGS (4S)

TRENCH PARALLEL TO FOOTINGS (4T)

TRENCH PARALLEL TO FOOTINGS (4U)

TRENCH PARALLEL TO FOOTINGS (4V)

TRENCH PARALLEL TO FOOTINGS (4W)

TRENCH PARALLEL TO FOOTINGS (4X)

TRENCH PARALLEL TO FOOTINGS (4Y)

TRENCH PARALLEL TO FOOTINGS (4Z)

TRENCH PARALLEL TO FOOTINGS (4AA)

TRENCH PARALLEL TO FOOTINGS (4AB)

TRENCH PARALLEL TO FOOTINGS (4AC)

TRENCH PARALLEL TO FOOTINGS (4AD)

TRENCH PARALLEL TO FOOTINGS (4AE)

TRENCH PARALLEL TO FOOTINGS (4AF)

TRENCH PARALLEL TO FOOTINGS (4AG)

TRENCH PARALLEL TO FOOTINGS (4AH)

TRENCH PARALLEL TO FOOTINGS (4AI)

TRENCH PARALLEL TO FOOTINGS (4AJ)

TRENCH PARALLEL TO FOOTINGS (4AK)

TRENCH PARALLEL TO FOOTINGS (4AL)

TRENCH PARALLEL TO FOOTINGS (4AM)

TRENCH PARALLEL TO FOOTINGS (4AN)

TRENCH PARALLEL TO FOOTINGS (4AO)

TRENCH PARALLEL TO FOOTINGS (4AP)

TRENCH PARALLEL TO FOOTINGS (4AQ)

TRENCH PARALLEL TO FOOTINGS (4AR)

TRENCH PARALLEL TO FOOTINGS (4AS)

TRENCH PARALLEL TO FOOTINGS (4AT)

TRENCH PARALLEL TO FOOTINGS (4AU)

TRENCH PARALLEL TO FOOTINGS (4AV)

TRENCH PARALLEL TO FOOTINGS (4AW)


TRENCH PARALLEL TO FOOTINGS (4AX)

TRENCH PARALLEL TO FOOTINGS (4AY)

TRENCH PARALLEL TO FOOTINGS (4AZ)


TRENCH PARALLEL TO FOOTINGS (4BA)

TRENCH PARALLEL TO FOOTINGS (4BB)

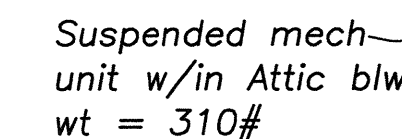

1. See Roof Framing Legend & Notes on S2.2
2. For roof framing, see S2.2

North
←



- (1) $\frac{3}{4}$ " SP @ floor, typ, see $\left(\frac{20}{S0.3}\right)$
- (2) Floor access hatch, see Arch dwgs
- (3) Furnace unit @ floor, max wt in parentheses
- (4) 4x10 @ furnace unit, coord w/Mech dwgs
- (5) CS16x8"-0" see $\left(\frac{7}{S4.4}\right)$
- (6) CS16x8"-0" see $\left(\frac{8}{S4.4}\right)$
- (7) Lap flr jst 16" onto 6x brn & nail w/8-16d, provide SPPN full length of flr jst
- (8) 3-1 $\frac{1}{2}$ x9 $\frac{1}{2}$ " LVL hdr - see $\left(\frac{11}{S4.4}\right)$



1. Only wood framed ceilings supported by walls or hangers are shown. For T-bar ceilings or ceilings attached directly to joists, see Arch.
2. Frame ceilings w/2x6 @ 24"cc, UNO.
3. Openings in ceiling framing (not shown) to be per 7/SO.3.
4. Partial height walls at T-bar ceilings to be braced per 24/SO.3.
5. Adjust ceiling hangers to avoid Mech ducts etc..
6. Hang all joists @ beams & ledgers w/JH's. Use SUL/SUR JH's @ skewed connections.
7. Frame ceilings per 12/SO.3, UNO.
8. Install stringbacks at ceiling joists @ 6'-0"cc max per 29/SO.3.

CEILING FRAMING PLAN
1/8" = 1'-0"

www.barrish.com

bp

barrish pelham
Consulting Engineers
Sacramento/Walnut Creek/Tahoe/Reno



600 Q Street, Suite 100
Sacramento, CA 95811
www.nachtley.com
916.329.4000



NO.	DWG BY	DATE	REVIEWED

DATE	February 23, 2017
JOB NO.	Y1538.00
SHEET TITLE	

Mech Attic Floor, Partial Roof and Ceiling Framing Plans

S2.3