Minimum Standards for the Design of BJMP Jails

Version 1.0

2018

Minimum Standards for the Design of BJMP Jails

Version 1.0

2018

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
DILG-NAPOLCOM Center, EDSA Corner, Quezon Avenue, West Triangle, Quezon City
www.dilg.gov.ph

OFFICE OF THE SECRETARY

Addressing the complexity of jail design through the crafting of this handbook on "**Minimum Standards for the Design of BJMP Jails"** is clearly a proactive response by the Jail Bureau on the recently approved RA 11032 otherwise known as "Ease of Doing Business Act" of President Rodrigo Roa Duterte. It shortens the planning phase of a jail construction project and prescribes the minimum standard requirements of the recently revised Mandela Rules on treatment of Persons Deprived of Liberty (PDL) in consonance with local codes.

With the absence of international specifications on translating the revised United Nation rules into specific and actionable parameters, this is definitely a monumental feat for the Bureau of Jail Management and Penology.

As your Secretary, I am proud for this particular achievement. It is indeed a good governance tool for your organization. *Congratulations*!

EDUARDO M. AÑO
Secretary

DILG-OSEC 11052018-00477

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 Mindanao Avenue, Quezon City
Trunklines: (+632)927-6383; 927-5505
Email Address: chief@bjmp.gov.ph Website: www.bjmp.gov.ph

Message

Planning for a concrete response for international requirements in treating Persons Deprived of Liberty (PDL) under our management with the realization of this tool is an enormous achievement.

This handbook is truly a stand-alone guidance on the technical and operational aspects of jail design that will be beneficial to our field project teams and engineers to efficiently deliver the general objectives of projects. Using this document as a tool and a reference book, our jails will be much more likely to meet our current and future needs; this will also help our jail personnel to do their best at their jobs and supports our vision and mission regarding detention and corrections.

As your ship's captain, I am guaranteed that I am steering towards the envisioned direction based on the strategies and ground works I laid out when I took the wheel of steering the BJMP. I believe in the competence of every men and women of our organization, thus strongly acknowledge the words of a wise man who said: "*Power resides where men think it resides*".

Finally, I am elated that when my tour of duty compulsorily ends in March 2019, I am leaving behind a tangible legacy of my leadership – this handbook containing the Minimum Standards for the Design of BJMP Jails. With this fiery tool, our project teams in 17 regional offices would deliver reasonably efficient end result for projects – avoiding budget overrun and schedule slippage which definitely could further court the trust and confidence of the DBM in increasing our Capital Outlays every fiscal year and one day we will be able to meet the ideal space for every PDL. Cheers!

DEOGRACIAS C TAPAYAN, CESE
Jail Director
Chief, BJMP

"Changing Lives, Building a Safer Nation"

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 Mindanao Avenue, Quezon City
Trunklines: (+632)927-6383; 927-5505
Email Address: chief@bjmp.gov.ph Website: www.bjmp.gov.ph

Message

Heavily burdened with unsatisfactory living conditions of the Persons Deprived of Liberty (PDL) due to congestion in all BJMP-manned jails in the Philippines, it is the time to take steps and do actions to remedy the problem.

The launching of the Handbook on "**Minimum Standards for the Design of BJMP Jails**" is a monumental phase of the BJMP's 27 years of existence, being one of the composites of Corrections Pillar of the Philippine Criminal Justice System. The collaborative efforts of the ICRC Team and BJMP Team have produced a tool that will guide all personnel especially those involved in jail planning and design to ensure that PDL will be treated more humanely and will be provided basic minimum standards of living that are due to them.

A profound gratitude is extended to the International Committee of the Red Cross (ICRC) for the development of this Handbook that has been made possible because of their unrelenting financial and technical support to the Jail Bureau.

LEO PAJO BALDON
Jail Chief Superintendent
Director of the Directorate for Logistics

"Changing Lives, Building a Safer Nation"

PROJECT TEAM

BJMP

J/SSUPT MA. ANNIE A ESPINOSA Deputy Director, Directorate for Operations	Project Team Leader
DIR. MARCOS B VILLALON Chief Operation Officer, Directorate for Program Development	Assistant Project Team Leader
J/CINSP ALBERTO M MARIANO Chief, Real Property Division Directorate for Logistics	Member
J/INSP JIMLANI J SAMPANG Chief, Repair and Maintenance Division Directorate for Logistics	Member
J/INSP WILLIAM MARC BENEDICK F TALLUNGAN Chief, Project Management Section Directorate for Logistics	Member

ICRC

Engr. Jean-Francois Pinera, PhD Water and Habitat Department	Member
Engr. Annarosa Cerrero, PMP Water and Habitat Department	Member
Ms. Nikka Munion Protection Department	Member

ACKNOWLEDGEMENTS

The **Bureau of Jail Management and Penology (BJMP),** wishes to thank all the personnel and resource persons who contributed in many ways to the preparation of this Minimum Standards for the Design of BJMP Jails. The shared technical expertise, experiences, and perspectives have produced a tool which had a significant impact on the crafting of this handbook, which is primarily for jail designers.

Special thanks are extended to the following personnel of the BJMP who collaborated in the preparation of the different functional components: J/CSUPT IGNACIO S PANTI, J/CSUPT RUEL S RIVERA, J/CSUPT PAUL MORENO, J/SSUPT LUISITO C MUÑOZ, J/SUPT JOHNSON CALUB, J/SUPT RANDELL H LATOZA, J/SUPT ELENA B ROCAMORA, J/SUPT MARIE ROSE J LAGUYO, J/SUPT MELCHOR O BOADILLA, J/SUPT DEOGRACIAS DE CASTILLO, J/CINSP MARIA IGNACIA MONTERON, J/CINSP MARIA JOYCE E LUYAO, J/CINSP LLOYD GONZAGA, J/CINSP JOHN CONRAD MARCELINO L BASILIO, J/CINSP CHRISTOPHER R PENILLA, J/CINSP RICKY HEART L PEGALAN, J/CINSP ELIZABETH A GARCERON, J/CINSP MIGUEL D LANGCAUON, J/CINSP CRISTINA PERALTA-CATILLO, J/CINSP NEVA RENCHIE DC SALLE, J/CINSP RUDILYN B SINOY, J/CINSP REYNALDO A PAGUIRIGAN JR, J/SINSP MARJORIE TECHIE C ORLAIN, J/SINSP CRYSTALENE A GONZALES, J/SINSP JEZA MAE SARAH C SANCHEZ, J/SINSP JOHN PAUL DG BORLONGAN, J/SINSP JAYREX JOSEPH BUSTINERA, J/SINSP NOLITO C ROMERO, J/SINSP MARK SYLVESTER C TAN, J/SINSP PRUDENCIO DULNUAN, J/SINSP JESS MAGUIAT, J/SINSP EMERALD C HOMBREBUENO, J/INSP MAR LOUIE V SALCEDO, J/INSP ROGELIO L ALIP, J/INSP EDILBERTO L TUMOLVA, J/INSP JOHNY RAYMUNDO, J/INSP CECILIA T PANGILINAN, J/INSP JAYSON NECIO, J/INSP ALI P MACATANONG, J/INSP PRINCESS DG MIGUEL, J/INSP CORAZON G PAYUMO, SJO4 ANGELINA IBAÑEZ, SJO4 Melanie A Garcia, SJO2 Felix Marcos Jr, JO2 Alicon M Dimala, JO2 Kristan Joy L Taruma, JO1 John Edward R Delliro, JO1 Nover L Casareno, JO1 Allan Christian C Benitez, JO1 Flaviano Panaga, and also for the ICRC, ARCH. JEAN-MARC ZBINDEN, ATTY. ROMARIC FERRARO, MR. TERRY HACKET, Dr. KESTER MANIAUL and MR. HARRY TUBANGI.

Sincere appreciation is also extended to the Directorate for Logistics Personnel who provided necessary data and editorial assistance during the finalization of this handbook: J/INSP RONNEL MERCADO, J/INSP MAY ANN BEJUNA, JO2 Gerardo Gabay, JO2 Christopher DC Dizon and Ms. Cristina Benabese. Special thanks also to Ms. Marilou C Sanchez of the Directorate for Program Development who provided inputs in the crafting of the Standard Operating Procedures (SOP) for this handbook to be institutionalized in the entire BJMP.

And as always, the crafting of this Minimum Standards for the Design of BJMP Jails would not have been possible without the generous experts' and financial support of the **International Committee of the Red Cross (ICRC**). The constant contributions of the ICRC are greatly appreciated.

Table of Contents

INTRODUCTION **4**

DIRECTORY OF FUNCTIONAL COMPONENTS **8**

LIST OF THE STANDARDS **18**

ANNEXES **188**

Figures

Figure 1: Holding Room for Type A Facilities (1-100 PDL capacity) 23

Figure 2: Holding Room for Type B Facilities (101-500 PDL capacity) 23

Figure 3: Holding Room for Type C and D Facilities (501-2000 PDL capacity) 24

Figure 4: Reception / Counter / Processing Area for Type A and B Facilities (1-500 PDL capacity) 26

Figure 5: Reception / Counter Area for Type C and D Facilities (501-2000 PDL capacity) 28

Figure 6: Processing Area / Desk Photo-booth for Type C and D Facilities (501-2000 PDL capacity) - One Photo-booth shown 30

Figure 7: Proposed Layout of a Diagnostic Room for Type C and D Facilities (501-2000 PDL capacity) 35

Figure 8: Orientation Room for Type B, C and D Facilities (101-2000 PDL capacity) 37

Figure 9: Post-holding Cell for Type A Jail Facilities (1-100 PDL capacity) 38

Figure 10: Quarantine Room for Type C and D Jail Facilities (501-2000 PDL capacity) 41

Figure 11: Standard Layout of a Cell for 10 PDL 43

Figure 12: Sample of Design of a Toilet and Bath of a Cell for 10 PDL. 45

Figure 13: Proposed Layout of a Single Accommodation Cell 47

Figure 14: Details of Cell Windows 50

Figure 15: Proposed Layout of Windows used in High Risk Facilities 50

Figure 16: Proposed Layout of a Cell Sliding Door 52

Figure 17: Proposed Layout of a Cell Swing Door 53

Figure 18: Two-level Bunk Bed Standard Design 55

Figure 19: Layout of Bunk Beds inside a Cell 55

Figure 20: Open Shelves Standard Design 56

Figure 21: Proposed Layout of a Visitors Processing Area 59

Figure 22: Proposed Layout of a Searching Area 61

Figure 23: Details of Strip-searching Area 62

Figure 24: Podium-stand Mounted All-in-One PC 66

Figure 25: Conjugal Visit Room 68

Figure 26: Non-Contact Visit Room for Type A Facilities (1-100 PDL capacity) 70

Figure 27: Double-door Design for Type A and B Facilities (1-500 PDL capacity) 72

Figure 28: Two-swing Door 72
Figure 29: Proposed Layout of Health Facilities in Type D Jails (1001-2000 PDL capacity) 73
Figure 30: Proposed Layout of a Consultation Room 78
Figure 31: Typical Design of Nurse Stations 79
Figure 32: Example of 10 Patients Bed-capacity Ward. 91
Figure 33: Laboratory Typical Layout 93
Figure 34: Radiations Sign 95
Figure 35: Gas Burner 98
Figure 36: Proposed Layout of a Kitchen Area for Type A Facilities (1-100 PDL capacity) 98
Figure 37: Proposed Layout of a Laundry Area for Type A Jail Facilities (1-100 PDL capacity) 108
Figure 38: Typical Layout of Warden's Office / Staff Office/ Records Room for Type A Facilities (1-100 PDL capacity) 120
Figure 39: Guard House Position within the Visitors Processing Area 133
Figure 40: Guard Tower 136
Figure 41: Dog-walk 138
Figure 42: Main Perimeter Fence 140
Figure 43: Catwalk 142
Figure 44: Main Gate / Vehicle Gate 144
Figure 45: Pedestrian Gate 146
Figure 46: Secondary Perimeter Fence 148
Figure 47: Typical Rainwater Harvesting System 153
Figure 48: Example of a Pumping System 156
Figure 49: Waste Segregation at the Garbage Collection Area 158
Figure 50: Stairs Design 160
Figure 51: Corridors with Area allowing 180° turn in a Wheelchair 161
Figure 52: Ramp Dimensions 162
Figure 53: Wheelchair Maneuvering Space 163
Figure 54: PWD-accessible Toilet. 165
Figure 55: PWD-accessible Toilet and Bath (to be used with assistance) 167
Figure 56: LED Emergency Light 170
Figure 57: Elbow-tap 174
Figure 58: Lavatories accessible to PWD 175
Figure 59: Septic Tank Placement 176
Figure 60: Septic Tank Design 179

Figure 61: Measuring Sludge Thickness 180
Figure 62: Percolation Test 182
Figure 63: Degreasing Tank 183
Figure 64: Cross Section of a Soak Pit 184
Figure 65: Percolation Pipe (plastic) 15 184
Figure 66: Drainage Trench 185

INTRODUCTION

Objectives using standards for the design of jails

Design standards are necessary tools for the implementation of construction projects. The main objective of using standards is to achieve **constant quality** and compliance with a number of **requirements** imposed by regulations (e.g. safety, environmental concerns etc.). Design standards are key elements in BJMP efforts to establish well-designed jail facilities suitable both for Persons Deprived of Liberty (PDL), BJMP personnel and visitors.

Background to the establishment of Minimum Standards for the Design of BJMP Jails

The need for design standards has been on BJMP agenda for a long time. In this endeavor, it benefited from strong support from the International Committee of the Red Cross (ICRC). This translated in the production in 2012 of **"BJMP Manual on Habitat, Water, Sanitation and Kitchen in Jails"**. However, while including a number of design guidelines, this manual did not equate to a genuine and comprehensive design standards document and in most cases, jail facilities constructed throughout the country did not meet minimum standard requirements in terms of size, location, furniture, and equipment. Hence, the proposal of developing new standards for the design of BJMP jails that are expected to be an essential stone in helping rational planning of BJMP infrastructure development.

Process of establishing Minimum Standards for the Design of BJMP Jails

Design standards are essential aspect of the construction **project management cycle** that starts with the project proposal in which the vision for a new jail facility is explained and justified, and continues with the jail brief in which the various functional components of the jail are defined, the feasibility study that determines whether the proposed site for the construction of the jail is adequate, and then the design, contracting, construction and hand-over of the new facility.

Design standards allow the jail brief document, where the programming of all functional components of the jail are described, to translate into a design that will take the form of a layout, while respecting a number of rules. These rules must be compatible with overarching national regulations, and if found relevant, to international standards. The various regulations that were taken into consideration while establishing these standards are the following:

Among Philippine standards:

- BJMP Operations Manual;
- BJMP Manual on Habitat, Water, Sanitation and Kitchen in Jails;
- National Building Code (PD1046) of the Philippines;
- National Plumbing Code of the Philippines;
- Fire Safety Code of the Philippines.

Among International standards / guidelines

- The revised United Nations Standards Minimum Rules for the Treatment of Prisoners (Nelson Mandela Rules);
- The United Nations Rules on the treatment of Women Prisoners and Non-custodial Measure for Women Offenders (The Bangkok Rules);
- ICRC's Water, Sanitation, Hygiene and Habitat in Prisons;

- UNOPS[1]' Technical Guidance for Prison Planning.

The process of establishing these standards was a **participatory** one, in which a large number of BJMP personnel working at the national headquarters, some regional offices and individual jails participated, with support from the ICRC. They covered fields ranged from jail management and security to engineering, logistics, health services, program development and PDL's welfare. This translated into the organization of five workshops that were organized in Quezon City between November 2017 and April 2018. The purpose of each of the workshop is detailed in the table below:

1	Introductory workshop: Listing functional components	November 2017
2	PDL classification and capacity	January 2018
3	Establishing standards for: accommodation, security, visits and commitment	February 2018
4	Establishing standards for: activities, outdoor access and health care	March 2018
5	Establishing standards for: food services, administration, solid waste and essential services	April 2018

After the various **functional components** of a jail regrouped in **functional areas** were listed, the jail capacity ranges were decided as well as the type of detainees, considering their specific needs and requirement.

It was decided to consider four **jail capacity ranges**:

A. Small jails: 100 and below PDL capacity;
B. Medium Jails: 101 to 500 PDL capacity;
C. Large jails: 501 to 1000 PDL capacity;
D. Very large jails: more than 1000 PDL capacity.

PDL categories that had to be taken into account when defining standards were determined as follows:

- Risk;
- Mobility of PDL.

Who should use the Minimum Standards for the Design of BJMP Jails?

The standards are meant to be used by jail designers (engineers and architect), although jail managers, directors and logistics officers should be familiar with them.

How to use the Minimum Standards for the Design of BJMP Jails

The **Directory** section lists the various **Functional Component** for each of the **Functional Areas**, namely:

1. Commitment
2. Accommodation
3. Visiting Area
4. Health Facilities
5. Food Services
6. Development Activities/ Livelihood

[1] United Nations Office for Project Services

7. Administration
8. Essential Services/Utilities
9. Solid Waste

A table for each of the **Functional Areas** lists the functional components it contains and indicates the number of the page where a **definition** and a **description** of each functional component can be found. When several functional components are included in the same cell of a table, this indicates the existence of sub-areas. For example, in Visiting Area (3), body-search area and a strip-search area both appear in the same cell because the strip-search area occupies a space that is included within the body-search area. The strip-search area is a sub-area and appears as such in the table.

Functional components can be:

- **Areas** (rooms, outdoor areas, corridors etc.), which appear on the layout and for which land/space must be allocated; or
- **Features**, which are any other elements of the design such as doors, windows, fences, ventilation systems, lighting etc. that don't require space allocation.

Areas type and **Features** type functional components are presented separately in the functional component area tables. Area type functional components are sometimes **merged** in the case of small facilities. In such cases the same area may serve several function e.g. an ALS room that is also a library.

Most functional components, whether area type or features type are **specific to an area**, however, some of them on the contrary can be found in several areas; they are denominated as **recurrent.** For instance: doors, windows, corridors, toilets, fans, etc. are identically designed in different areas of the jail and are part of the recurrent functional components. All **Recurrent Functional Components**, whether area type or features type are regrouped at the end of the **Standards** document.

The Directory indicates whether the design of the concerned Functional Component is influenced by:

- Risk (special provisions for high-risk PDL); or
- PWD access (wheelchair accessibility especially).

The **Description** of each functional component include four elements:

1. **Location**: indications on the specificity of the location of a functional component;
2. **Dimensions:** that can be a length, a surface, a volume, a ratio, a fix value, a maximum threshold, a minimum threshold or a range. This element provides an indication on the required size of the functional component;
3. **Number**: indicates a quantity / ratio related to the concerned functional component (e.g. how many taps, toilet bowls etc.);
4. **Characteristics**: provide any specifications on the functional component.

When one or more of these elements are not relevant, they are marked as: non-applicable (n/a)

What is the expected impact of the Minimum Standards for the Design of BJMP Jails?

A few positive impacts of using design standards and procedure in upcoming jail construction projects are listed below:

- **Improved Living Condition**: A significant improvement in the living conditions in terms of decent and sanitary accommodation and related services can be expected);

- **Better implementation of PDL Welfare and Development Programs**: Better jail design would pave the way for the formulation of necessary policies for PDL. As a result, it would allow the personnel to implement various IWD programs in a conducive environment;
- **Increased Security and Order**: A better designed jail along with a stricter imposition of jail rules and enhanced custody supervision will provide the jail administration with safe and highly controlled environment for the benefit of personnel, visitors and PDL;
- **Opportunities for Personnel Career Development:** Assigned jail personnel would be regularly trained for competency and would have an excellent foundation on which to build an array of PDL program and services;
- **Increased appearance of institution's sensitivity to public service:** Most jails in the country are likely to respond to the public perception where PDL will be housed in the same type of facility and be treated equally in accordance to the level of security and custody required;
- **Increased Stakeholder Participation and Cohesiveness:** With better jail design, the administration is more likely to receive NGOs', GOs', religious and other civic organizations' participation in jail activities and services.

DIRECTORY OF FUNCTIONAL COMPONENTS

#	FUNCTIONAL AREAS	Page
1	COMMITMENT	9
2	ACCOMMODATION	10
3	VISITATION	11
4	HEALTH SERVICES	12
5	FOOD SERVICES	13
6	DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES	14
7	ADMINISTRATION	15
8	SECURITY	16
9	ESSENTIAL SERVICES / UTILITIES	16
10	SOLID WASTE MANAGEMENT	17

1. COMMITMENT

<table>
<tr><th colspan="4">SPECIFIC AREAS / SUB-AREAS</th></tr>
<tr><th colspan="4">Jail Capacity</th></tr>
<tr><th>A (Small)</th><th>B (Medium)</th><th>C (Large)</th><th>D (Very Large)</th></tr>
<tr><td colspan="4">1.1 Holding Cell – Page 22</td></tr>
<tr><td colspan="2" rowspan="2">1.2 Reception / Counter / Processing Area – Page 25</td><td colspan="2">1.3 Reception / Counter Area – Page 27</td></tr>
<tr><td colspan="2">1.4 Processing Area / Desk Photo-booth – Page 29</td></tr>
<tr><td rowspan="2">1.5 Diagnostic Room / Body-search / Orientation Area – Page 31</td><td rowspan="2">1.6 Diagnostic Room / Body-search Area – Page 32</td><td>1.7 Body-search Area – Page 33</td><td rowspan="2">1.8 Diagnostic Room– Page 34</td></tr>
<tr><td colspan="2">1.9 Orientation Room – Page 36</td></tr>
<tr><td colspan="4">1.10 Post-holding Cell – Page 38</td></tr>
<tr><td colspan="4">1.11 PCCU (PDL Classification Counseling Unit) – Page 39</td></tr>
<tr><td colspan="4">1.12 Quarantine Room – Page 40</td></tr>
</table>

RECURRENT AREAS	RECURRENT FEATURES
A.1 Corridors, Staircases and Entrance / Exit – Page 159 PWD ACCESS	F1. Lighting and Natural Ventilation – Page 167
A.2 Ordinary and PWD-accessible Toilets – Page 163 PWD ACCESS	F2. Artificial Ventilation – Page 170
A.3 Ordinary and PWD-accessible Toilet and Bath – Page 166 PWD ACCESS	F.4 Lavatories and Faucets– Page 175 PWD ACCESS
	F.5 Septic Tanks – Page 176
	F.6 Degreasing Tanks, Soak Pits and Drainage Trenches – Page 181
	F.7 Fire Safety – Page 186

2. ACCOMMODATION

SPECIFIC AREAS / SUB-AREAS			
Jail Capacity			
A (Small)	B (Medium)	C (Large)	D (Very Large)
2.1 Sleeping and Dining Area – Page 42 PWD ACCESS			
2.2 Cell Toilet and Bath – Page 43 PWD ACCESS			
2.3 Single-accommodation Cell – Page 46			
2.4 Recreation Area – Page 48			

SPECIFIC FEATURES
2.5 Windows for Cells and Recreation Areas – Page 49 RISK
2.6 Doors for Cells and Recreation Areas – Page 51
2.7 Bunk Bed – Page 54
2.8 Open Shelves – Page 56

RECURRENT AREAS	RECURRENT FEATURES
A.1 Corridors, Staircases and Entrance / Exit – Page 159 PWD ACCESS	F1. Lighting and Natural Ventilation – Page 167
	F2. Artificial Ventilation – Page 170
	F.4 Lavatories and Faucets – Page 175 PWD ACCESS
	F.5 Septic Tanks – Page 176
	F.6 Degreasing Tanks, Soak Pits and Drainage Trenches – Page 181
	F.7 Fire Safety – Page 186

3. VISITATION

SPECIFIC AREAS / SUB-AREAS			
Jail Capacity			
A (Small)	B (Medium)	C (Large)	D (Very Large)
3.1 Visitors Holding Area – Page 57 PWD ACCESS			
3.2 Visitors Processing Area – Page 58 PWD ACCESS			
3.3 Searching Area for Visitors – Page 60 / 3.4 Strip-searching Area – Page 61 PWD ACCESS			
3.5 Visitors Area for Contact Visit – Page 63 PWD ACCESS / 3.6 Visitors Area for Official Visit – Page 64 PWD ACCESS 3.7 Commissary – Page 65 / 3.8 Teleconferencing Room (e-Dalaw) – Page 65			
3.9 Conjugal Visit Room – Page 66			
3.10 Visitors Area for Non-Contact Visit – Page 68 RISK, PWD ACCESS			

RECURRENT AREAS	RECURRENT FEATURES
A.1 Corridors, Staircases and Entrance / Exit – Page 159	F1. Lighting and Natural Ventilation – Page 167
A.2 Ordinary and PWD-accessible Toilets – Page 163	F2. Artificial Ventilation – Page 170
A.3 Ordinary and PWD-accessible Toilet and Bath – Page 166	F.4 Lavatories and Faucets – Page 175
	F.5 Septic Tanks – Page 176
	F.6 Degreasing Tanks, Soak Pits and Drainage Trenches – Page 181
	F.7 Fire Safety – Page 186

4. HEALTH SERVICES

<table>
<tr><th colspan="4">SPECIFIC AREAS / SUB-AREAS</th></tr>
<tr><th colspan="4">Jail Capacity</th></tr>
<tr><th>A (Small)</th><th>B (Medium)</th><th>C (Large)</th><th>D (Very Large)</th></tr>
<tr><td colspan="4">4.1 Patient Reception Area – Page 70 PWD ACCESS</td></tr>
<tr><td rowspan="6">4.2 Consultation Room / Dental Office / Nurse Station / Equipment Area / Supply-Room / Pharmacy – Page 71 PWD ACCESS</td><td rowspan="2">4.3 Consultation Room / Nurse Station / Health Staff Office – Page 75 PWD ACCESS</td><td>4.4 Consultation Room – Page 77 PWD ACCESS</td><td></td></tr>
<tr><td>4.5 Nurse Station – Page 79</td><td></td></tr>
<tr><td colspan="2">4.6 Health Staff Office – Page 80</td><td></td></tr>
<tr><td rowspan="2">4.7 Dental Office / Maternal / Pre-natal Care Area – Page 81 PWD ACCESS</td><td colspan="2">4.8 Dental Office – Page 82 PWD ACCESS</td><td></td></tr>
<tr><td colspan="2">4.9 Maternal / Pre-natal Care Area – Page 83 PWD ACCESS</td><td></td></tr>
<tr><td colspan="2" rowspan="2">4.10 Equipment Area / Supply Room / Pharmacy – Page 84</td><td>4.11 Equipment Area – Page 84</td></tr>
<tr><td>4.12 Supply Room / Pharmacy – Page 86</td></tr>
<tr><td colspan="4">4.13 Isolation Cells for TB and MDR-TB – Page 87</td></tr>
<tr><td colspan="4">4.14 Isolation Cells for Other Infectious Diseases – Page 88</td></tr>
<tr><td colspan="4">4.15 Sputum Collection Area – Page 89</td></tr>
<tr><td></td><td></td><td colspan="2">4.16 Patients' Ward – Page 90 PWD ACCESS</td></tr>
<tr><td></td><td></td><td colspan="2">4.17 Laboratory – Page 91</td></tr>
<tr><td></td><td></td><td colspan="2">4.18 Medical Imaging, X-Ray – Page 94 PWD ACCESS</td></tr>
<tr><td></td><td></td><td colspan="2">4.19 Temporary Observation Ward – Page 96 PWD ACCESS</td></tr>
</table>

RECURRENT AREAS	RECURRENT FEATURES
A.1 Corridors, Staircases and Entrance / Exit – Page 159 PWD ACCESS	F1. Lighting and Natural Ventilation – Page 167
A.2 Ordinary and PWD-accessible Toilets – Page 163 PWD ACCESS	F2. Artificial Ventilation – Page 170
A.3 Ordinary and PWD-accessible Toilet and Bath – Page 166 PWD ACCESS	F.3 Air Conditioning – Page 172
	F.4 Lavatories and Faucets – Page 175 PWD ACCESS
	F.5 Septic Tanks – Page 176
	F.6 Degreasing Tanks, Soak Pits and Drainage Trenches – Page 181
	F.7 Fire Safety – Page 186

5. FOOD SERVICES

SPECIFIC AREAS / SUB-AREAS			
Jail capacity			
A (Small)	B (Medium)	C (Large)	D (Very Large)
5.1 Kitchen Area – Page 97			
5.2 Food Distribution Area – Page 98			
5.3 Food Storage Area – Page 99			
5.4 Kitchen-waste Collection Area – Page 101			
5.5 Fuel Storage Area – Page 102			
5.6 Kitchen-staff Office – Page 103			
		5.7 Kitchen-aide Cell – Page 103	

SPECIFIC FEATURES
5.8 Kitchen Water-storage – Page 104

RECURRENT AREAS	RECURRENT FEATURES
A.1 Corridors, Staircases and Entrance / Exit – Page 159 PWD ACCESS	F1. Lighting and Natural Ventilation – Page 167
A.2 Ordinary and PWD-accessible Toilets – Page 163 PWD ACCESS	F2. Artificial Ventilation – Page 170
	F.4 Lavatories and Faucets – Page 175 PWD ACCESS
	F.5 Septic Tanks – Page 176
	F.6 Degreasing Tanks, Soak Pits and Drainage Trenches – Page 181
	F.7 Fire Safety – Page 186

6. DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES

<table>
<tr><td colspan="4">SPECIFIC AREAS</td></tr>
<tr><td colspan="4">Jail capacity</td></tr>
<tr><td>A (Small)</td><td>B (Medium)</td><td>C (Large)</td><td>D (Very Large)</td></tr>
<tr><td colspan="4">6.1 Outdoor Access – Page 106</td></tr>
<tr><td colspan="4">6.2 Laundry Area – Page 107</td></tr>
<tr><td colspan="4">6.3 Worship Area – Page 108</td></tr>
<tr><td colspan="2" rowspan="3">6.4 Training Room / ALS Room / Library – Page 110</td><td colspan="2">6.5 Training Room – Page 111</td></tr>
<tr><td rowspan="2">6.6 ALS Room / Library – Page 112</td><td>6.7 ALS Room – Page 113</td></tr>
<tr><td>6.8 Library – Page 114</td></tr>
<tr><td colspan="4">6.9 Livelihood Area – Page 115</td></tr>
</table>

RECURRENT AREAS	RECURRENT FEATURES
A.1 Corridors, Staircases and Entrance / Exit – Page 159 PWD ACCESS	F1. Lighting and Natural Ventilation – Page 167
A.2 Ordinary and PWD-accessible Toilets – Page 163 PWD ACCESS	F2. Artificial Ventilation – Page 170
	F.4 Lavatories and Faucets – Page 175 PWD ACCESS
	F.5 Septic Tanks – Page 176
	F.6 Degreasing Tanks, Soak Pits and Drainage Trenches – Page 181
	F.7 Fire Safety – Page 186

7. ADMINISTRATION

SPECIFIC AREAS			
Jail capacity			
A (Small)	B (Medium)	C (Large)	D (Very Large)
7.1 Warden's Quarter – Page 116			
7.2 Warden's Office – Page 116 PWD ACCESS			
7.3 Staff Quarters – Page 118			
7.4 Staff Office – Page 119 PWD ACCESS			
7.5 Office Supply Storage Area – Page 120			
7.6 Armory – Page 122			
7.7 Conference Room / Staff Training Room – Page 123		7.8 Conference Room – Page 123	
		7.9 Staff Training Room – Page 124	
7.10 Staff Kitchen / Dining Room / Food Storage Area – Page 126			
7.11 Fitness Room– Page 126		7.12 Staff Sports and Recreational Area – Page 127	
7.13 Parking Lot – Page 128			
	7.14 Motor pool – Page 130		

RECURRENT AREAS	RECURRENT FEATURES
A.1 Corridors, Staircases and Entrance / Exit – Page 159 PWD ACCESS	F1. Lighting and Natural Ventilation – Page 167
A.2 Ordinary and PWD-accessible Toilets – Page 163 PWD ACCESS	F2. Artificial Ventilation – Page 170
A.3 Ordinary and PWD-accessible Toilet and Bath – Page 166 PWD ACCESS	F.3 Air Conditioning – Page 172
	F.4 Lavatories and Faucets – Page 175 PWD ACCESS
	F.5 Septic Tanks – Page 176
	F.6 Degreasing Tanks, Soak Pits and Drainage Trenches – Page 181
	F.7 Fire Safety – Page 186

8. SECURITY

SPECIFIC AREAS			
Jail capacity			
A (Small)	B (Medium)	C (Large)	D (Very Large)
	8.1 Command Control – Page 131		
8.2 Guard House – Page 132			
8.3 Sally Port– Page 134			
8.4 Guard Tower – Page 135			
8.5 Dog-walk – Page 136			

SPECIFIC FEATURES
8.6 Main Perimeter Fence – Page 139
8.7 Catwalk – Page 141
8.8 Main Gate – Page 143
8.9 Pedestrian Gate – Page 145 PWD ACCESS
8.10 Secondary Perimeter Fence – Page 147
8.11 Inner Barriers – Page 149 PWD ACCESS
8.12 Control Post – Page 150

RECURRENT AREAS	RECURRENT FEATURES
A.1 Corridors, Staircases and Entrance / Exit – Page 159 PWD ACCESS	F1. Lighting and Natural Ventilation – Page 167
A.2 Ordinary and PWD-accessible Toilets – Page 163 PWD ACCESS	F2. Artificial Ventilation – Page 170
	F.3 Air Conditioning – Page 172
	F.4 Lavatories and Faucets – Page 175 PWD ACCESS
	F.5 Septic Tanks – Page 176
	F.6 Degreasing Tanks, Soak Pits and Drainage Trenches – Page 181
	F.7 Fire Safety – Page 186

9. ESSENTIAL SERVICES / UTILITIES

SPECIFIC AREAS			
Jail capacity			
A (Small)	B (Medium)	C (Large)	D (Very Large)
9.1 Power Room – Page 151			

SPECIFIC FEATURES
9.2 General Water Supply – Page 152
9.3 Water Storage – Page 154

10. SOLID WASTE MANAGEMENT

SPECIFIC AREAS			
Jail capacity			
A (Small)	B (Medium)	C (Large)	D (Very Large)
10.1 Garbage Collection Area – Page 156			

RECURRENT FEATURES
F.6 Degreasing Tanks, Soak Pits and Drainage Trenches – Page 181

LIST OF THE STANDARDS

SPECIFIC AREAS AND FEATURES:

1. COMMITMENT:	Page
1.1 Holding Cell	22
1.2 Reception / Counter / Processing Area	25
1.3 Reception / Counter Area	27
1.4 Processing Area / Desk Photo-booth	29
1.5 Diagnostic Room / Body-search / Orientation Area	31
1.6 Diagnostic Room / Body-search Area	32
1.7 Body-search Area	33
1.8 Diagnostic Room	34
1.9 Orientation Room	36
1.10 Post-holding Cell	38
1.11 PCCU (PDL Classification Counseling Unit)	39
1.12 Quarantine Room	40
2. ACCOMMODATION:	**Page**
2.1 Sleeping and Dining Area	42
2.2 Cell Toilet and Bath	44
2.3 Single-accommodation Cell	46
2.4 Recreation Area	48
2.5 Windows for Cells and Recreation Areas	49
2.6 Doors for Cells and Recreation Areas	51
2.7 Bunk Bed	54
2.8 Open Shelves	54
3. VISITATION:	**Page**
3.1 Visitors Holding Area	57
3.2 Visitors Processing Area	58
3.3 Searching Area for Visitors	60
3.4 Strip-searching Area	62
3.5 Visitors Area for Contact Visit	63
3.6 Visitors Area for Official Visit	64
3.7 Commissary	65
3.8 Teleconferencing Room (e-Dalaw)	66
3.9 Conjugal Visit Room	67
3.10 Visitors Area for Non-Contact Visit	68

4. HEALTH SERVICES:	Page
4.1 Patient Reception Area	70
4.2 Consultation Room / Dental Office / Nurse Station / Equipment Area / Supply-Room / Pharmacy	71
4.3 Consultation Room / Nurse Station / Health Staff Office	75
4.4 Consultation Room	77
4.5 Nurse Station	79
4.6 Health Staff Office	80
4.7 Dental Office / Maternal / Pre-natal Care Area	81
4.8 Dental Office	82
4.9 Maternal / Pre-natal Care Area	83
4.10 Equipment Area / Supply Room / Pharmacy	84
4.11 Equipment Area	85
4.12 Supply Room / Pharmacy	86
4.13 Isolation Cells for TB and MDR-TB	87
4.14 Isolation Cells for Other Infectious Diseases	88
4.15 Sputum Collection Area	89
4.16 Patients' Ward	90
4.17 Laboratory	92
4.18 Medical Imaging, X-Ray	94
4.19 Temporary Observation Ward	96
5. FOOD SERVICES :	**Page**
5.1 Kitchen Area	97
5.2 Food Distribution Area	99
5.3 Food Storage Area	100
5.4 Kitchen-waste Collection Area	101
5.5 Fuel Storage Area	102
5.6 Kitchen-staff Office	103
5.7 Kitchen-aide Cell	104
5.8 Kitchen Water-storage	104
6. DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES:	**Page**
6.1 Outdoor Access	106
6.2 Laundry Area	107
6.3 Worship Area	109
6.4 Training Room / ALS Room / Library	110
6.5 Training Room	111
6.6 ALS Room / Library	112
6.7 ALS Room	113
6.8 Library	114
6.9 Livelihood Area	115

7. ADMINISTRATION:	Page
7.1 Warden's Quarter	116
7.2 Warden's Office	117
7.3 Staff Quarters	118
7.4 Staff Office	119
7.5 Office Supply Storage Area	120
7.6 Armory	122
7.7 Conference Room / Staff Training Room	123
7.8 Conference Room	124
7.9 Staff Training Room	125
7.10 Staff Kitchen / Dining Room / Food Storage Area	126
7.11 Fitness Room	127
7.12 Staff Sports and Recreational Area	128
7.13 Parking Lot	128
7.14 Motor pool	130
8. SECURITY:	**Page**
8.1 Command Control	131
8.2 Guard House	132
8.3 Sally Port	134
8.4 Guard Tower	135
8.5 Dog-walk	137
8.6 Main Perimeter Fence	139
8.7 Catwalk	141
8.8 Main Gate	143
8.9 Pedestrian Gate	145
8.10 Secondary Perimeter Fence	147
8.11 Inner Barriers	149
8.12 Control Post	149
9. ESSENTIAL SERVICES / UTILITIES:	**Page**
9.1 Power Room	151
9.2 General Water Supply	152
9.3 Water Storage	155
10. SOLID WASTE MANAGEMENT:	**Page**
10.1 Garbage Collection Area	157

RECURRENT AREAS:

LIST	Page
A.1 Corridors, Staircases and Entrance / Exit	159
A.2 Ordinary and PWD-accessible Toilets	164
A.3 Ordinary and PWD-accessible Toilet and Bath	166

RECURRENT FEATURES:

LIST	Page
F1. Lighting and Natural Ventilation	168
F2. Artificial Ventilation	171
F.3 Air Conditioning	172
F.4 Lavatories and Faucets	174
F.5 Septic Tanks	176
F.6 Degreasing Tanks, Soak Pits and Drainage Trenches	181
F.7 Fire Safety	186

1. COMMITMENT :

1.1 Holding Cell

CAPACITY RANGE

☒ **A: 1-100** ☒**101-500** ☒**501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Holding Cell** is a room in which PDL wait their turn for their documents to be processed.

An **Ordinary Toilet** (see page 166) and a **Lavatory** (see page 174) must be attached to the cell.

DESCRIPTION

LOCATION:

- Near the **Main Gate** (see page 143);
- Must be on the ground-floor.

DIMENSIONS:

A (small)	At least 6 sq. m
B (medium)	At least 18 sq. m
C (large) to D (very large)	At least 24 sq. m

- For Categories A (small), these dimensions do not include space for an **Ordinary Toilet** and a **Lavatory**;
- For Categories B (medium), C (large) and D (very large), these dimensions include the space required for an **Ordinary Toilet** and a **Lavatory.**

NUMBER:

N/A.

CHARACTERISTICS:

- Reinforced CHB masonry walls in paint finish;
- Grills shall be used for partition at the front of the cell;
- Grill Door should be at least 0.7 m in width;
- The area should be equipped with adapted **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

REMARKS

Possible designs are shown on the figures below.

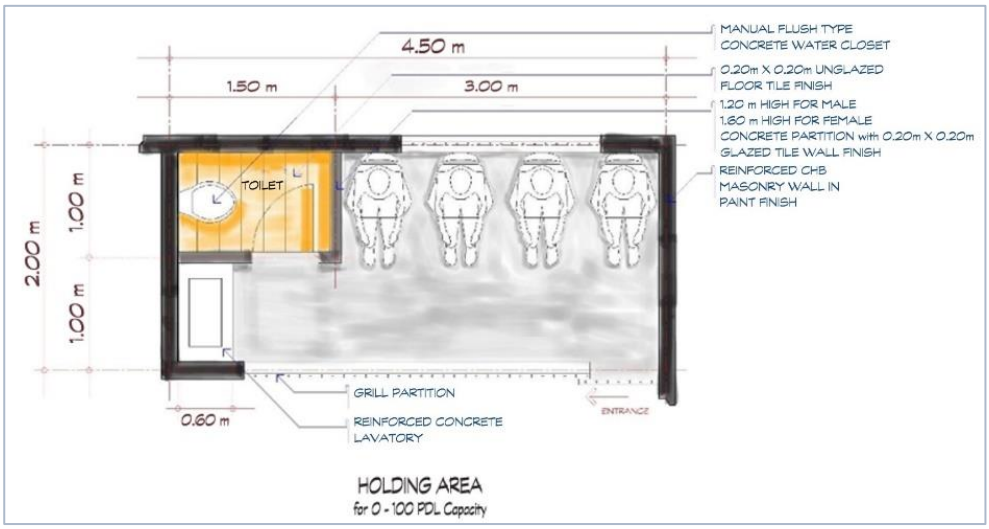


Figure 1: Holding Room for Type A Facilities (1-100 PDL capacity)

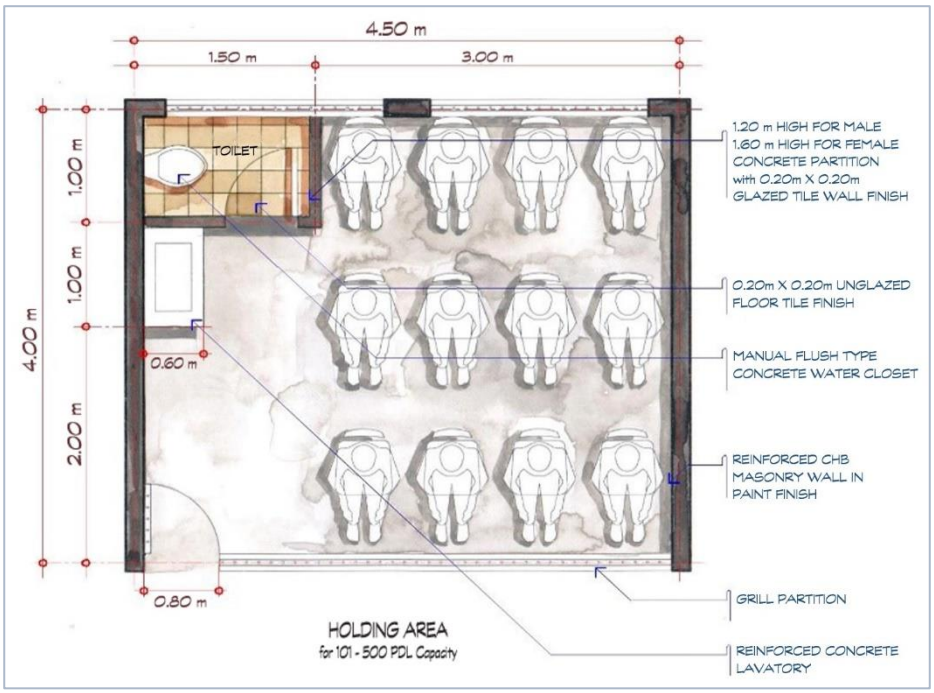


Figure 2: Holding Room for Type B Facilities (101-500 PDL capacity)

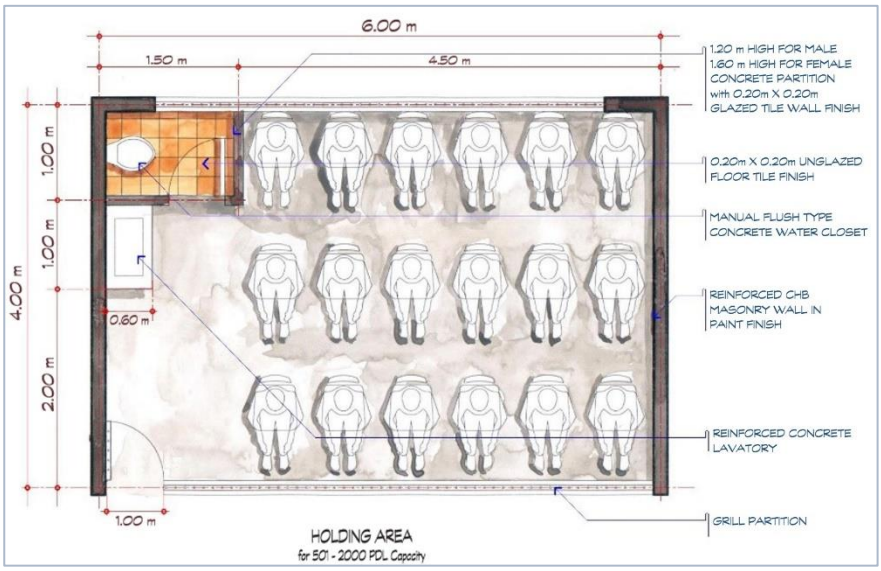


Figure 3: Holding Room for Type C and D Facilities (501-2000 PDL capacity)

1. COMMITMENT :

1.2 Reception / Counter / Processing Area

CAPACITY RANGE

☒ **A: A: 1-100** ☒ **B: 101-500** ☐ **C: 501-1000** ☐ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Reception / Counter / Processing Area** is a room where PDL are received when they arrive and are about to be committed at BJMP jail facilities. The jail officer accomplishes a jail booking report attaching thereto the newly committed PDL personal information, medical evaluation and photograph for reference. It is managed by a receiving officer or desk officer and gater.

The **Reception / Counter / Processing Area**, making up the Processing Unit, is an indoor facility that requires an office desk, table and chair to be used by BJMP personnel and by PDL upon their commitment. There should also be a storage cabinet for the compilations of various records and documents of PDL.

This area should be secured by BJMP personnel who are assigned in the commitment procedure.

DESCRIPTION

LOCATION:

- Near the **Main Gate** (see page 143);
- Must be on the ground-floor.

DIMENSIONS:

At least 5.00 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Reinforced CHB masonry walls in paint finish;
- The area should be equipped with adapted **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

REMARKS

- Consider egress when positioning the door;
- A possible design is shown on the figure below.

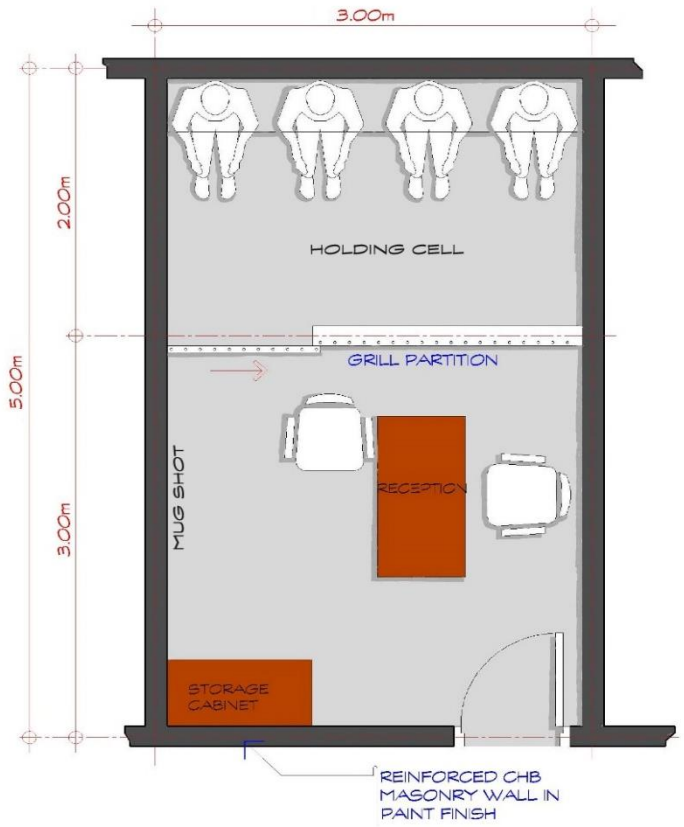


Figure 4: Reception / Counter / Processing Area for Type A and B Facilities (1-500 PDL capacity)

1. COMMITMENT :

1.3 Reception / Counter Area

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Reception / Counter Area** is a place where PDL are received when they arrive and are about to be committed at BJMP jail facilities. It is managed by a receiving officer or desk officer and a gater.

The Processing Unit is an indoor facility that requires an office desk, table and chair to be used by BJMP personnel and by PDL upon their commitment. There should also be a storage cabinet for the compilations of various records and documents of PDL.

This area should be secured by BJMP personnel who are assigned in the commitment procedure.

DESCRIPTION

LOCATION:

- Near the **Main Gate** (see page 143);
- Must be on the ground-floor.

DIMENSIONS:

At least 3 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Reinforced CHB masonry walls in paint finish;
- The area should be equipped with adapted **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

REMARKS

A possible design is shown on the figure below.

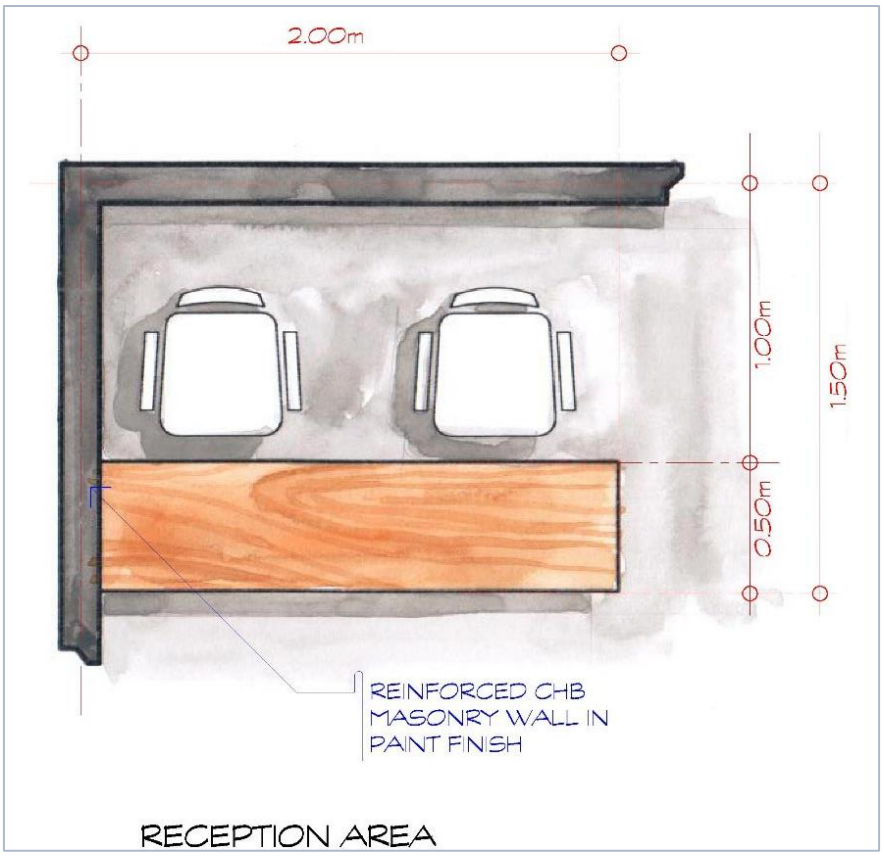


Figure 5: Reception / Counter Area for Type C and D Facilities (501-2000 PDL capacity)

1. COMMITMENT :

1.4 Processing Area / Desk Photo-booth

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Processing Area / Desk Photo-booth** is the area where the jail officer accomplishes a Jail Booking Report attaching thereto the newly committed PDL personal information, medical evaluation, and photograph for reference.

The **Desk Photo-booth** is the area in the Processing Unit where the Photographic-portrait of a person, typically from the waist up, is taken after a person is committed. The mug-shot is compiled into the records books to determine the identity of the newly committed PDL.

The area must contain a standard BJMP mug-shot backdrop camera, a biometric scanner and a computer with webcam. There should also be a storage cabinet for the compilations of various records and documents of PDL.

This area should be secured by BJMP personnel who are assigned in the commitment procedure (preferably at least two staffs).

DESCRIPTION

LOCATION:

- Near the **Counter Area** (see page 27);
- Must be on the ground-floor.

DIMENSIONS:

At least 6 sq. m.

NUMBER:

2 Photo-booths.

CHARACTERISTICS:

- Reinforced CHB masonry walls in paint finish;
- The area should have sufficient **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

REMARKS

A possible design is shown on the figure below.

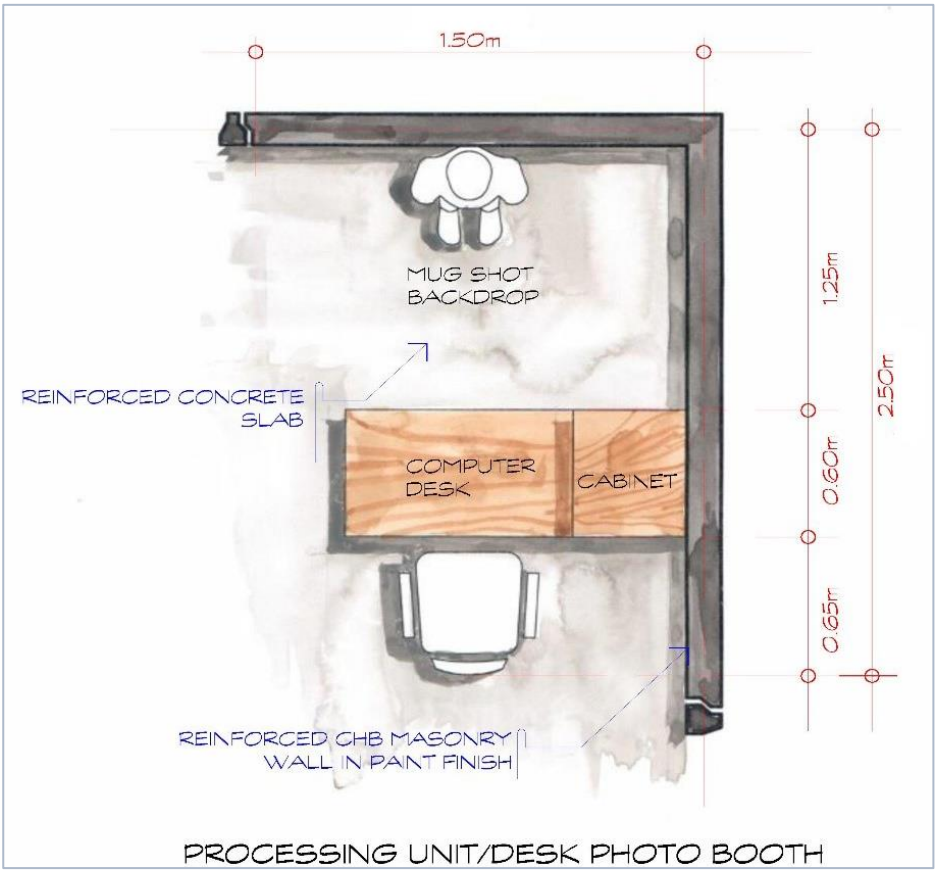


Figure 6: Processing Area / Desk Photo-booth for Type C and D Facilities (501-2000 PDL capacity) - One Photo-booth shown

1. COMMITMENT :

1.5 Diagnostic Room / Body-search / Orientation Area

CAPACITY RANGE

☒ **A: 1-100** ☐ **B: 101-500** ☐ **C: 501-1000** ☐ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Diagnostic Room / Body-search / Orientation Area** is a room used for:

- Medical-examination of newly committed PDL for screening;
- **Body-search** conducted to search and seize prohibited items, stolen goods or evidence of a crime;
- **Orientation** of PDL ensuring awareness and understanding of jail rules and regulations.

One PDL is processed at a time in the presence of a BJMP Health Officer.

The room should contain essential furniture and relevant medical equipment.

A **Toilet and Bath** (see page 166) may be attached to the room or located nearby in order to allow PDL to take a bath before Medical-examination.

DESCRIPTION

LOCATION:

- Near the **Counter Area** (see page 27);
- Must be on the ground floor.

DIMENSIONS:

At least 16 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Reinforced CHB masonry walls in paint finish;
- Allow some measure of visibility (panel glass door);
- Curtain Partition Wall (privacy drape for body-search);
- Closed room with sufficient **Natural Lighting and Ventilation** (see page 167).

1. COMMITMENT :

1.6 Diagnostic Room / Body-search Area

CAPACITY RANGE

☐ **A: 1-100** ☒ **B: 101-500** ☐ **C: 501-1000** ☐ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Diagnostic Room / Body-search Area** is a room used for:

- Medical-examination of newly committed PDL for Screening;
- **Body-search** conducted to search and seize prohibited items, stolen goods or evidence of a crime.

If more than one PDL is committed at one time, then a partition of the room will be made accordingly. Visual and acoustic privacy should be ensured.

A **Toilet and Bath** (see page 166) may be attached to the room or located nearby in order to allow PDL to take a bath before Medical Examination. The room should contain essential furniture and relevant medical equipment.

DESCRIPTION

LOCATION:

- Near the **Counter Area** (see page 27);
- Must be on the ground floor.

DIMENSIONS:

At least 16 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Reinforced CHB masonry walls in paint finish;
- Allow some measure of visibility (glass-panel door);
- Curtain partition wall (privacy drape for body-search);
- Closed room with **Natural Lighting and Ventilation** (see page 167).

1. COMMITMENT :

1.7 Body-search Area

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Body-search Area** is a place to conduct the **Body-search** of PDL to search and seize prohibited items, stolen goods or evidence of a crime.

DESCRIPTION

LOCATION:

- Must be on the ground floor Near the **Processing Area** (see page 29).
- Attached to the **Diagnostic Room** (see page 34);

DIMENSIONS:

At least 3 sq. m.

NUMBER:

2 units.

CHARACTERISTICS:

- The area can be enclosed with a partition made of curtains or any other suitable means;
- The area should have sufficient **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

1. COMMITMENT :

1.8 Diagnostic Room

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Diagnostic Room** is a room used for the Medical-examination of newly committed PDL for screening. It should contain essential furniture and relevant medical equipment including a Dental-chair and Portable X-ray.

- The room should contain essential furniture and relevant medical equipment.
- One or more **Toilet and Bath** (see page 166) must be attached to the room(s) or located nearby in order to allow PDL to take a bath before Medical Examination.

DESCRIPTION

LOCATION:

- Preferably on the ground floor;
- Near the **Processing Area** (see page 29).

DIMENSIONS:

- At least 16 sq. m.
- Examination-table dimensions : 0.8 m x 1.9 m = 1.5 sq. m ;
- Space allocation for the Dental-chair: 1.5 m x 0.9 m = 1.35 sq. m.

NUMBER:

More than one room can be considered.

CHARACTERISTICS:

- Reinforced CHB masonry walls in paint finish;
- The room should contain a **Lavatory** (see page 174);
- Reinforced concrete counter, tile-finished (recommended);
- Stainless sink lavatory (recommended);
- Closed room with **Natural Lighting and Ventilation** (see page 167).

REMARKS

- Consider egress when positioning the door;
- A possible design is shown on the figure below.

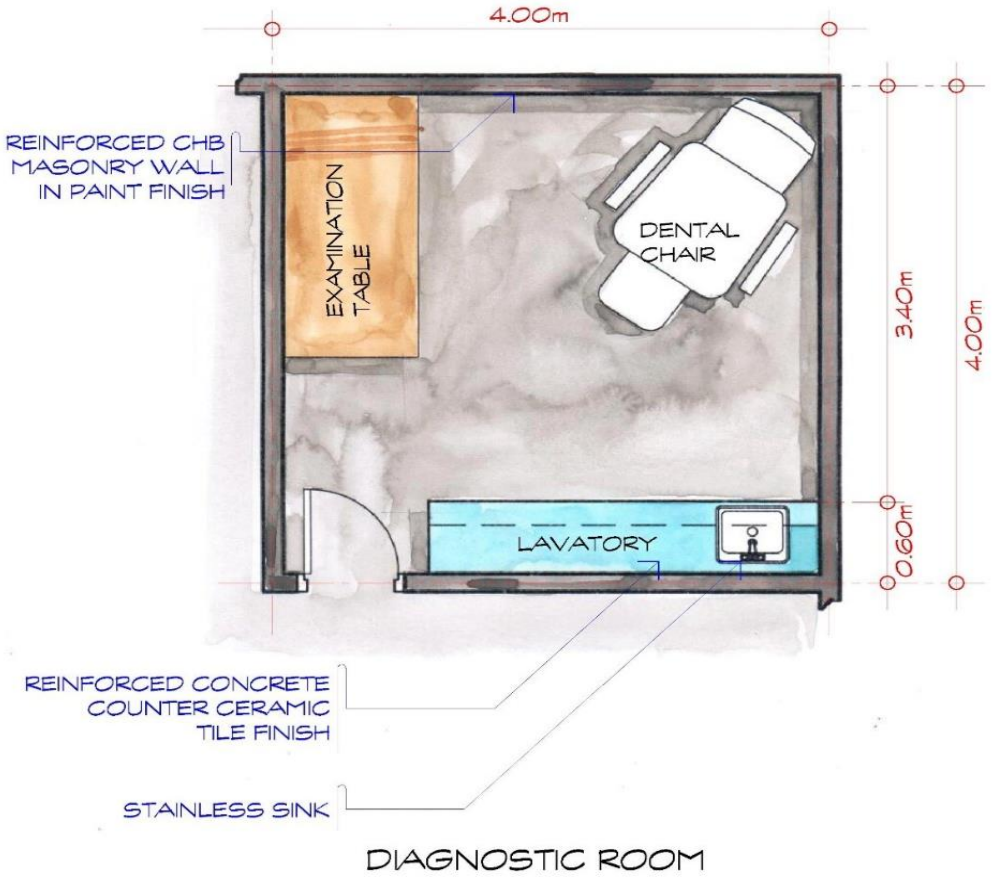


Figure 7: Proposed Layout of a Diagnostic Room for Type C and D Facilities (501-2000 PDL capacity)

1. COMMITMENT :

1.9 Orientation Room

CAPACITY RANGE

☐ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Orientation Room** is a place where **Orientation** of PDL is conducted to ensure awareness and understanding of jail rules and regulations. It must contain at least chairs.

The room must have an accessible **Ordinary Toilet** (see page 163).

DESCRIPTION

LOCATION:

Near the **Diagnostic Room** (see page 33).

DIMENSIONS:

- At least 12 sq. m;
- 12 PDL capacity.

NUMBER:

N/A.

CHARACTERISTICS:

- Reinforced CHB masonry walls in paint finish;
- Install CCTV, white board with marker, video projector (optional);
- **Natural Lighting and Ventilation** (see page 167).

REMARKS

- Consider egress when positioning the door;
- A possible design is shown on the figure below.

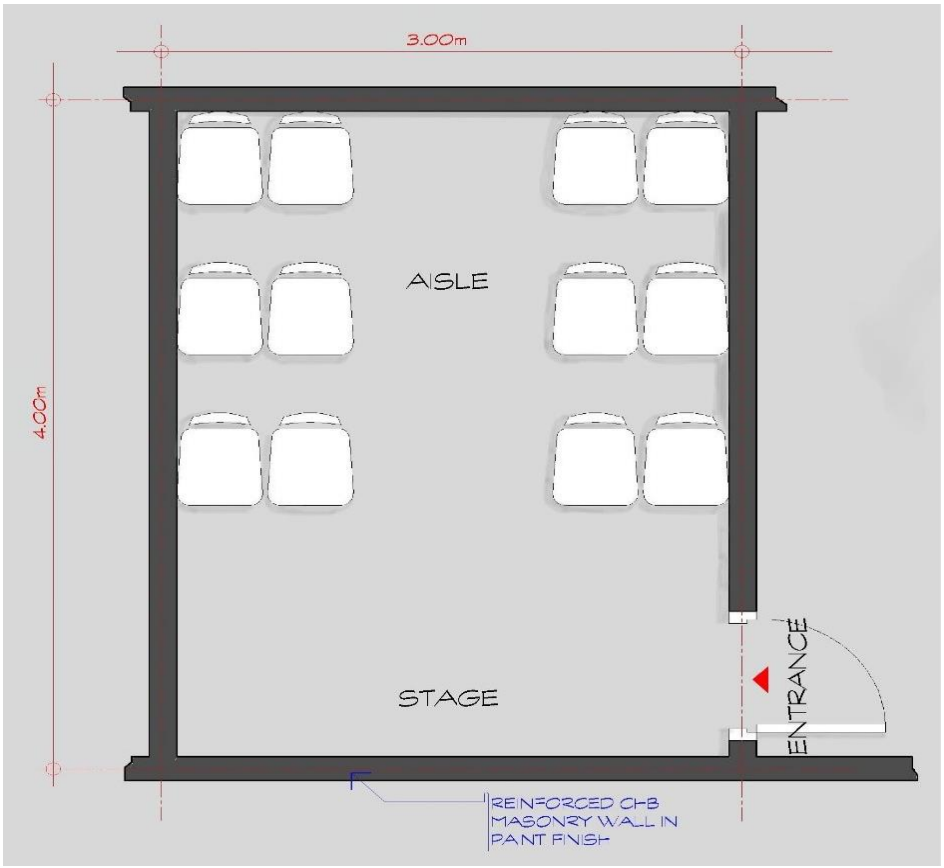


Figure 8: Orientation Room for Type B, C and D Facilities (101-2000 PDL capacity)

1. COMMITMENT :

1.10 Post-holding Cell

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Post-holding cell** is a room in which PDL are temporarily held before they will be classified according to their cell assignment in the **PCCU**, or escorted to court hearing or transferred to another facility. Beds are not a requirement for holding cells. It must contain at least chairs.

DESCRIPTION

LOCATION:

Preferably near the **Sally Port** (see 134**).**

DIMENSIONS:

A (small)	At least 6 sq. m
B (medium)	At least 18 sq. m
C (large) to D (very large)	At least 24 sq. m

NUMBER:

N/A.

CHARACTERISTICS:

- The cell must be equipped with grilled walls and door;
- **Natural Lighting and Ventilation** (see page 167).

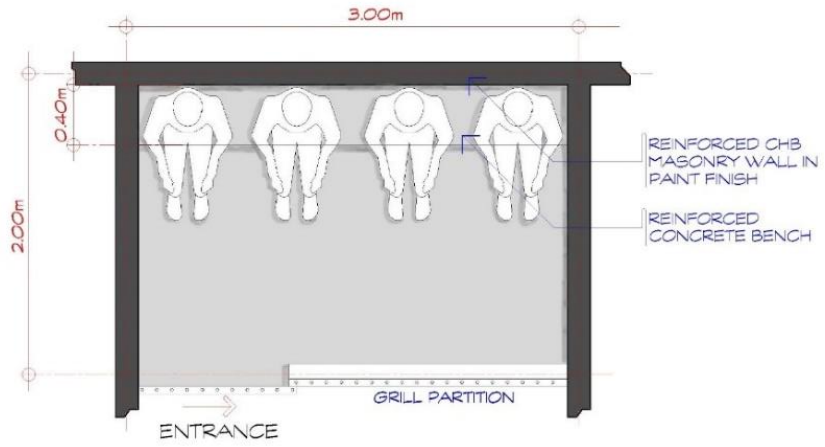


Figure 9: Post-holding Cell for Type A Jail Facilities (1-100 PDL capacity)

1. COMMITMENT :

1.11 PCCU (PDL Classification Counseling Unit)

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **PCCU (PDL Classification Counseling Unit)** is a cell or group of cells where the newly committed PDL are temporarily assigned until the completion of the Classification process. Only PDL not affected by any communicable disease are kept in the **PCCU**. PDL affected with communicable diseases are kept in the **Quarantine Room** (see page 40).

PCCU has the same kind of equipment a characteristics as ordinary cells (**Cells Toilet and Bath**, see page 44; **Bunk-beds**, see page 54, etc.).

DESCRIPTION

LOCATION:

When PCCU is made of more than one cell, at least one should be on the ground floor.

DIMENSIONS:

- At least 48 sq. m;
- Each cell has a capacity of 10 PDL. See page 42.

NUMBER:

A (small)	1 cell
B (medium)	2 cells
C (large)	3 cells
D (very large)	4 cells

CHARACTERISTICS:

See **Sleeping and Dining Area** page 42.

1. COMMITMENT :

1.12 Quarantine Room

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

A **Quarantine room** is a cell where PDL with Communicable Diseases. The **Quarantine room** serves as **PCCU** for PDL affected with Communicable Diseases.

It has the same kind of equipment and characteristics as ordinary cells (**Cells Toilet and Bath**, see page 44; **Bunk-beds**, see page 54, etc.).

DESCRIPTION

LOCATION:

Preferably on the ground floor and away from other PDL ordinary detention cells.

DIMENSIONS:

A (small) and B (medium)	At least 24 sq. m
C (large) and D (very large)	At least 48 sq. m

- In small to medium facilities the capacity of the quarantine room is 5 PDL;
- In large to very large facilities the capacity of the quarantine room is 10 PDL.

NUMBER:

At least 1.

CHARACTERISTICS:

- See **Sleeping and Dining Area** page 42;
- A possible design is shown on the figure below.

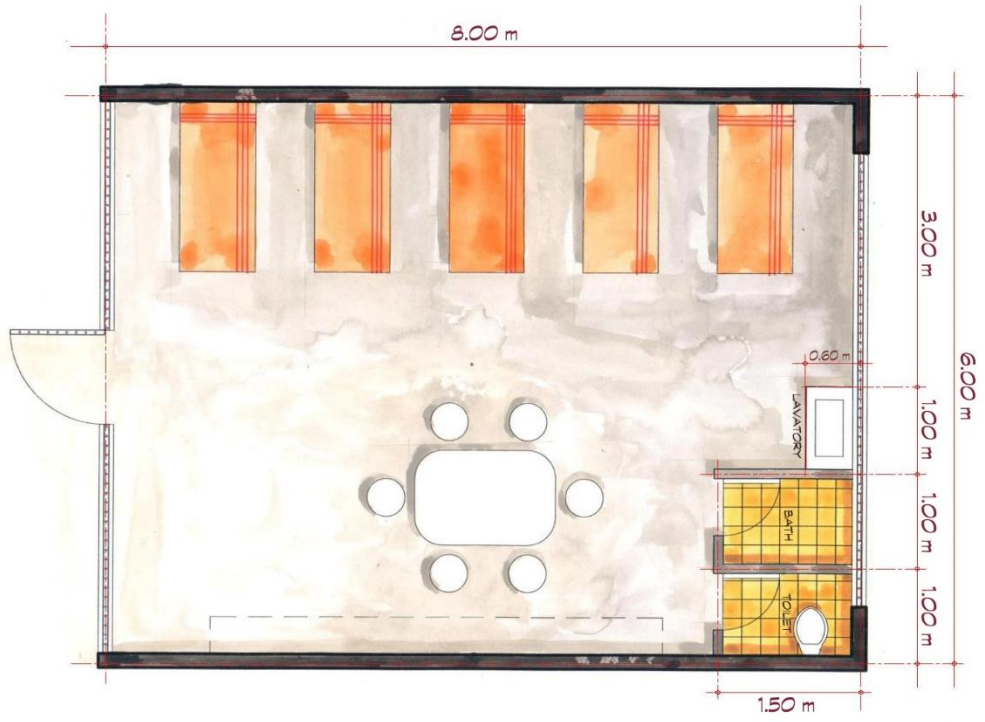


Figure 10: Quarantine Room for Type C and D Jail Facilities (501-2000 PDL capacity).

2. ACCOMMODATION:

2.1 Sleeping and Dining Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Sleeping and Dining Area** is a jail cell where more than one PDL sleep, eat, and have access to sanitary facilities. It is equipped with **Bunk-beds** (see page 54) and **Open Shelves** (see page 56) and has an attached cell **Toilet and Bath** (see page 44).

DESCRIPTION

LOCATION:

- In Cells Buildings or next to the kitchen (for **Kitchen Aide Cells**, see page 104).
- At least one (1) cell must be located on the ground floor and be accessible to PWD (wheelchair).

DIMENSIONS:

- Area: At least 4.3 sq. m per PDL capacity, 4.7 sq. m per PDL including Toilet and Bath (see page 44);
- The **Sleeping and Dining Area** capacity must not exceed 10 PDL (44 sq. m);
- Ceiling Height: At least 3 m.

NUMBER:

The number of cells in a building should preferably allow a ratio of 10 PDL/cell.

CHARACTERISTICS:

- See Figure 11
- Floor: plain cement finish.
- Walls:
  - Thickness: 150 mm (6“);
  - CHB masonry walls in plain cement plaster finish at both sides;
  - Painted finish.
- Grills:
  - Made of 25mm and plain round bar with ¼” thk x 2” flat bar;
  - Vertical Grills: 25mm Diameter plain bars @ 0.10m on centers;
  - Frame: 2”x ¼” thk Flat Bar;
  - Horizontal support: 2”x ¼” thk Flat Bar @0.60m on centers maximum spacing;
  - Position: Facing the corridor;
  - Height: Provide “zocalo” of :
    - 0.3 m height for interior cells and of
    - 0.9 m height for cells opening onto a corridor with opening to the outdoors.

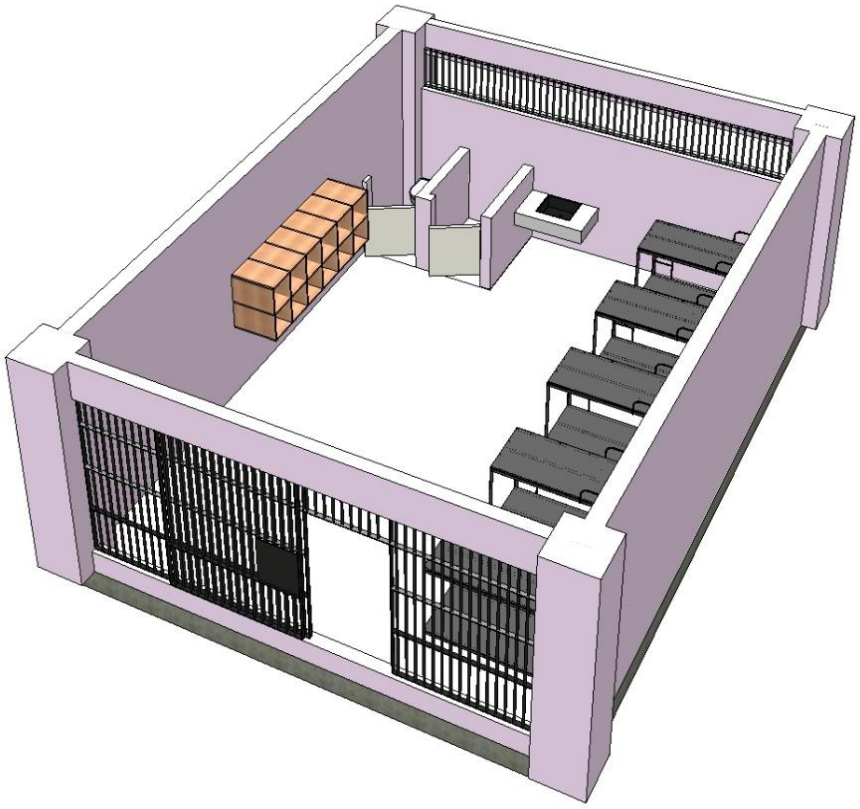


Figure 11: Standard Layout of a Cell for 10 PDL

2. ACCOMMODATION:

2.2 Cell Toilet and Bath

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☒ NO ☐
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Cell Toilet and Bath** (see Figure 12 below) is a room where PDL can bathe and satisfy their personal necessities. It must include:

- a Water Closet;
- a Wash Area consisting of a **Lavatory** (see page 174);
- a Bath Area;
- **Faucets** (see page 174).

The room must be accessible at all time to PDL while they are staying in the **Sleeping and Dining Area** (see page 42).

LOCATION:

Attached to the **Sleeping and Dining Area**.

DIMENSIONS:

- At least 0.4 sq. m per PDL capacity, with a minimum of 1.2 sq. m;
  - Smallest dimension is 0.9 m.
- The **Cell Toilet and Bath** capacity must not exceed 10 PDL (4 sq. m);
- Partition/wall height:
  - Female: 1.60 m;
  - Male: 1.20 m.
- Access opening: At least 0.60 m;
- Ceiling Height: At least 3 m.

NUMBER:

1 water closet (toilet bowl)/10 PDL.

CHARACTERISTICS:

- Access opening: door or curtain;
- Common toilet:
  - "Buhos" (manual flushing) type;
- One **Lavatory** and two **Faucets**; one for bath, and one for **Lavatory** (see page 174);
- One **Faucet** (see page 174) for **Toilet** flushing.
- **Walls**:
  - Concrete Hollow-Block(CHB);

- Thickness: 100 mm (4”);
- 0.20 m x 0.20 m (recommended size) ceramic glazed-tile finish at least in the bathroom;
- Tiled wall height: Partition wall;
- Walls in the toilet must be painted if not tiled.

- **Floor**:
  - 0.20 m x 0.20 m (recommended size) ceramic unglazed tile.

REMARKS

- Aspects of the design appear on Figure 12;
- **Ordinary and PWD-accessible Toilet and Bath** (see page 166) have a different design. They are not used in cells with the exception of the cell accessible to PDL with disability that must be located on the ground-floor of at least one Cells Building.



Figure 12: Sample of Design of a Toilet and Bath of a Cell for 10 PDL.

2. ACCOMMODATION:

2.3 Single-accommodation Cell

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

A **Single-accommodation Cell** is a cell that holds only one PDL. It is meant to be used for Disciplinary Measures or for newly committed PDL with erratic behavior.

The cell is equipped with a **Toilet and Bath** (see page 166) and with a **Lavatory** (see page 174).

DESCRIPTION

LOCATION:

In the Cells Building.

DIMENSIONS:

- Area : 6 sq. m including **Toilet and Bath** (see page 166);
- Partition/wall height:
  - Female: 1.6 m;
  - Male: 1.2 m.
- Access opening: At least 0.60 m;
- Ceiling Height: At least 3 m.

NUMBER:

At least 1 in every jail.

CHARACTERISTICS:

- See Figure 13;
- Access opening: door or curtain;
- **Ordinary Toilet** (see page 163):
  - Buhos" (manual flushing) type;
  - One **Faucet** (see page 174) for flushing;
- Walls:
  - Concrete Hollow-Block(CHB) wall;
  - Thickness: 100 mm (4");
  - Tiled wall height: Partition wall;
  - 0.20 m x 0.20 m (recommended size) ceramic glazed tile finish walls.

- Floor:
  - 0.20 m x 0.20 m (recommended size) ceramic unglazed tile.
- One **Lavatory** and two **Faucets** (one for bathing, and one for the lavatory, see page 174).

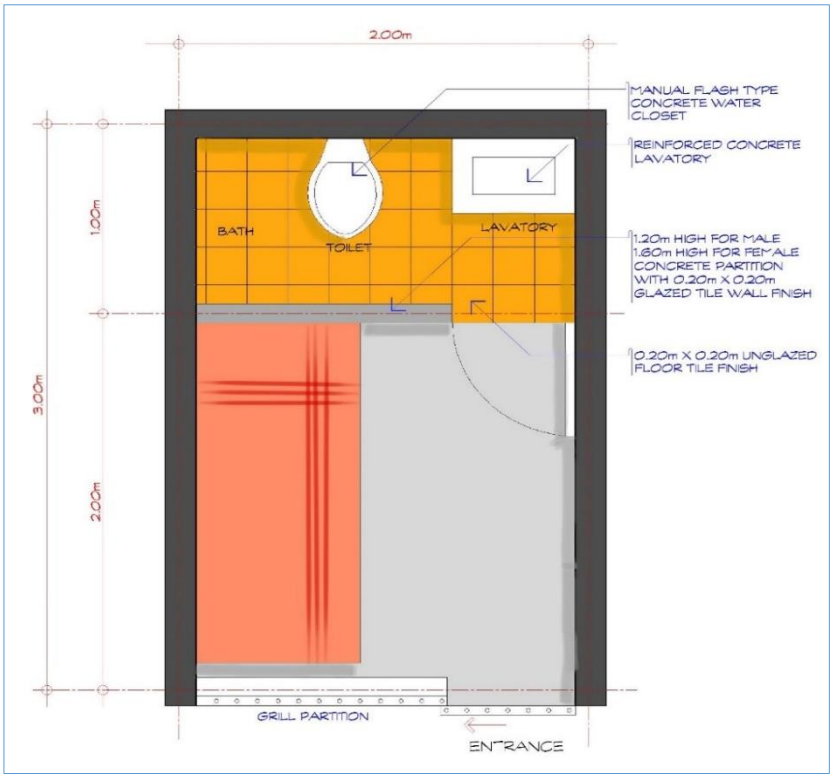


Figure 13: Proposed Layout of a Single Accommodation Cell

2. ACCOMMODATION:

2.4 Recreation Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Recreation Area** is an indoor area that allows PDL to enjoy Entertainment Activities such as indoor sports, reading, music and acquaintances with other PDL.

It may include tables and chairs.

DESCRIPTION

LOCATION:

Must be accessible from all ordinary cells at all times during the day.

DIMENSIONS:

At least 1 sq. m / PDL capacity.

NUMBER:

N/A.

CHARACTERISTICS:

- Plain cement flooring, painted walls;
- Sufficient **Lighting and Ventilation** (see page 167).

2. ACCOMMODATION:

2.5 Windows for Cells and Recreation Areas

DEFINITION

The **Windows for Cells and Recreation Areas** are openings allowing Fresh Air and Natural Light to enter the cells or recreation areas. The windows should be equipped with Barriers to prevent PDL from seeing beyond the facility, escaping, and getting contraband items from the outside.

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☒ NO ☐
- Specific Provisions for PWD Access? YES ☐ NO ☒

DESCRIPTION

LOCATION:

- On the walls of **Sleeping and Dining Area** (see page 42) and of **Recreation Area** (see page 48);
- The bottom of windows should be at least at 1.4 m from the floor.

DIMENSIONS:

- "The windows shall be large enough to enable the detainees to read or work by natural light, and shall be constructed to allow the entrance of fresh air whether or not there is artificial ventilation" (From UN Standard Minimum Rules for the Treatment of Prisoners; the Nelson Mandela Rules).
- Windows opening area must be at least 10% of the Floor Area;
- Vertical grills must be 25 mm in diameter plain bar. Their spacing must be 0.10 m on center;
  - Maximum distance between horizontal support must not be more than 0.20 m;
- Horizontal supports must be ¼" thk x 2" flat bar.

Computation for a 10 PDL cell:

Cell Area = 48 sq. m (6 m x 8 m)
Consider 10% of the Floor Area: 48 sq. m / 10 = 4.8 sq. m

a. Solving for the Width of the Window (W) considering a 5.65 m Length

$$W = \frac{4.8 \text{ sq. m}}{5.65 \text{ m}} = 0.85 \text{ m}$$

b. Solving for the Horizontal Support Spacing:
Minimum spacing = 0.20 m
Number of Divisions = Width of the Window / Minimum Spacing

$$D = \frac{0.85 \text{ m}}{0.2 \text{ m}} = 4.25 \approx 5$$

Spacing (S) = Width of the Window / Number of Divisions

$$S = \frac{0.85 \text{ m}}{5} = 0.17 \text{ m}$$

- See Figure 14.

- For High Risk facilities:
  - All windows must have Security Louvers which are offset of at least 1 m;
  - Gauge 24 GI sheet Louver spaced at least 5 cm on center;
  - 2" x 2" x ¼" Angle Bar Frame.
  - See Figure 15.

NUMBER:

N/A.

CHARACTERISTICS:

- Windows located on the ground floor must be equipped with Security Louvers.

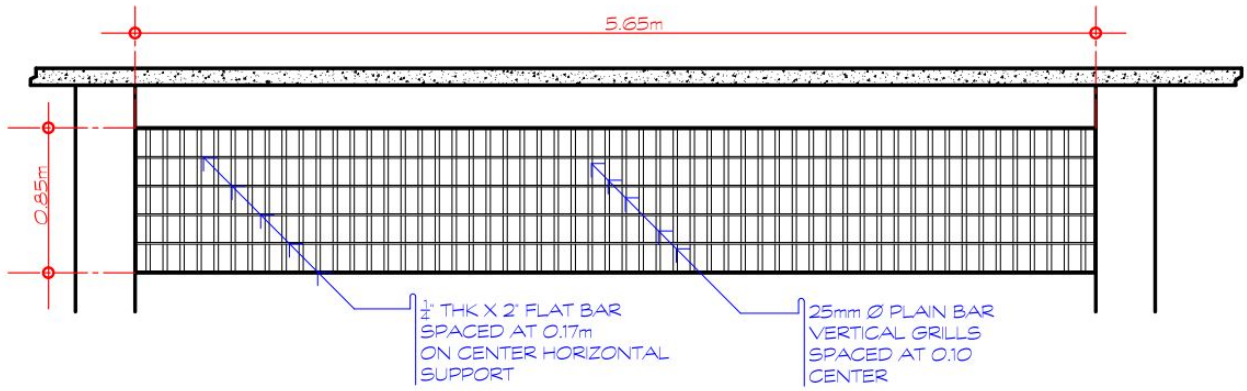


Figure 14: Details of Cell Windows

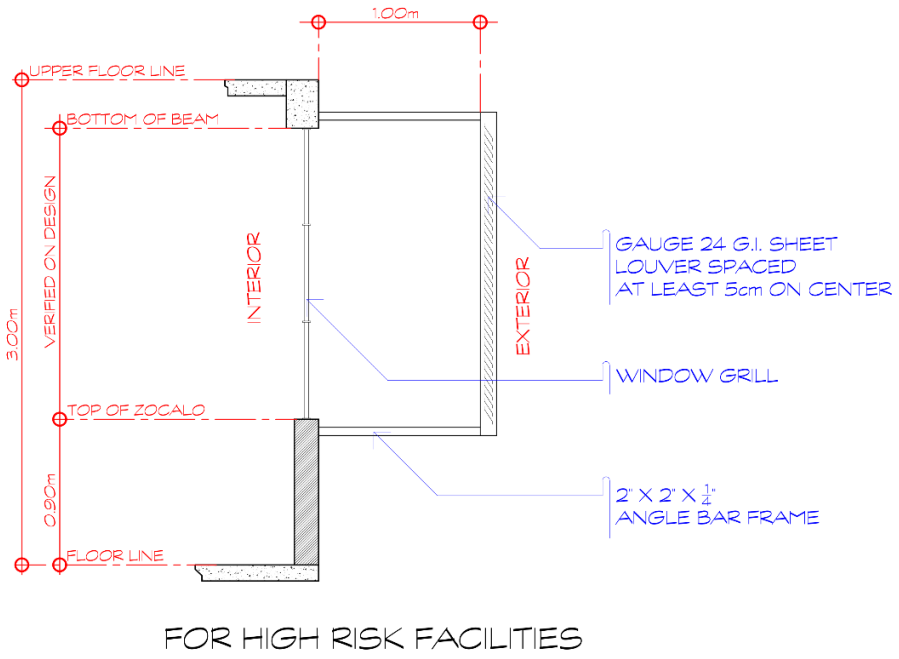


Figure 15: Proposed Layout of Windows used in High Risk Facilities

2. ACCOMMODATION:

2.6 Doors for Cells and Recreation Areas

DEFINITION

The **Doors for Cells and Recreation Areas** are openings allowing people entering cells or recreation areas. The doors should be lockable in order to manage PDL movements in and out from these areas.

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DESCRIPTION

LOCATION:

- In the **Corridors** (see page 159) of access to **Sleeping and Dining Area** (see page 42) and of **Recreation Area** (see page 48).

DIMENSIONS:

- Main cell door dimensions should be: 1 m x 2.1 m (sliding type)

NUMBER:

1 cell door per cell

CHARACTERISTICS:

- See Figure 16 and Figure 17 for details of the design;
- Doors must be made of 25mm diameter plain bar spaced @ 0.10 m on centers;
- Locking system shall be barrel-bolt type equipped with chain and provided with 1.2 m x 1.2 m backing plate 3/16" thk.

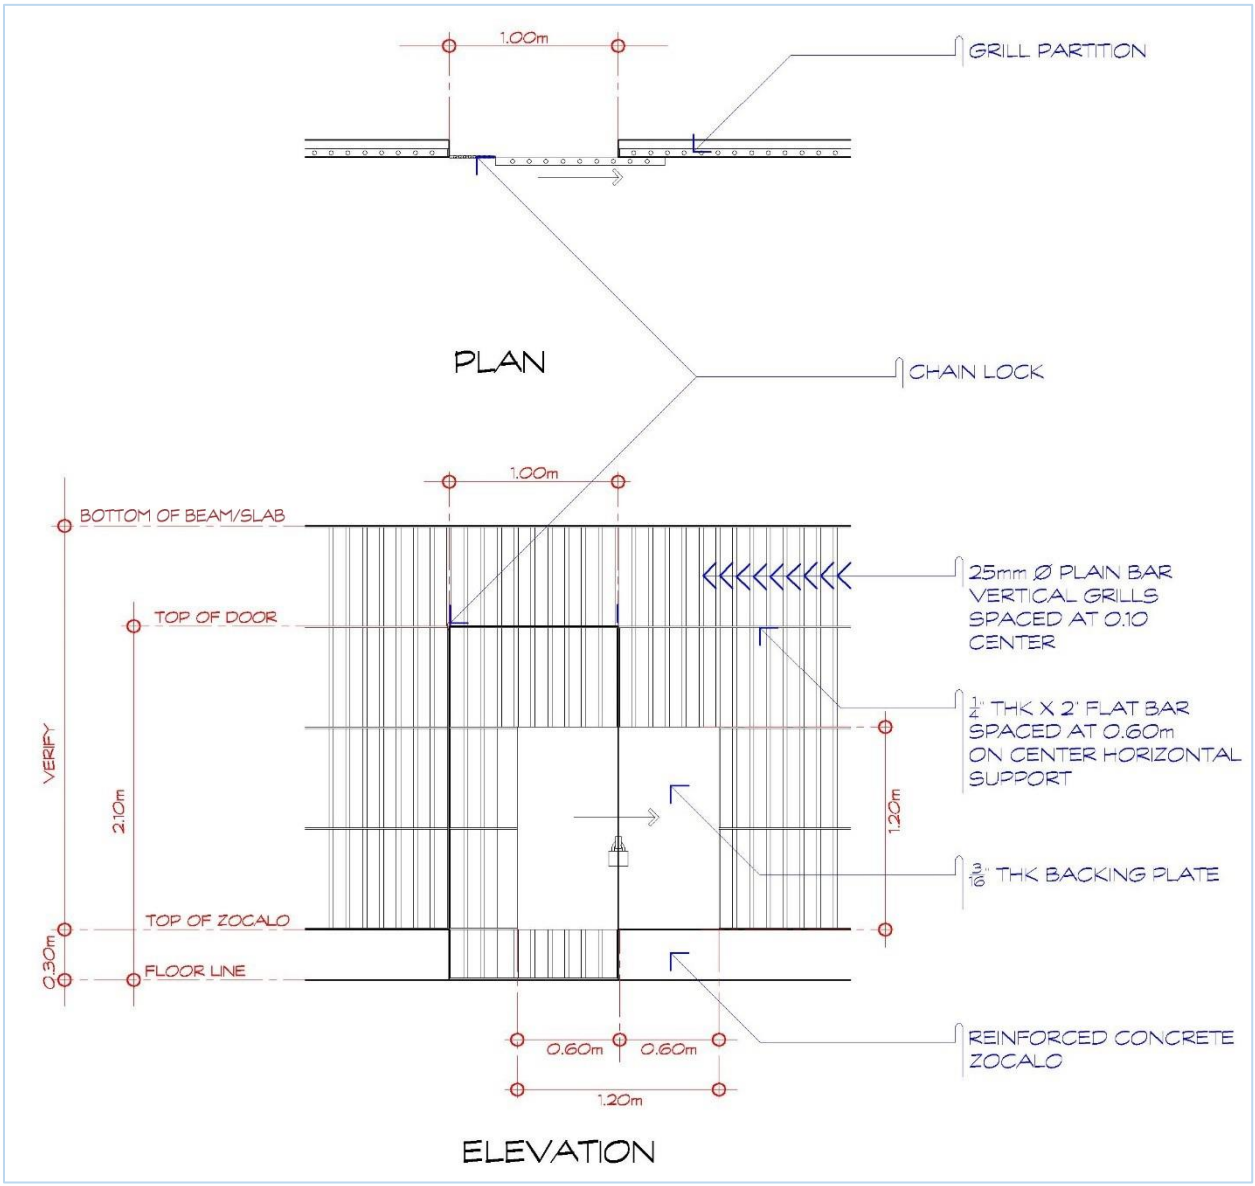


Figure 16: Proposed Layout of a Cell Sliding Door

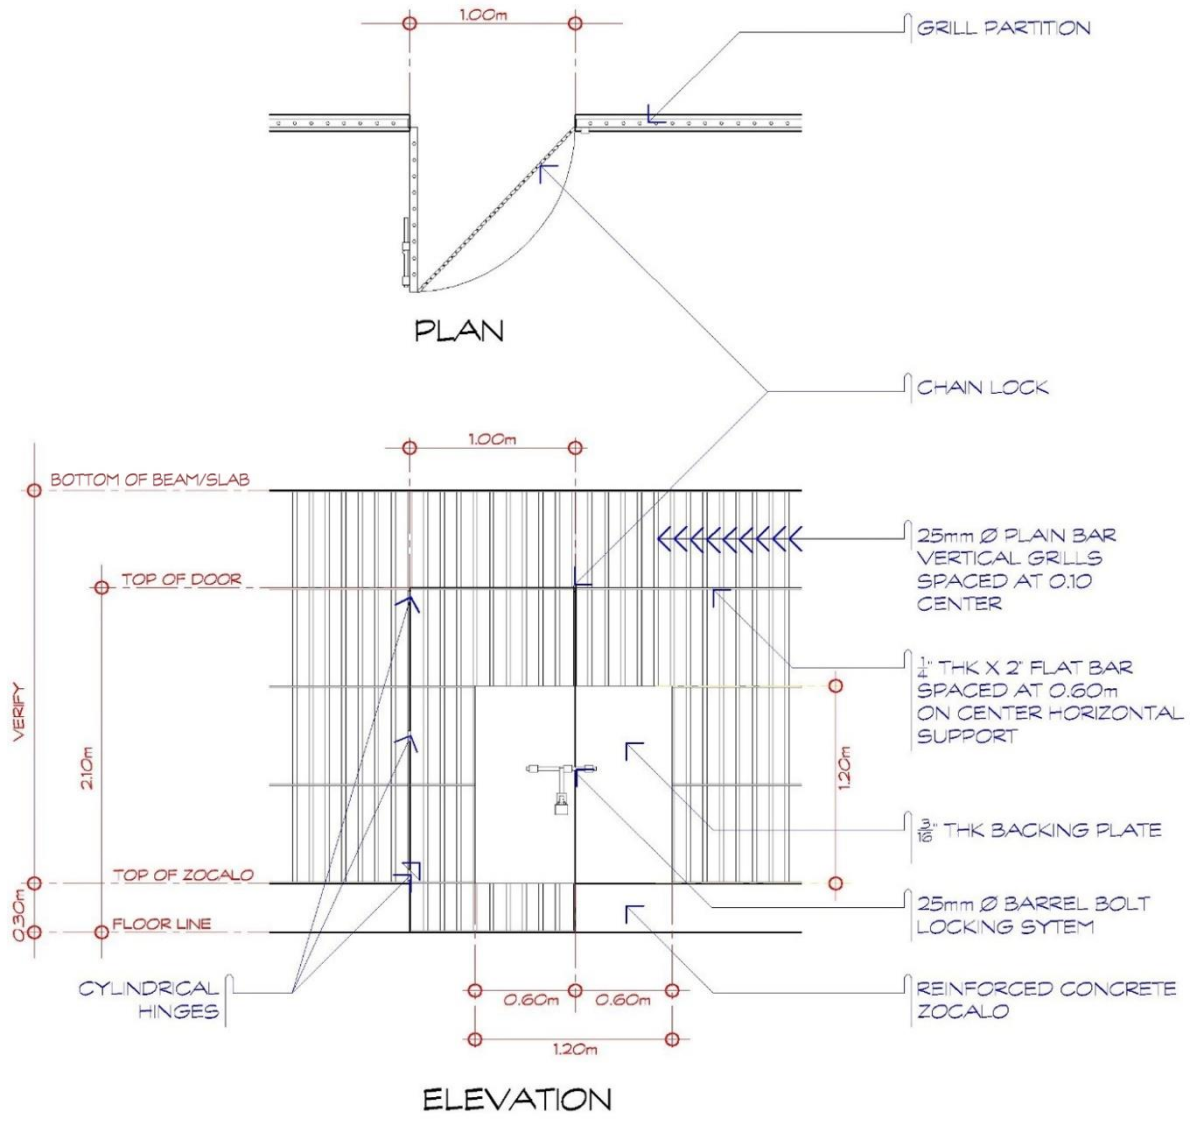


Figure 17: Proposed Layout of a Cell Swing Door

2. ACCOMMODATION:

2.7 Bunk Bed

DEFINITION

A **Bunk Bed** is a piece of furniture consisting of two beds, one above the other, that form a unit. Two PDL use **Bunk Beds** to sleep and rest.

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DESCRIPTION

LOCATION:

- In the **Sleeping and Dining Area** (see page 42).

DIMENSIONS:

- Bed dimensions: 0.8 m x 1.8 m.
- Bed height:
  - From finish floor to first level: 0.4 m;
  - From 1st to 2nd level: 1 m.

NUMBER:

1 unit of Bunk Beds for two PDL.

CHARACTERISTICS:

- See figures below.
- Materials (see Figure 18):
  - Post:
    - 1 1/2”x 1 ½”x ¼”thk angle bars.
  - Bed frame:
    - 1 1/2”x 1 ½”x ¼”thk angle bars.
  - Welding Rod:
    - #6011 or 7018 of any brand.
  - Bed studs:
    - 1 1/2”x 1 ½”x ¼”thk angle bars transverse support;
    - 1 1/2”x ¼”thk flat bars joists.
  - Bed floor:
    - ¾”thk marine plywood.
  - Head Board:
    - ¾”thk marine plywood.
- Bunk Beds Layout (see Figure 19):
  - For a 6 m x 8 m cell, bunk layout as shown on the figure is ideal since enough open spaces can still be left out for PDL other activities.

- A folding table is also provided for PDL to use in their leisure time, dining, group meetings and livelihood activities.

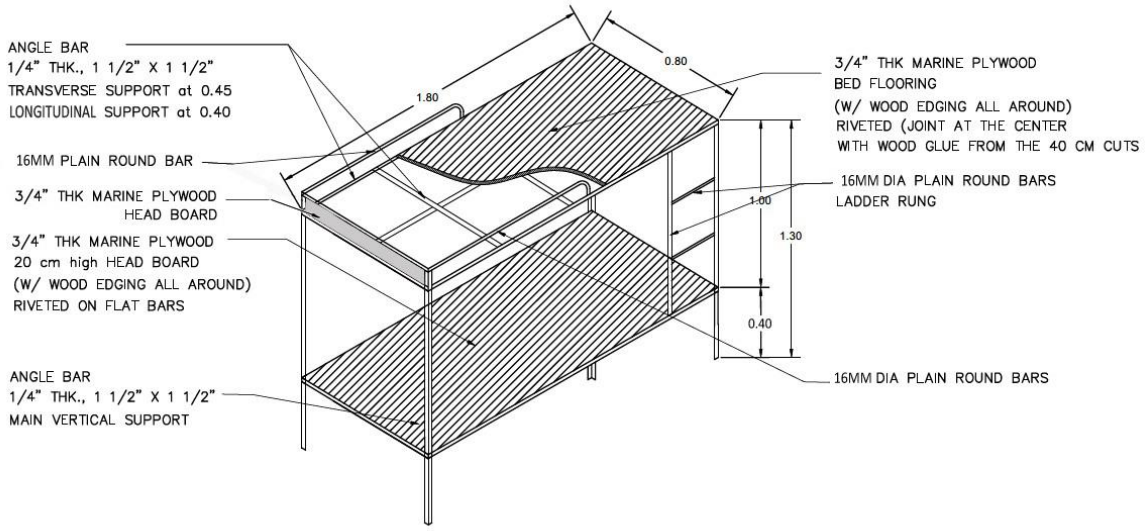


Figure 18: Two-level Bunk Bed Standard Design

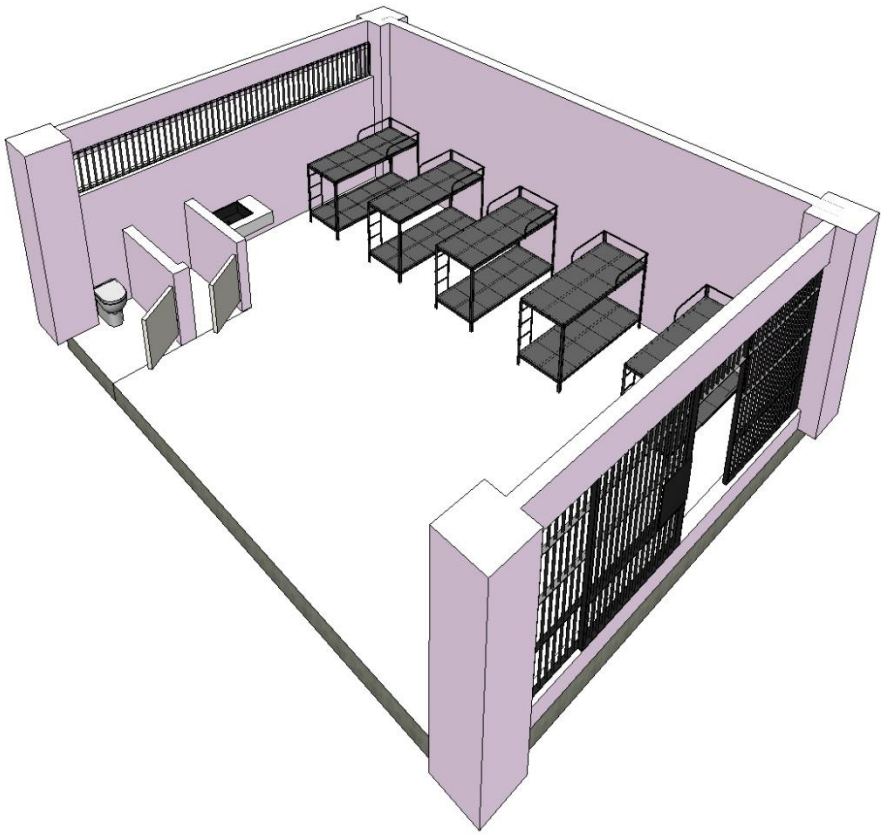


Figure 19: Layout of Bunk Beds inside a Cell

2. ACCOMMODATION:

2.8 Open Shelves

DEFINITION

Open Shelves are pieces of furniture where the PDL will be allowed to keep their belongings thereby avoiding clutters inside the cell.

This provision will limit the number of allowable things a PDL could bring inside the cell and will eliminate their ability to hide any contraband because the shelves can be easily inspected by the jail authorities.

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DESCRIPTION

LOCATION:

- On the walls of the **Sleeping and Dining Area** (see page 42). See Figure 20 for shelves fixing position on the wall.

DIMENSIONS:

- 2 m x 0.8 m x 0.4 m;
- ¾ thk Marine Plywood.

NUMBER:

1 unit for 10 PDL capacity.

CHARACTERISTICS:

- Fixed wall mounted open shelves;
- Made of ¾" thk marine plywood assembled to a quality workmanship;

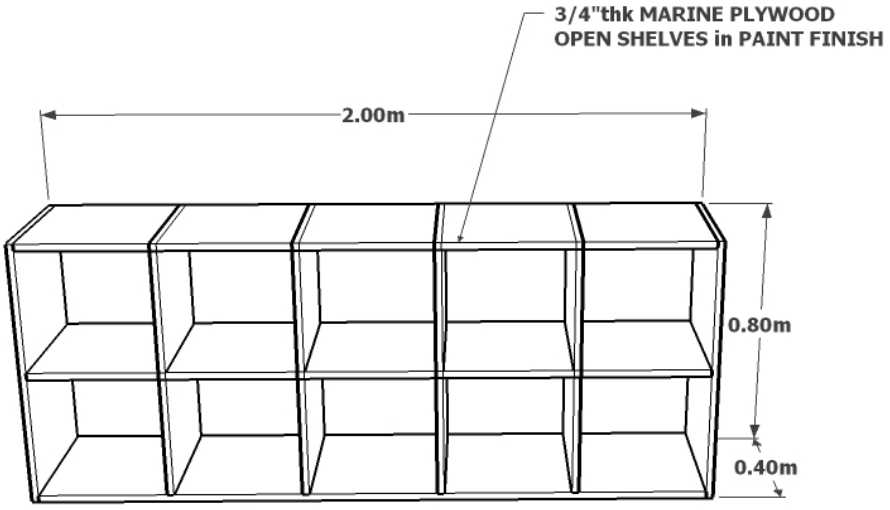


Figure 20: Open Shelves Standard Design

3. VISITATION:

3.1 Visitors Holding Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Visitors Holding Area** is a place where visitors can wait for their turn to enter the facility.

DESCRIPTION

LOCATION:

- Not far from the **Main Gate** (see page 143) but outside the **Main Perimeter Fence** (see page 139);
- The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance / Exit** page 159).

DIMENSIONS:

- At least 8 sq. m;
- The Area must be able to accommodate at least 10 visitors.

NUMBER:

N/A.

CHARACTERISTICS:

- The area must be roofed in order to protect from the rain and direct sunlight;
- Equipped with benches;
- May be equipped with Public-Address (PA system).

3. VISITATION:

3.2 Visitors Processing Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Visitors Processing Area** is a place intended for the verification of visitor's documents, identification and registration before proceeding to the visiting area to meet and have contact with the PDL. It should contain a reception booth, a waiting lobby, tables and chairs.

The area should give access to at least one **PWD-accessible Toilet** (see page 163).

DESCRIPTION

LOCATION:

- Must be at the ground floor and close to the **Pedestrian Gate** (see page 145) ;
- The **Visitors Processing Area** should be adjacent to the **Searching Area for Visitors** (see page 60); which could be provided with separator/barrier either made of glass or of steel matting so that duty personnel can have full view of both functional components herein mentioned;
- The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance / Exit** page 159);
- See example of location on Figure 21.

DIMENSIONS:

1 sq. m per visitor with a minimum area of 12 sq. m to a maximum of 40 sq. m as indicated in the table below:

A (small)	At least 9 sq. m
B (medium)	At least 20 sq. m
C (large)	At least 30 sq. m
D (very large)	At least 40 sq. m

NUMBER:

N/A.

CHARACTERISTICS:

- The area must be roofed;
- The floor must be tiled;
- Should have sufficient Lighting and Natural Ventilation (see page 167).

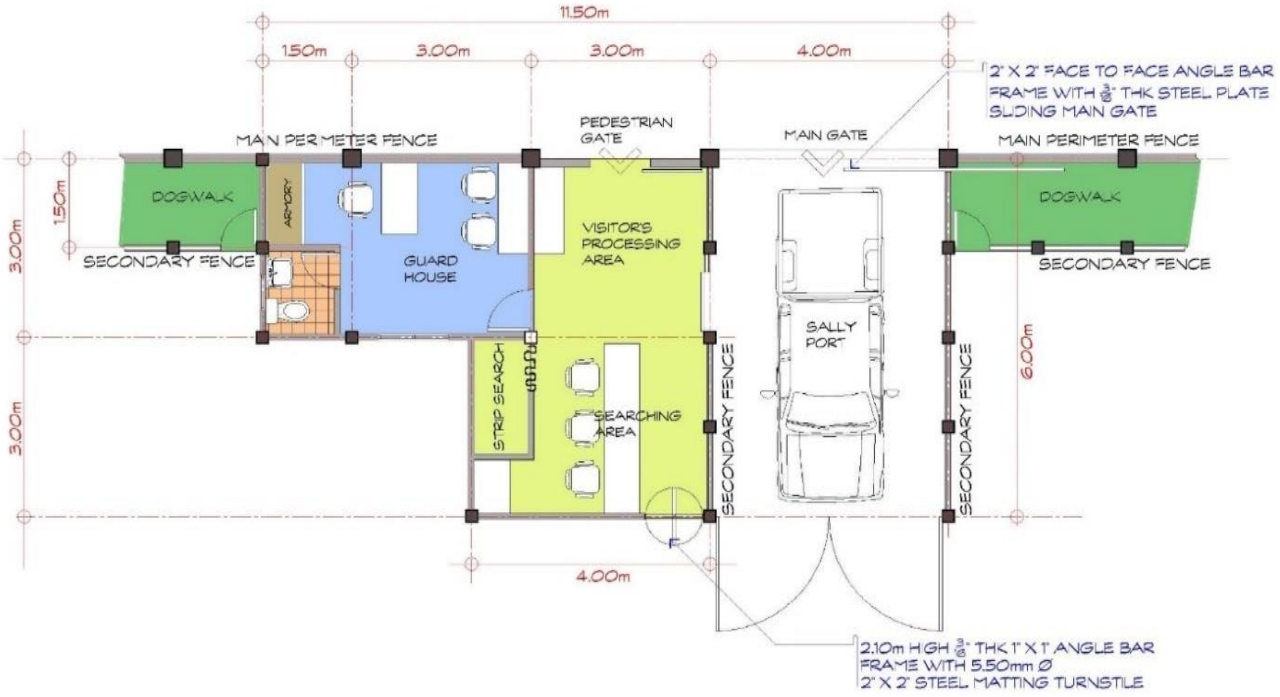


Figure 21: Proposed Layout of a Visitors Processing Area

3. VISITATION:

3.3 Searching Area for Visitors

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Searching Area for Visitors** is an area used to conduct a thorough search of visitors and their belongings using visual body-search or strip search.

It should be equipped with tables, chairs and hanging cabinet, metal detectors, body scanners and canine detection (optional).

DESCRIPTION

LOCATION:

- It is a pre-secured area located between the **Visitors Processing Area** (see page 58) and the **Visiting Area**, whether the type of visit is **Contact** (see page 63), **Official** (see page 64), **Conjugal** (see page 67) or **Non-contact** (see page 68);
- The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance / Exit** page 159);
- See example of location on Figure 22.

DIMENSIONS:

At least 12 sq. m (for three visitors at a time).

NUMBER:

N/A.

CHARACTERISTICS:

- Privacy must be ensured for strip searching by providing partitions: see page 62.

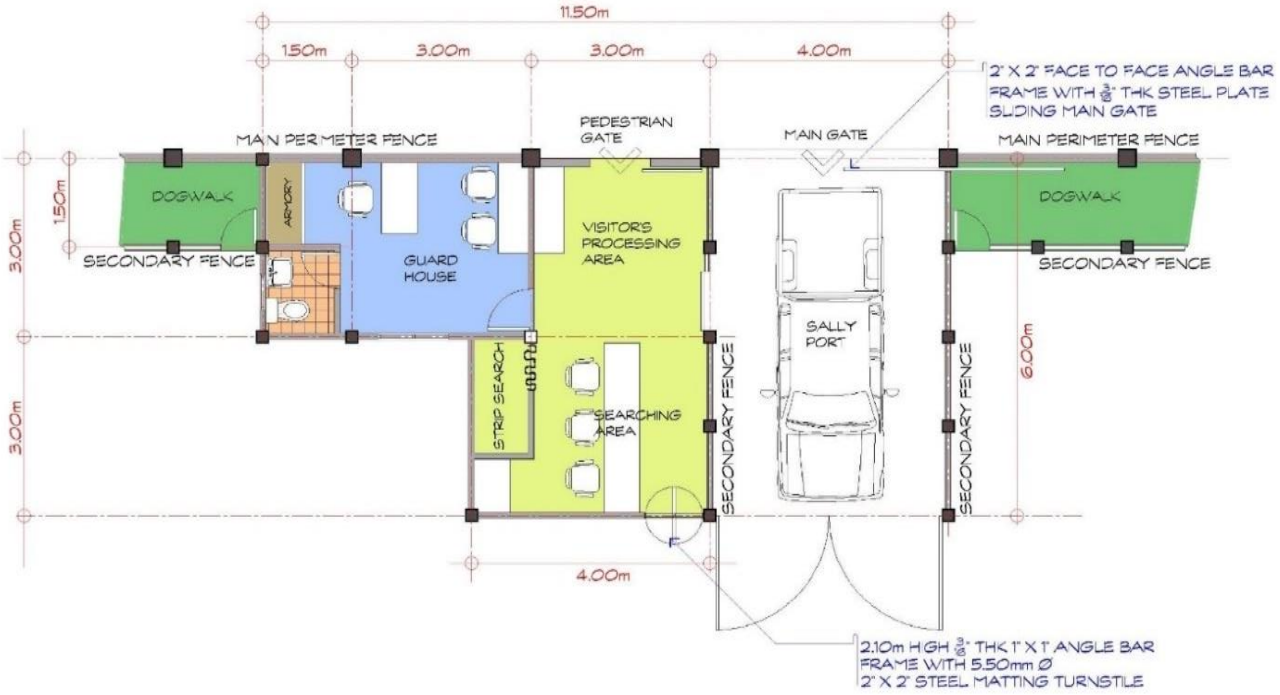


Figure 22: Proposed Layout of a Searching Area

3. VISITATION:

3.4 Strip-searching Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Strip-searching Area** is a place used to conduct strip-search.

DESCRIPTION

LOCATION:

- Within the **Searching Area for Visitors** (see page 60).
- See example of location on Figure 22.

DIMENSIONS:

At least 2 sq. m.

NUMBER:

A (small) and B (medium)	At least 1 room
C (large) and D (very large)	At least 2 rooms

CHARACTERISTICS:

- See Figure 23;
- The area must allow total privacy (Searcher/Visitors);
- The area must be equipped with mirrors, and exhaust and blower fans;
- The area must have sufficient **Lighting** (see page 167).

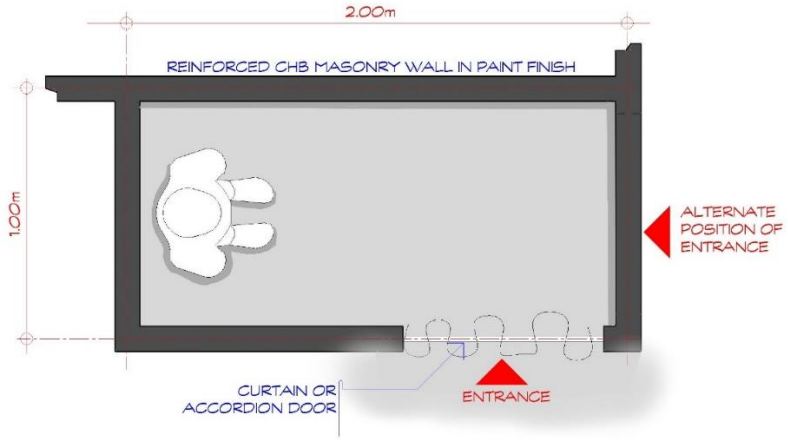


Figure 23: Details of Strip-searching Area

3. VISITATION:

3.5 Visitors Area for Contact Visit

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Visitors Area for Contact Visit** is an area of the jail to receive visitors during visiting hours. The visitors are allowed to have contact with the PDL or undertake any official activity. Tables and chairs must be available in the visitors area.

DESCRIPTION

LOCATION:

- The area should be easily accessible from the Cells Building and from the **Visitors Processing Area** (see page 58);
- It must be on the ground floor, in order to be accessible to PWD (see **A.1 Corridors, Staircases and Entrance / Exit** page 159);
- It should give access to **Ordinary Toilets** (see page 163) as well as to **PWD-accessible Toilets** (see 163).

DIMENSIONS:

At least 0.40 sq. m per PDL capacity.

NUMBER:

N/A.

CHARACTERISTICS:

- The floor must be at least "smooth finish";
- The area should have sufficient Water Supply (see page 152);
- The area should have at least one Lavatory equipped with Faucets (see page 174) for hand-washing.
- Number of Accessible Toilets (see page 166):

A (small) and B (medium)	At least 1 **PWD-accessible Toilet** used by everyone
C (large) and D (very large)	At least: - 1 **Ordinary Toilet** and; - 1 **PWD-accessible Toilet**

- At least one Control Post (see page 150) should be included in the area;
- Convex mirrors may be installed to facilitate the surveillance;
- There should be a Public Address (PA) system;
- The area must be roofed, sufficient **Lighting** and **Natural Ventilation** (see page 167).

3. VISITATION:

3.6 Visitors Area for Official Visit

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Visitors Area for Official Visit** is a place intended for PDL's special visitors (doctors, lawyers, and spiritual leaders) for any official activity during visit hours. This area is usually a designated rooms or a structure such as trailer or a small cabin. It must be equipped with at least a table and four chairs.

DESCRIPTION

LOCATION:

- Within the **Visitors Area for Contact Visit** (see page 63);
- The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance / Exit** page 159).

DIMENSIONS:

7.80 sq. m per room (included in the surface allocated to **Visitors Area for Contact Visit**, see page 63).

NUMBER:

1 to 2 rooms for up to 500 PDL.

CHARACTERISTICS

- A closed room with sufficient **Lighting** and **Natural Ventilation** (see page 167).
- The area should give access to at least:
- Two **Ordinary Toilet** (see page 163), one for males and one for females and;
- A **PWD-accessible Toilet** (see page 163).

3. VISITATION:

3.7 Commissary

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Commissary**, sometimes called the shop, is an area where PDL, jail personnel and visitors can purchase goods, such as towels, blankets, beverages, soap, shampoo and magazines to help meeting various needs. A commissary usually has shelves and a table.

DESCRIPTION

LOCATION:

- Within the **Visitors Area for Contact Visit** (see page 63).

DIMENSIONS:

- Commissary's surface must not be larger than 10% of the **Visitors Area for Contact Visit**.

NUMBER:

One in each facility.

CHARACTERISTICS:

- Enclosed with at least steel matting;
- Sufficient **Lighting** and **Natural Ventilation** (see page 167).

3. VISITATION:

3.8 Teleconferencing Room (e-Dalaw)

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Teleconferencing Room (e-Dalaw)** is a place where PDL can communicate with their families and loved-ones through long distance communication using internet. It consists of a personal computer, tables and chairs, and internet connection.

Only required in jails with good access to the internet.

DESCRIPTION

LOCATION:

- Within the **Visitors Area for Contact Visit** (see page 63).

DIMENSIONS:

1.00 sq. m per cubicle.

NUMBER:

- At least 1 cubicle for up to 500 PDL;
- 5 cubicle as a maximum above 500 PDL capacity.

CHARACTERISTIC

- The cubicle should be well ventilated and equipped with a table and chairs.

REMARKS

Figure 24 shows a possible technological option for Teleconferencing (e-Dalaw). The picture is for illustration purposes only. Actual units may vary.



Figure 24: Podium-stand Mounted All-in-One PC

3. VISITATION:

3.9 Conjugal Visit Room

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Conjugal Visit Room** is a place where a PDL can have an intimate relationship with his/her legal partner. The room should be equipped with a Bed and **Toilet and Bath** (see page 166).

DESCRIPTION

LOCATION:

- Preferably at the ground floor;
- The place should be easily accessible from the Cells Building and from the **Visitors Processing Area** (see page 58);
- The **Conjugal Visit** Room should be attached to or be near to a **Toilet and Bath** (see page 166).

DIMENSIONS:

- Size: 5 sq. m /room excluding toilet and bath;
- See bed dimensions indicated on the figure below.

NUMBER:

- 2 to 8 rooms.

A (small)	2 rooms
B (medium)	2 to 4 rooms
C (large)	4 to 6 rooms
D (very large)	6 to 8 rooms

CHARACTERISTICS:

- The rooms should be equipped with adapted **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

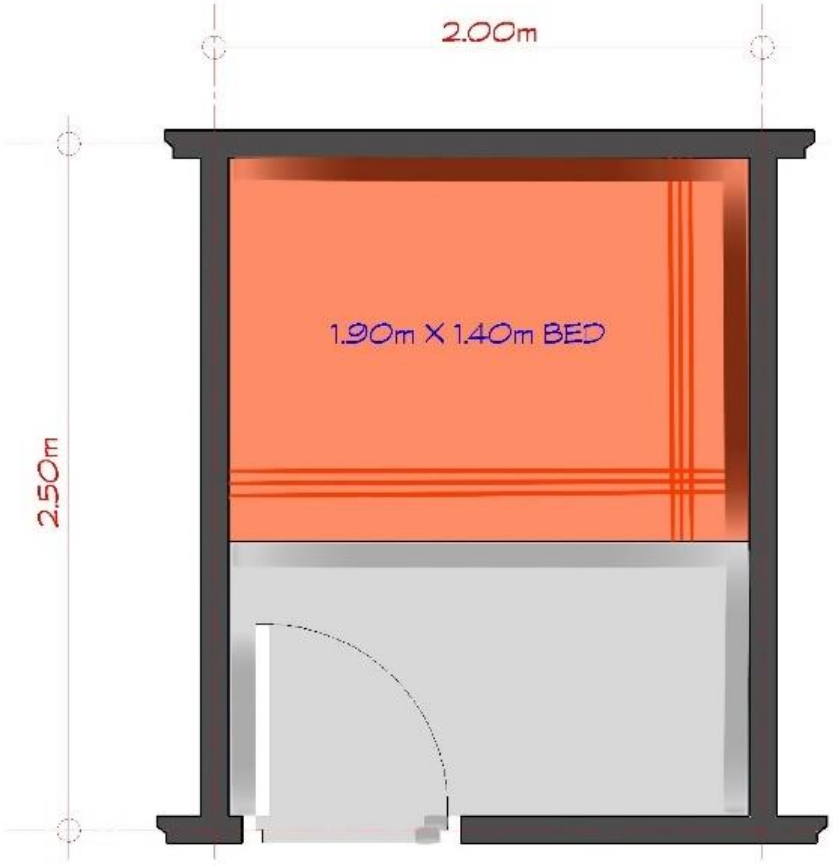


Figure 25: Conjugal Visit Room

3. VISITATION:

3.10 Visitors Area for Non-Contact Visit

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☒ NO ☐
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Visitors Area for Non-Contact Visit** is a room where PDL can receive visitors during visiting hours but that does not allow physical contact. Visits are meant to last 30 minutes. It is reserved to High-Risk and Restricted PDL[2].

DESCRIPTION

LOCATION:

- Preferably at the ground floor;
- The place should be easily accessible from the Cells Building and from the **Visitors Processing Area** (see page 58);
- No access to **Visitors Area for Contact Visit** (see page 63);
- The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance / Exit** page 159).

DIMENSIONS:

1.92 sq. m per visitor with a minimum of 10.00 sq. m to a maximum of 28.80 sq. m.

NUMBER:

A (small)	3 cubicles
B (medium)	6 cubicles
C (large)	9 cubicles
D (very large)	15 cubicles

CHARACTERISTICS:

- Reinforced CHB masonry wall in paint finish; Bolted seats;
- With hallway;
- Fixed seats, partition should at least be steel matting with 10 mm x 10 mm holes between PDL and the visitor with ledge;
- Partitions on visitors' side as well as on PDL's side for privacy purposes.

- For PDL side:

[2] High Risk: PDL considered highly dangerous and who require a higher degree of security, control and supervision;

Restricted: under disciplinary restriction.

- At least one **Ordinary Toilet** (see page 163) must be accessible from the area.

- For visitors' side:
  - At least one **PWD-accessible Toilet** (see page 163) must be accessible from the area.
- Adapted **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

REMARKS

The toilets accessible from the area may be shared with those used for contact visits (especially in small capacity jails) wherever both contact and non-contact visit areas are present.

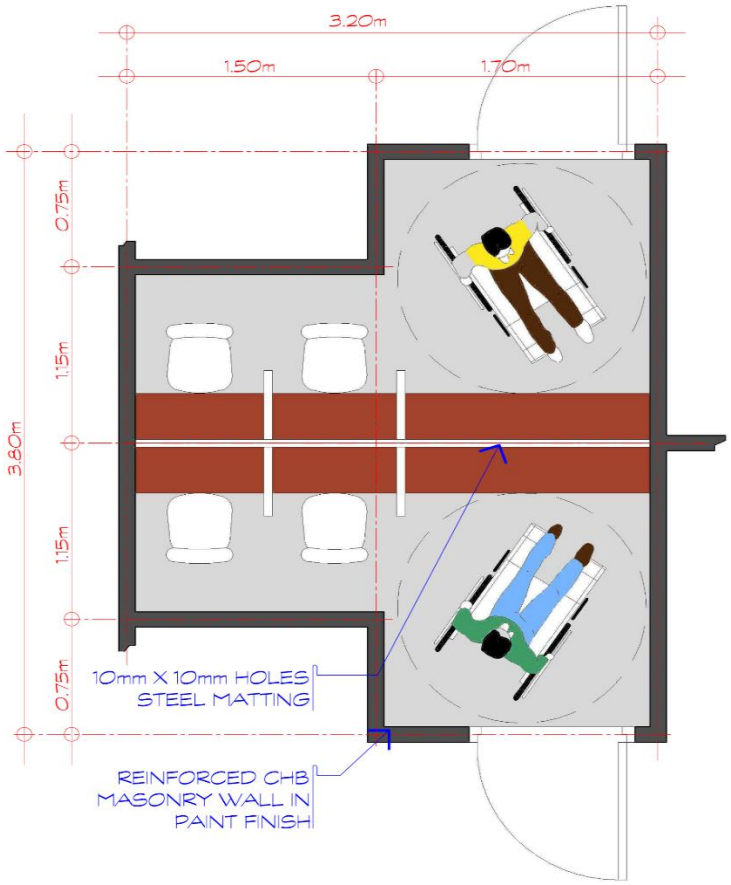


Figure 26: Non-Contact Visit Room for Type A Facilities (1-100 PDL capacity)

4. HEALTH SERVICES:

4.1 Patient Reception Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The Patient Reception Area is an area, preferably an open space, through which patients enter the health facility. It may also serve as a receiving area for registration and waiting area for Out-Patient-Department (OPD) patients. It must have a small booth (within the reception area) for registration and Inmate Health Record (IHR) keeping purposes and contain tables, chairs/bench and cabinets. This is also the room in which patients await the attentions of medical professionals.

DESCRIPTION

LOCATION:

- The area should provide access to the **Consultation Room** (see page 77) and other services;
- It should be located on the ground-floor;
- The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance** / Exit page 159).
- See Figure 29 for a location example in a Type D facility (1001-2000 PDL capacity).

DIMENSIONS:

A (small) and B (medium)	At least 2.5 m x 4 m = 10 sq. m
C (large) and D (very large)	At least 5 m x 2 m = 10 sq. m Plus 1.5m x 1.5m = 2.25 sq. m for reception-booth. Total: 12.25 sq. m

NUMBER:

N/A.

CHARACTERISTICS:

- Door Design:

A (small) and B (medium)	Double-door: 0.8 m (large part) and 0.4 m (small part)
C (large) and D (very large)	Two-swings door 1.6 m wide

- Adequate **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172);
- See doors designs below.

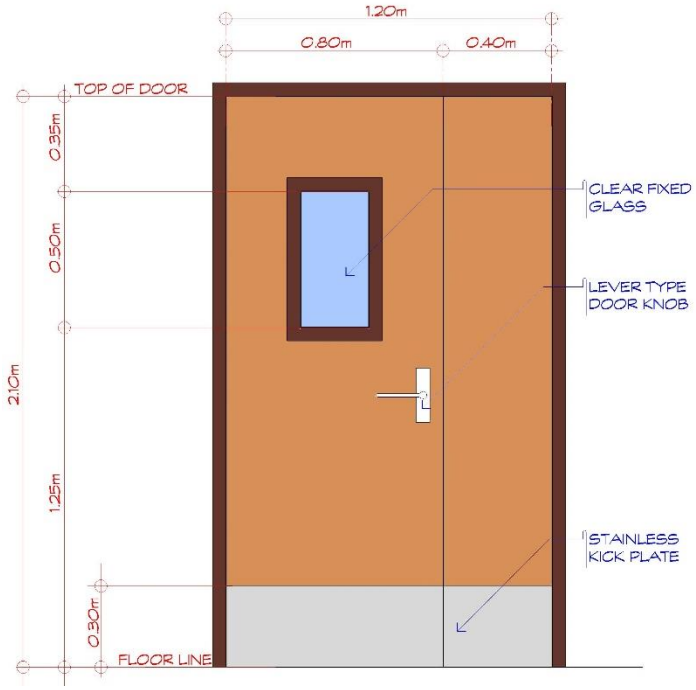


Figure 27: Double-door Design for Type A and B Facilities (1-500 PDL capacity)

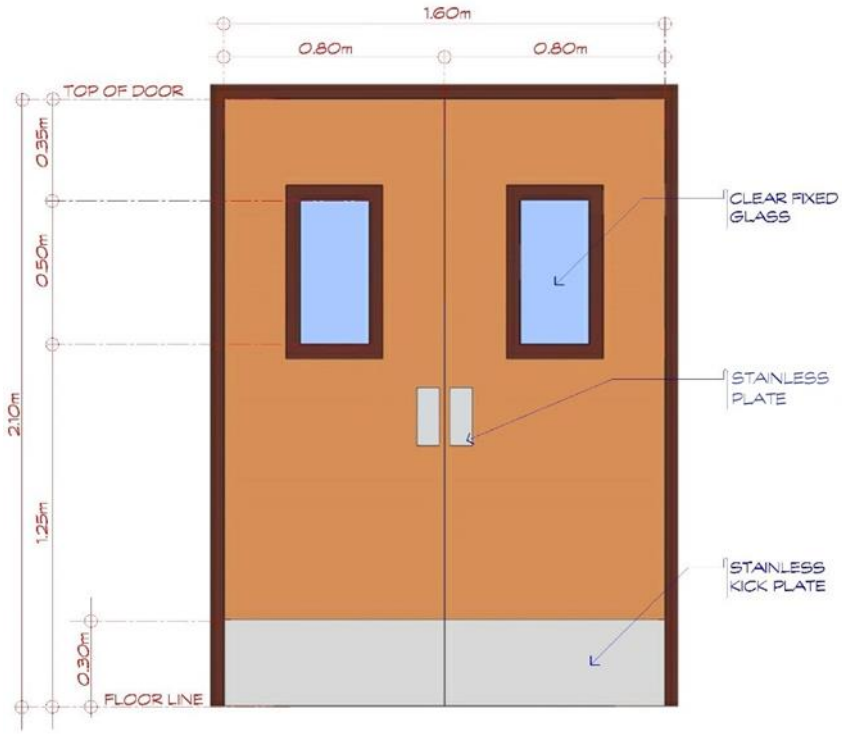


Figure 28: Two-swing Door



Figure 29: Proposed Layout of Health Facilities in Type D Jails (1001-2000 PDL capacity)

4. HEALTH SERVICES:

4.2 Consultation Room / Dental Office / Nurse Station / Equipment Area / Supply-Room / Pharmacy

CAPACITY RANGE

☒ **A: 1-100** ☐ **B: 101-500** ☐ **C: 501-1000** ☐ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Consultation Room / Nurse Station / Equipment Area / Supply-Room / Pharmacy / Dental Office** is a multipurpose area that serves:

- for Health Assessment of PDL, including in Emergency Cases, by a doctor or a medical professional, including Dental Assessment and basic treatment (no Dental-chair is required);
- as a place to maintain and keep PDL' Medical Records in a locked cabinet;
- For the safekeeping of medical supplies, medicines and other medical consumables as well as for medical equipment (such as instruments, wheelchairs, etc).

The room should contain at least a table and a chair, filing cabinets, an oxygen tank and an Examination-table (see below).

DESCRIPTION

LOCATION:

- Preferably on the ground floor; with easy access to the **Main Gate** (see page 143) to facilitate emergency referrals;
- Next to the **Patient Reception Area** (see page 70);
- The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance** / Exit page 159).

DIMENSIONS:

- **Consultation room** (see page 77): At least 12 sq. m (preferably 3m x 4m);
- Examination-table dimensions : 0.8 m x 1.9 m = 1.5 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- The room should be visually and acoustically private;
- The room should contain a **Lavatory** (see page 174);
- A Panic-button should be installed;
- Adequate **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

4. HEALTH SERVICES:

4.3 Consultation Room / Nurse Station / Health Staff Office

CAPACITY RANGE

☐ **A: 1-100** ☒ **B: 101-500** ☐ **C: 501-1000** ☐ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Consultation Room/ Nurse Station/ Staff Office** is a place in which a doctor or a medical professional can examine PDL for Health Assessment or for Emergency Treatment, and discuss with them about their health problems.

It must be equipped with a table and chair, a dressing table, an Examination-table (see below), a medical cabinet, medical equipment for diagnosis, a refrigerator, and an oxygen tank. The room should be secure (lockable).

The **Nurse station** is a booth or a counter where health staff can record data for daily monitoring like charting & preparation of medicine. It is an area accessible to the close relatives of PDL patient. In addition to the booth or counter it must be equipped at least with a table and chairs for daily medicine preparations and with a locked cabinet for Medical Records.

The **Staff Office** is a room that may function as a lounge or a meeting room, where health staff can meet, rest, discuss and deal with administrative tasks. The room must contain tables and chairs, lockers and cabinets for archiving. There should be an attached **Toilet and Bath** (see page 166).

DESCRIPTION

LOCATION:

- Preferably on the ground floor; with easy access to the **Main Gate** (see page 143) to facilitate emergency referrals;
- Next to the **Patient Reception Area** (see page 70);
- The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance** / Exit page 159).

DIMENSIONS:

- **Consultation room** (see page 77): At least 12 sq. m (preferably 3m x 4m);
- Reception / Waiting: At least 10 sq. m (preferably 2.5m x 4m);
  - Total: At least 22 sq. m.
  - Examination-table dimensions : 0.8 m x 1.9 m = 1.5 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- The room should must be secured and must be visually and acoustically private;
- The room must have **Water Supply** (see page 152);
- The room should contain a **Lavatory** that may be equipped with an **Elbow-tap** (see page 174);
- A Panic-button should be installed;
- Adequate **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

4. HEALTH SERVICES

4.4 Consultation Room

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Consultation Room** is a place in which a doctor or a medical professional can examine PDL for Health Assessment, discuss with them about their health problems and receive emergency cases. It must be equipped with a table and chair, a dressing table, an Examination-table (see below), a medical cabinet, medical equipment for diagnosis, a refrigerator, and an oxygen tank. The room should be secure (lockable).

DESCRIPTION

LOCATION:

- Preferably on the ground floor; with easy access to the **Main Gate** (see page 143) to facilitate emergency referrals;
- Next to the **Patient Reception Area** (see page 70);
- The room must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance** / Exit page 159);
- See Figure 29 for a location example in a Type D facility (1001-2000 PDL capacity).

DIMENSIONS:

- **Consultation room**: At least 12 sq. m (preferably 3m x 4m);
- Waiting room: At least 10 sq. m (preferably 2.5m x 4m);
- Examination-table dimensions : 0.8 m x 1.9 m = 1.5 sq. m.

NUMBER:

C (large)	1 unit
D (very large)	2 units

CHARACTERISTICS:

- The room must be Acoustically private;
- The room must have **Water Supply** (see page 152);
- The room should contain a **Lavatory** that may be equipped with an **Elbow-tap** (see page 174);
- The room must have an overhead cabinet;
- A Panic-button should be installed;
- The room must have Adequate **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

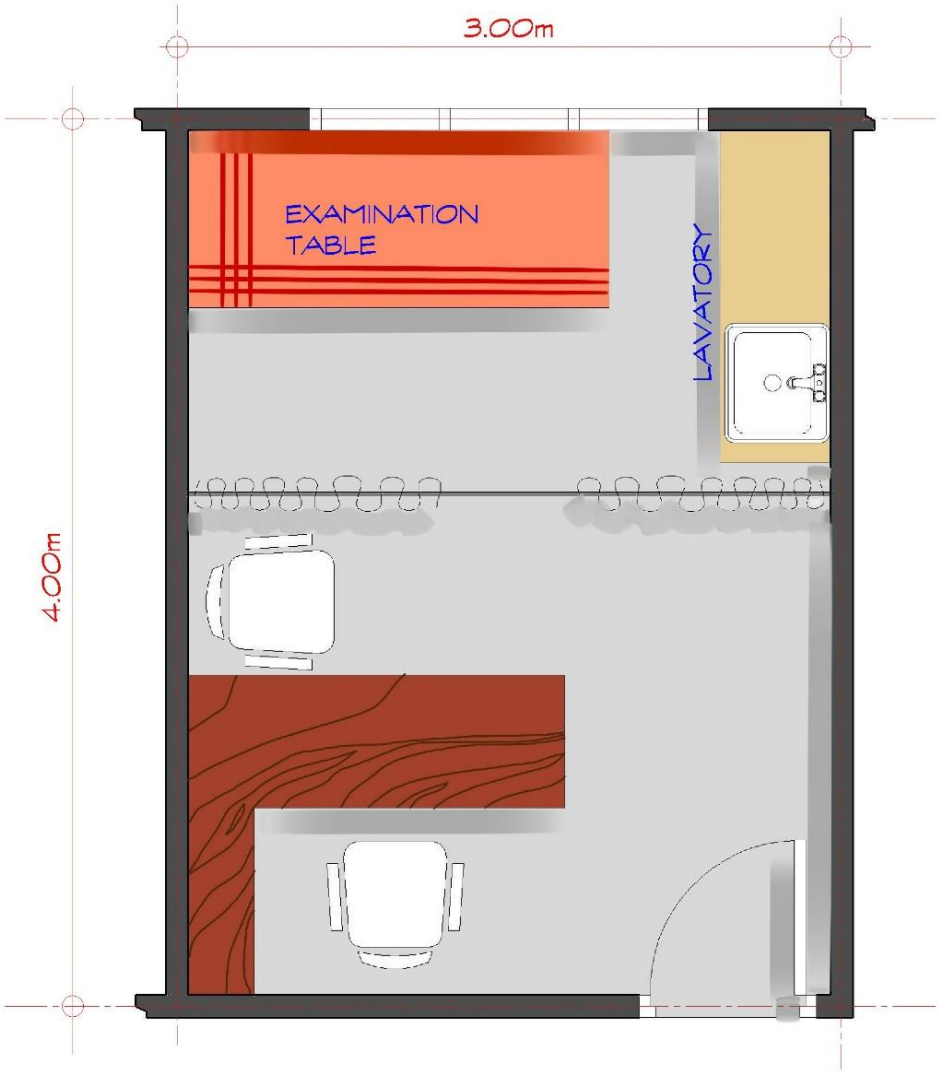


Figure 30: Proposed Layout of a Consultation Room

4. HEALTH SERVICES

4.5 Nurse Station

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Nurse Station** is a booth or a counter where health staff can record data for daily monitoring like charting and preparation of medicine. In addition to the booth or counter it must be equipped at least with a table and chairs for daily medicine preparations and with a cabinet for records.

DESCRIPTION

LOCATION:

- Located next to the **Patient's Ward** (see page 90) and the **Observation Ward** (see page 96);
- See Figure 29 for a location example in a Type D facility (1001-2000 PDL capacity).

DIMENSIONS:

At least 9 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- The booth or counter should preferably have 180-degree vision;
- Adequate **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

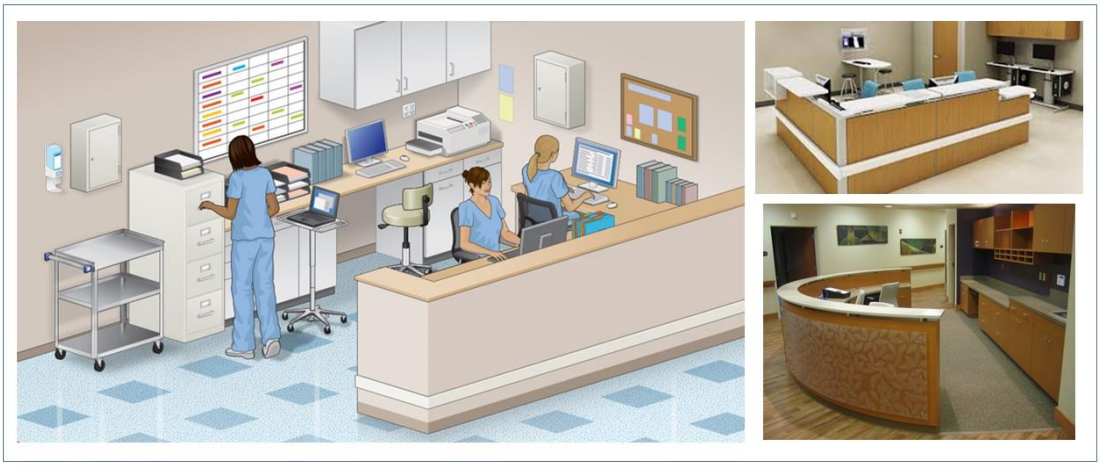


Figure 31: Typical Design of Nurse Stations

4. HEALTH SERVICES

4.6 Health Staff Office

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Health Staff Office** is a room that may function as a lounge or a Meeting Room, where health staff can meet, rest, discuss and deal with administrative tasks. The room must contain tables and chairs, lockers and locked cabinets for archiving.

There should be an attached **Toilet and Bath** (see page 166).

DESCRIPTION

LOCATION:

- Located within the restricted area of the health facility (No PDL access);
- See Figure 29 for a location example in a Type D facility (1001-2000 PDL capacity).

DIMENSIONS:

- Two users and above: At least 4 sq. m per user;
- As per BJMP Operations Manual, ratio of health staff to PDL is 1:150 for large and very large jails. Two or three shifts are considered.

Category	Capacity Range	Number of Health Staff	Size
C (large)	500 - 900 PDL	2	At least 8 sq. m
C (large)	901 - 1000 PDL	3	At least 12 sq. m
D (very large)	1001 - 1500 PDL	4	At least 16 sq. m
D (very large)	1501 - 1800 PDL	5	At least 20 sq. m
D (very large)	1801 - 2000 PDL	6	At least 24 sq. m

NUMBER:

N/A.

CHARACTERISTICS:

- Adequate **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

4. HEALTH SERVICES

4.7 Dental Office / Maternal / Pre-natal Care Area

CAPACITY RANGE

☐ **A: 1-100** ☒ **B: 101-500** ☐ **C: 501-1000** ☐ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☐
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Dental Office / Maternal / Pre-natal Care Area** is a room used both for dental and maternal health services (in female dormitories). It must contain at least an Examination-table (see below) in Female Dormitories, a table, chairs and cabinet. No Dental-chair is required.

The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance** / Exit page 159).

DESCRIPTION

LOCATION:

- Next to the **Patient Reception Area** (see page 70);
- The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance** / Exit page 159).

DIMENSIONS:

- At least 8 sq. m.
- Examination-table dimensions : 0.8 m x 1.9 m = 1.5 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- The room must have **Water Supply** (see page 152);
- The room should contain a **Lavatory** that may be equipped with an **Elbow-tap** (see page 174);
- Adequate **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

4. HEALTH SERVICES

4.8 Dental Office

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Dental Office** is a room for Dental Treatment. It must contain at least a Dental-chair, table and chairs and a cabinet.

DESCRIPTION

LOCATION:

- Next to the **Patient Reception Area** (see page 70);
- The room must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance** / Exit page 159);
- See Figure 29 for a location example in a Type D facility (1001 - 2000 PDL capacity).

DIMENSIONS:

- At least 8 sq. m;
- Space allocation for the Dental-chair : 1.5 m x 0.9 m = 1.35 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- The room should contain a **Lavatory** that must be equipped with an **Elbow-tap** (see page 174);
- Power Supply and **Water Supply** (see page 152) compatible with the use of a Dental-chair;
- Adequate **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

4. HEALTH SERVICES

4.9 Maternal / Pre-natal Care Area

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Maternal/Pre-natal Care Area** is a room used for maternal health services in Female Dormitories. It must contain at least, an Examination-table (see below), a table, chairs and a cabinet.

DESCRIPTION

LOCATION:

- Next to the **Patient Reception Area** (see page 70);
- The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance** / Exit page 159);
- See Figure 29 for a location example in a Type D facility (1001 - 2000 PDL capacity).

DIMENSIONS:

At least 8 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- The room must have **Water Supply** (see page 152);
- The room should contain a **Lavatory** that may be equipped with an **Elbow-tap** (see page 174);
- Adequate **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172);
- Examination-table dimensions : 0.8 m x 1.9 m = 1.5 sq. m.

4. HEALTH SERVICES

4.10 Equipment Area / Supply Room / Pharmacy

CAPACITY RANGE

☐ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☐ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Equipment Area / Supply Room / Pharmacy** is a storage area for the safekeeping of medical supplies medicines and other medical consumables as well as for medical equipment (such as instruments, wheelchairs, etc.).

DESCRIPTION

LOCATION:

- Should be next to the **Nurse Station** (see page 79) or the **Consultation Room** (see page 77).

DIMENSIONS:

At least 4 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- An opening with window made on the door must be provided for the distribution of drugs;
- Good **Natural Ventilation** (see page 167) is required;
- For the storage of drugs and medical supplies, racks must be provided. The racks should be placed on elevated platforms in order for the supplies to be protected from dampness and water.

4. HEALTH SERVICES

4.11 Equipment Area

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☐ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

The **Equipment Area** is a room or a space used for the safekeeping of medical equipment (such as instruments, wheelchairs, etc.).

DESCRIPTION

LOCATION:

- Should be next to the **Nurse Station** (see page 79) or **Pharmacy** (see page 86);
- See Figure 29 for a location example in a Type D facility (1001 - 2000 PDL capacity).

DIMENSIONS:

At least 5 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Simple storage room that must contain some cabinets for storage of small equipment.

4. HEALTH SERVICES

4.12 Supply Room / Pharmacy

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☐ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

The **Supply Room / Pharmacy** is a place for the safekeeping of medical supplies, medicines and other medical consumables.

DESCRIPTION

LOCATION:

- Should be next to the **Nurse Station** (see page 79) or **Consultation Room** (see page 77);
- See Figure 29 for a location example in a Type D facility (1001 - 2000 PDL capacity).

DIMENSIONS:

At least 10 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- An opening with window made on the door must be provided for the distribution of drugs;
- For the storage of drugs and medical supplies, racks must be provided. The racks should be placed on elevated platforms in order for the supplies to be protected from dampness and water;
- Good **Natural Ventilation** (see page 167) is required.

4. HEALTH SERVICES

4.13 Isolation Cells for TB and MDR-TB

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

Isolation Cells for TB and MDR-TB keep PDL affected by TB disease (active TB/MDR cases) while they are contagious (permanently in the case of MDR-TB). It must be equipped in the same way as an ordinary cell and allow direct access to the outdoors (sunning).

DESCRIPTION

LOCATION:

A (small) and B (medium)	Near the **Consultation Room** (see page 77)
C (large) and D (very large)	Within the Health Facility specialized Custodial Care Area[3]

DIMENSIONS:

A (small) and B (medium)	At least 6 sq. m
C (large) and D (very large)	At least 48 sq. m

These dimensions include **Toilet and Bath** (see page 166).

NUMBER:

A (small) and B (medium)	At least 2 units
C (large)	At least 3 units
D (very large)	At least 4 units

Calculated based on prevalence rate of 4.5% per population (as of 2011 WHO study in prisons and jails of the Philippines).

CHARACTERISTICS:

- Design as per characteristics of **Sleeping and Dining Area** (see page 42) and **Cell Toilet and Bath** (see page 44);
- The cell should have direct opening to the outdoors at least on one side;
- Adequate **Lighting** and good **Natural Ventilation** (see page 167);
- Effective **Artificial Ventilation** systems, blowers and **Exhaust Fans** (see page 170) must be provided.

[3] The Custodial Care Area is the part of the Health Facility that deals with patient care. This may include the **Patient Ward** (see page 81) in addition to the **Isolation Cells**.

4. HEALTH SERVICES

4.14 Isolation Cells for Other Infectious Diseases

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

Isolation Cells for Other Infectious Diseases keep PDL affected by communicable diseases that are not TB (e.g. measles, chickenpox, conjunctivitis, etc.) while they are contagious. It must be equipped in the same way as an ordinary cell and allow direct access to the outdoors (sunning).

DESCRIPTION

LOCATION:

A (small) and B (medium)	Near the **Consultation Room** (see page 75)
C (large) and D (very large)	Within the specialized Custodial Care Area[4] of the health facility

DIMENSIONS:

At least 7 sq. m including **Toilet and Bath** (see page 166).

NUMBER:

A (small) and B (medium)	1 unit
C (large) and D (very large)	2 units

CHARACTERISTICS:

- Design as per characteristics of **Sleeping and Dining Area** (see page 42) and **Cell Toilet and Bath** (see page 44);
- With direct opening to the outdoors at least on one side;
- Adequate **Lighting** and good **Natural Ventilation** (see page 167).

[4] The Custodial Care Area is the part of the Health Facility that deals with patient care. This may include the **Patient Ward** (see page 90) in addition to the **Isolation Cells**.

4. HEALTH SERVICES

4.15 Sputum Collection Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

The Sputum Collection Area is a booth size (at least) space or an open space used to collect sputum samples from TB patients. It should be well ventilated equipped with a **Lavatory** (see page 174). The **Lavatory** must be exclusively used for sputum collection.

This functional component is not to be included in all jail facilities but in selected facilities as decided by BJMP Health.

DESCRIPTION

LOCATION:

- The area should preferably be away from the Cells Building;
- If indoors (booth size), the area should be next to the **Isolation Cells for TB and MDR-TB** (see page 87);
- See Figure 29 for a location example in a Type D facility (1001 - 2000 PDL capacity).

DIMENSIONS:

Booth size for indoors area: At least 1.5 m x 1m.

NUMBER:

N/A.

CHARACTERISTICS:

- The booth-type door should have a glass pane so the patient can be monitored from outside;
- A speaker may be installed on the booth to allow talking to the patient for instructions;
- If indoors, the area should be well ventilated and equipped with an **Exhaust Fan** (see page 170);
- The area must be exposed to sunlight;
- If this is not possible, then the area should be equipped with Ultra Violet (UV) radiation using a UV lamp. See Figure 29.

4. HEALTH SERVICES

4.16 Patients' Ward

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Patients' Ward** is a room where sick or debilitated PDL who needs close monitoring are admitted upon discretion of an attending doctor. Patients in the ward are supervised or monitored by a nurse.

DESCRIPTION

LOCATION:

- The ward must be adjacent to the **Nurse Station** (see page 79);
- The ward must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance** / Exit page 159).

DIMENSIONS:

- 10 single bed-capacity with provision of a common **PWD-accessible Toilet and Bath** (see page 166);
- At least 5 sq. m / bed: 50 sq. m per ward;
- Hospital Standard Bed size: 0.9 m x 2.1 m = 1.89 sq. m.

NUMBER:

C (large)	1 ward
D (very large)	2 wards

CHARACTERISTICS:

- Bars on the front, CHB walls on the sides, with access to toilet and sunning on one side;
- Good **Artificial Ventilation** (see page 170);
- Must be equipped with a centralized wall-mounted oxygen distribution system (oxygen tanks to be kept in a separate and secure area including spare tanks);
- Adequate **Lighting** Good **Natural Ventilation** (see page 167).

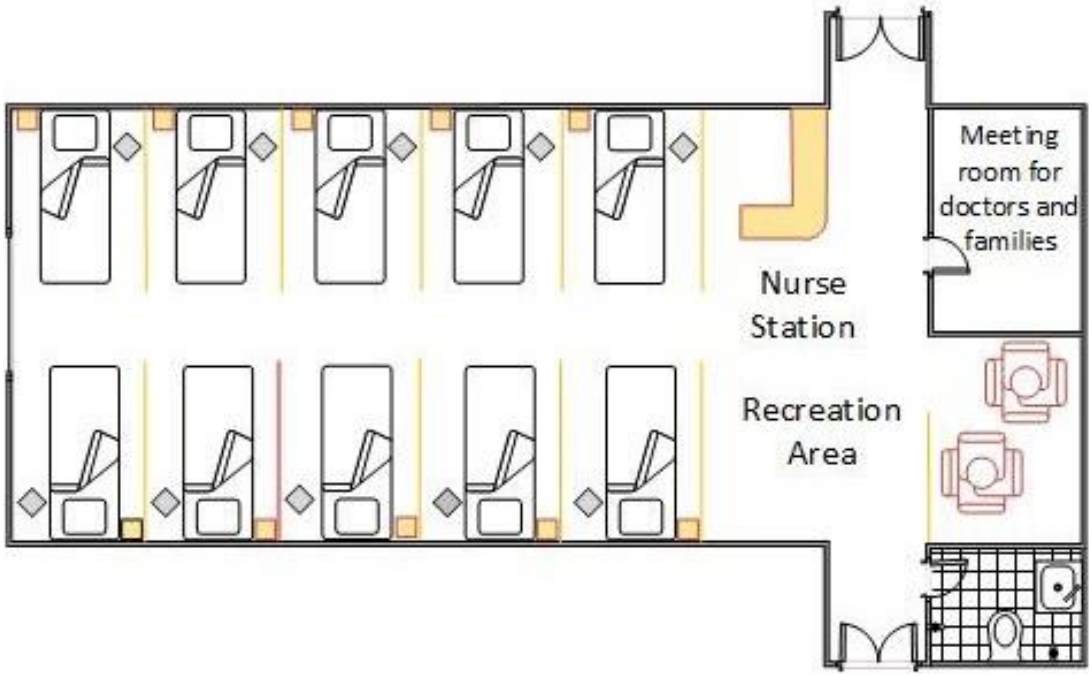


Figure 32: Example of 10 Patients Bed-capacity Ward.

4. HEALTH SERVICES

4.17 Laboratory

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION [5]

The **Laboratory** is a room receiving PDL newly or about to be committed as well as PDL patients for Diagnostic Study and where medical analyses (including TB screening) are performed. It is managed by staff health personnel.

- It should include an area for the safe preparation, handling and storage of acids, stains and solvents;
- Facilities for storing outer garments and personal items should be provided outside work areas.

This functional component is not to be included in all jail facilities but in selected facilities as decided by BJMP Health.

DESCRIPTION

LOCATION:

- Near the Health Staff Office, the Consultation Room, and the Pharmacy;
- See Figure 29 for a location example in a Type D facility (1001 - 2000 PDL capacity).

DIMENSIONS:

C (large)	Work area should be at least 10 sq. m (hematology, fecalysis, blood typing)
D (very large)	Work area should be at least 20 sq. m (hematology, fecalysis, blood typing, blood chemistry)

NUMBER:

N/A.

CHARACTERISTICS[1]:

- The **Laboratory** should contain Adequate Storage space to hold supplies for immediate use and prevent material and equipment left on bench tops and in **Corridors** (see page 159) outside the **Laboratory**. Additional space for long-term storage should be provided and located conveniently outside work areas;
- A specific counter should be designated for the reception of specimens;

[5] In part adapted from WHO: "Tuberculosis Laboratory Biosafety manual" p.16

- **Laboratory** doors should have a glass-window panel and appropriate fire ratings; they should be self-closing;
- Curtains must not be used;
- Walls, ceilings and floors should be smooth (preferably tiled) and easy to clean;
- Floors should be slip-resistant;
- Adequate **Water supply** (see page 152) should be provided;
- A **Lavatory** (see page 174) for handwashing and soap should be provided in each room of the **Laboratory**, preferably near the exit. Automated or **Elbow-taps** (see page 174) are recommended in certain places;
- A dispenser for paper towels should be at the **Lavatory**;
- Wastewater should be disposed into a **Soak Pit** (see page 181) and go through a **Degreasing Tank** (see page 181);
- The **Laboratory** should have adequate **Natural** and **Artificial Ventilation** (see page 168 and 171);
- Special attention should be paid to airflow direction (especially when dealing with TB);
- Laboratory Hoods[6] should be installed in designated places;
- **Air conditioning** (see page 172) may be required;
- **Lighting** (see page 168) should be adequate for all activities. Undesirable reflections and glare should be avoided.

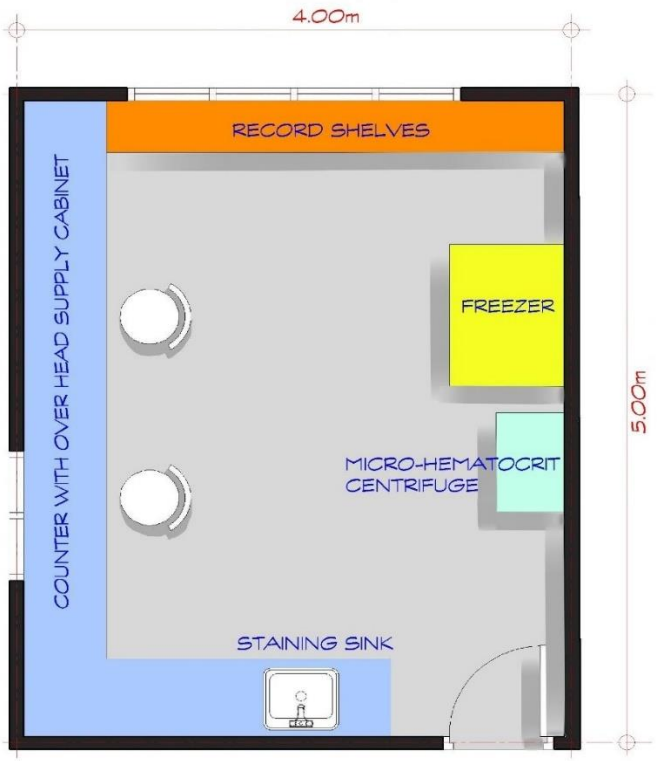


Figure 33: Laboratory Typical Layout

[6] An exhaust system that protects the users from inhaling toxic gases.

4. HEALTH SERVICES

4.18 Medical Imaging, X-Ray

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Medical Imaging, X-Ray** area is a specialized medical room designed for X-ray Services. It is being managed by staff health personnel (preferably with a radiologist).

The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance** / Exit page 159).

This functional component is not to be included in all jail facilities but in selected facilities as decided by BJMP Health.

DESCRIPTION

LOCATION:

- Near the **Health Staff Office** (see page 80), the **Consultation Room** (see page 77), and the **Pharmacy** (see page 86);
- Preferably on the ground-floor;
- See Figure 29 for a location example in a Type D facility (1001 - 2000 PDL capacity).

DIMENSIONS[7]:

- The area should be at least 5 sq. m;
- The base of any window(s) in the **X-Ray** examination room shall be elevated to a height of at least 2 m from the floor or ground outside the X-ray examination room.

NUMBER:

N/A.

CHARACTERISTICS[8]:

- Walls must be made of any of the following materials to a height of at least 2 m from the floor:
  - At least 150 mm poured concrete;
  - At least 150 mm CHB with all cavities filled and packed with concrete and plastered with at least 1/2 inch cement plaster on each side of the blocks;

[7] Based on DoH: "Radiation Protection Survey and Evaluation Checklist" and on DoH "Manual on Technical Guidelines For Hospitals and Health Facilities Planning and Design – Annexe 5."

[8] Based on DoH: "Radiation Protection Survey and Evaluation Checklist" and on DoH "Manual on Technical Guidelines For Hospitals and Health Facilities Planning and Design – Annexe 5."

  - At least 1.5mm thick lead sheet.
- Care must be taken to avoid punctures in the lead sheet which may occur during installation. It is recommended that the lead sheet be glued onto and sandwiched between wooden panels;
- A lead glass viewing window with lead equivalence of at least 1.5 min must be provided on a wall isolating the operator from the patient when indicated. The lead glass viewing window must be wide enough to view the patient during the examination. The outer edge of the lead glass viewing window should be at least 0.45 m from the outer edge of wall. The separation wall must not reach the ceiling in order to allow communication between the patient and the operator;
- The door leading to the **X-ray** examination room must be lined with at least 1.5 mm thick lead sheet to a height of at least 2 m from the floor. To prevent sagging of lead sheet the lead sheet should be glued onto and sandwiched between wooden panels;
- The door should close automatically;
- A red warning light-bulb that is automatically illuminated when the X-ray machine is switched on shall be installed outside the X-ray examination room above the x-ray room door;
- A warning notice shall be put outside the x-ray examination room door. It shall be made up of a solid yellow equilateral triangle 180mm long on each side. At the center of the triangle is a black tre-foil sign for radiation. Under the triangle are the words “X-RAY ROOM: DO NOT ENTER WHEN THE RED LIGHT IS ON” (see Figure 34). The warning notice shall be on 180 mm x 270 mm white background;
- Adequate **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172) shall be provided inside the **X-ray** examination room.



Figure 34: Radiations Sign

4. HEALTH SERVICES

4.19 Temporary Observation Ward

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Temporary Observation Ward** is a room where mentally ill PDL who need close monitoring are admitted upon discretion of an attending doctor and for a limited period, until they are referred to a mental hospital. Admission may occur right after commitment. Patients in the ward are supervised or monitored by a nurse.

The area must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance** / Exit page 159).

This functional component is not to be included in all jail facilities but in selected facilities as decided by BJMP Health.

DESCRIPTION

LOCATION:

- Near the **Health Staff Office** (see page 80), the **Consultation Room** (see page 77), and the **Pharmacy** (see page 86).

DIMENSIONS:

- At least 5 sq. m / bed;
- 5 to 10 beds.

NUMBER:

N/A.

CHARACTERISTICS:

- It must be possible to visually monitor the inside of the ward at all times from the **Nurse Station** (see page 79);
- There should be no hanging points;
- Applying padded panels on the walls may be considered;
- A **Toilet and Bath** (see page 166) accessible to PWD must be attached to the ward.

5. FOOD SERVICES

5.1 Kitchen Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Kitchen Area** is a room used for the preparation and cooking of food for PDL. It must contain:

- A washing area where raw food and cooking utensils are washed;
- A food preparation and food cooking areas;
- A cooking utensils storage area;
- A secured storage for sharp **Kitchen** tools.

The area must be equipped with a **Lavatory** (see page 174) reserved for hand-washing.

See Figure 36 for a layout example in a Type A facility (0 - 100 PDL capacity).

DESCRIPTION

LOCATION:

- Within Food Service Area that includes the Kitchen, the Kitchen Aide Cells and various Storage areas (food, gas cylinders).

DIMENSIONS:

- Area: 0.07 sq. m / PDL capacity with a minimum of 20 sq. m;
- Ceiling Height: At least 3 m (floor to top of beam).

NUMBER:

One centralized **Kitchen** for any jail capacity.

CHARACTERISTICS:

- The structure should be made of concrete columns, CHB walls and concrete floor;
- Floor should be tiled with non-slippery, unglazed floor-tiles;
- Window opening should be at least 20% of the floor area covered with screen and additional fans;
- If ceiling is not installed, a roof heat insulator should be installed;
- Walls should be plain cement finish and painted;
- At least two stainless-steel counters and sinks;
- A stainless-steel food preparation surface should be provided;

- There must be cabinets for storing of pots and other **Kitchen** utensils. Utensils storage should be secured;
- At least one potable water point for cooking purposes and another separate water point for washing purposes;
- LPG shall be used as fuel;
- No individual gas cylinder, instead there should be a Centralized Gas Piping System.
- Number of Gas Burners:

A (small)	At least 2
B (medium)	2 to 3
C (large)	3 to 4
D (very large)	4 to 6

  - Above 1000 PDL capacity: 1 burner for 500 PDL;
  - Burners diameter: 40 cm;
  - See Figure 35.
- Extraction hoods should be installed to deal with fumes and heat;
- Sufficient **Artificial Ventilation** (see page 170) ;
- Wastewater should go through a **Degreasing Tank** (see page 181);
- Adequate **Lighting and Natural Ventilation** (see page 167).



Figure 35: Gas Burner

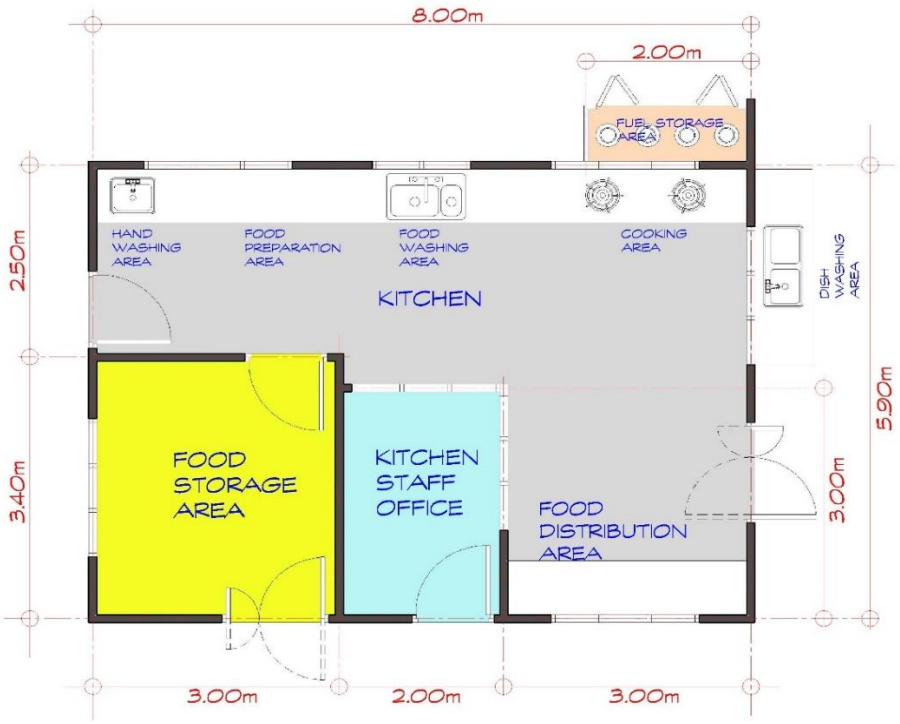


Figure 36: Proposed Layout of a Kitchen Area for Type A Facilities (1-100 PDL capacity)

5. FOOD SERVICES

5.2 Food Distribution Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Food Distribution Area** is a place where cooked food is collected from the **Kitchen Area** (see page 97) and packed for individual consumption before being distributed.

DESCRIPTION

LOCATION:

- Adjacent to the **Kitchen Area**;
- See Figure 36 for a layout example in a Type A facility (0 - 100 PDL capacity).

DIMENSIONS:

Area: At least 30% of the **Kitchen** area.

NUMBER:

N/A.

CHARACTERISTICS:

- Non-slippery floor tiles;
- Stainless counter-top;
- Openings and floor-grade should be accessible to food-cart;
- There should be a free movement flow from the **Kitchen Area** (see Figure 36).

5. FOOD SERVICES

5.3 Food Storage Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

The **Food storage Area** is a place provided for storing food. Food can be fresh raw vegetable or meat (freezer and refrigerator may be installed) as well as dry food (rice, pulses, oil, spices etc.).

DESCRIPTION

LOCATION:

- Adjacent to the **Kitchen Area** (see page 97);
- See Figure 36 for a layout example in a Type A facility (0 - 100 PDL capacity).

DIMENSIONS:

Area: 0.05 sq. m / PDL capacity with a minimum of 10 sq. m.

NUMBER:

One centralized **Kitchen** for whatever jail capacity.

CHARACTERISTICS:

- The room must be secured (locked);
- The floor must be tiled to avoid dampness;
- Metal doors are better than wooden doors;
- Openings should be accessible to carts;
- All windows and other openings must be screened;
- The temperature must be kept as low as possible by means of a suitable **Ventilation** system (see page 171). It is useful to have two doors or windows opposite each other, if possible, in the direction of the prevailing wind;
- Power Supply should be provided with the required strength if freezers are installed;
- There should be sufficient **Lighting** (see page 168).

5. FOOD SERVICES

5.4 Kitchen-waste Collection Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

The **Kitchen-waste Collection Area** is a place allocated for segregation of **Kitchen** waste. It should include waste-bins preferably used with garbage bags and equipped with covers.

DESCRIPTION

LOCATION:

- In a place separate from the **Kitchen** but close enough for practical use.

DIMENSIONS:

- At least 3 sq. m, based on an assumed production of 1 liter of waste / day / PDL capacity.

NUMBER:

Should be able to accommodate an average of three covered containers.

CHARACTERISTICS:

- Secured from vermin infiltration and large enough for one-day waste generation;
- Cemented floor surface.

5. FOOD SERVICES

5.5 Fuel Storage Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

The **Fuel Storage Area** is a place where Gas Cylinders are stored.

DESCRIPTION

LOCATION:

- Preferably adjacent to the cooking area of the **Kitchen**;
- See Figure 36 for a layout example in a Type A facility (0 - 100 PDL capacity).

DIMENSIONS:

At least 1.5 sq. m (good for four cylinders).

NUMBER:

N/A.

CHARACTERISTICS:

- Secured and covered;
- Equipped with gas pipes connected to the burners;
- Openings should allow good **Natural Ventilation** (see page 167).

5. FOOD SERVICES

5.6 Kitchen-staff Office

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Kitchen-staff Office** is a secured place for the maintenance of records such as inventory of stocks and delivery-invoices. It should include table, chairs and a storage cabinet.

DESCRIPTION

LOCATION:

- Adjacent to the **Kitchen Area** (see page 97);
- Location should allow visual monitoring of the **Kitchen** and delivery activities;
- See Figure 36 for a layout example in a Type A facility (0 - 100 PDL capacity).

DIMENSIONS:

At least 6 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Walls and openings design should allow visual monitoring of the **Kitchen** and delivery activities.

5. FOOD SERVICES

5.7 Kitchen-aide Cell

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Kitchen-aide** cell accommodates PDL regularly working in the **Kitchen**. Its design should be the same as in other cells.

DESCRIPTION

LOCATION:

- Near the **Kitchen Area** (see page 97).

DIMENSIONS:

As for **Sleeping and Dining Area** (see page 42) and **Cell Toilet and Bath** (see page 44).

NUMBER:

Jail Capacity	Number of Kitchen Aides[9]
C (large)	6 to 8
D (very large)	12 to 16

CHARACTERISTICS:

- Size and number of cells as per characteristics described in **Sleeping and Dining Area** (see page 42) and **Cell Toilet and Bath** (see page 44).

[9] Reference: Memorandum Circular No. 2008-01. Revised Standards on Food Service Management, dated 12 March 2008.

5. FOOD SERVICES

5.8 Kitchen Water-storage

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

The **Kitchen Water-storage** is a reservoir used to store water for cooking. It ensures that sufficient water supply is constantly available for cooking.

DESCRIPTION

LOCATION:

- Inside or near the **Kitchen Area** (see page 97).

DIMENSIONS:

- Volume should be at least 2 liters / PDL capacity;
- Total volume should be sufficient for one day water supply in the **Kitchen**.

NUMBER:

N/A.

CHARACTERISTICS:

It may be elevated (not compulsory).

6. DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES

6.1 Outdoor Access

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The area for **Outdoor Access** (sunning) is a place for exercise and to practice sports such as basketball.

DESCRIPTION

LOCATION:

- The area must be accessible from the Cells Building.

DIMENSIONS:

1 sq. m / PDL capacity with a minimum of 400 sq. m.

NUMBER:

- The area must have at least two (2) **Ordinary Toilets** (see page 163) for up to 500 PDL capacity and an additional two units for every additional 500 PDL capacity:

Category	Capacity Range	Number of Ordinary Toilets (Toilet Blocks)
A (small) to C (large)	Up to 1000 PDL	2
D (very large)	1000 - 1500 PDL	4
D (very large)	1500 - 2000 PDL	6

CHARACTERISTICS:

- The area must be enclosed with a see-through fence at least 2.5 m tall and topped with concertina wire;
- The area must include at least a Basketball Court;
- he area must have a paved surface, at least on the Basketball Court;
- The area must have **Water Supply** (see page 152) at least to supply a Toilet Block.

6. DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES

6.2 Laundry Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Laundry Area** is a place for washing and drying of clothes and bed linen provided for the PDL.

DESCRIPTION

LOCATION:

- Must be accessible from the Cells Building.

DIMENSIONS:

- Must be accessible to a group of up to 100 PDL;
- At least 20 sq. m / 100 PDL capacity.

NUMBER

- One unit for every 100 PDL capacity:

Category	Capacity Range	Number of Laundry Areas	Total Surface
A (small)	Up to 100 PDL	1	20 sq. m
B (Medium)	100 - 500 PDL	2 to 5	40 to 100 sq. m
C (Large)	500 - 1000 PDL	6 to 10	120 to 200 sq. m
D (very large)	1000 - 2000 PDL	11 to 20	220 to 400 sq. m

- 10 **Faucets** and **Lavatories** (see page 174), with drying racks.

CHARACTERISTICS:

- Tiled or concrete sink;
- The Washing Area must be roofed;
- The Drying Area must be well ventilated and must be roofed as well so that it is usable throughout the year;
- Wastewater from the **Laundry** should go through a **Degreasing Tank** (see page 181).

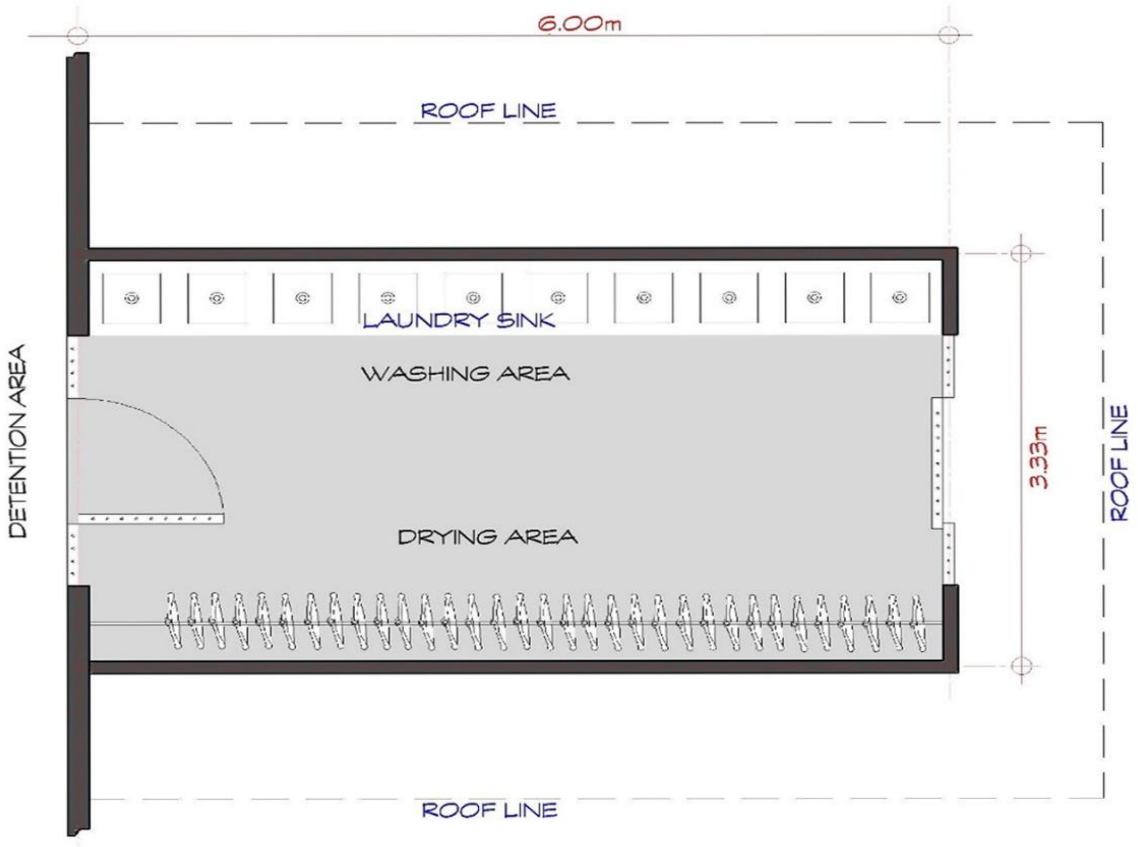


Figure 37: Proposed Layout of a Laundry Area for Type A Jail Facilities (1-100 PDL capacity)

6. DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES

6.3 Worship Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Worship Area** is a place where PDL can engage in religious activities. It should contain chairs/benches, an elevated platform rostrum, a cabinet for storage of religious materials and a sound system.

It should be near at least one **Ordinary Toilet** (see page 163).

Characteristics of all religions present in the region should be taken into consideration. For instance, an Ablution Area should be attached to the **Worship Area** when Muslim PDL are present.

DESCRIPTION

LOCATION:

- Preferably on the ground floor;
- Must be accessible from the Cells Building.

DIMENSIONS:

- When space allows 1.35 sq. m / PDL capacity;
- At least 135 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Roofed, tiled floor, enclosed;
- Must have adequate **Water Supply** (see page 152);
- Must have adequate **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

6. DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES

6.4 Training Room / ALS Room / Library

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☐ **C: 501-1000** ☐ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Training Room / ALS Room / Library** is a place for the PDL to undergo different activities aiming to develop their skills and character through conventional or unconventional methods. It also contains books and other media.

DESCRIPTION

LOCATION:

- Preferably on the ground floor;
- Must be accessible from the Cells Building;
- It should be near at least one **Ordinary Toilet** (see page 163).

DIMENSIONS:

At least 25 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Sufficient **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

6. DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES

6.5 Training Room

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Training Room** is a place for the PDL to undergo different activities aiming to develop their skills through lectures and group exercises.

It should be near at least one **Ordinary Toilet** (see page 163).

DESCRIPTION

LOCATION:

- Preferably on the ground floor;
- Must be accessible from the Cells Building.

DIMENSIONS:

At least 50 sq. m.

NUMBER:

- 1 **Training Room** for up to 2000 PDL capacity;
- More units can be added for larger facilities as per 1 additional Training Room for each 1000 PDL capacity.

CHARACTERISTICS:

- Sufficient **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

6. DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES

6.6 ALS Room / Library

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☐ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **ALS Room / Library** is used for Alternative Learning System sessions, which is non-formal education as well as a library where books and other media are put at the disposal of for PDL.

It should be near at least one **Ordinary Toilet** (see page 163).

DESCRIPTION

LOCATION:

- Preferably on the ground floor;
- Must be accessible from the Cells Building.

DIMENSIONS:

At least 50 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Sufficient **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

6. DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES

6.7 ALS Room

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☐ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **ALS Room** is used for Alternative Learning System sessions, which is non-formal education.

It should be near at least in one **Ordinary Toilet** (see page 163).

DESCRIPTION

LOCATION:

- Preferably on the ground floor;
- Must be accessible from the Cells Building.

DIMENSIONS:

At least 50 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Sufficient **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

6. DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES

6.8 Library

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☐ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Library** is a room that serves to keep and consult books/reading materials and other media that are available to PDL.

It should be near at least one **Ordinary Toilet** (see page 163).

DESCRIPTION

LOCATION:

- Preferably on the ground floor;
- Must be accessible from the Cells Building.

DIMENSIONS:

At least 50 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Sufficient **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

6. DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES

6.9 Livelihood Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Livelihood Area** is an indoor or outdoor place where production of crops, goods and other livelihood projects take place.

It should be near at least one **Ordinary Toilet** (see page 163).

DESCRIPTION

LOCATION:

- Preferably on the ground floor.

DIMENSIONS:

1 to 2 sq. m / 10 PDL capacity.

NUMBER:

N/A.

CHARACTERISTICS:

- The area should be provided with roof (if outdoors);
- The area must have sufficient **Water Supply** (see page 152) and Power Supply;
- The area must have fire safety equipment (e.g. fire extinguisher), especially for risky activities (with a lot of material that can burn);
- Sufficient **Lighting** (see page 167) and **Artificial Ventilation** (see page 170).

ADMINISTRATION

7.1 Warden's Quarter

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Warden's Quarter** is an accommodation area inside the jail facilities provided for the Warden. Depending on the size of the facility, it can range from a single room with **Toilet and Bath** (see page 166) to a **studio**, an apartment or a house.

DESCRIPTION

LOCATION:

- It should be close to the Administration Building where the **Warden's Office** (see page 117) is located.

DIMENSIONS:

At least 12.00 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

The **Warden's Quarters** must be equipped with all usual facilities in accommodation quarters: At least **Toilet and Bath** (see page 166), **Artificial Ventilation** (see page 170), **Air Conditioning** (see page 172), tiled floor, etc. The quarters may also comprise rooms such as kitchen, spare bed-room etc. depending on the type of accommodation, which is linked to the size of the jail facility.

ADMINISTRATION

7.2 Warden's Office

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Warden's Office** is a place where the warden conducts his/her duties, including meeting visitors. The office must be equipped with CCTV monitor, intercom and means of communication including the internet. It should be equipped with executive table and chairs and built-in cabinets (may include steel cabinet for cash and valuables).

The office must have an attached **Ordinary Toilet** (see page 163).

DESCRIPTION

LOCATION:

- The **Warden's Office** should be inside the Administration Building and easily accessible from the **Warden's Quarters** (see page 116). It should also be located in a strategic place from where the warden could easily access, oversee and supervise personnel;
- The office must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance / Exit** page 159).

DIMENSIONS:

- Area: At least 16 sq. m;
- Ceiling Height: At least 3 m.

NUMBER:

N/A.

CHARACTERISTICS:

- **Emergency Lights** (see page 168);
- Sufficient **Lighting, Natural Ventilation** (see page 167) and **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

7. ADMINISTRATION

7.3 Staff Quarters

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Staff Quarters** are used as a billeting for all jail personnel to keep their uniforms and other personal belongings and to rest as needed. It can also be used as standby area during red alert status periods. The quarters may be equipped with **Bunk Beds** (see page 54) and with **Toilet and Bath** (see page 166).

DESCRIPTION

LOCATION:

Inside or next to the Administration Building.

DIMENSIONS:

- Area: At least 4.7 sq. m / personnel, **Toilet and Bath** (see page 166) included;
- Room size must not exceed 8 m x 6 m;
- Ceiling Height: At least 3 m.

NUMBER:

N/A.

CHARACTERISTICS:

- Tiled floor;
- Sufficient **Lighting, Natural Ventilation** (see page 167) and **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

7. ADMINISTRATION

7.4 Staff Office

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

The **Staff Office** is used by BJMP staff to conduct all desk-tasks related to their function, store and staff records and meet with counterparts as needed. The area includes a Public Assistance and Complaint Desk (PACD) or Sentinel Area to screen and record visitors for the admin office.

- In general there will be no individual office;
- A separate room must be provided for keeping the records of PDL and staff;
- The **Staff Office** must have desks, tables and chairs, computers, printers and filing cabinets. The office should be equipped with, telephone / fax lines, a photocopier, a shredder, internet access, intercom and radio.

DESCRIPTION

LOCATION:

- Inside the Administration Building.
- The office must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance / Exit** page 159).

DIMENSIONS:

- Area:
  - For single-occupancy office: At least 6 sq. m;
  - For shared office: At least 4 sq. m. per user;
  - For record-keeping, 1 sq. m. per 100 PDL capacity with a minimum of 5 sq. m.

Category	Capacity Range	Number of Office Staffs	Minimum Total Surface
A (small)	Up to 100	10	40 sq. m
B (Medium)	101 - 500	15	60 sq. m
C (Large)	501 - 1000	30	120 sq. m
D (very large)	1001 - 2000	40	160 sq. m

- Ceiling Height: At least 3 m.

NUMBER:

N/A.

CHARACTERISTICS:

- Tiled floor;
- The Records Room must be secured;
- At least two **PWD-accessible Toilets** (see page 163) must be provided in the area;
- Sufficient **Lighting, Natural Ventilation** (see page 167) and **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

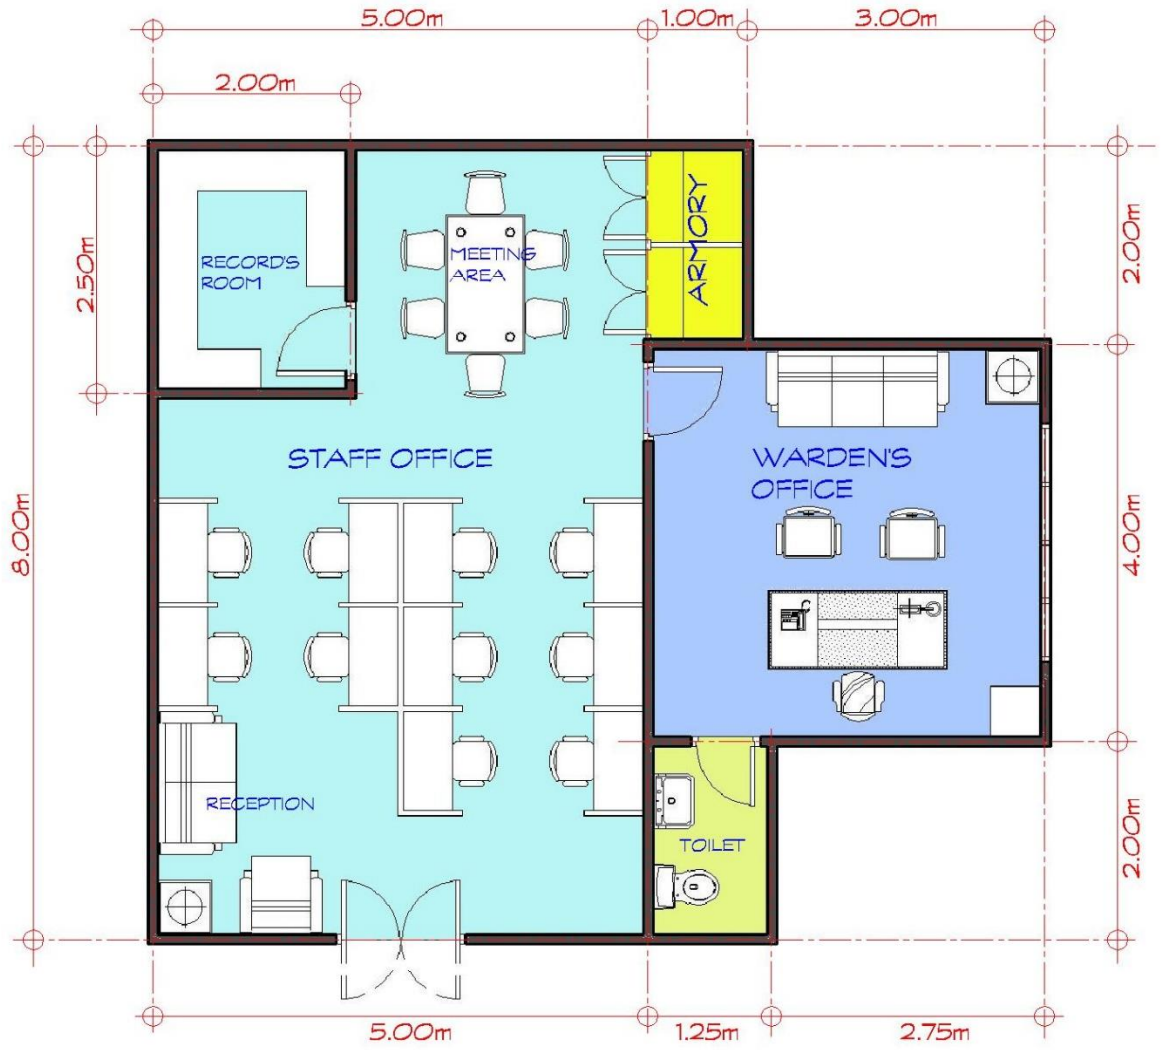


Figure 38: Typical Layout of Warden's Office / Staff Office/ Records Room for Type A Facilities (1-100 PDL capacity)

7. ADMINISTRATION

7.5 Office Supply Storage Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Office Supply Storage Area** is a place where office supplies and other jail logistical equipment are properly and safely stored.

DESCRIPTION

LOCATION:

- Inside the Administration Building.

DIMENSIONS:

- Area: At least 8.00 sq. m;
- Ceiling Height: At least 3 m.

NUMBER:

N/A.

CHARACTERISTICS:

- Should be a separate room;
- Should be secured;
- Sufficient **Lighting and Natural Ventilation** (see page 167).

7. ADMINISTRATION

7.6 Armory

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The Armory is a room or a steel cabinet where arms, ammunitions and other military equipment are stored to be used as needed. The armory should contain arm-racks.

DESCRIPTION

LOCATION:

- Inside the Administration Building or in the **Guard House** (see page 132).

DIMENSIONS:

- 8 pieces long fire-arms / sq. m;
- Number of fire arms: At least 16 long-fire arms per jail facility;
- Area: At least 2 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Secured room or cabinet with locks;
- Should be provided with adequate **Lighting** including **Emergency Lights** (see page 167).

7. ADMINISTRATION

7.7 Conference Room / Staff Training Room

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☐ **C: 501-1000** ☐ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Conference Room/ Staff Training Room** is a place where Meetings, Conferences, and Trainings are being held. It can also serve as Back-up Command Center during crisis management. It should be equipped with tables and chairs, microphones, a podium, a white board, a TV and a projector.

The room may also serve as a Library, where books and other reading materials are arranged on shelves to suit the available space.

DESCRIPTION

LOCATION:

- Inside the Administration Building.

DIMENSIONS:

- Area: At least 30 sq. m;
- Ceiling Height: At least 3 m.

NUMBER:

N/A.

CHARACTERISTICS:

- Tiled floor;
- Sound proof;
- Electrical outlets, extension wires, AVR for laptop and **Emergency Lights** (see page 167);
- Sufficient **Lighting, Natural Ventilation** (see page 167) and **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

7. ADMINISTRATION

7.8 Conference Room

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Conference Room** is a place where meetings and conferences are being held. It can also serve as Back-up Command Center during crisis management. It should be equipped with tables and chairs, microphones, a podium, a white board, a TV and a projector.

DESCRIPTION

LOCATION:

- Inside the Administration Building;
- Should be near the **Warden's Office** (see page 117) and the **Staff Office** (see page 119).

DIMENSIONS:

- Area: At least 30 sq. m;
- Ceiling Height: At least 3 m.

NUMBER:

N/A.

CHARACTERISTICS:

- Tiled floor;
- Sound proof;
- Sufficient **Lighting, Natural Ventilation** (see page 167) and **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

7. ADMINISTRATION

7.9 Staff Training Room

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Staff Training Room** is a place where trainings are conducted for the personnel. It may also be used for other purposes, like Seminars and workshops as well as personnel information /education sessions.

The room may also serve as a Library, where books and other reading materials are arranged on shelves to suit the available space.

DESCRIPTION

LOCATION:

- Inside the Administration Building.

DIMENSIONS:

- Area: At least 30 sq. m;
- Ceiling Height: At least 3 m.

NUMBER:

N/A.

CHARACTERISTICS:

- Tiled floor;
- Sound proof;
- Electrical outlets, extension wires, AVR for lap top and **Emergency Lights** (see page 167);
- Sufficient **Lighting, Natural Ventilation** (see page 167) and **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

7. ADMINISTRATION

7.10 Staff Kitchen / Dining Room / Food Storage Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Staff Kitchen/Dining Room/Food Storage** area is a place that serves as a dining and cooking area for the personnel, as well as for storage of food. It should be equipped with at least sink, a gas stove and a refrigerator. It should also have a dining table and chairs.

DESCRIPTION

LOCATION:

- Inside the Administration Building;
- Near the Staff Office (see page 119).

DIMENSIONS:

- Area: At least 30 sq. m;
- Ceiling Height: At least 3 m.

NUMBER:

N/A.

CHARACTERISTICS:

- Tiled floor;
- **Exhaust Fan** (see page 170);
- Sufficient **Lighting, Natural Ventilation** (see page 167) and **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

7. ADMINISTRATION

7.11 Fitness Room

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☐ **C: 501-1000** ☐ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Fitness Gym** is a place that houses exercise equipment for the purpose of **Physical Exercise** and **Health Development** that may utilized by the personnel. The area should be equipped with Basic Gym Equipment, a mirror, sound system and TV.

DESCRIPTION

LOCATION:

- Inside or next to the Administration Building;
- If possible near **Staff Quarters** (see page 118).

DIMENSIONS:

- Area: At least 24 sq. m. For both Fitness Room and Changing-room (wherever possible);
- Ceiling Height: At least 3 m.

NUMBER:

N/A

CHARACTERISTICS:

- Floor made of plain cement with rubberized paint;
- If sufficient space is available, the area must be provided with Changing-rooms. The Changing-room must be divided into two parts (for male and female), each with an attached **Toilet and Bath** (see page 166). If this is not possible, **Staff Quarters** (see page 118) must be close-by so that they can be used as changing-rooms;
- Sufficient **Lighting, Natural Ventilation** (see page 167) and **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

7. ADMINISTRATION

7.12 Staff Sports and Recreational Area

CAPACITY RANGE

☐ **A: 1-100** ☐ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Staff Sports and Recreational Area** is an indoor and/or outdoor area in which personnel can do Physical Exercise. Indoor facilities may consist of a **Fitness Room** (see page 126).

DESCRIPTION

LOCATION:

- May be partly indoors and partly outdoors but not far from the **Staff Quarters** (see page 118).

DIMENSIONS:

Area: At least 400 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Indoor facility: as per characteristics include in **Fitness Room** (see page 126);
- Floor made of plain cement with rubberized paint (for outdoor sport facilities).

7. ADMINISTRATION:

7.13 Parking Lot

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Parking Lot** is a place for parking vehicles. There should be enough space to park at least BJMP official vehicles.

DESCRIPTION

LOCATION:

- In front of the Administration Building.

DIMENSIONS:

According to NBCP[10], the area of one parking space should be at least 10 sq. m.

NUMBER:

Category	Number of Parking lots[11]
A (small)	1 (Transport Vehicle) + 1 (Warden) = 2
B (Medium)	3 (Transport Vehicle) + 1 (Warden) = 4
C (Large)	5 (Transport Vehicle) + 1 (Warden) = 6
D (very large)	6 (Transport Vehicle) + 1 (Warden) = 7

CHARACTERISTICS:

- Concrete rough finish.

REMARKS

An additional **Parking Lot** can be provided outside the **Main Perimeter Fence** (see page 139) for visitors if sufficient space is available.

[10] National Building Code of the Philippines

[11] Reference: Standard Equipage Distribution.

7. ADMINISTRATION

7.14 Motor pool

CAPACITY RANGE

☐ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Motor pool** is an area where the repair and maintenance of jail vehicles such as prisoners van/bus is conducted. The area should have a storage space for tools and equipment for repairs and maintenance

DESCRIPTION

LOCATION:

- Outside the Administration Building.

DIMENSIONS:

B (medium)	24 sq. m
C (large)	48 sq. m
D (very large)	96 sq. m

Ceiling / Roof Height: At least 4 m.

NUMBER:

N/A.

CHARACTERISTICS:

- The area must be roofed;
- Rough cement floor finish;
- There should be a place for the storage of tools;
- Provided with ramp or pit;
- A drainage channel with a **Degreasing Tank** (see page 181) should be built to evacuate Wastewater from washing the vehicle.

8. SECURITY:

8.1 Command Control

CAPACITY RANGE

☐ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Command Control** is a restricted room wherein PDL's behavioral monitoring, control and recording take place. It should be equipped with Power Supply, CCTV monitoring system, audio system and base radio. The room must at least have basic furniture. (table / desk and chairs, shelves etc.).

DESCRIPTION

LOCATION:

- Preferably located adjacent to the **Warden`s Office** (see page 117);
- Or co-located in the Administration/Operation Office of the Administration Building, having easy access to authorized personnel.

DIMENSIONS:

B (medium)	15 sq. m
C (large)	20 sq. m
D (very large)	25 sq. m

- Minimum dimensions : 3 m x 4.5 m;
- Ceiling Height: At least 3 m.

NUMBER:

N/A.

CHARACTERISTICS:

- Highly secured (locked cabinets);
- Internet and Phone connections;
- Electrical outlets, extension wires, AVR for lap top and **Emergency Lights** (see page 167);
- Sufficient **Lighting, Natural Ventilation** (see page 167) and **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

8. SECURITY:

8.2 Guard House

CAPACITY RANGE

☒ A: 1-100 ☒ B: 101-500 ☒ C: 501-1000 ☒ D: 1001-2000

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Guard house** is a room where jail personnel is posted to render their duties such as: registering / searching all vehicles and visitors entering or leaving the jail.

It must be equipped with CCTV, office tables and chairs.

DESCRIPTION

LOCATION:

- Adjacent to **Main Gate** (see page 143);
- See example of location on Figure 39.

DIMENSIONS:

- Minimum dimensions : 3 m x 3 m = 9 sq. m;
- Ceiling Height: At least 3 m.

NUMBER:

A (Small)	1
B (medium)	1
C (large)	2
D (very large)	2

CHARACTERISTICS:

- The room must be roofed and have windows;
- May include and **Ordinary Toilet** (see page 163);
- May include the **Armory** (see page 122), with walls made of steel or concrete;
- Must have sufficient **Lighting, Natural Ventilation** (see page 167) and **Artificial Ventilation** (see page 170) or **Air Conditioning** (see page 172).

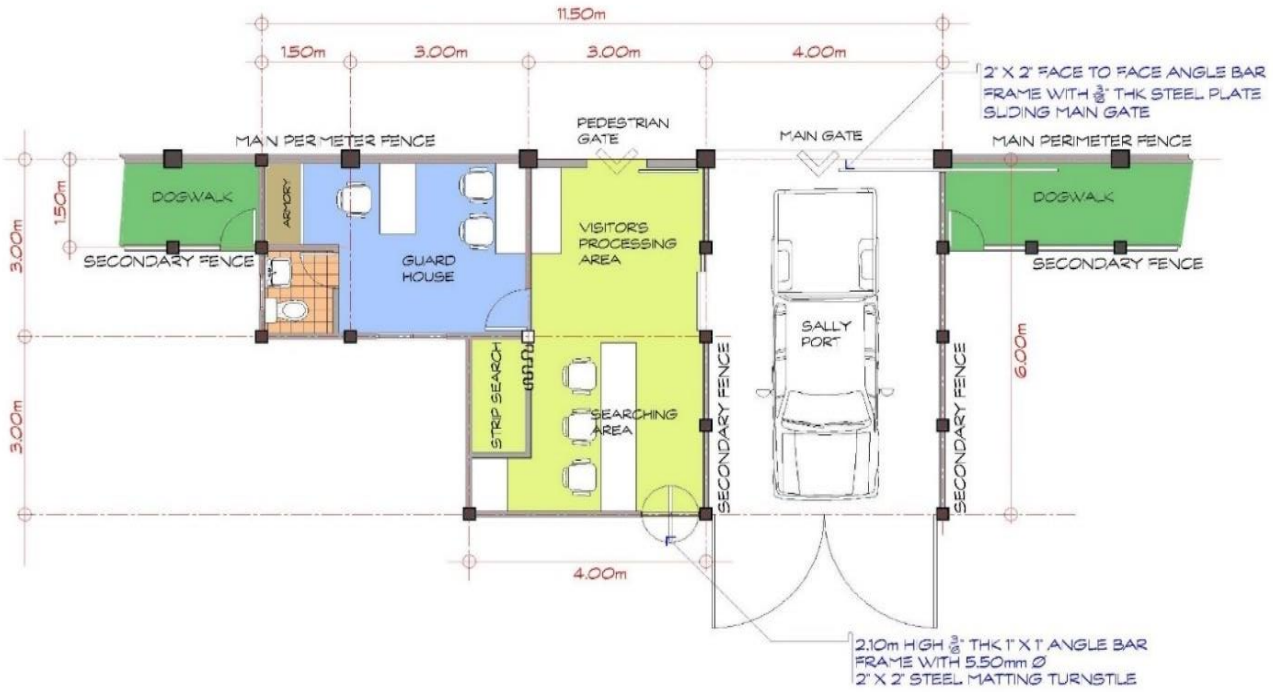


Figure 39: Guard House Position within the Visitors Processing Area

8. SECURITY

8.3 Sally Port

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Sally Port** is a closed controlled entry way to the jail facility used for searching vehicles before entering and leaving the jail facility. The area should be installed with see-through fence and steel gate and equipped with CCTV and built-in concave mirrors.

DESCRIPTION

LOCATION:

- Found between the **Main Gate** (see page 143) and the Secondary Gate, upon entry;
- See example of location on Figure 39.

DIMENSIONS:

A (Small)	At least 6 m x 4 m = 24 sq. m
B (medium)	At least 6 m x 4 m = 24 sq. m
C (large)	At least 10 m x 6 m = 60 sq. m
D (very large)	At least 10 m x 6 m = 60 sq. m

NUMBER:

N/A.

CHARACTERISTICS:

- Concrete pavement;
- May include steel-matting side-walls with concertina wires on top;
- Strong **Lighting** from the top (see page 167).

8. SECURITY

8.4 Guard Tower

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Guard Tower** is a structure integrated to the **Main Perimeter Fence** (see page 139), where jail personnel can monitor and maintain security and control PDL's activities at vantage points.

DESCRIPTION

LOCATION:

- On the **Main Perimeter Fence** (see page 139), linked by the **Catwalk** (see page 141);
- **Guard Towers** should be 30 m to 50 m apart or at every corner of the **Main Perimeter Fence** (see page 139).

DIMENSIONS:

- Minimum Area: 2 m x 2 m = 4 sq. m;
- Ceiling Height: At least 2.1 m;
- Elevation from the ground line: At least 4 m.

NUMBER:

N/A

CHARACTERISTICS:

- Roofed preferably with corrugated G.I. sheet;
- Sufficient **Lighting** (see page 167) and **Artificial Ventilation** (see page 170);
- May include An **Ordinary Toilet** (see page 163) or a Urinal.

REMARKS

Details on the recommended design of the Guard Towers appear on Figure 40.

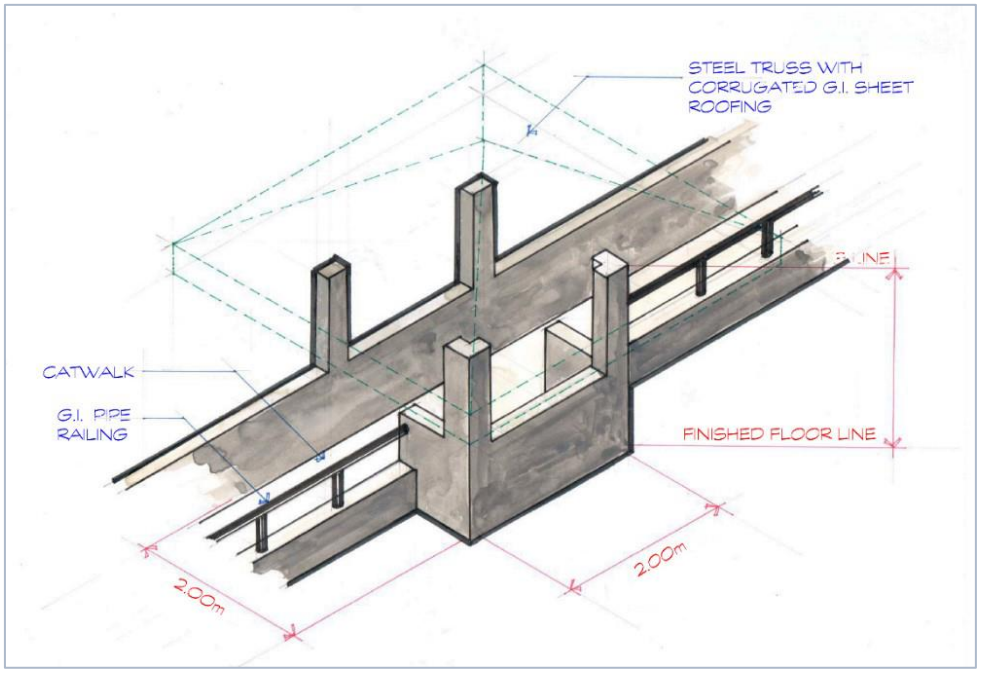


Figure 40: Guard Tower

8. SECURITY

8.5 Dog-walk

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Dog-walk** is an open area between the **Main Perimeter Fence** (see page 139) and the **Secondary Perimeter Fence** (see page 147). It is not accessible by anyone except during emergencies.

DESCRIPTION

LOCATION:

- Ground area between the **Main Perimeter Fence** (see page 139) and the **Secondary Perimeter Fence** (see page 147).

DIMENSIONS:

At least 1.5 m wide.

NUMBER:

N/A.

CHARACTERISTICS:

- The **Dog-walk** must have a CCTV and adequate **Lighting** (see page 167) and must be covered with steel matting, concertina and barbed-wire fixed by concrete posts.

REMARK

- **Dog-walk** is also known as “Buffer Zone”;
- See details of design on Figure 41.

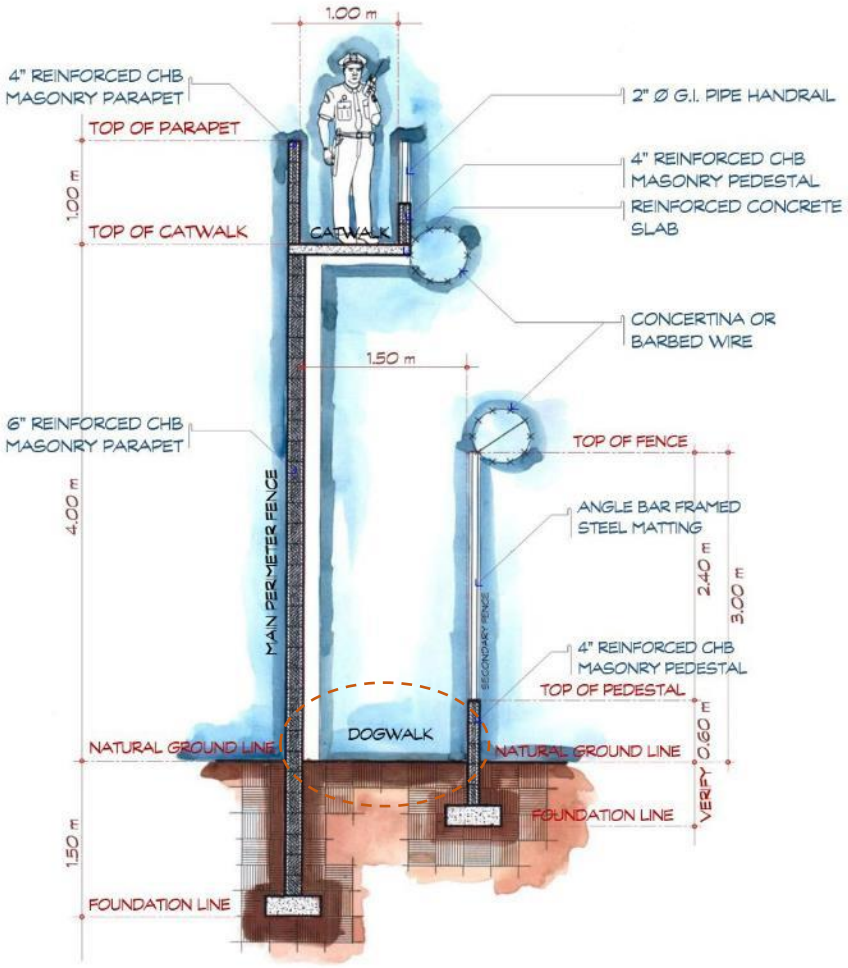


Figure 41: Dog-walk

8. SECURITY

8.6 Main Perimeter Fence

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Main Perimeter Fence** serves as the main physical security barrier of the jail from its surrounding environment. It comprises the **Guard Towers** (see page 135) and the **Catwalk** (see page 141). It may be equipped with spotlights, barbed-wire and concertina wire. Urinals may be provided at certain places.

DESCRIPTION

LOCATION:

- Along the lot limits except for the front of the facility, whenever setback[12] is applied.

DIMENSIONS:

- At least 4 m in height from the ground-line up to the **Catwalk** made of CHB masonry;
- There should be an additional 1 m CHB masonry wall on top of the **Catwalk**;
- Total height: At least 5 m.

NUMBER:

N/A.

CHARACTERISTICS:

- At least 6" (150 mm) thick CHB masonry wall for the first 4 m from the ground-line;
- At least 4" (100 mm) thick CHB masonry wall above **Catwalk** level;
- At least 1.5 m buried underground (foundations);
- Adequate **Lighting** that includes **Emergency Lights** (see page 167).

REMARKS

See details of design on Figure 42.

[12] Distance from the property line.

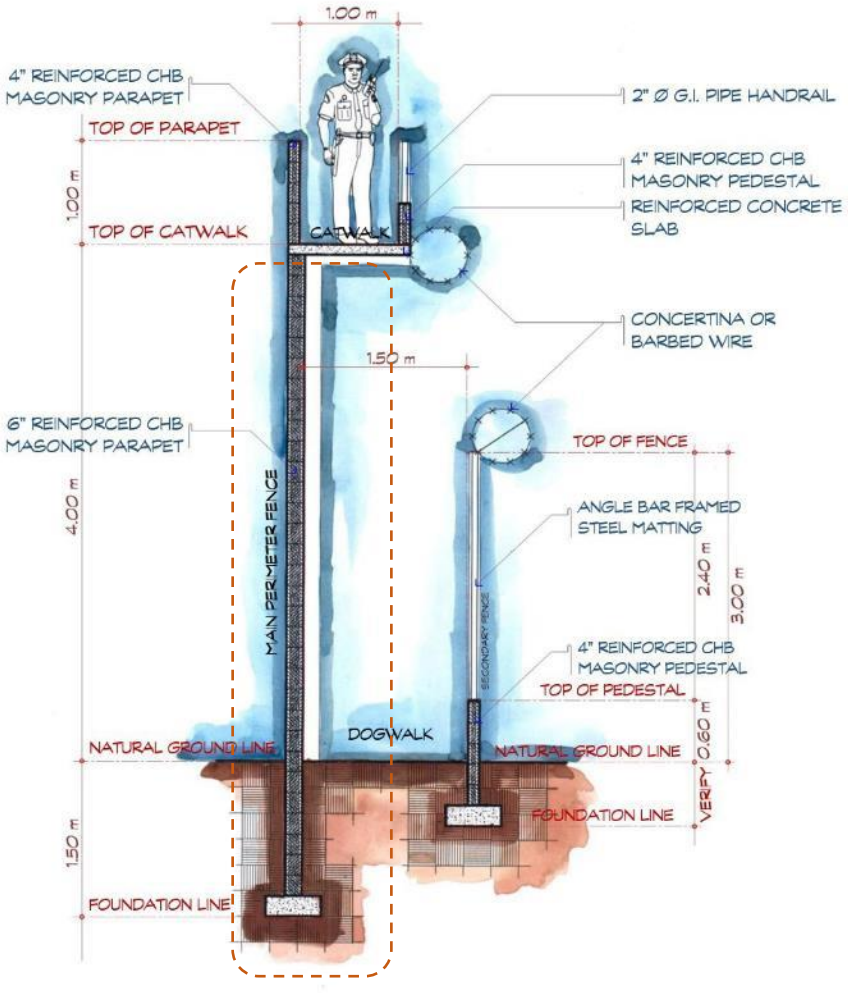


Figure 42: Main Perimeter Fence

8. SECURITY

8.7 Catwalk

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Catwalk** is the elevated walkway connecting the **Guard Towers** (see page 135) located atop of the **Main Perimeter Fence** (see page 139) directly above the **Dog Walk** (see page 137).

DESCRIPTION

LOCATION:

- Atop of the **Main Perimeter Fence**.

DIMENSIONS:

- At least 1 m clear width;
- There should be at least 1 m from the top of the **Catwalk** to the top of the Parapet (see Figure 43).

NUMBER:

N/A.

CHARACTERISTICS:

- Enclosed by at least 4" CHB Wall;
- Equipped with 1 m in height G.I. pipe handrail;
- Equipped with barbed-wire and concertina wire leaning towards the jail at 45° angle;
- Adequate **Lighting** (see page 167).

REMARKS

See details of design on Figure 43.

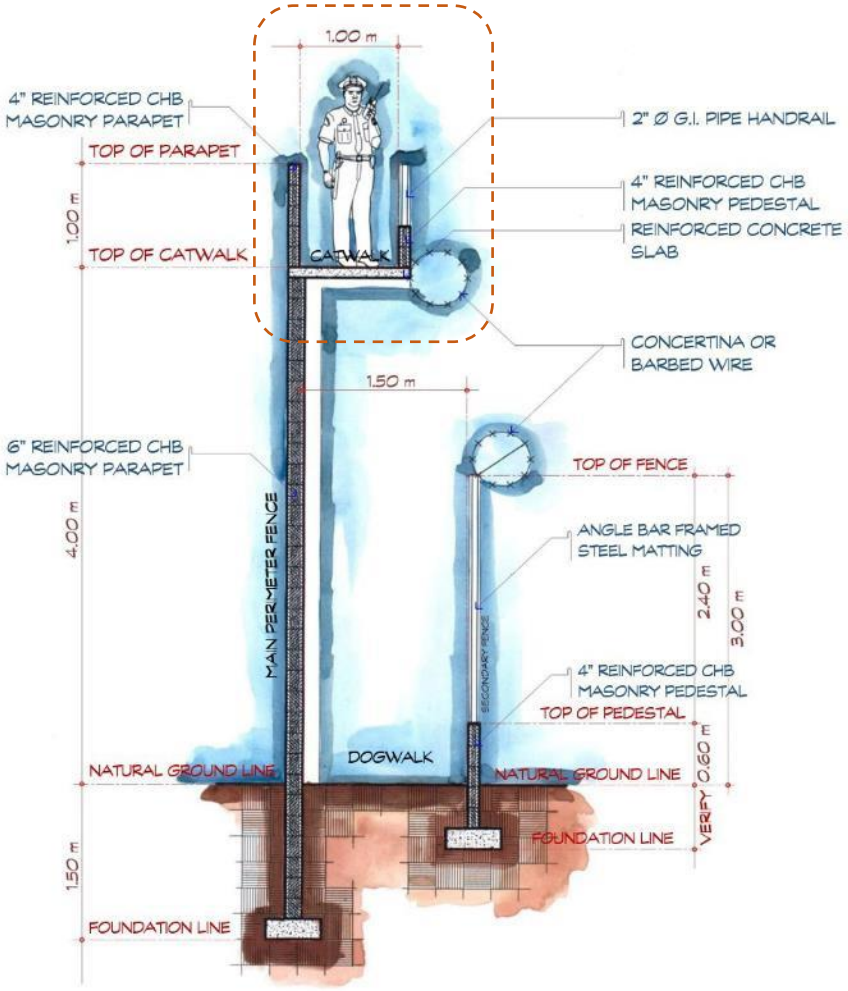


Figure 43: Catwalk

8. SECURITY

8.8 Main Gate

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Main Gate / Vehicle Gate** is a large door allowing the entry and exit of vehicles.

DESCRIPTION

LOCATION:

- Opening to the jail main access road.

DIMENSIONS:

- Minimum in height: 4 m.

A (Small) and B (medium)	At least 3 m wide
C (large) and D (very large)	At least 4 m wide

NUMBER:

N/A.

CHARACTERISTICS:

- Preferably sliding;
- Preferably Motor-controlled;
- Made with 3/16" thk steel plate;
- Frame should be fabricated as follows: ¼" thk 2" x 2" angle bar placed face to face.

REMARKS

See details of design on Figure 44.

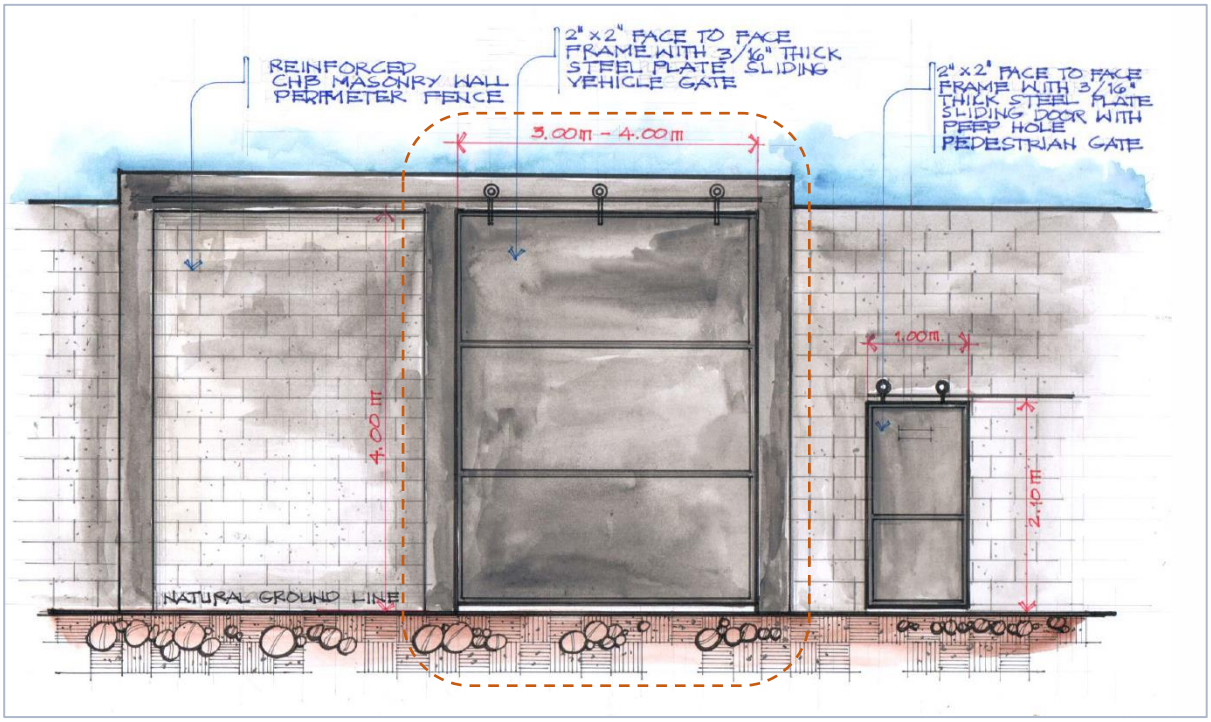


Figure 44: Main Gate / Vehicle Gate

8. SECURITY

8.9 Pedestrian Gate

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☒ NO ☐

DEFINITION

The **Pedestrian Gate** is used for the entry and exit of personnel, visitors, PDL and other people.

It must be designed in a way that allows usage by PWD (see **A.1 Corridors, Staircases and Entrance / Exit** page 159).

DESCRIPTION

LOCATION:

- On the **Main Perimeter Fence** (see page 139) beside the Main Gate.

DIMENSIONS:

- Minimum area: 1 m x 2.1 m opening.

NUMBER:

N/A.

CHARACTERISTICS:

- May be sliding type;
- Made with 3/16" thk steel plate;
- Frame should be fabricated as follows: ¼" thk 2" x 2" angle bar placed face to face;
- Equipped with Peep-hole.

REMARKS

See details of design on Figure 45.

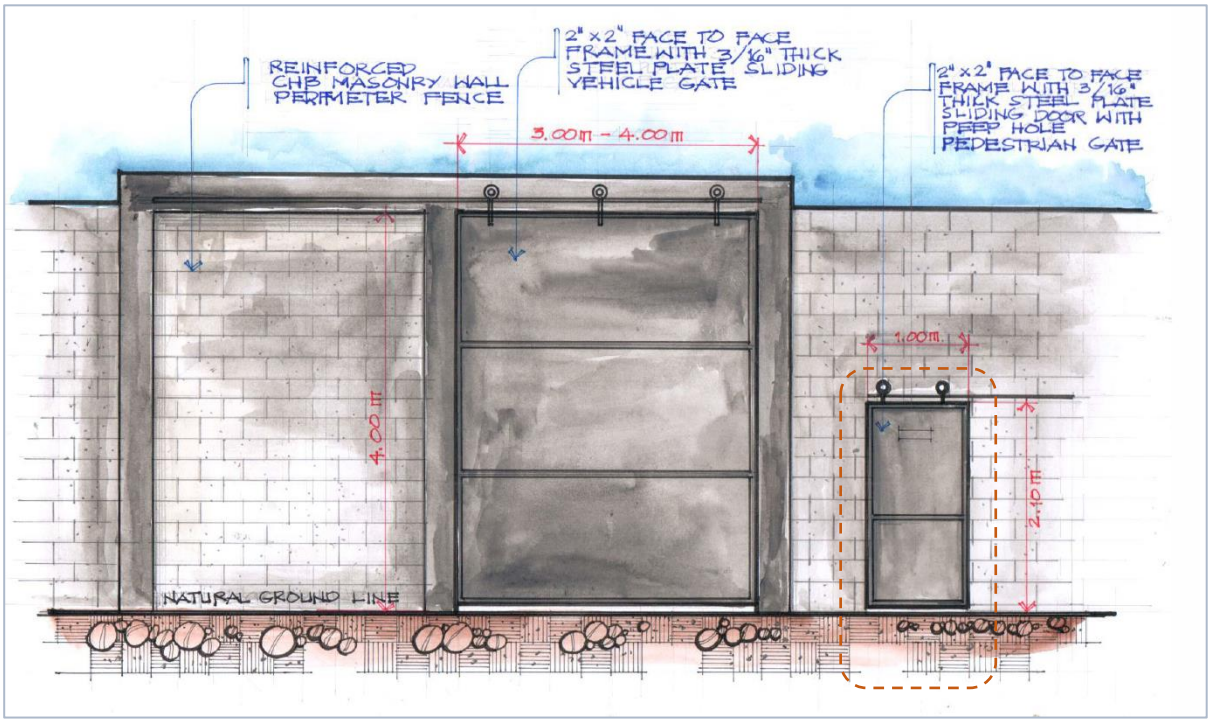


Figure 45: Pedestrian Gate

8. SECURITY

8.10 Secondary Perimeter Fence

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Secondary Perimeter Fence** serves as physical security barrier between the **Main Perimeter Fence** (see page 139) and the interior part of the jail.

DESCRIPTION

LOCATION:

Inside and parallel to the **Main Perimeter Fence**.

At least at 1.5 m from the **Main Perimeter Fence**. The space between the **Main Perimeter Fence** and the **Secondary Perimeter Fence** is called the **Dog Walk** (see page 137) or the "Buffer Zone".

DIMENSIONS:

- At least 3 m in height.

NUMBER:

N/A.

CHARACTERISTICS:

- Preferably made up of steel structure with steel matting and concertina wires;
- Adequate **Lighting** that includes **Emergency Lights** (see page 167);
- CCTV, Spot-light, and Motion Sensors.

REMARKS

See details of design on Figure 46.

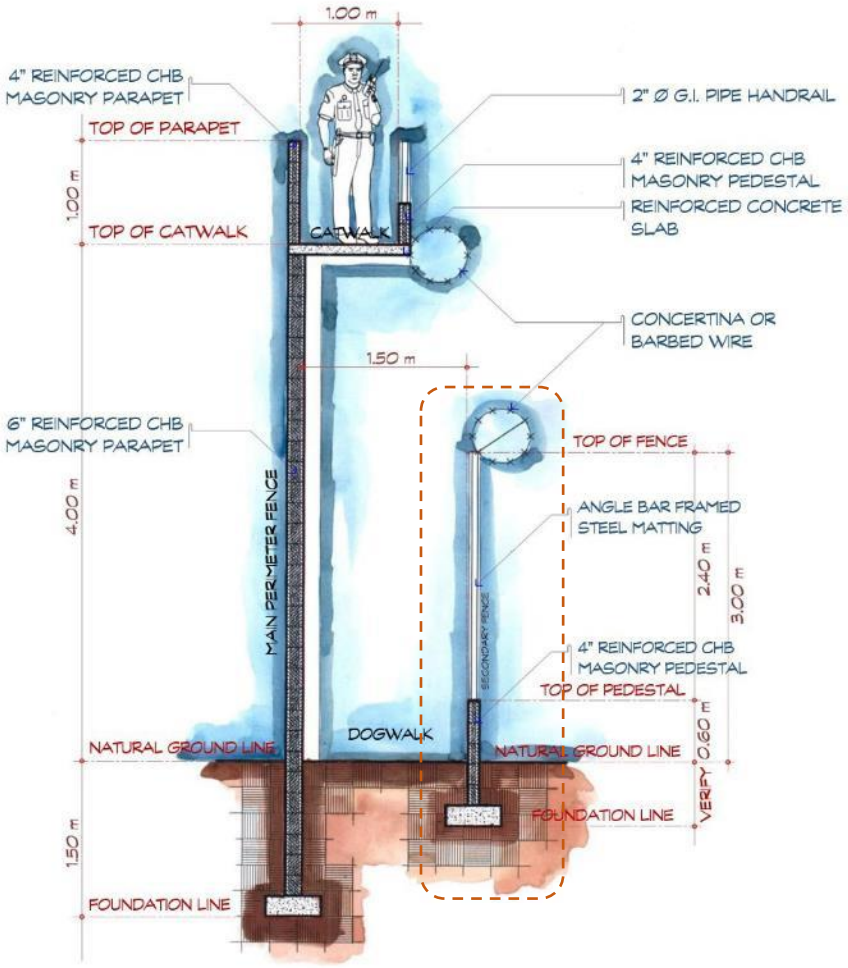


Figure 46: Secondary Perimeter Fence

8. SECURITY

8.11 Inner Barriers

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

Inner Barriers are used to control the flow of people inside the jail. They are equipped with Control Gates.

Control Gates on the way to the Administration Building, the **Visitors Area for Contact Visit** (see page 63), and the **Visitors Area for Non-Contact** (see page 69) must be accessible to PWD (see **A.1 Corridors, Staircases and Entrance / Exit** page 159).

DESCRIPTION

LOCATION:

- Within the perimeter defined by the **Secondary Perimeter Fence** (see page 147).

DIMENSIONS:

- At least 3 m in height;
- Area: 1 m x 2.10 m = 2.1 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Preferably steel matting framed with angle bar and concertina wire;
- Barrel-bolt lock on gate;
- Adequate **Lighting** that includes **Emergency Lights** (see page 167);
- Possibly CCTV, Spot-light, and Motion Sensors.

8. SECURITY

8.12 Control Post

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

SPECIFIC REQUIREMENTS

- Specific Design for High-Risk Jail Facilities? YES ☐ NO ☒
- Specific Provisions for PWD Access? YES ☐ NO ☒

DEFINITION

The **Control Post** is a platform station used by custodial guards doing direct and intermittent surveillance within the jail and mainly in the Cells Building.

DESCRIPTION

LOCATION:

- Strategic areas.

DIMENSIONS:

1.5 m x 1.5 m = 2.25 sq. m.

NUMBER:

N/A.

CHARACTERISTICS:

- Equipped with a table and a chair.

9. ESSENTIAL SERVICES / UTILITIES

9.1 Power Room

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

The **Power Room** is an area wherein the main electrical controls and the emergency Power Supply systems (e.g. generator) of the jail are located.

DESCRIPTION

LOCATION:

- Near the Administration Building area (inside or attached to the building).

DIMENSIONS:

A (Small)	At least 10 sq. m
B (medium)	At least 20 sq. m
C (large)	At least 30 sq. m
D (very large)	At least 40 sq. m

NUMBER:

N/A.

CHARACTERISTICS:

- The emergency power supply must be used to illuminate the perimeter of the facility as main priority;
- The room should be secured (locked);
- It should have cement floor;
- Sufficient **Lighting** (see page 167) must be provided;
- Well ventilated, **Artificial Ventilation** (see page 170) may be required;
- If possible, the room should be sound-proof.

9. ESSENTIAL SERVICES / UTILITIES

9.2 General Water Supply

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

General Water Supply is a system supplying water to all areas of the jail, especially to dormitories, health facilities, visiting area, kitchen, outdoor areas, development/ livelihood activities, and administration.

Water is used for all purposes including: drinking, cooking, washing and bathing, cleaning, livelihood activities, fire security and gardening.

Possible water sources include a local water network, ground water (dug wells, borehole, spring catchment), and **Rainwater Harvesting** (see below). **Rainwater Harvesting** systems must be installed wherever possible.

The **General Water Supply** system includes water supply, treatment if required, storage and distribution.

DESCRIPTION

LOCATION:

- Water should be able to reach all areas of the jails.

DIMENSIONS:

- Required Volume:
  - 95 liters of water / day / PDL capacity;
  - 3 to 5 l should be potable water.

NUMBER:

- For potable water:
  - 1 tap per 100 PDL capacity with at least 1 tap in each building and 1 tap outside;
  - At least 1 tap in each functional area: visiting, health facilities, kitchen, development, administration.

CHARACTERISTICS:

- Minimum flow at any tap: 12 liters /min (see page 152);
- Potable water must respect WHO/PNSDW[13] standards.

[13] Philippine National Standards for Drinking Water.

REMARKS:

Design guidelines for **Rainwater Harvesting** system are shown below:

Rainwater Harvesting can supply significant amounts of water. A study of rainfall patterns in the area where the jail is located should indicate whether it is worth installing a **Rainwater Harvesting** system and, if so, what results might be expected. Obviously, such a system will not remedy water shortages during the dry season.

Rainfall is measured in millimeters per year. It is expressed as the depth of water measured per unit of surface on the ground.

It is estimated that about 0.8 to 0.9 liters may be harvested per square-meter and per millimeter of annual rainfall. One millimeter of rainfall over an area of one square meter is equivalent to one liter. Thus in a region where the average rainfall is 1,000 mm/year, about 900 liters of water per square-meter can be harvested. This means that a roof measuring 100 m^2 can provide about 90,000 liters of water per year.

The type of roof and its state will determine the most appropriate harvesting method. The quality of the water harvested will depend on the type of roofing material and the system installed to discard the initial flush of water which rinses the roof and washes off dust and debris. Rainwater must be treated before it is suitable for human consumption.

The brackets that fix the gutters under the corrugated iron sheeting (or other material) forming the roof must allow the water to flow towards the catchment system without stagnation and without loss.

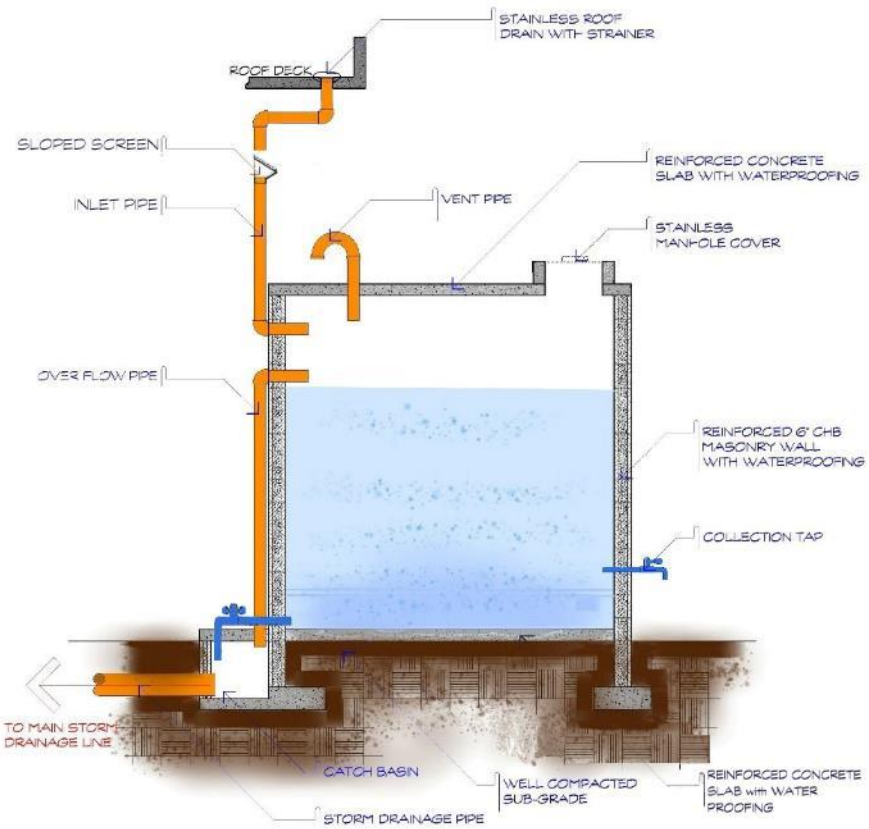


Figure 47: Typical Rainwater Harvesting System

Average Rainfall in the Philippines: 2535 mm / year[14] .

January	February	March	April	May	June
150 mm	100 mm	103 mm	101mm	190 mm	265 mm
July	**August**	**September**	**October**	**November**	**December**
310 mm	302 mm	283 mm	283 mm	241 mm	207 mm

[14] 1991-2015 average. Source: The World Bank.

9. ESSENTIAL SERVICES / UTILITIES

9.3 Water Storage

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

Water storage ensure the continuity of the supply of water in the jail. It is made up of one or several tanks. Procedures must be put in place to ensure regular cleaning of the tanks.

DESCRIPTION

LOCATION:

In addition to the main **Water Storage**, separated **Water Storage** must be installed in the kitchen and in health facilities, which includes water for hospitalization beds.

DIMENSIONS:

- Storage for human consumption:
  - The overall volume stored should be sufficient for two days consumption: 95 liters x (PDL + STAFF) x 2
  - Considering 1 staff for 5 PDL, this amounts to [95 x (1+1/5) x 2] liters per PDL = 228 liters per PDL capacity.
  - Considering an additional 30% for Fire Safety Water Reserve Tank: 228 x 1.30 = 296 liters per PDL capacity.

NUMBER:

N/A.

CHARACTERISTICS:

- As much as possible, water should be pumped into a Centralized Overhead Tank from where it is distributed to the different points of consumption by gravity;
- Water tanks should be cleaned and disinfected at least once a year.

REMARKS:

The required power for the pump used to lift the water to the overhead tank is calculated as follow:

$P = Q \times \mu \times g \times TMH$

Where:

- P = power required in Watts (W)
- Q = discharge rate (cu. m/sec)
- μ = unit weight of water (1,000.00 kg/m3)
- g = gravitational acceleration (9.81m/sec^2)
- TMH = Total Manometric Height (m) = total height + friction loss on the pipe

- friction loss on the pipe = coefficient of friction x total length of pipe

Example:

Considering the system shown on Figure 48:

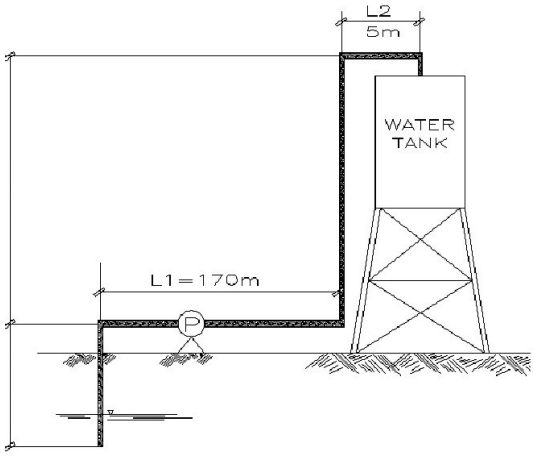


Figure 48: Example of a Pumping System

If the required discharge of the pump is 2 liters / sec and the coefficient of friction (fl) of the pipe used is 5.85%.

Q = 2liters/sec = 0.002m3/sec ;

coefficient of friction: fl = 5.85%.

TMH = H1 + H2 + friction loss.

H1 = 25 m; H2 = 6 m

Friction losses: Total Length x fl = (6 + 170 + 25 + 5) x 0.0585

= 206 x 0.0585 = 12.051 m

TMH = 25.00 + 6.00 + 12.051 = 43.051 m

P = Q x μ x g x TMH

Substituting values:

P = 0.002 x 1,000 x 9.81 x 43.051 = 844.661 Watts or 1.13 HP say 1.50 HP.

10. SOLID WASTE MANAGEMENT

10.1 Garbage Collection Area

CAPACITY RANGE

☒ **A: 1-100** ☒ **B: 101-500** ☒ **C: 501-1000** ☒ **D: 1001-2000**

DEFINITION

The **Garbage Collection Area** is a place where all the jail garbage is collected, in principle for not more than 48 hours, before it is evacuated or disposed of. The area should be divided into four areas:

1. Non-recyclable;
2. Recyclable,
3. Medical
4. Compost.

DESCRIPTION

LOCATION:

- Inside the **Main Perimeter Fence** (see page 139), accessible to the Garbage Collector Truck.

DIMENSIONS:

	Total	Compost
A (Small)	At least 6 sq. m	At least 4 sq. m
B (medium)	At least 12 sq. m	At least 8 sq. m
C (large)	At least 24 sq. m	At least 16 sq. m
D (very large)	At least 48 sq. m	At least 32 sq. m

NUMBER:

N/A.

CHARACTERISTICS:

- The area should be enclosed, secured and at least partly roofed;
- The floor should be partly cemented and equipped with drainage channels and **Degreasing Tank** (see page 181);
- The area should be equipped with a Water Point and a hose for cleaning;
- A partition should allow the separation of Medical Waste from General Waste;
- Part of the area should be dedicated to recyclable garbage;
- The compost area must have earth ground, not exposed to direct sun and not be roofed.

REMARKS

An example of Waste Segregation in shown on the figure below.

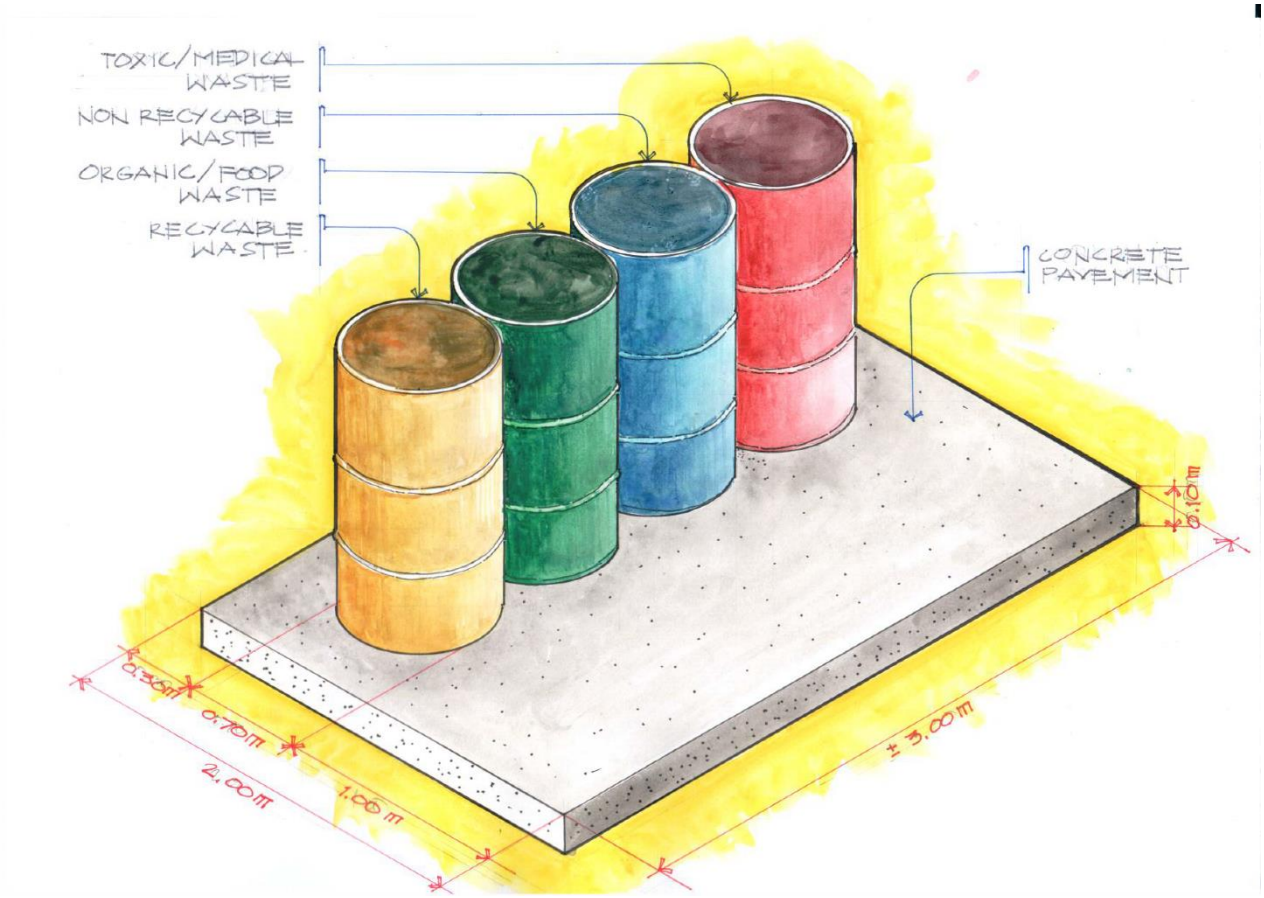


Figure 49: Waste Segregation at the Garbage Collection Area

RECURRENT AREAS:

A.1 Corridors, Staircases and Entrance / Exit

DEFINITION

Corridors are pedestrian spaces used to move from one place to another. They are used by PDL, Staff and visitors. Security, and filtering measures may be applied on the movement of PDL and visitors. Corridors should be adequately sized to accommodate the required flow of people while insuring security and safety. It should also take into consideration the transit of wheelchairs and carts in certain places as well as the presence of **Sally Ports** (see page 134).

Staircases are structures containing Stairways consisting of flights of stairs usually with landing allowing passage from one storey to another. Likewise, they should be sized to accommodate the required flow of people while insuring security and safety. **Staircases** are equipped with Handrails, which narrow bars are placed on the side of a **Staircase** so that you can hold as you walk.

Entrance / Exit are facilitated by openings in a wall allowing **Entrance** and **Exit** to and from a storey or to and from a building or an area to the outdoors. **Exits** may allow escaping from an emergency situation.

The design of **Corridors** and **Entrance / Exit** must take into account PWD usage, and especially access with wheelchairs. At least the following areas should be accessible to PWD:

- **Pedestrian Gate** (see page 145);
- Some **Inner Barriers** (see page 149);
- Visitation Area;
- Administration Building[15]: at least **Warden's Office** (see page 117) and **Staff Office** (see page 119).

This includes locating these areas on the ground floor (unless an elevator is provided), doors and corridors of the right size and access to **PWD-accessible toilets** (see page 159).

DESCRIPTION

LOCATION:

- **Exits**[16]**:**
  - The maximum distance between any cell or room door and an **Exit** from a storey must be 30 m;
  - The maximum distance between any point on a storey and an **Exit** from a storey must be 46 m;
  - If only two (2) **Exits** are required in a building or area, they must be placed a distance apart of at least half of the diagonal dimension of the building or area, measured in a straight line between exits nearest edges;
  - Where three (3) or more **Exits** are required, they must be arranged a reasonable distance apart so that if one becomes blocked, the others will be available.

[15] Exceptions may be allowed in the case of small jail in which space does not allow the Warden's Office and/or the Staff Office to be located on the ground floor.

[16] Based on Fire Code of the Philippines 2008 IRR.

- **Staircases**[17]**:**
    - Vertical distance between Landings must not exceed 3.6 m.
    - Handrails must be placed between 0.8 m and 0.9 m above the nosing of treads (see Figure 50), and ends of handrails must be returned or must terminate in newel posts or safety terminals.

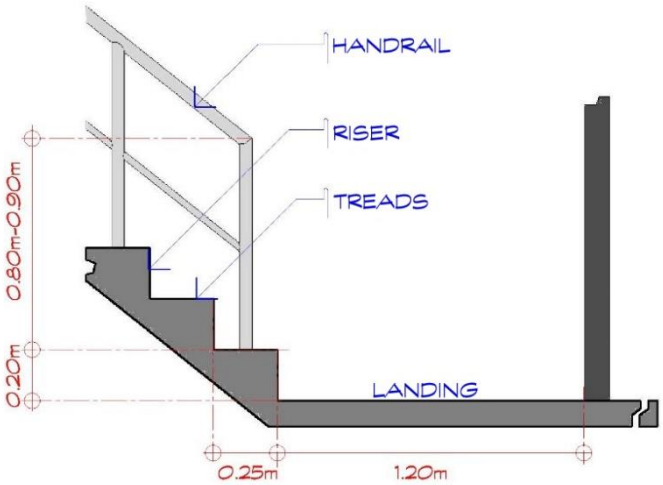


Figure 50: Stairs Design

DIMENSIONS:

- **Corridors**[18]**:**
    - In buildings where PDL are absent on in limited number (administration, security, kitchen); every **Corridor** or **Entrance / Exit** shall be at least 1.1 m in width clear opening;
    - In buildings where a large number of PDL are present (e.g. accommodation, visitation, development, livelihood), every **Corridor** or **Entrance / Exit** must be at least 1.5 m in width clear opening;
    - In accommodation buildings where cells open onto a **Corridor** on both sides, Corridors / space between facing cells must be between 2 m and 3m in width clear opening;
    - **Corridors** in buildings that must be accessible to PWD must be at least 1.5 m in width clear opening, with a part that is at least 1.6 m in width over at least 2.15 m in length in order to allow 180° turn in a wheelchair[19] (see Figure 51).

[17] Based on National Building Code Section 1207 d.1, page 33 Section 1207.e

[18] Based on National Building Code Section 1207 d.1

[19] Based on ISO Standard ISO 21542.

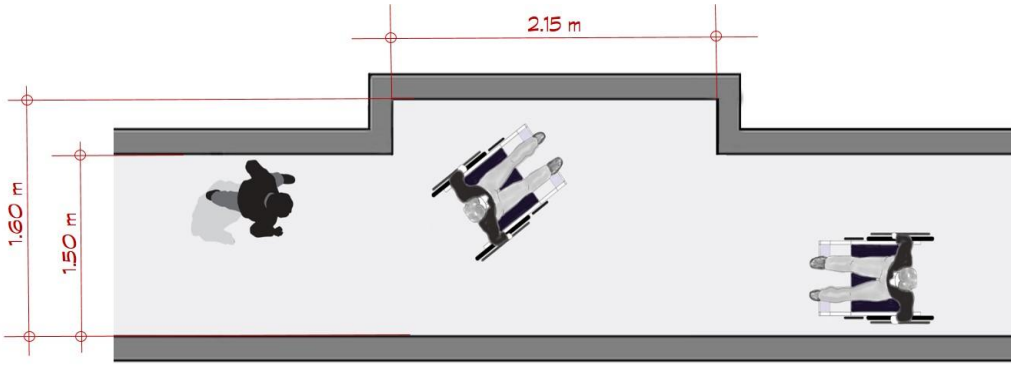


Figure 51: Corridors with Area allowing 180° turn in a Wheelchair

- **Staircases:**
  - **Staircases** clear opening width must be at least 1.3 m.
  - Risers:
    - Risers must not exceed 0.2 m and run must not be less than 0.25 m;
    - The variations in the height of risers and the width of treads in any one flight must not exceed 5 mm.
  - Landings:
    - The dimension of every Landing measured in the direction of travel must be equal to the width of the stairway. Such dimension must not exceed 1.2 m when the stairs has a straight run;
    - A door fully open in a landing must not reduce its width by more than 0.1 m.
- **Exits:**
  - Every required **Exit** doorway must be of a size allowing the installation of a door at least 0.9 m in width and at least 2 m in height;
  - When installed in exit doorways, exit doors must be capable of opening at least 90°;
  - Door Leaf Width: No leaf of an exit door shall exceed 1.20 m.

NUMBER:

- **Exits**[20]:
  - The number of **Exits** required from any storey of a building is determined by using the Occupant Load[21]of floors which exit through the level under consideration;
    - The Occupant Load is defined as the maximum number of persons intended to occupy a considered floor/building;
    - Every building or storey with an Occupant Load of more than 10 must have at least 2 Exits.
  - The total width of **Exits** from a building in meters must be at least equal to:

Occupant Load / 165

[20] Based on National Building Code Section 1207 page 32

[21] Occupant Load: Maximum number of person that may be in the space at any time.

This is shown in the table below:

Occupant load per storey or building	Minimum Total Width of Exits	Example: Number of 0.9 m wide Exits	Example: Number of 1.6 m wide Exits
200	200/165 = 1.2 m	2	2
300	300/165 = 1.8 m	2	2
400	400/165 = 2.4 m	3	2
500	500/165 = 3 m	4	2

CHARACTERISTICS:

- Corridors, hallways, or aisles used as a mean of Exit must not have a pocket or dead end exceeding 6 m.
- **PWD Access [22]:**

Entrance to buildings that are accessible to PWD must be equipped with an Access Ramp.

The slope of the ramp should be as follows (see figure below):

- For a Rise of 700mm to 900 mm Slope must not exceed 1:12 (8.33%);
- The surface width of the ramp must be at least 1.2 m;
- The length of an end landing and an intermediate landing should be at least 1.5 m;
- The surface material of the ramp shall be rigid with a plain and slip-resistant surface, in both wet and dry conditions.

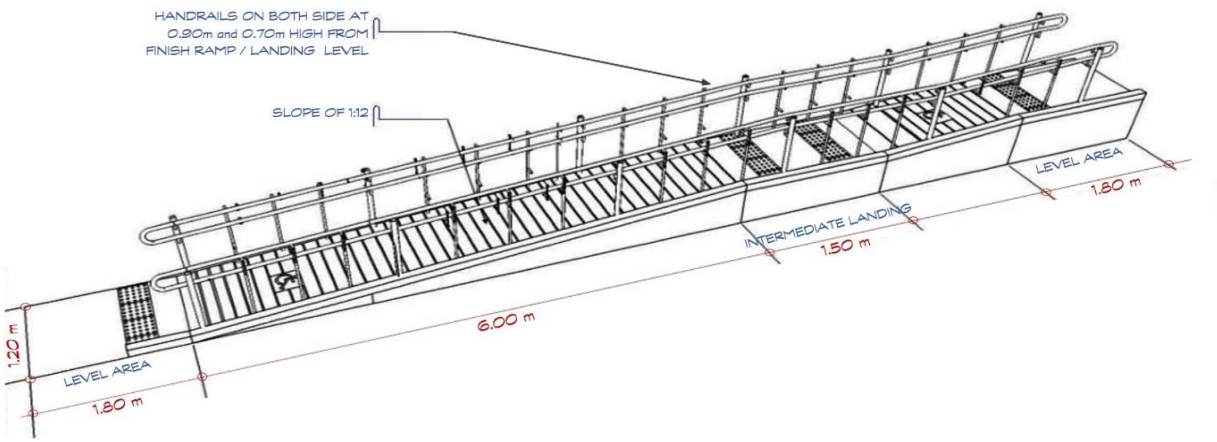


Figure 52: Ramp Dimensions[23]

[22] Based on ISO Standards ISO 21542.

[23] Source: BP 344: Accessibility Law

In front of the door opening into a building, there should be a minimum horizontal maneuvering space of 1.5 m x 1.5 m.

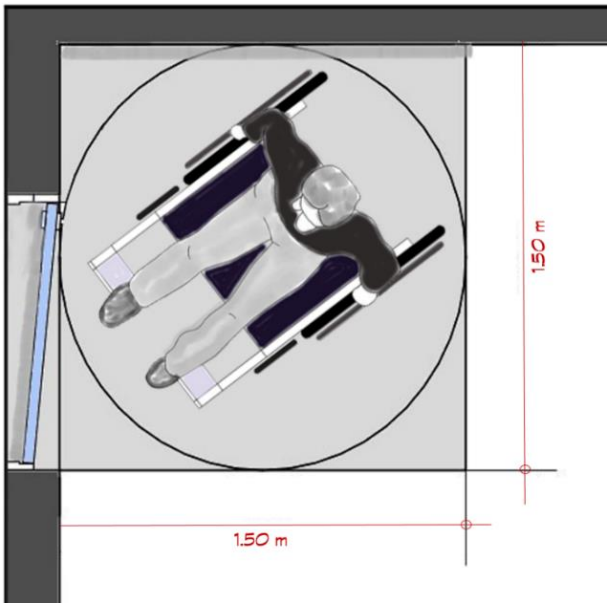


Figure 53: Wheelchair Maneuvering Space

RECURRENT AREAS:

A.2 Ordinary and PWD-accessible Toilets

DEFINITION

Ordinary Toilets are rooms used by PDL, Staff and Visitors to satisfy their personal necessities. It must contain of a Water Closet and a Wash Area consisting of a **Lavatory** (see page 174) and **Faucets** (see page 174).

- **PWD-accessible Toilets** can be accessed and used by people in a wheelchair.
- The Wash Area may be located inside the room with the Water Closet or just outside. Wastewater coming from **Toilets** are always connected to a **Septic Tank** (see page 175).
- **Ordinary Toilets** for males may, in addition, may contain a Urinal.

DESCRIPTION

LOCATION:

In all buildings. The **Cell Toilet and Bath** (see page 44) are however slightly different in design.

DIMENSIONS:

- For **Ordinary Toilets**:
  - Area should be at least 1.2 m x 1 m = 1.2 sq. m for both male and female;
  - Access opening should be at least: At least 0.60 m.
- For **PWD-accessible Toilets**[24]**:**
  - Area should be at least 1.8 m x 1.8 m = 3.2 sq. m;
  - Access opening for **PWD-accessible Toilet** should be at least 0.80 m wide;
  - There should be at least 1.05 m / 0.45 m at each side of the toilet at shown on Figure 54;
  - On both side of the toilet, a grab rail shall be provided at a height of 0.2 m to 0.3 m above the toilet seat. It should have a circular profile of 32 mm;
  - Toilet seat height should be comprised between 0.4 m and 0.48 m.

NUMBER:

N/A.

CHARACTERISTICS:

- Concrete Hollow-Block(CHB) wall;
- Thickness: 100 mm (4”);
- Ceramic tile finish walls and floor;
- “Buhos” (manual flushing) type;
- One **Faucet** (see page 174) for flushing;
- Handrail for **PWD-accessible toilets** should be round stainless.

Remark

See Figure 54 for some details on PWD-accessible toilets.

[24] Based on: BP 344: Accessibility Law

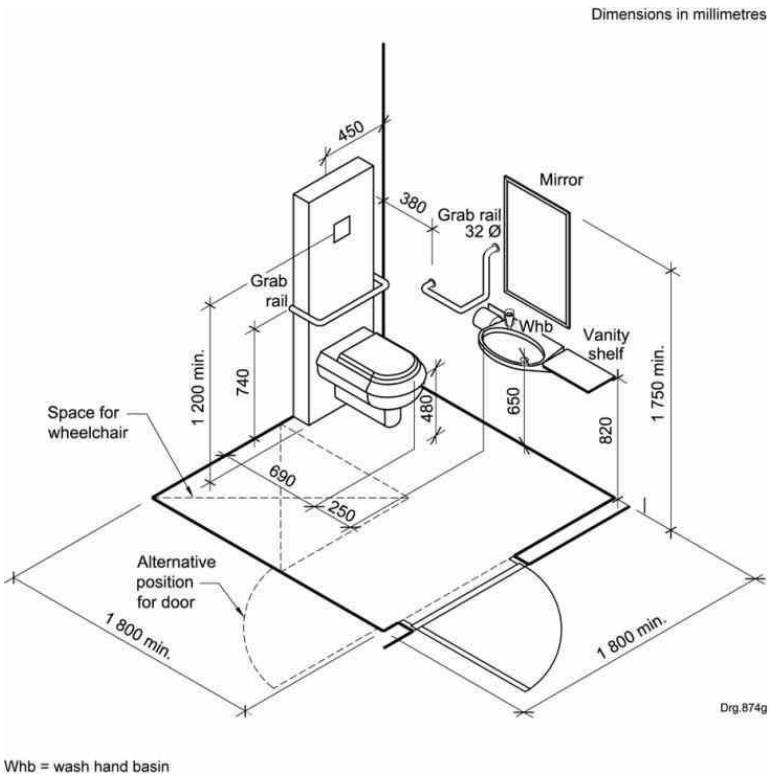


Figure 54: PWD-accessible Toilet.[25]

[25] Source: BP 344: Accessibility Law

RECURRENT AREAS:

A.3 Ordinary and PWD-accessible Toilet and Bath

DEFINITION

The **Toilets and Bath** is a room where PDL can wash and satisfy their personal necessities. This room plays a key part for PDL that they may be required to shower after being search and before conducting Medical-examination. It consists of a Water Closet**,** a **Wash Area** consisting of a **Lavatory** (see page 174) and **Faucets** (see page 174).

- **PWD Toilets and Bath** can be accessed and used by people in a wheelchair;
- It should have **Water Supply** (see page 152), drainage, and sufficient **Lighting** (see page 167);
- Wastewater coming from **Toilets** are always connected to a **Septic Tank** (see page 175);
- Wastewater coming from **Bath** may be connected to a **Degreasing Tank** (see page 181) and then to a **Soak Pit** (see page 181).

DESCRIPTION

LOCATION:

- Ordinary **Toilet and Bath** are attached to the **Diagnostic Room** (see page 34), to **Single Accommodation Cells** (see page 46), and found in **Warden's Quarters** (see page 116), **Staff Quarters** (see page 118) and sometimes attached to the **Fitness Room** (see page 127).
- PWD-accessible **Toilet and Bath** are attached to **Patient Wards** (see page 90) and **Mental Wards** (see page 96).

DIMENSIONS:

- For **Ordinary Toilet and Bath**:
  - Area should be at least: 2m x 1.5m = 3 sq. m;
  - Access opening should be at least: At least 0.60 m.
- For **PWD-accessible Toilet and Bath**:
  - Area should be at least: 2.6 m x 2.7 m = 7 sq. m (2.6 m and 2.7 m are minimum values);
  - Access opening for **PWD-accessible Toilet and Bath** should be at least 0.80 m wide;
  - The should be 1.5 x 0.9 m floor space for the **Toilet**;
  - The should be 1.2 x 0.75 m floor space for the **Lavatory**;
  - There should be at least 1.05 m / 0.45 m at each side of the toilet;
  - On both side of the toilet, a grab rail shall be provided at a height of 0.2 m to 0.3 m above the toilet seat. It should have a circular profile of 32 mm;
  - Toilet seat height should be comprised between 0.4 m and 0.48 m;
  - This design applies to **PWD-accessible Toilet and Bath to be used with assistance;**

NUMBER:

N/A.

CHARACTERISTICS:

- Concrete Hollow-Block(CHB) wall;
- Thickness: 100 mm (4");
- Ceramic tile finish walls and floor;
- "Buhos" (manual flushing) type;

- One **Lavatory** (see page 174);
- One **Faucet** (see page 174) for flushing;
- One **Faucets** for bath, and one **Faucet** for Lavatory;
- Handrail for **PWD-accessible toilets** should be round stainless.

REMARKS

- See Figure 54 for details on **PWD-accessible toilets**;
- See Figure 55 for details on **PWD-accessible Toilet and Bath**.

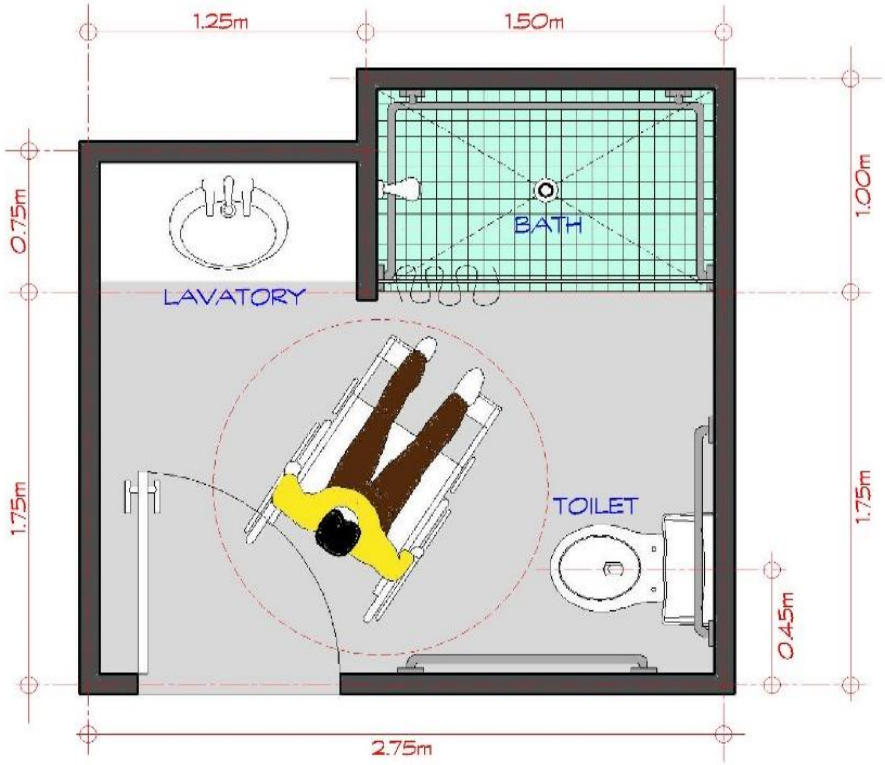


Figure 55: PWD-accessible Toilet and Bath (to be used with assistance)

RECURRENT FEATURES:

F1. Lighting and Natural Ventilation

DEFINITION

Lighting is illumination as a result of natural or artificial light. **Natural Lighting** captures daylight using openings to the outdoors while **Artificial Lighting** is electric and requires Power Supply. Adequate levels of lighting are essential in a jail for the well-being or PDL and staff, to carry out daily activities, and to ensure security. **Artificial Lighting** shall be provided when daylight fails or for area where the daylight illumination is insufficient[26].

Ventilation designates the circulation of air in a room. **Natural Ventilation** in a building is determined by the presence, size and position of openings to the outdoors.

DESCRIPTION

LOCATION:

- Luminaire Fixtures must be placed away from bunk beds to avoid access by PDL;
- There should be artificial lighting in every toilet.

DIMENSIONS[27]:

- **Natural Ventilation**:
    - Any Habitable Room should allow 14 cu. m of air space per person.
    - Habitable Rooms not provided with **Artificial Ventilation** systems (see page 171):
        - Must have Ceiling Heights of not less than 2.70 m.
        - Must be provided with a window or windows with a total free area of openings equal to at least 10% of the floor area of the room, provided that such opening shall be not less than 1 sq. m.
    - **Toilets and Bath** rooms (see page 166), **Laundry** rooms (see page 107) and similar rooms shall be provided with window with an area not less than 5% of the floor area of such rooms, provided that such opening shall be not less than 0.24 sq. m.
    - In such conditions, windows shall open directly to a court, yard, public street or alley, or open watercourse.
    - It is recommended that clean air flow is at least 20 to 40 cu. m/h as to effect a complete change of air four (4) to eight (8) times per hour.

NUMBER:

N/A.

---

[26] Occupational Safety and Health Standards (As Amended in 1989) – Department of Labor and Employment – Philippines p. 30.

[27] Based on National Building Code (P.D. 1096) Section 807 and 808 and Occupational Safety and Health Standards (As Amended in 1989) – Department of Labor and Employment – Philippines p. 30.

CHARACTERISTICS:

- **Lighting**:
  - All Lighting fixture must use LED technology;
  - Luminaire Fixtures must have security grills to prevent access by PDL;
  - There should be lighting control outside the cell;
  - Levels of Illumination are measured in lux. Illumination can vary from 20 lux to 1000 lux or more;
  - Illumination Power of a Luminaire fixture is defined in Lumens. 1 lux = 1 lumen / sq. m;
  - One 18 Watts LED Luminaire Fixture provides 1125 Lumens illumination, therefore 1 Watt LED provides approximately 62 Lumens;
  - Reading requires at least 200 lux illumination.

The level of illumination required in a jail can be defined as follows[28]:

Location	Lux	Lumen / 100 sq. m	Watts LED / 100 sq. m
Yards and Roadways were no surveillance is required	20	2000	30
Yards and Roadways were surveillance is required as well as corridors and stairways.	50	5000	80
Toilets and bathrooms. Storage rooms and livelihood areas where slight discrimination of details is essential (e.g basket making), fitness room.	100	10,000	160
Cells[29], kitchens, patient wards, visit rooms, livelihood areas where moderate discrimination of details is essential.	200	20,000	320
Offices, training rooms, search rooms, conference rooms, livelihood areas where moderate discrimination of details is essential (sewing).	350-450	35,000 to 45,000	560 to 720
Spot lighting used for security	1000	100'000	1600

Examples considering 18 Watts LED luminaires:

- A 44 sq. m cell will require at least: 320 / 100 x 44 = 140.8 Watts, which requires 140.8 / 18 = 8 units;
- A 100 sq. m office will require at least: 560 Watts, which requires 560 / 18 = 32 units;
- A 10 m x 1.7 m corridor (17 sq. m) will require at least: 80/100 x 17 = 13.6 Watts, which require a single unit (in the case of a corridor, several less powerful units may be more appropriate in order to obtain uniform light);

[28] Based on Occupational Safety and Health Standards (As Amended in 1989) – Department of Labor and Employment – Philippines p. 30 and 31.

[29] As per "United Nations Standard Minimum Rules for the Treatment of Prisoners (the Mandela Rules)" p. 12 Artificial light shall be provided sufficient for the prisoners to read or work without injury to eyesight.

- A 4 sq. m Toilet and Bath will require at least: 160/100 x 4 = 6.4 Watts.

- **LED Emergency Light:**

- 2 to 5 Watts;
- Type : Rabbit (Automatic Rechargeable);
- Performance Time: 6 hours at full charge.
- See Figure 56.



Figure 56: LED Emergency Light

RECURRENT FEATURES:

F2. Artificial Ventilation

DEFINITION

Ventilation designates the circulation of air in a room. **Artificial Ventilation** is produced by electric fans, which are electric devices that consist of a series of vanes radiating from a hub rotated on its axle by a motor, thereby creating ventilation. They require adequate Power Supply.

In jails Blower Fans and Exhaust Fans can be found:

- Blower Fans produce ventilation while stirring the air in a place by moving it. Blower fans can be fixed on the ceiling or on the wall. They can also be autonomous devices with their own stand;
- Exhaust Fans produce ventilation while extracting the air from a room so that it is replaced by fresh air from outdoors through existing openings.

DESCRIPTION

LOCATION:

- Blower Fans are typically found in living and working quarters;
- Exhaust Fans are typically found, along with Blower Fans, in places where air must be regularly renewed such as in kitchens, laboratories, living quarter of infectious patient carrying airborne disease and other specific professional activity (welding, activities involving chemicals etc.).

DIMENSIONS:

N/A

NUMBER:

- 2 ceiling fans / 48 sq. m cell;
- At least 1 ceiling fan / 25 sq. m.

CHARACTERISTICS:

	Specifications / Capacity	Downrod Length	Nb of fans / 48 sq.m
Ceiling Fans	52 " or 1.32 m blade span	14" or 0.35 m	2
Other Blowers	1152 cu. m/h airflow		
Exhaust Fans	1152 cu. m/h airflow		

- Ensures at least 4 to 8 air changes per hour for combined natural and **Artificial Ventilation**[30];
- Ceiling Heights should be at least 2.4 m;
- When used in cells, there should be a control outside the cell.

[30] Based on Occupational Safety and Health Standards (As Amended in 1989) – Department of Labor and Employment – Philippines p. 32.

RECURRENT FEATURES:

F.3 Air Conditioning

DEFINITION

Air Conditioning is the fact of equipping a room with an electric device that controls air temperature and humidity. It requires adequate Power Supply.

DESCRIPTION

LOCATION:

- **Air Conditioning** is typically found in the Administration Building, the Health Facility, and in Staff Living Quarters.

DIMENSIONS:

N/A.

NUMBER:

N/A.

CHARACTERISTICS:

Area to be cooled (sq. m)	Capacity Needed	
	(Kilojoules per hour)	Estimated HP Rating[31]
17	8,440	0.75
20	9,496	1.0
22	10,550	1.0
26	12,661	1.5
30	14,771	1.5
38	18,991	2.0
44	22,156	2.0
50	24,266	2.5
64	31,625	3.0
72	35,872	3.0

- Inverter type Air Conditioning should be installed;
- If the room is heavily shaded, capacity should be reduced by 10 percent;
- If the room is very sunny, capacity should be increased by 10 percent;
- If more than two people regularly occupy the room, 633 kilojoules should be added for each additional person.

[31] Recommendation from the Department of Energy.

Possible applications:

Functional Component	Area	Potential Number of Users	Required Air Conditioning HP rating
Health Services			
Patient Reception Area	10 to 12.25 sq. m	2 to 5	0.75 to 1 HP.
Consultation room, Nurse station, Health Staff Office	8 to 24 sq. m	2 to 6	0.75 to 1.5 HP
Dental Office, Maternal /Prenatal Care	8 sq. m	2	0.75 HP
Laboratory	10 to 20 sq. m	2 to 8	0.75 to 1.5 HP
Administration			
Warden's quarter	12 sq. m	2	0.75 HP
Warden's Office	16 sq. m	2	0.75 HP
Staff Office (largest room)	40 sq. m	10	2.5 HP
Conference Rooms, Staff Training Room	30 sq. m	20	2.5 HP
Fitness room	24 sq. m	6	1.5 HP
Security			
Command Control	15 to 25 sq. m	2 to 4	1.5 HP
Guard House	9 sq. m	2 to 3	0.75 HP

RECURRENT FEATURES:

F.4 Lavatories and Faucets

DEFINITION

Lavatories are large bowls for water that are used to wash your hands and face. They are equipped with **Faucets** and require adequate **Water Supply** (see page 152). Wastewater coming from **Lavatories** may be connected to a **Degreasing Tank** (see page 181) and then to a **Soak Pit** (see page 181).

Faucets are devices used to control the flow of water from a pipe.

In areas of the Health Facility where medical acts such as dental surgery or gynecology may be practiced the installation of **Elbow-taps** can be considered. **Elbow-taps** are **Faucet**s that can be operated with the elbow (see Figure 57) for hygienic reasons.



Figure 57: Elbow-tap

DESCRIPTION

LOCATION:

- In jails, **Lavatories** are found in:
  - **Ordinary and PWD-accessible Toilets** (see page 163);
  - **Ordinary and PWD-accessible Toilets and Bath** (see page 166);
  - In other areas of the jail where people need to wash their hands, especially in the **Consultation Rooms** (see page 77) in the Health Facility, in the **Kitchen** (see page 97), and in the Family Visit Area.

DIMENSIONS:

In areas that should be accessible to PWD, the space under a **Lavatory** should be between 0.65 m and 0.7 m high and 0.2 m deep. A toe clearance of at least 0.3 m should be provided. The reaching distance to the tap control should be a maximum of 0.3 m[32] (See Figure 58).

[32] Based on ISO Standards ISO 21542.

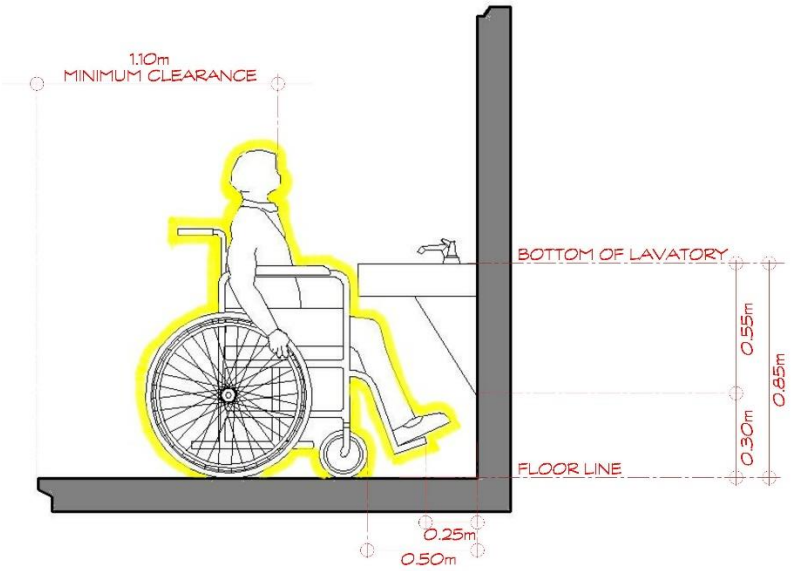


Figure 58: Lavatories accessible to PWD[33]

NUMBER:

N/A.

CHARACTERISTICS:

- Recommended type of faucets: ½" Diameter stainless ball-type valves.
- Pipes equipping **Lavatories**[34]:
  - 58 mm minimum waste pipe;
  - 38mm Diameter fixture drainage pipe.
- Characteristics of **Faucets**[35]:
  - Size of water supply pipe and Water Supply Fixture Units: 12mm diameter.

[33] Based on Accessibility Law BP 344.

[34] Philippine National Plumbing Code Chapter 3

[35] Philippine National Plumbing Code Chapter 3

RECURRENT FEATURES:

F.5 Septic Tanks

DEFINITION

Septic Tanks are underground recipients used to collect Wastewater and liquify solid matter, thus facilitating its sedimentation and bacterial degradation. The **Septic Tank** prepares Wastewater coming from **Toilets** (see page 163) for treatment by the soil with **Soak Pits** or **Drainage Trenches** (see page 181) or for collection in a Main Street Sewer.

DESCRIPTION

LOCATION:

- **Septic Tanks** must be built to serve any building were at least one **Toilet** (see page 163) has been installed;
- **Septic Tanks** should not be at too great a distance from toilets because excreta do not travel far without large quantities of water. It may be necessary to install several of them. Also, if the distance of pipe that run between **Toilet** (see page 163) and **Septic Tank** is long, it may not be possible to get the required minimum gradient in laying the pipe;
- **Septic tanks** should preferably be located outside the internal security perimeter so as to facilitate access for desludging operations (see figure below);
- If the site is difficult to access by vacuum truck, desludging can be done using a submersible sludge pump;
- There must be enough space to install a **Soak Pit** or a **Drainage Trench** (see page 181) whenever possible and necessary (i.e. in the absence of a Main Street Sewer).

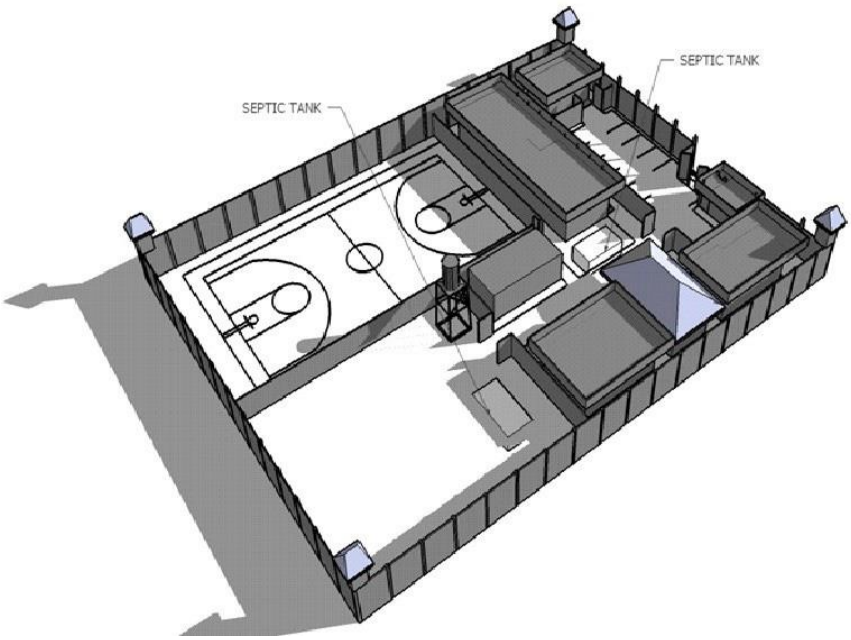


Figure 59: Septic Tank Placement

DIMENSIONS:

To maximize the use of **Septic Tank**: Only pipes servicing the **Toilets** (see page 163) should go directly to the **Septic Tank** while other pipes used for washing, bathing and cleaning should go to a **Degreasing Tank** (see page 181), before it is rejected into a Main Street Sewer, a **Soak Pit** or a **Drainage Trench** (see page 181).

The processes that occur in a **Septic Tank** are listed below:

- sedimentation;
- formation of scum;
- digestion and solidification of sludge;
- stabilization of liquids.

The net capacity of a **Septic Tank** is determined by retention time. "Retention time" means the average length of time that the Wastewater remains in the tank and during which the waste liquefies and sediments. In countries with a hot climate, it is considered that retention time must be at least 24 hours for large tanks. The tank must have a capacity that corresponds to the volume of Wastewater produced during one day, taking into account the volume of the non-soluble matter which accumulates at the bottom of the tank.

Example of **Septic Tank** size Calculation:

Preference should be given to the latest regulations under the National Plumbing Code of the Philippines.

Let's determine the size of a septic tank to serve 100 PDL in a proposed jail building :

A. Calculate the volume of the Digestive Chamber: For that, refer to the Technical Data from Table 1 considering a jail as a Residential Building serving a large number of people. 0.17 cu. m of liquid will be chosen.

Volume = 100 PDL x 0.17 cu.m

Volume = 17.00 cu.m

DETERMINING VOLUME OF SEPTIC TANK

Technical Data in Determining Volume of Septic Tank

Minimum width.....	90 cm.
Minimum length.....	150 cm.
Minimum depth of water.....	120 cm.
For residential buildings to serve larger number of people, allocate per person.....	0.14 to 0.17 cu. m. of liquid
For a small residential house to serve up to 12 persons, the chamber should have a liquid content of not more than.....	2.0 cubic meters
For school, commercial and industrial establishments, the volume of the septic tank should not be less than.....	0.057 cu. m. nor
more than.....	0.086 cu. m. per person

Table 1: Table determining the volume of septic tank

B. If you set the Assumed Width of the Septic Tank at 2 m or 200 cm (just as a guideline value), compute for the Total Inside Length of the Digestive Chamber refering to Table 2 for the recommended Depth of Liquid.

Volume = (Total Inside Length) x (Assumed Width) x (Depth of Liquid)

17 cu. m = (Total Inside Length) x 2 m x 1.50 m

Total Inside Length = 17 cu. m / 3 m = 5.66m

Inside Length of Digestive Chamber = 5.70 m

SUGGESTED SIZE OF SEPTIC TANK									
	Residential				Commercial or Industrial				
No. of Persons persons served	1-5	6-10	11-15	16-20	21-30	31-40	41-50	51-75	76-100
Inside Width (cm)	90	110	120	150	130	150	150	200	200
Inside Length plus leaching well	150	200	270	300	210	250	300	330	350
Depth of Liquid	120	120	120	120	120	120	130	130	150
Inside Clear Height of Tank	150	150	150	150	150	150	150	150	150

Table 2: Suggested size of septic tank in cm

C. Compute for the Length of Leaching Chamber

Length of Leaching Chamber = Digestive Chamber Inside Length / 2

Length of Leaching Chamber = 5.70m / 2

Length of Leaching Chamber = 2.85m

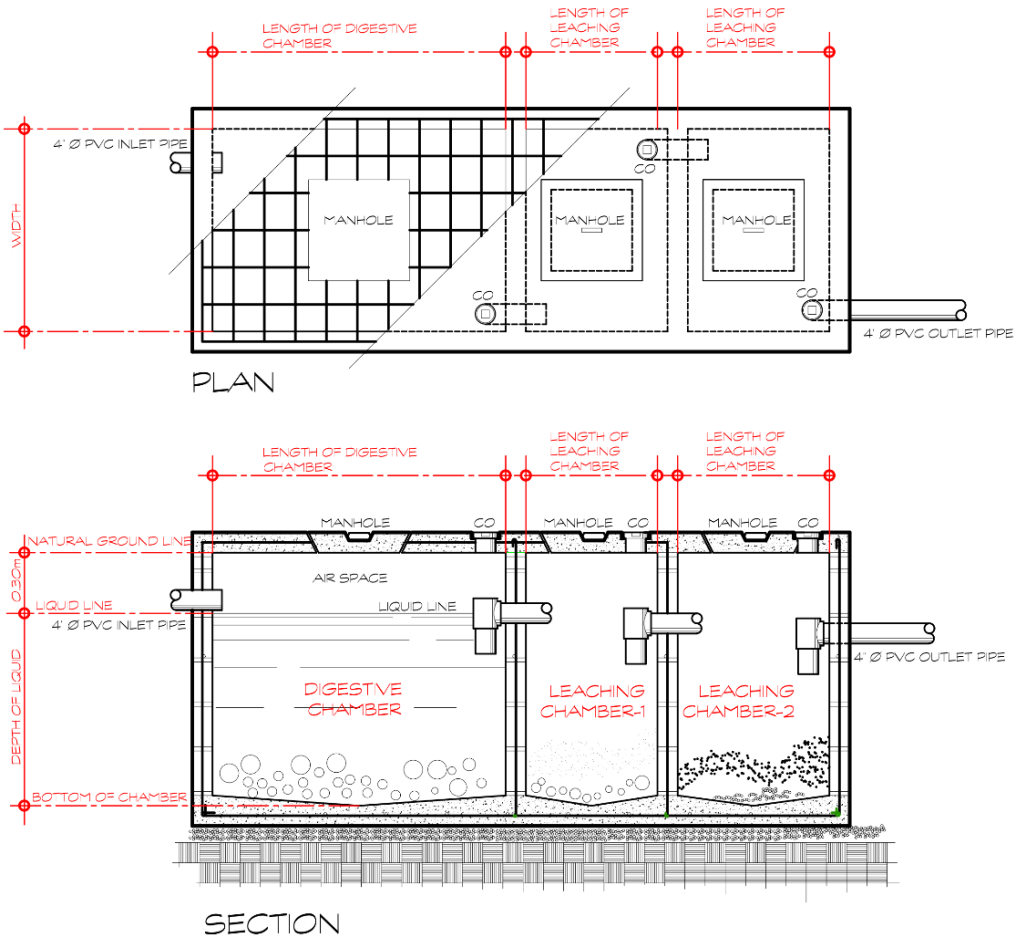



Figure 60: Septic Tank Design

NUMBER:

N/A

CHARACTERISTICS:

- When the **Septic Tank** is first brought into service it must be filled with water; it may be seeded with sludge from another tank so as to activate the digestive process;
- **Septic Tanks** have to be inspected at least once every three months. This is particularly important if the number of PDL exceeds the ideal capacity of the jail (overcrowding). In such a case the capacity of the **Septic Tank** will be insufficient, retention time will no longer be observed and the liquid flowing out will contain far too much solid matter in suspension. The inevitable result is that percolation in the **Soak Pits** (see page 181) will slow down, the sides will clogged more rapidly, and the pits will overflow. The purpose of inspection is to determine whether the sludge level has reached one third of the depth of the tank (in which case, desludging is required), and to check that the inlet and outlet pipes are not clogged by an excessive accumulation of sludge.

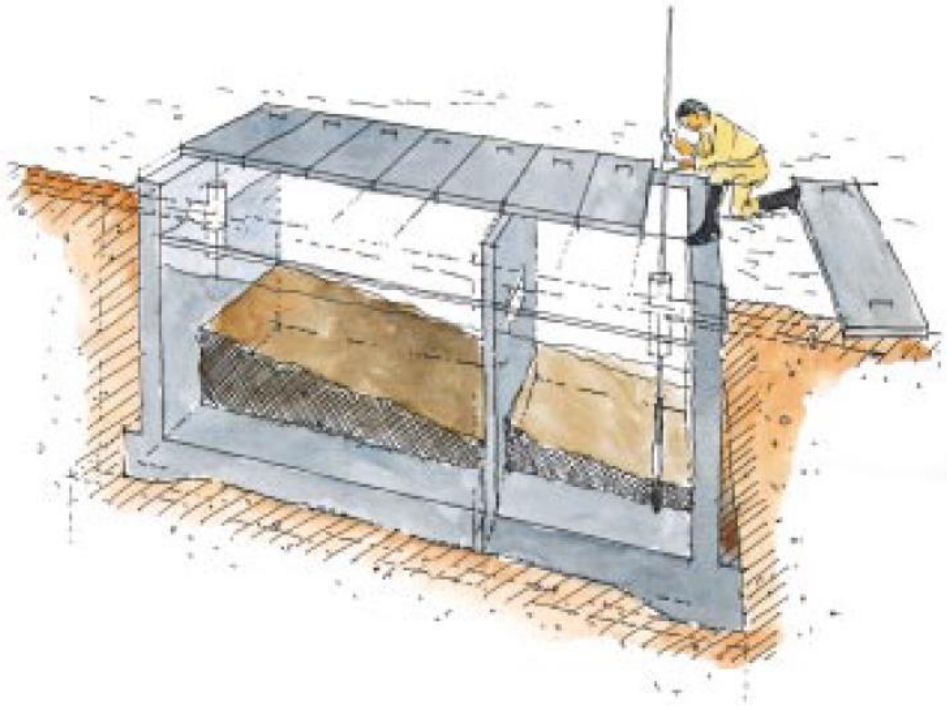

-

Figure 61: Measuring Sludge Thickness[36]

-

[36] From ICRC: Water, Sanitation, Hygiene, and Habitat in Prisons, p.65.

RECURRENT FEATURES:

F.6 Degreasing Tanks, Soak Pits and Drainage Trenches

DEFINITION

- A **Degreasing Tank** is a simple system designed to separate grease from water. It comprises a tank divided into three parts (see Figure 63 below)
  1. An Entry Chamber which slows the rate of flow of the effluent and spreads it out;
  2. A Middle Chamber in which the grease rises to the surface and heavier solids sink to the bottom, forming a layer of sludge and;
  3. An Outlet Chamber through which the degreased water is evacuated.
- **Soak Pit** and **Drainage Trenches**[37] are features allowing the effluent from a **Septic Tank** (see page 176) to percolate into the ground by spreading it over a sufficiently large soil area (see Figure 64, Figure 65 and Figure 66). **Soak Pits** are a simple excavation in the ground in which percolation occurs mostly through its wall. **Drainage Trenches** allow infiltration along the walls of a trench, thereby increasing the surface area. A **Drainage Trench** can cope with a greater amount of wastewater than a **Soak pit** of the same volume. However, **Drainage Trenches** require a large area and are only appropriate in permeable soil conditions.

DESCRIPTION

LOCATION:

- **Degreasing Tanks** are placed on a sewerage line to retain grease, but it can be any floating matter present in water, such as foam from soap or detergent. They are found on the Sewers of **Kitchen** (see page 97), **Toilet and Bath** (to retain foam from soap, see page 166), **Laundry Areas** (see page 107) and **Laboratories** (see page 91).
- **Soak Pits** and **Drainage Trenches** are placed at the outlet of **Septic Tank** when Sewerage is not available. **Soak Pits** can also be used to dispose of Wastewater from **Laboratories** (see page 91) in order to avoid directing chemical into common Sewers. They must be located far from dwellings and water distribution points.

DIMENSIONS:

- The capacity of the **Degreasing Tank** must be twice the maximum volume of liquid flowing into the tank in one hour. As this volume is often difficult to estimate, an approximate value is used, equivalent to one and a half times the capacity of the cooking pots, that is, about 1.5 cu. m per 1,000 PDL. Hence the following table:

	Total Degreasing Tank(s) Volume
A (Small)	Up to 0.15 cu. m
B (medium)	Up to 0.7 cu. m
C (large)	Up to 1.5 cu. m
D (very large)	Up to 3 cu. m

[37] Information on Soak Pits and Drainage Trenches adapted from from WEDC: "Emergency Sanitation" and "Excreta Disposal in Emergencies".

- The required size of the **Soak Pit** / **Drainage Trench** infiltration area depends on the results of the Percolation Test, which determines whether Ground Conditions are adapted to infiltration.

A simple Percolation Test method consists of:

1. Forcing an open cylinder (without ends) of about 300 mm diameter a few centimeters into the soil so that it stands upright;
2. Filling the cylinder with clean water;
3. Measuring the drop in water level (d) at convenient intervals (5, 10, 20, 30 minutes) as water infiltrates into the soil (See Figure 62).

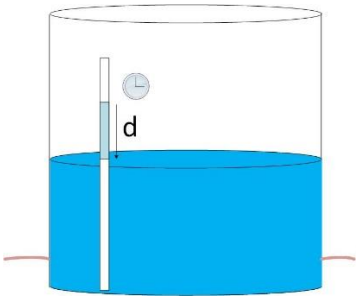


Figure 62: Percolation Test

The Percolation Value or Infiltration Rate is: d / time often expressed in mm/day.

Example: 12 mm in 30 minutes: Infiltration Rate = 12/30 x 60 = 24 mm / hour or 576 mm/day.

This procedure must be repeated several times and averaged. First time does not count as soil must be impregnated.

If Infiltration Rate is below 5 mm per hour soil is unsuitable for ground infiltration.

Below table provides the Infiltration Rate for clean water in mm/hour for different soil types and the corresponding infiltration rate for Wastewater in mm/day:

Soil Type	**Infiltration Rate for clean water (mm/hour)**	**Corresponding soil Infiltration Rate for wastewater (mm/day)**
Gravel, coarse and medium sand	61-100	50
Fine and loamy sand	30-60	33
Sandy loam and loam	20-30	24
Loam, porous silt loam	10-20	18
Silty clay loam and clay loam	5-10	8
Clay	1-4	Unsuitable for ground infiltration

- **Soak Pits** should be between 1.5 and 2.5 m in Diameter. To calculate the Total Depth of a **Soak Pit** apply the following method:
  - Calculate the Pit Wall Area (sq. m) :
    Daily Flow of Wastewater (liters) / soil Infiltration Rate (mm/day)
  - Calculate the Depth Required to dispose of all the Wastewater:
    Pit Wall Area (sq. m) / (π x Diameter in m).
  - Add 0.5 m should be added to obtain the Total Depth of the pit.

- Example: if daily Flow of Wastewater is 10 x 2 x 50 = 1000 liters[38] and soil Infiltration Rate is estimated to 33 mm/ day (fine sand, see table above):
- Pit Wall Area is: 1000 / 33 = 30.3 sq. m;
- For a Diameter of 2 m, the Depth Required should be: 30.3 / (π x 2) = 4.8 m;
- Total Depth of the Pit should be: 4.8 + 0.5 = 5.3 m.

- **Drainage Trenches** should be as narrow as possible: 0.3 to 0.6 m wide, about 1 m deep below pipe level and allowing about 0.3 m above the pipe to be covered with soil. The Diameter of the pipe used should be at least 100 mm. To calculate the Total Depth of a **Drainage Trench** apply the following method:
  - Calculate the Trench Wall Area (sq. m) :
    - Daily Flow of Wastewater (liters) / soil Infiltration Rate (mm/day)[39]
  - Calculate the Total Length of Side Walls required to dispose of all the Wastewater:
    - Trench Wall Area (sq. m) / Trench Depth below the distribution pipe.
  - Length of Trench required = Total Length of Side Walls / 2.
  - Example: if daily Flow of Wastewater is 10 x 2 x 50 = 1000 liters[40] and soil Infiltration Rate is estimated to 33 mm/ day (fine sand, see table above):
    - Trench Wall Area is = 1000 / 33 = 30.3 sq. m;
    - For Depth below the distribution pipe of 1 m, the Total Length of Side Walls required should be: 30.3 / 1 = 30 m;
    - The Length of Trench required is then 30 / 2 = 15 m.

NUMBER:

N/A

CHARACTERISTICS:

- The **Degreasing Tank** must be easily accessible. Ideally, drainage grease traps/filters should be cleaned daily to reduce odor and prevent clogging, and the grease removed during cleaning must be buried**.**

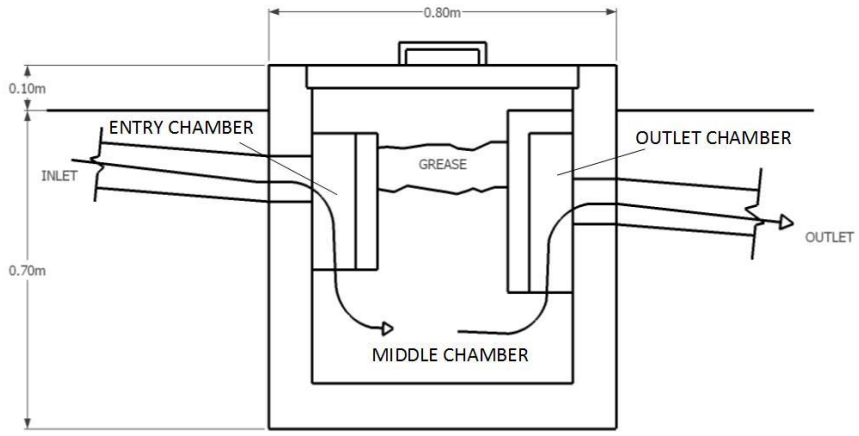


Figure 63: Degreasing Tank

[38] 10 liters / flushing into a septic tank, twice a day by 50 people.

[39] As for the Soak Pit.

[40] 10 liters / flushing into a septic tank, twice a day by 50 people.

- **Soak Pits** should be built with the following specifications :
  - the pit must be lined with bricks or concrete blocks with open joints;
  - the 0.5 m space at the top must be reinforced with masonry to prevent it from caving in;
  - the pit must be filled with aggregate such as stones or broken bricks.

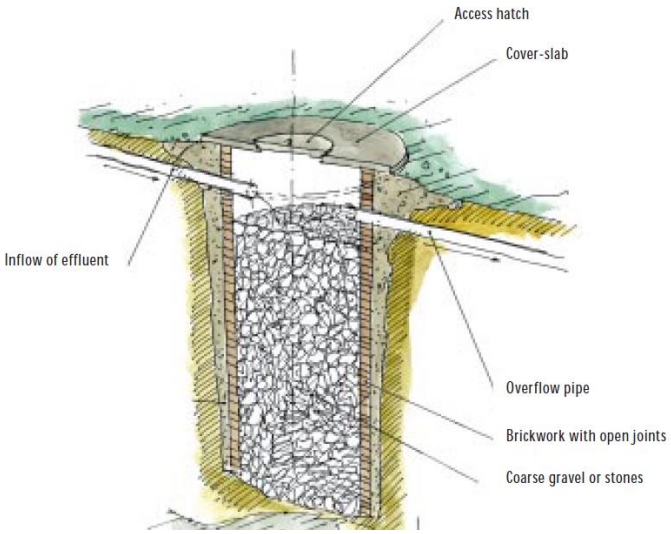


Figure 64: Cross Section of a Soak Pit[41]

- **Drainage Trenches** should be built with the following specifications :
  - The pipe should be placed toward the top of the trench as the portion of the trench useful for infiltration is below the pipe;
  - The pipe can either be made of plastic (typically PVC) or made of cement (see Figure 65) ;
  - If the pipe used is made of plastic, slots must be made on its lower part (see Figure 66);
  - If cement pipe are used, they must be allow to leak at the joint;
  - The trench must be filled with aggregate such as stones or broken bricks;
  - The portion of the trench above the pipe should be filled with soil. Builders' paper or straw can be placed between the part filled with aggregates and the portion filled with soil.

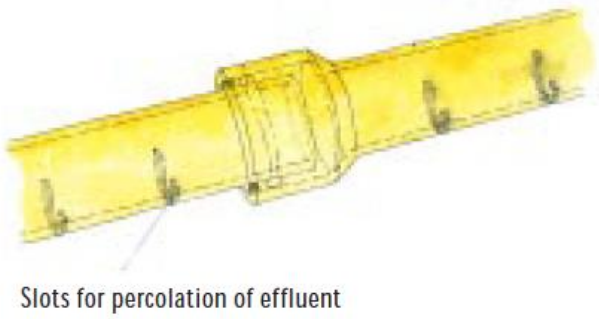


Figure 65: Percolation Pipe (plastic) 15

[41] From ICRC: Water, Sanitation, Hygiene, and Habitat in Prisons

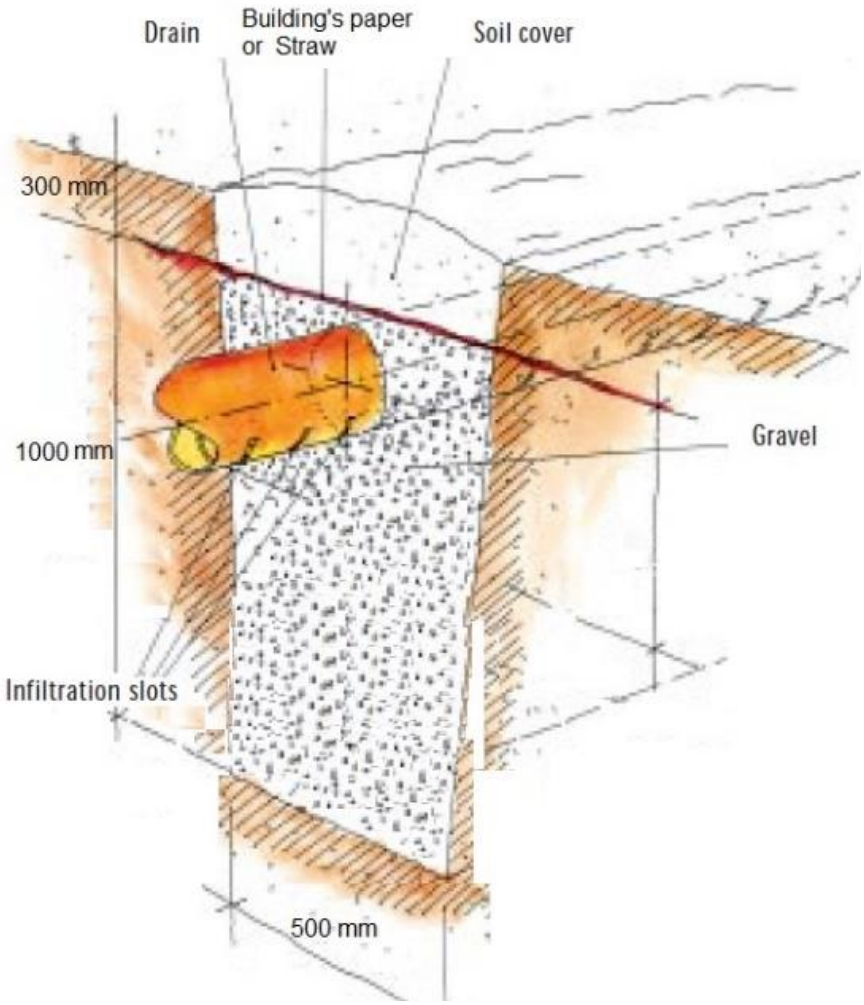


Figure 66: Drainage Trench

RECURRENT FEATURES:

F.7 Fire Safety

DEFINITION

Fire safety refers to planning and infrastructure design aims at reducing the risk of fire or impeding the spread of a fire when one does break out.

CHARACTERISTICS

- **Arrangement of Means of Egress**[42]

Every sleeping room (**Sleeping and Dining Areas** or **Staff Quarters**) must have a door leading directly to an exit access corridor or to a recreation area that can be used for access to an exit.

- **Exit Marking**
  - Exit signs shall be provided in areas accessible to the public. Every Exit Sign must be readily visible in size, color and design. There must be no decorations, furnishing, equipment or any brightly illuminated sign/object (for other than exit purposes) which impair visibility of an Exit Sign.
  - An "EXIT" sign with an arrow indicating the direction must be placed in every location where the direction of travel to reach the nearest exit is not immediately apparent. The word "EXIT" must be in plainly legible letters not less than fifteen centimeters (15 cm) high with the principal strokes of letters not less than nineteen millimeters (19 mm) wide.
  - Every sign shall be distinctive in color and shall provide contrast with colors interior finish used for decoration, or other signs.

- **Detection, Alarm and Communication Systems**
  - Manual fire alarm boxes shall be permitted to be locked or located in a staff location, provided that staff is present within the area when it is occupied and staff has keys readily available to unlock the boxes, and that the staff has direct supervision of the sleeping area.
  - Smoke detectors shall be required in **Sleeping and Dining Area** and **Staff Quarters** with five or more occupants.
- **Extinguishment Requirements**

  Three possible type of extinguishment systems:
  1. Portable fire extinguishers shall be located at staff locations only and shall be permitted to be locked, provided that personnel are on duty on a 24-hour basis and keys are readily available to unlock access to the extinguishers;
  2. Sprinkler Systems are integrated networks of hydraulically design piping systems installed in a building structure are with outlets arranged in a systematic pattern that automatically discharges water when activated by heat or combustion products from a fire;
  3. Standpipe Systems are sets of vertical pipes in a building to which fire hoses can be attached on each floor, including a system by which water is made available to water outlets as needed. Dry Standpipes are not filled with water until needed in firefighting while a "Wet" Standpipe is filled with water and is pressurized at all times.

[42] Action of going out of or leaving a place.

- Sprinkler Systems are required in all buildings with restricted movements;
- Dry standpipes must be provided for any building over two storeys in height. The size of the standpipe shall have a diameter of at least 100 mm (4") and the system must be provided with 64 mm (2 ½") hose connections.
- Fittings and connections must be of sufficient strength to withstand 21 kg/cm^2 (300 psi) of water pressure when ready for service. All horizontal runs of dry standpipes systems shall have a 20% slope for the purpose of draining.
- Fire service connections must be in the street side of the buildings, fully visible and recognizable from the street or nearest point of fire apparatus accessibility and must be located and arranged so that hose lines can be attached to the inlets without interference from nearby objects, including buildings, fences, posts, or other fire service connections.
- Wet standpipes must be provided for any building with four or more storeys. The size of the standpipes shall not be less than 64 mm (2 ½") in diameter and must equipped with 38 mm valve (1 ½") located at between 0.91 m and 1.82 m above the floor.

For additional reference, refer to Division 11 (DETENTION AND CORRECTIONAL OCCUPANCIES) of the **Fire Code of the Philippines**. Page 161-169.

ANNEXES

#	Type of Annex	Page
1	SOP FACILITY DEVELOPMENT PROCESS (FDP)	1
2	PROJECT PROPOSAL TEMPLATE	4
3	JAIL ASSESSMENT REPORT	10
4	BRIEF TEMPLATE	14
5	PROGRAMMING CHECKLIST	20
6	BRIEF GUIDELINES	25
7	FEASIBILITY STUDY TEMPLATE	34
8	FEASIBILITY STUDY CHECKLIST	40
9	SPACE MATRIX	43
10	PICTURES TAKEN DURING THE WORKSHOPS	55
11	LETTER ORDERS	58
12	CORRESPONDENCE WITH UNITED ARCHITECTS OF THE PHILIPPINES	65
13	PICTURES TAKEN AT THE OFFICE OF THE UNITED ARCHITECTS OF THE PHILIPPINES	67


SOP FACILITY DEVELOPMENT PROCESS (FDP)

Facility Development Process (FDP)	1. Project Proposal	2. Jail Brief	3. Feasibility Study	4. Develop Design	5. Bidding Process	6. Construction	7. Hand over
Goal	**Definition of the Vision of the proposed facility**	**Identification of jail Requirements (Programming)**	**Validation of the site with respect to project requirements**	**Development of the detailed layout, construction details, including cost estimates**	**Contracting of the construction works**	**Execution and monitoring of project**	**Ensuring continuity in the proper operation and maintenance of the facility**
Deliverables	✓ Jail Assessment Report (JAR) ✓ Project Proposal Document	✓ Programming Checklist + Bubble Diagram + Space Matrix (SM) ✓ Jail Brief Document	✓ Feasibility Study Report	✓ Concept Design (Initial Floor plan) ✓ Detailed Design (Construction Drawings, Technical Specifications, Bill of Quantities)	✓ Bid Documents ✓ Contracts	✓ Monitoring Reports ✓ Completion Report	✓ Hand-over Plan ✓ Acceptance Certificate ✓ Operation and Maintenance Plan
Activities	✓ Conduct Jail Assessment (to produce the JAR) ✓ Research statistics about jail operations ✓ Collate other relevant information or correspondence ✓ Hand-over collated documents and JAR to the Technical Working Group (TWG). ✓ Create the Project Proposal	✓ Produce Programming Checklist that identifies the proposed jail's Functional Components and desired operational requirements with corresponding impacts on the design ✓ Determine interrelationship among all functional components through bubble diagrams ✓ Estimate the potential floor space area requirement for the proposed jail Refer to the Brief Guidelines for details.	✓ Identify suitability of the site based on requirements from the brief and potential risks considering mainly the lot size, location and accessibility ✓ Propose alternative solutions to identified problems ✓ Recommend which solution is most feasible to implement	✓ Develop schematic design ✓ Determine engineering requirements ✓ Conduct Detailed Engineering ✓ Develop floor plan, elevations, sections ✓ Develop construction plans/drawings ✓ Develop construction specifications	✓ Develop bid documents ✓ Complete bidding tasks ✓ Advertise for bids ✓ Receive and open bids ✓ Select Lowest Calculated and Responsive Bid.	✓ Secure Construction Permits and Clearances ✓ Administer construction contract ✓ Review drawings ✓ Monitor construction quality ✓ Oversee construction completion ✓ Obtain occupancy permits ✓ Receive as built drawings	✓ Develop and initiate a building maintenance program ✓ Develop and manage a plan for transferring PDL and personnel to the new facility ✓ Develop hand over activities ✓ Site inspection ✓ Close-out meeting

Methodologies	✓ Visual inspection and measurements ✓ Interviews ✓ Statistical data analysis	✓ Brainstorming ✓ Focus Group Discussions ✓ Interviews	✓ Visual inspection ✓ Document Research/Review ✓ Meetings ✓ Analysis ✓ Decision-making	✓ Designs ✓ Construction Drawings ✓ BoQs ✓ Schedules ✓ Quality standards	✓ Advertisement ✓ Analysis ✓ Negotiations ✓ Decision-making	✓ Visual inspection ✓ Performance measurements ✓ Meetings	✓ Visual inspections ✓ Meetings ✓ Ceremonies
Office/ Team Primary Responsible	✓ <u>Data collection</u>: Warden (jail level) ✓ <u>TWG</u>: Consolidation and Project Proposal Creation ✓ <u>Members of TWG</u>: • Chief Logistics Division, • CRS, • Regional Operations Officer	✓ <u>Requirements identification</u>: Warden and the jail personnel with support from Regional Engineer ✓ <u>TWG</u>: Consolidation and Brief Document production ✓ Members of TWG: • Chief Logistics Division, • CRS, • Regional Operations Officer, • IWD Officer, • Health Officer	Data collection: • Chief Logistics Division, • Personnel from Operations of the Region, • Personnel from the Regional Intelligence Division (RID), • Proponent/ Warden concerned TWG: Consolidation and report writing Members of TWG: • Chief Logistics • CRS, • Regional Operations Officer • Intel Officer	✓ Regional Engineers ✓ Technical Personnel of Directorate for Logistics (when needed)	✓ Bids and Awards Committee ✓ Procurement Section, (Logistics Division)	✓ Project Management Team ✓ Logistics Division	✓ End-User ✓ Inspection and Acceptance Committee

Signatories	• Prepared by: Secretariat and TWG; • Conforme: Warden; • Approved by: Regional Director	• Prepared by: Secretariat and TWG; • Conforme: Warden; • Approved by: Regional Director	• Prepared by: Secretariat and TWG; • Conforme: Warden; • Approved by: Regional Director	• Regional Engineer • Chief Logistics Division • Head of Procuring Entity (HOPE)	• Bids and Awards Committee Members • Head of Procuring Entity (HOPE)	• Regional Logistics • Directorate for Logistics	• Technical Inspection and Acceptance Committee for Infrastructure
Time Frame	approximately 1 month	approximately 1 month	approximately 1 month	approximately 1 month	Project should be awarded within 3 months after advertisement	Depending on the contract period	Within a week after issuance of Certificate Of Completion

PROJECTED TIMELINE FOR FDP

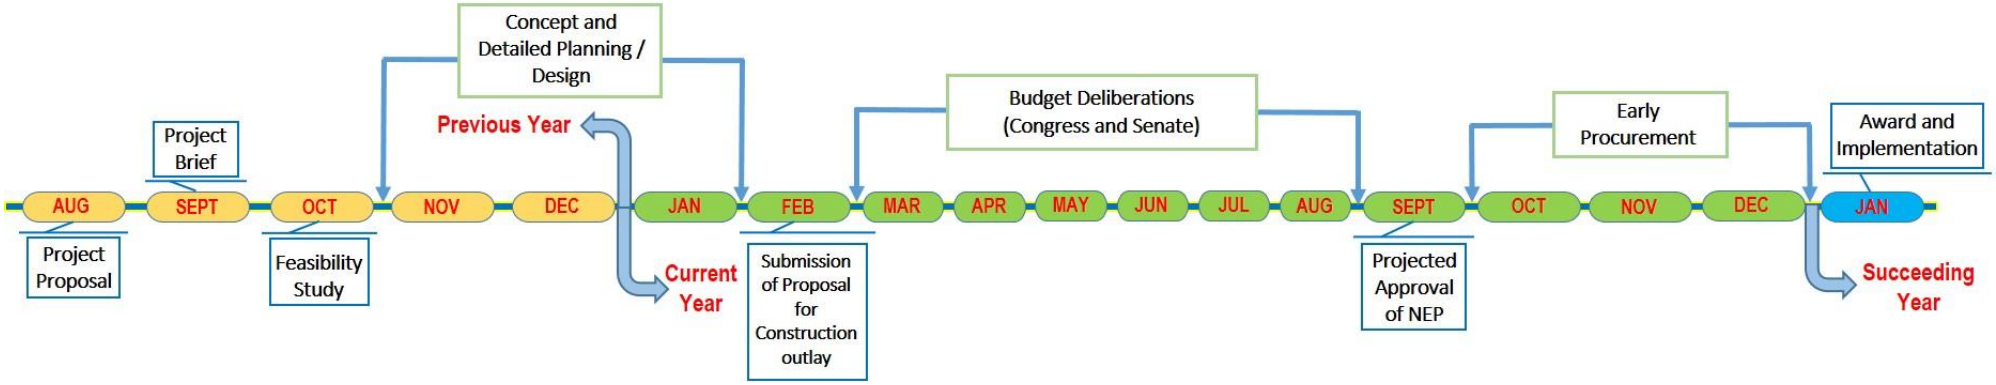

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
BJMP- Regional Office I

[Jail Name]

[Date]

PROJECT PROPOSAL

[Project Name]

TABLE OF CONTENTS

TABLE OF CONTENTS 1
SUMMARY 2
INTRODUCTION 3
NEEDS/PROBLEMS 3
OBJECTIVES 4
EXPECTED SUPPORT 5
APPENDIX 6

SUMMARY

This section should include information for readers who may not want to read the entire document but who still need a summary of the proposal. Although this section appears first in the document, it is usually written last.

The summary should remain on a separate page and not exceed one page.

The summary should contain the following elements:

- Brief identification and purpose of the jail;
- The purpose and anticipated end-result of this proposal;
- The type of support requested;
- Other information you deem pertinent.

INTRODUCTION

Introduce your current jail here:

Name / type	e.g.: Manila City Jail
Area Covered	e.g.: Manila City
Ideal Capacity	e.g.: 1200
Current Population	e.g.: Male 1350, Female: 256
Date	

If the jail has two separate managements for male and female PDL, mention it.

1. Follow up by explaining:

The history of the existing facility (location, previous function of the building prior to BJMP take-over and occupancy, who owns it, how old it is if known, etc..) and the description of jail activities.

2. Conclude by citing: the main problems of the current facility (ie overcrowding, dilapidation of the building, lack of space..) that triggered the decision of expanding or building a new facility

3. Explain: the detrimental consequences if the project of expanding or building a new jail does not go ahead.

NEEDS/PROBLEMS

Identify all the needs and problems to be addressed in the current jail facility. Include any measurable data from the assessment that would quantify the needs and highlight the gap between the current situation and the standards. The topics may include the following:

- Living space (space per PDL)
- Sunning
- Infrastructure/Design (status of infrastructure (age, year of construction, location)
- Security
- Visits
- Essential services: Water, sanitation, ventilation, electricity etc.
- Access to Health (types of diseases)

- Kitchen
- Administration / Staff quarters
- Development / Recreation/ Education/Livelihood activities

OBJECTIVES

State the desired goals and objectives to address the needs/problems stated above.

Projected Capacity of the new jail including final capacity if future expansion is foreseen

- Make several population projections based on:
  - PDL population growth rate for the last 10-20 years
  - general population growth rate of the catchment area derived from statistics office
- Decide on the final design capacity within the limits of the above projections and the corresponding category of the proposed jail[43]
- If the projected jail capacity exceeds 2,000, consider proposing multiple jail facilities

Ideal location of the new jail

- Cite the location requirements with due consideration to environmental risks and considering access, proximity to PNP and court as well essential services availability.

Also include key benefits of reaching goals/objectives.

- Benefits to the BJMP in terms of better living conditions for PDL and better working conditions for jail staff
- Benefits to community of rehabilitation and development programs implemented in the jail such as reduction of re-offending, security and safety of the community.

EXPECTED SUPPORT

[43] A: below 100 PDL Capacity, B: 101-500 PDL Capacity, C: 501-1000 PDL Capacity, D: 1001-2000 PDL Capacity.

Specify the actions expected from the readers of this document, which will be based on on-going negotiations between the jail authorities and other stakeholders, whether within

the BJMP, or with other government agencies. Examples: Land donations, financial support, material support etc.

PREPARED BY:

NAME (TWG SEC)
DESIGNATION

Date:

CONFORMED/REVIEWED BY:

NAME (WARDEN)
DESIGNATION

APPROVED/DISAPPROVED:

NAME (RD)
DESIGNATION

APPENDIX

Provide supporting materials for your proposal here. It may be:

- Jail Assessment Report with pictures;
- Calculations of population projections;
- Statistics about the jail operations (ie staff, number of incidents, jail disturbances, health statistics, etc);
- Other relevant information or internal BJMP correspondence.

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
BJMP- Regional Office I

ANNEX: Jail Assessment Report

JAIL NAME	
Jail location	
Assessed by	
Date assessed	
Existing Jail Profile:	
Number of personnel	
Ratio of personnel to PDL (against ideal 1:3)	
Number of PDL	
High Risk	
High Profile	
Ideal jail capacity (M+F)	
Total Land Area (sq. m)	
Total cell area Male (sq. m)	
Total cell area Female (sq. m)	
Congestion rate Male (based on 4.7 sq. m/PDL)	
Congestion rate Female (based on 4.7 sq. m/PDL)	
Actual cell area per Male PDL (total cell area/total population)	
Actual cell area per Female PDL (total cell area/total population)	

ENVIRONMENTAL RISKS

Geohazards of the current jail location (ie flooding, proximity to fault line, landslide)

SECURITY CONDITIONS

Perimeter fences – existence, type, height, presence of guard-towers.

SLEEPING SPACES

Short description + Show pictures of the actual jail accommodation situation

ACCESS TO SUNNING AREA

Percentage of PDL with at least one hour/day	
Percentage of PDL with less than one hour/day	
Percentage of PDL with no access	

OTHER DEVELOPMENT ACTIVITIES

☐ Livelihood	Is there a dedicated area?	☐Yes	☐No
☐ Training/ALS		☐Yes	☐No
☐ Worship		☐Yes	☐No
☐ Outdoor recreation		☐Yes	☐No
☐ Others, Please specify:		☐Yes	☐No

Remarks:

OTHER ESSENTIAL SERVICES

ELECTRICAL SERVICE and FACILITIES Comment on the following: ✓ Continuity of service ✓ Electrical wirings, fixtures (switches, plugs, lamps, outlets, etc.) ✓ Emergency systems (generators)	
WATER SUPPLY	
What is/are the main source/s of water?	
Water quality (ie salty, clear, potable, etc.)	
Water service levels (availability and continuity of supply)	
SEPTIC TANKS	
How many Physical condition (cracks, pipe leaks, overflowing, etc)	

Desludging/siphoning and maintenance issues (how often)	

BUILDING CONDITIONS: 1 BUILDING

Building Name	**Description (presence of cracks, leaks, faded paints, general condition)**
Walls	
Roof	
Ceilings	
Windows	
Doors	
Toilets	
Stairs	
Hallways	
Floors	
Columns	
Beams	
Electrical wirings	
Water lines	
Sewerage lines	
Others	

Add more table for additional buildings as necessary

VISITING AREA

Presence and size of dedicated space for visiting area:	☐Yes	☐No
Furniture available (tables, chairs):	☐Yes	☐No
Toilets for visitors	☐Yes	☐No

Average number of visits in a day:	

HEALTH FACILITIES (Y/N)

Isolation for contagious PDL ☐Yes ☐No

Number of dedicated isolation rooms	
Size of dedicated isolation rooms	

Storage for drugs and equipment ☐Yes ☐No

Availability of dedicated space for proper medical consultation ☐Yes ☐No

KITCHEN

Comments or any problems related to the following:

- ✓ Facility *Design, size against served population*:
- ✓ Water supply *Availability, quality, storage*:
- ✓ Ventilation (smoke extraction), lighting:
- ✓ Food Storage *Presence, type, size and characteristics*:
- ✓ Furniture and equipment (stoves, tables, counter, fridges):
- ✓ Drainage *Presence, conditions*:
- ✓ Presence of vectors:
- ✓ Ease of maintenance/cleaning:
- ✓ Solid waste management:

FACILITIES FOR PERSONNEL

☐Personnel Barracks	Current capacity:
☐Gym	Comment:
☐Kitchen	Comment:
Others: Please specify	Small lounge with chairs and a table

BRIEF TEMPLATE

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
BJMP- Regional Office I

JAIL BRIEF DOCUMENT

[Jail Name]

[Date]

*[This document shall be prepared when the construction of a new jail or the expansion of an existing one is planned. In the case of an expansion, a brief document will be compulsory **only** if the new capacity changes the category of the jail, for instance from Type A to Type B.]*

Capacity	
Category	☐A ☐B ☐C ☐D
Jail Classification	☐Male ☐Female ☐Both
Security	☐High-risk ☐High profile ☐Ordinary
Type of Visits	☐ Contact ☐Non-contact ☐ Conjugal ☐ Teleconferencing (e-Dalaw)
Outdoor Access	☐Basketball Court ☐Yard ☐Rooftop
Main Livelihood Activities	
Health Facilities	☐Dental Office ☐Maternal / Pre-natal Care ☐Mental Ward ☐ Patient Ward ☐Laboratory ☐ X-ray

TABLE OF CONTENTS

JAIL LAYOUT 3

COMMITMENT 3

ACCOMMODATION 4

VISITATION 4

HEALTH FACILITIES 4

FOOD SERVICES 5

DEVELOPMENT, RELIGIOUS AND LIVELIHOOD ACTIVITIES 5

ADMINISTRATION 6

SECURITY 6

All requirements defined in the Jail Brief Document shall be in line with the Minimum Standards for the Design of BJMP Jail. Compliance should be verified for all sections listed below.

JAIL LAYOUT

This section frames the general layout of the facility by defining which functional areas are included in the defined zones depending on security clearance levels of PDL, staff and different types of visitors (family, service providers, professionals, etc.). The zones within the facility may be classified as follows:

- Zones accessible to BJMP personnel only
- Zones accessible to BJMP personnel and trustees only
- Zones accessible to all PDL and BJMP personnel
- Zones accessible to all PDL and visitors

For example, the zone in which accommodation for PDL is located should be accessible to all PDL and BJMP personnel while the zone in which administration is located should be accessible to BJMP personnel only or to BJMP personnel and trustees. Certain zones could be further subdivided in order to ensure the protection of certain PDL population e.g. female, LGBT, elderly.

- The security barriers / procedures between zones should also be described.
- The design capacity (as mentioned in the Project Proposal) and the initial plans for possible future expansion may be cited in this section.

It helps completing this section while consulting the various Bubble Diagrams created by the brief team.

COMMITMENT

This section describes the commitment process and its implications on the functional components required to facilitate the flow of PDL from the moment they first enter the jail until they reach their permanent accommodation.

- The number of people (PDL and personnel) present at a time in each of the functional components should be indicated as well as the corresponding equipment, furniture and other recurrent areas (such as toilets) and features.

ACCOMMODATION

This section describes the proposed distribution of PDL based on classification and segregation (according to gender, health, risk, etc.). This distribution should be consistent with the zones defined in the layout section. The need for single accommodation cells

should be indicated along with their intended use (e.g. for high-risk PDL, disciplinary reasons).

- State the routine security checks to be conducted within the Cells Buildings.
- Mention the type of recreation activities envisaged within the building.
- Consider accommodation of PDL with disability, elderly and pregnant women.

VISITATION

This section describes the movement of visitors and related procedures along the different functional components from the holding area to the visitor's area where the visits actually take place. Aspects related to security (checks, equipment) that may influence the design/features of the rooms should be reviewed.

- The number of people (PDL, personnel and visitors) foreseen to be present at a time in each of the functional components should also be indicated as well as the corresponding furniture and other recurrent areas (such as toilets) and features.
- Accessibility to PWD should be considered.
- Wherever Teleconferencing (e-Dalaw) is considered, corresponding room/furniture/equipment should be described as precisely as possible.
- Number of conjugal visits rooms and their characteristics should be indicated.

HEALTH FACILITIES

This section focuses on the type and level of health care provided in the new facility, the potential number of patients that can be received and the health staff, equipment and supplies required.

- Special attention must be paid on the risk of communicable disease transmission, especially in the case of Tuberculosis (TB) and the related need for confinement of infectious patients.
- Facilities must be fully accessible to PWD.

FOOD SERVICES

This section describes the equipment (especially for cooking), personnel and PDL aides required to ensure daily preparation of food.

- Issue of food and water storage and its impact on required space (area or volume) should be reviewed based on foreseen quantities and / or available standards.
- If freezers are foreseen to be used, their capacity should be indicated.

The location of the kitchen in relation to the accommodation building should be determined, as well as the accommodation of kitchen aides (in ordinary dormitories or in a special facility next to the kitchen). Kitchen location should also be determined taking into account food providers' access.

DEVELOPMENT, RELIGIOUS AND LIVELIHOOD ACTIVITIES

This section lists and describes the development, religious and livelihood activities envisioned in the new facility. For any type of activity, the potential number of participants should be estimated. The corresponding locations, areas and features required should be detailed, especially related to any goods production included in livelihood activities (e.g. basket production that may need space and water supply, welding that may need electrical supply...). Likewise, religious practices may require specific arrangement (space, light, water supply) that should be indicated.

- Laundry areas should be described in terms of number, characteristics and location.

ADMINISTRATION

This section provides information on the requirements in terms of premises, furniture and equipment for the administration of the new facility, the recreation of the personnel, and the parking and maintenance of vehicles.

- For this purpose the number of people foreseen to be present at a time in the various rooms is indicated.
- Furniture and equipment requirement focus on specific activities ranging from meetings to training, cooking and sports.
- Requirement for the warden's quarters focus on the usual fixtures found in residential accommodation.
- The administration building must be accessible to PWD at least up to the staff office and warden office.
- Administration building location should be determined in relation to management / security requirements.
- Special attention should be given to the armory (whether it is a room or a cabinet) focusing on its location and characteristics.

- In large facilities, sport and recreational area must be provided outside the administration building. The location of this area should be defined taking account access and type of activity.
- The parking and motor pool location and characteristics requirements shall be determined taking into account the number and type of vehicles that the new facility is meant to obtain.

SECURITY

In this section, security needs of the new facility must be described in order to select / design the appropriate security features to be provided. For instance the listing of the areas requiring surveillance shall determine the position of observation spots (guard towers, catwalk) and/or the position of security equipment (CCTV, sensors). This section is also concern with the flow of vehicles and pedestrians in /out and within the jail and its corresponding security checks. This will take into account the zoning defined in the first section of the document.

- Security has to be ensured by the appropriate number and type of personnel. Their needs in terms of space and other requirements (e.g. toilets) must be included.

PREPARED BY:

NAME (TWG SEC)

DESIGNATION

DATE:

CONFORMED/REVIEWED BY:

NAME (WARDEN)

DESIGNATION

APPROVED/DISAPPROVED:

NAME (RD)

DESIGNATION

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 Mindanao Avenue, Project 8, Quezon City
Trunklines: (+632) 927 - 6383; 453 - 1196
Email Adress: director@bjmp.gov.ph Website: www.bjmp.gov.ph

Programming Checklist

JAIL LAYOUT

1.1 **Jail Capacity** and Possibility of Expansion

- State the desired jail capacity based on projections as indicated in the Project Proposal.

1.2 **Zoning of the Jail**

a. Define the various areas in the facility based on security clearance levels for various types of PDL. (areas in which all PDL are allowed, only trustees, only staff or visitors)
b. Define the corresponding general distribution of buildings per zone

The **Functional Areas** to be distributed in the various zones are:

- Commitment area
- Accommodation
- Visiting area
- Health facilities
- Food services
- Development activities / livelihood
- Administration

Some Functional Areas may be present in more than one zone.
Creating **Bubble Diagrams** may help defining the various zones.
Define the corresponding security barriers to be placed between zones.

COMMITMENT

2.1 Location of the commitment area

2.2 **Holding Area**

a. Ave. no. of PDL committed per day
b. Hygiene level required;
c. Type of PDL to be committed (Male, female and LGBT);
d. Time in holding cell;
e. Furniture, equipment, or fixtures to be found (number, type, etc).

2.3 **Reception/Processing**

a. Number of personnel working at a time of processing;
b. Processing time;
c. Furniture, equipment, or fixtures to be found.

2.4 **Diagnostic/Orientation/Body Search**

a. Time for diagnostic + orientation + body search;
b. Number of staff
c. Equipment for body search;
d. Furniture, equipment, or fixture to be found

2.5 **Post Holding Cell (PHC)**

a. Time in PHC;
b. Furniture, equipment, or fixtures to be found

2.6 **PDL Classification and Counseling Unit (PCCU)**

a. Number of days in ICCU;
b. No. of PDL Capacity;

2.7 **Quarantine**

a. No. of PDL capacity
b. No. of days
c. Specific room characteristics (e.g. ventilation)

ACCOMMODATION

3.1 **PDL classification** and segregation (according to gender, health, risk, etc)

3.2 Number per classification

3.3 Recommended number of PDL/cell

3.4 Number of **single accommodation cells** required and intended use

3.5 Where are **security checks** conducted (entrance level, per floor, at cell) and how often?

3.6 In the recreation area, what are the **activities** carried out indoors? Outdoors?

VISITATION (consider PWD access to hallways, corridors, doors, etc.)

4.1 **Visitors holding area**

a. average number of visitors per day
b. profile of visitors(age, gender)
c. schedule of visits
d. location (inside or outside the main perimeter fence)

4.2 **Processing area**

a. steps to get inside the visiting area
b. location (inside or outside the main perimeter fence)

4.3 **Searching area**

a. equipment
b. searching modes (frisking, strip search, cavity search)
c. storage for visitors' belongings
d. location (inside or outside the main perimeter fence)

4.4 **Visitor`s area (for contact visits)**

a. average number of visitors per day (same as above)
b. average number of official visit per day (lawyers, doctors, priest)
c. segregation for different types of visitors
d. equipment, furniture, fixtures including CCTVs

4.5 **Access to toilets**

4.6 Commissary - volume of commodities that may be sold

4.7 Teleconferencing room - average number of PDL using the facility

4.8 Conjugal visit - average number of conjugal visits per day and duration

4.9 **Non-contact Visit Area**

a. security, health and risk assessment of PDL
b. average number of non-contact visits per day and duration

HEALTH FACILITIES

5.1 **Patients reception area**

a. average number of PDL availing health services daily
b. furniture required

5.2 **Consultation room**

a. average number of daily consultations
b. furniture required

5.3 **Nurse station**

a. Number of staff present at a time
b. Furniture required

5.4 **Staff office**

a. Furniture required
b. Number of health staff

5.5 **Equipment area/Supply room** – equipment and supplies required (volume)

5.6 **Pharmacy**- Volume of medicines and other items to be kept

5.7 **Dental office** - average number of PDL availing dental services daily

5.8 **Maternal/pre-natal care area** - average number of female PDL availing maternal care daily

5.9 **Isolation cells for PDL with TB** - average number of PDL requiring TB isolation at a time

5.10 **Isolation for other infectious diseases** - average number of PDL requiring isolation due to infectious diseases at a time

5.11 **Sputum collection area** – location, average number of users daily

5.12 **Patients ward** - average number of PDL requiring hospitalization at a time, required furniture

5.13 **Laboratory** (if required in the jail)

a. kind of lab services to be offered
b. number of staff
c. Equipment, machines

5.14 **Medical imaging X ray** (if required in the jail) – average number of PDL availing x-ray services daily

5.15 **Temporary Observation ward** (if required in the jail) - average number of PDL to be kept at a time, required furniture

FOOD SERVICES

6.1 **Kitchen Area, Food Distribution Area**

a. Location
b. Number of stoves, refrigerators and other equipment

6.2 **Fuel Storage Area** - Average number of LPG tanks (11kg or 50kg)

6.3 **Food Storage Area**

a. Accessibility by service providers' vehicles (how do service providers access the area, by which gate, loading dock?, etc)
b. Type and duration maximum volume of goods to be kept in the storage area

6.4 **Kitchen-waste Collection Area** - Average volume of garbage and interval of collection in the jail

6.5 **Kitchen-aide Cells**

a. Number of kitchen aide
b. Kitchen staff per shift
c. Location of the cells

6.6 **Kitchen-staff Office**

a. Location
b. Number of jail staff
c. Equipment, furniture, fixture

DEVELOPMENT, LIVELIHOOD ACTIVITIES

7.1 What are the development activities foreseen indoors? Outdoors?

7.2 How many PDL are expected to participate at a time for each of these activities?

7.3 Predominant religions and number per religion of PDL

7.4 Laundry services – location (is it in a centralized area or decentralized per Cells Building)

ADMINISTRATION

8.1 **Warden's Quarter**
a. Location (in the Admin building, separate structure, other location)
b. Nature: Room, studio, apartment, house

8.2 **Warden's Office size**

8.3 **Staff Quarters**
a. Location (in the Admin building, separate structure, other location)
b. Number of staff, number per shift
c. Type of accommodation: male/female staff or mix (dormitory, locker room, bathroom…)

8.4 **Staff Office**
a. Number of personnel
b. Equipment: Table, computers, printers, cabinet, etc.
c. PDL and staff Records Room
d. Accessibility to toilet (consider PWD access)
e. Potential number of visitors to the Administration – space for accommodating the visitors

8.5 **Supply Storage -** Nature and quantity of supply (define requirement for shelves, cabinets, etc)

8.6 **Armory**
a. Location;
b. Nature and quantity of weapons

8.7 **Conference Room**
a. Capacity;
b. Equipment, furniture, fixtures;
c. Sitting arrangement.

8.8 **Training Room**

a. Capacity;
b. Equipment, furniture, fixtures (projector?);
c. Sitting arrangement.

8.9 **Staff Kitchen/Dining**

a. Capacity;
b. Equipment, furniture, fixtures;
c. Sitting arrangement.

8.10 **Fitness Gym**

a. Location/capacity;
b. Equipment, furniture, fixtures;
c. Locker room.

8.11 **Staff Sports and Recreation Area**

a. Location;
b. Activities;
c. Potential number of users per activity.

8.12 **Parking Lot**

1. Location;
2. Number of Visitors (Visitors, staff, lawyers courts employee);
3. Segregation for staff and different types of visitors;
4. Type of vehicle ;
5. Flooring.

8.13 **Motorpool (Type B, C, D only)**

1. Type of building or area;
2. Capacity;
3. Type of vehicles to be maintained;
4. Type of maintenance activity to be performed.

SECURITY

9.1 **Staff**

a. Total number of security personnel
b. Number per shift

9.2 **Security functional elements**:

a. Location of Command Control (near the gate Admin building or Other location)
b. Guard Tower (location, areas to be observed)
c. Pedestrian gate (number, location)
d. Inner barriers (including secondary fence) – Based on zones defined earlier, describe the design of the internal fences and gates.

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 Mindanao Avenue, Project 8, Quezon City
Trunklines: (+632) 927 - 6383; 453 - 1196
Email Adress: director@bjmp.gov.ph Website: www.bjmp.gov.ph

Conducting a Jail Construction Brief: Practical Guidelines

WHAT IS A JAIL CONSTRUCTION BRIEF?

The Jail Construction Brief (brief for short) is a document that presents to the designer the physical and human considerations to be incorporated when designing a jail. It is a written description with corresponding graphical representation of the vision, operational objectives, activities and flow associated of each functional component within the facility. It must be considered as an expression of future operations and not as a description of the situation at the time of running the Brief.

For example, it will provide information on the type of services provided to the PDL (health, livelihood, training, family visits and food services) and the expected levels of security.

A Jail Construction Brief should be made prior to building a **new jail** or when an existing one has to be **expanded**.

WHO SHOULD CONTRIBUTE TO THE BRIEF?

The required team to contribute to the Brief (the Brief Team) comprises at least:

1. the Warden/Deputy Warden
2. An officer in charge of Administration
3. An officer in charge of Security and control
4. An officer in charge of Inmate Welfare Development (training, livelihood, education, religious, health, food services)

This would be the **Core Team**.

The team may, in addition, get support from the **Regional Engineer** and **Health Officer** for more technical considerations. Other possible contributors may include former PDL and local government representatives (planning and engineering offices, especially).

HOW CAN THE BRIEF BE ACHIEVED?

Ideally, the Brief should include:

A. A **Consultation Process** and;
B. An **Analytical Process**.

A. The Consultation Process

It consists of asking for the opinion of the main stakeholders to the functioning of a jail facility, i.e.:

1. PDL;
2. jail staff; and
3. visitors (PDL friend and relatives as well as lawyers, suppliers etc.) …

…on how the current facility functions, and draw lessons for theDEFINITION of the requirement for the design of the new facility.

The **Core Team** should interact with each of the three categories of stakeholders using techniques such as Brainstorming Sessions, Focus Group Discussions and Interviews.

Groups of volunteers may be formed among PDL and staff considering their specific needs and issues (male, female, youngster, elderly, LGBT, etc.). Written consultation may be considered when appropriate.

The themes tackled during consultation sessions should be those relevant to each of the three categories:

1. For PDL: Accommodation, Food services, essential services[44], development activities[45], health services, visitation;
2. For jail staff: Staff quarters, procedures / security, administration, essential services, health services;
3. For visitors: visitation.

Discussions/interviews should focus on the review of the practices in place in the existing jail trying to identify:

1. The problems encountered in the existing facility that should be addressed in the design of the new facility;
2. The good practices found in the existing facility that should be kept in the new facility.

[44] Water supply, power supply, sanitation.

[45] Including outdoor access.

The Jail Assessment Report (previously used in the Project Proposal document) can be used as a basis for this exercise.

B. The Analytical Process

It shall be conducted by the **Core Team** with the support of additional members as needed for certain issues.

It shall consist of reviewing and streamlining the outcome of the **Consultation Process** making a clear listing of the issues distinguishing **Problems** and **Good Practices** for each of the Functional Areas to be included in the Brief.

The following table would be the model to follow:

	Problems	**Good Practices**
Commitment	Problem 1 Problem 2	
Accommodation	Problem 1 Problem 2	Good Practice 1 Good Practice 2
Visitation	Problem 1 Problem 2	Good Practice 1 Good Practice 2
Food Services	Problem 1 Problem 2 Problem 3	Good Practice 1
Health Services	Problem 1 Problem 2 Problem 3	Good Practice 2
Development Activities		Good Practice 1
Administration	Problem 1	Good Practice 1
Essential Services	Problem 1 Problem 2	
Security	Problem 1 Problem 2	


This table will help following the **Programming Checklist** that covers these areas. Requirements for the new facility should address the **Problems** identified in this way while maintaining the **Good Practices**.

Issues that were not tackled during the consultation process shall be directly analyzed by the **Core Team** with relevant external support.

Requirements listed in this way shall be reviewed against existing relevant guidelines such as Mandela Rules, Bangkok Rules, and BJMP Operations Manual.

The numbering that appears on the Checklist shall be reproduced for every listed requirement so that the reader can easily refer to the corresponding question on the checklist.

The following chart summarized the process:

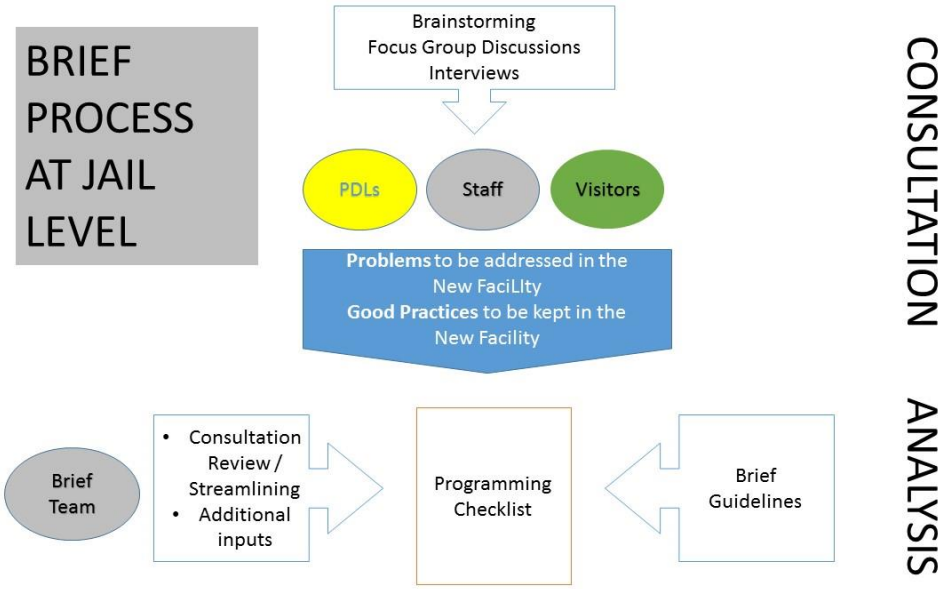

Drawing of **Bubble Diagram** is also part of the Analytic process. The **Core Team** may choose to create these diagrams while responding to the questions appearing in the **Programming Checklist.**

Bubble Diagram is a means of representing the connection between the different functional components that make up the facility. They show the possible path between areas focusing on a single functional area or at the level of the entire facility. The various zones existing in the facility in terms of security clearances may be represented. The level of detail represented is upon the discretion of the **Core Team** depending on the importance given to certain aspects.

A number of example of **Bubble Diagrams** are enclosed.
Once the **Programming Checklist** and the **Bubble Diagram** are done, the **Space Matrix** can be established. The **Space Matrix** summarizes the space allocated to each functional component, taking into consideration the threshold established by the **Minimum Standards for the Design of BJMP Jails**. This must be conducted with the assistance of the **Regional Engineer** using the provided template.

WHERE SHOULD THE ANALYTICAL PROCESS TAKE PLACE?

The **Analytical Process** should preferably take place outside the jail in order for the participants to be focused on the activities. Otherwise the daily activities might distract them and compromise the quality of the work.

WHAT HAPPENS ONCE THE PROGRAMMING CHECKLIST / BUBBLE DIAGRAMS / SPACE MATRIX HAVE BEEN COMPLETED?

All these documents must be sent to the Regional Office through the Technical Working Group which will be used to establish the **Jail Brief Report.** (Please refer to the FDP matrix for details on the sequence of activities).

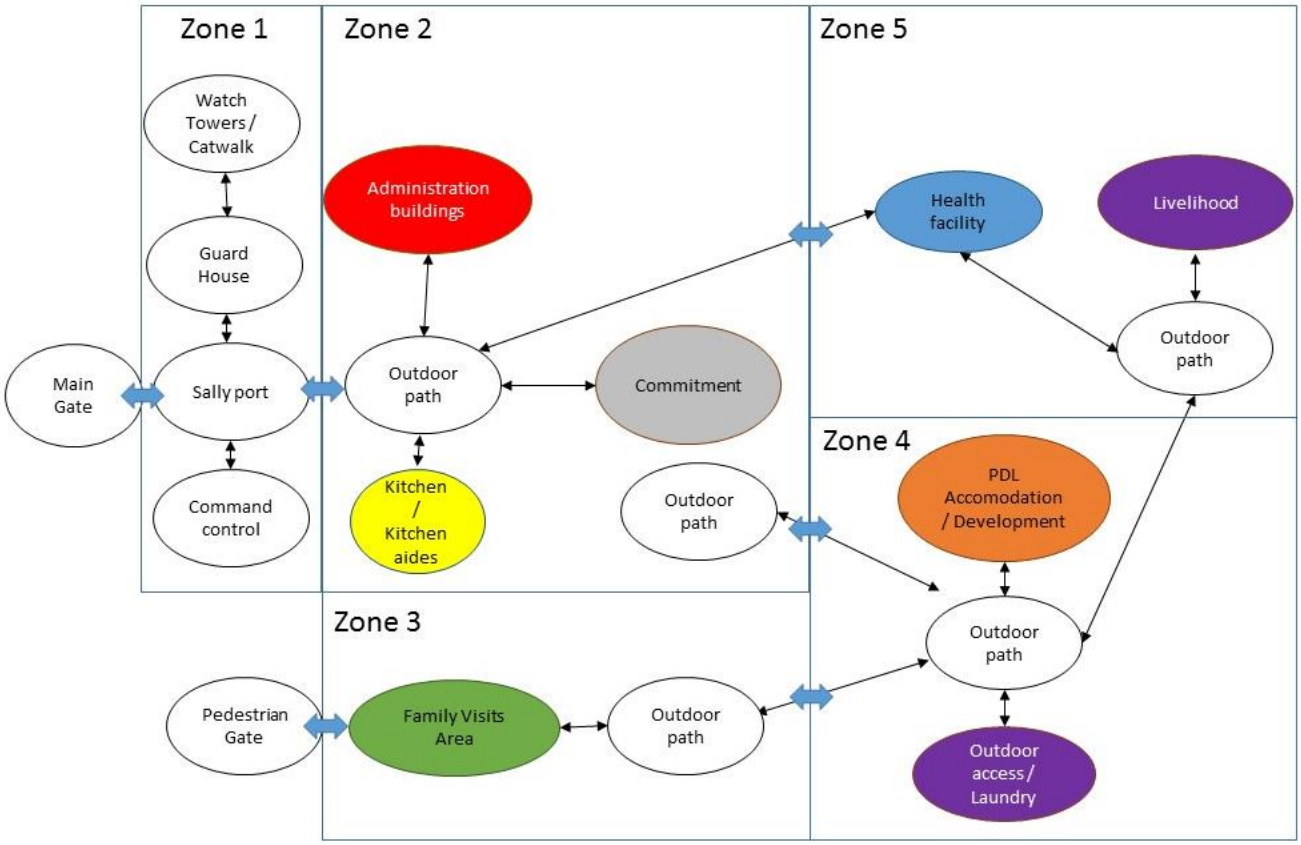


Figure 1: Example of Bubble Diagram for a large facility - General Layout

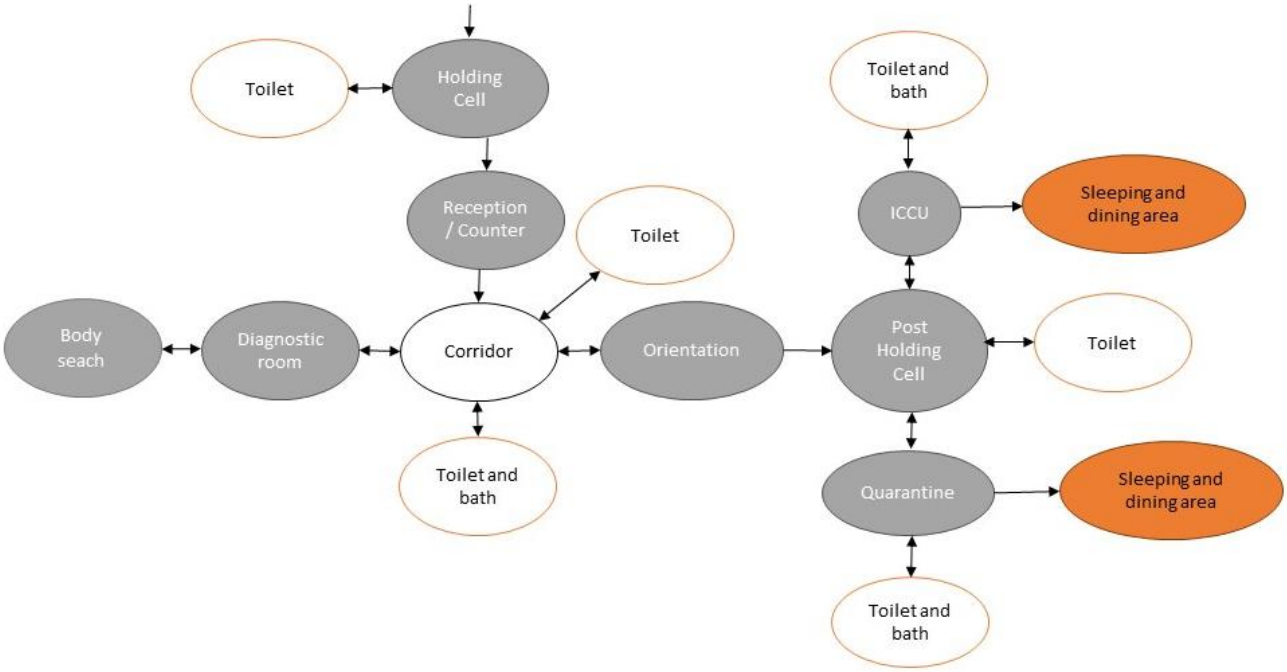


Figure 2: Example of a Bubble Diagram for a Large Facility - Commitment

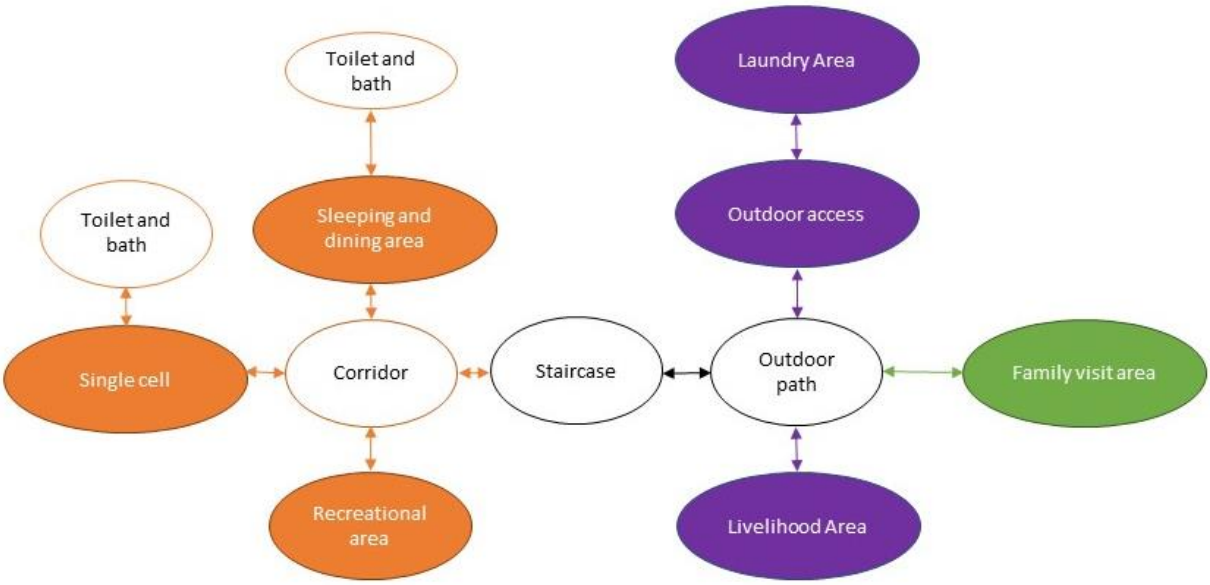


Figure 3: Example of a Bubble Diagram for a Large Facility – Accomodation

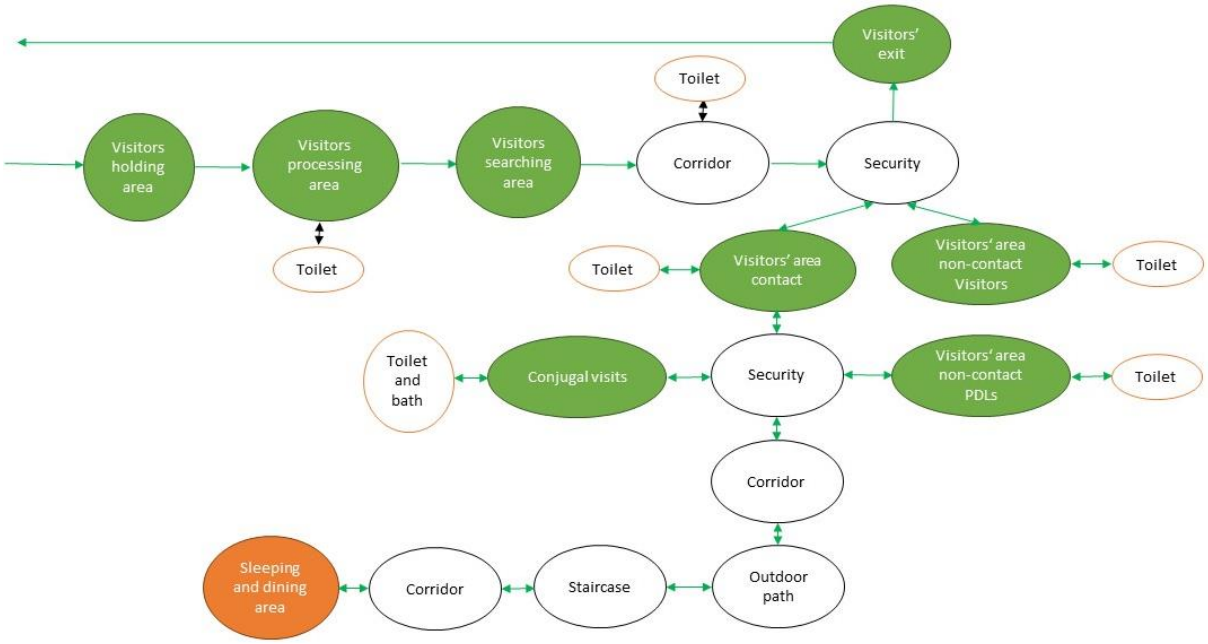


Figure 4: Example of a Bubble Diagram for a Large Facility - Visitation

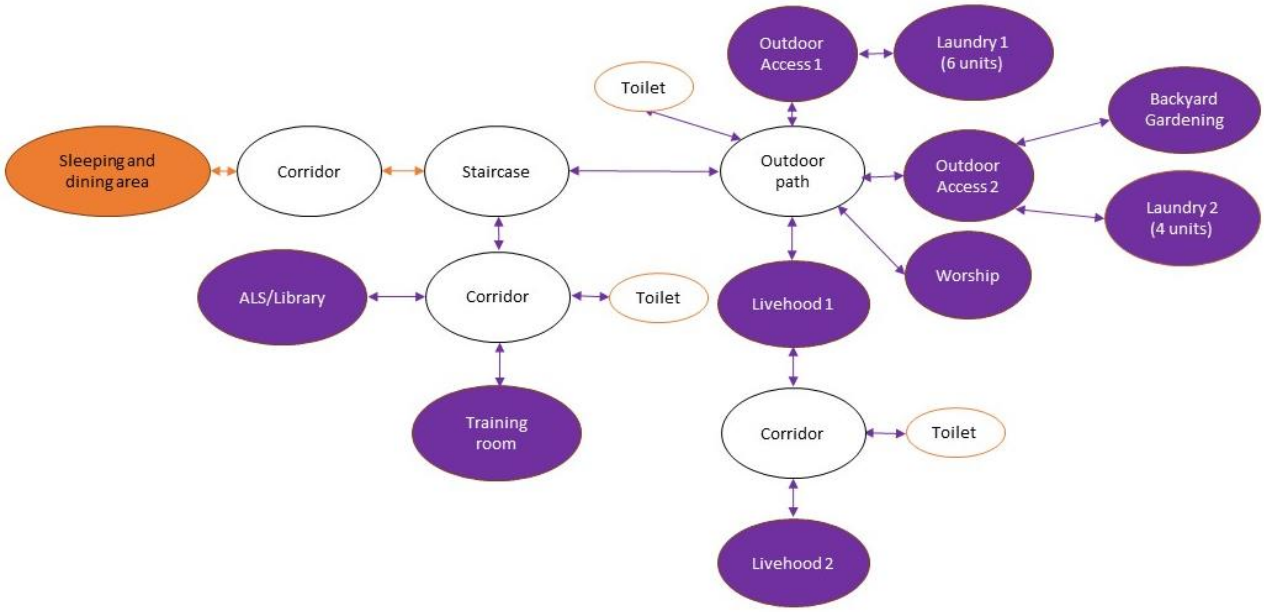


Figure 5: Example of a Bubble Diagram for a Large Facility - Development Activities

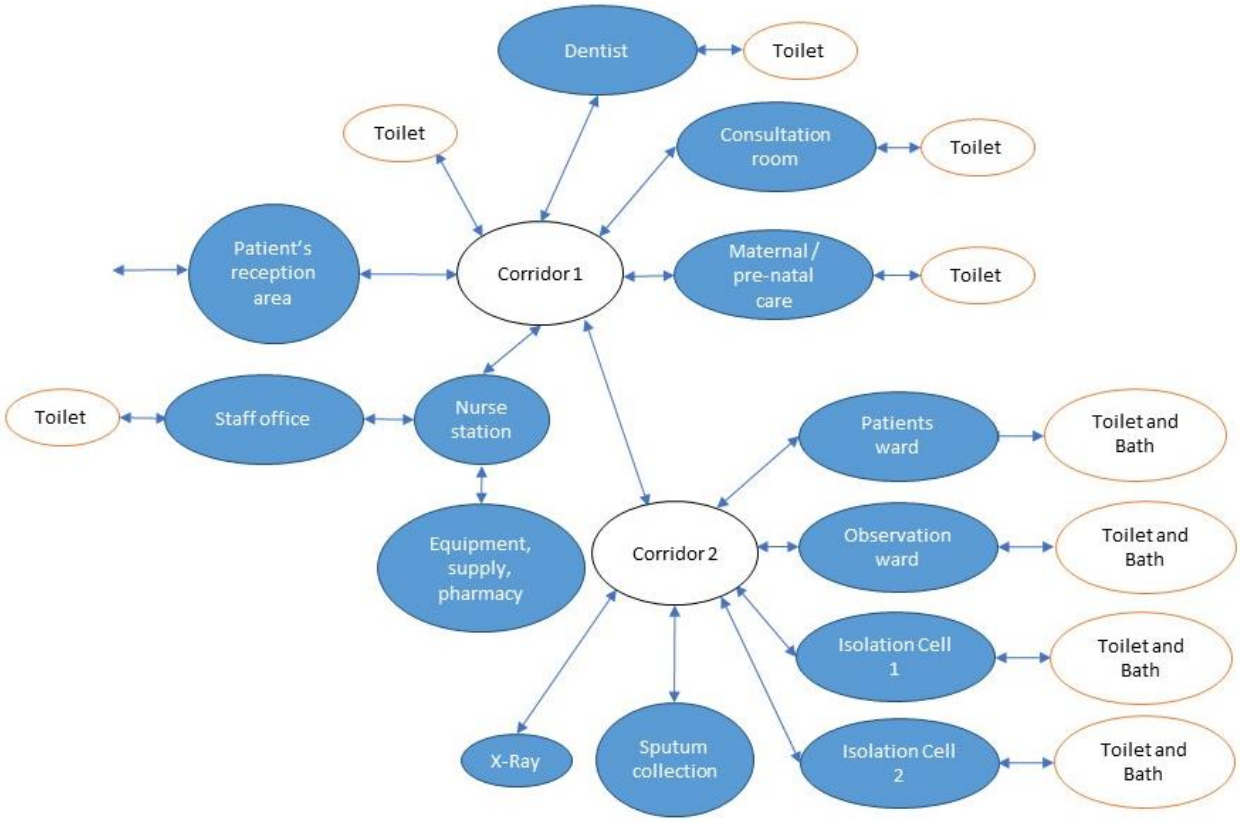


Figure 6: Example of a Bubble Diagram for a Large Facility - Health Facility

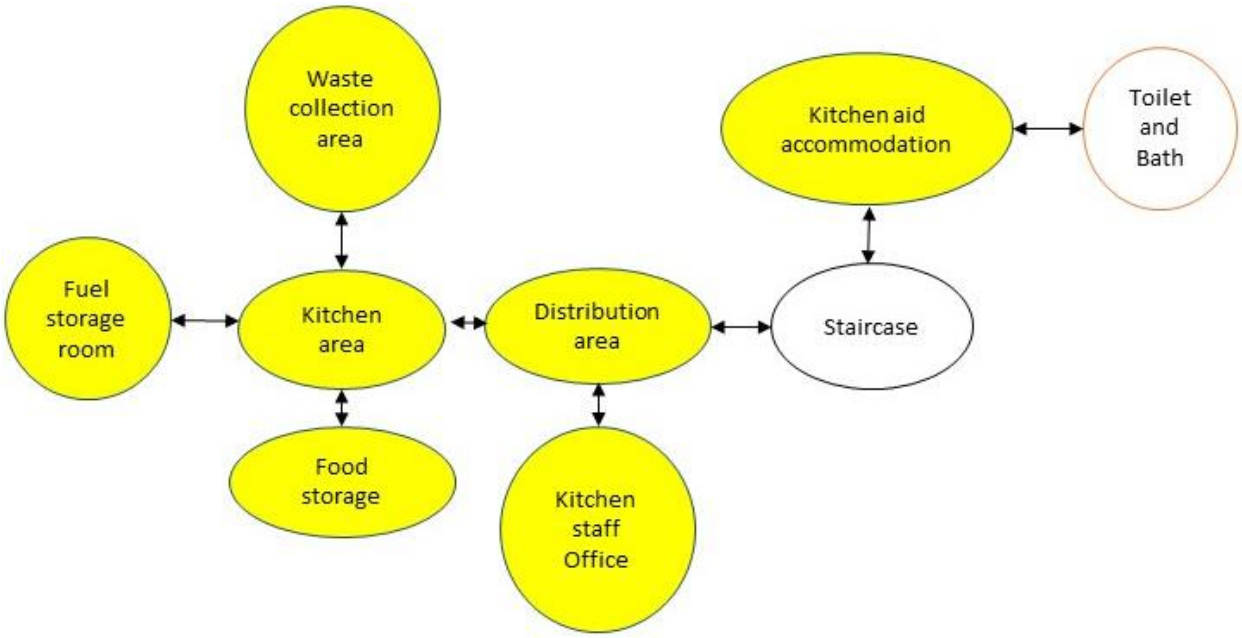


Figure 7: Example of a Bubble Diagram for a Large Facility – Food Services

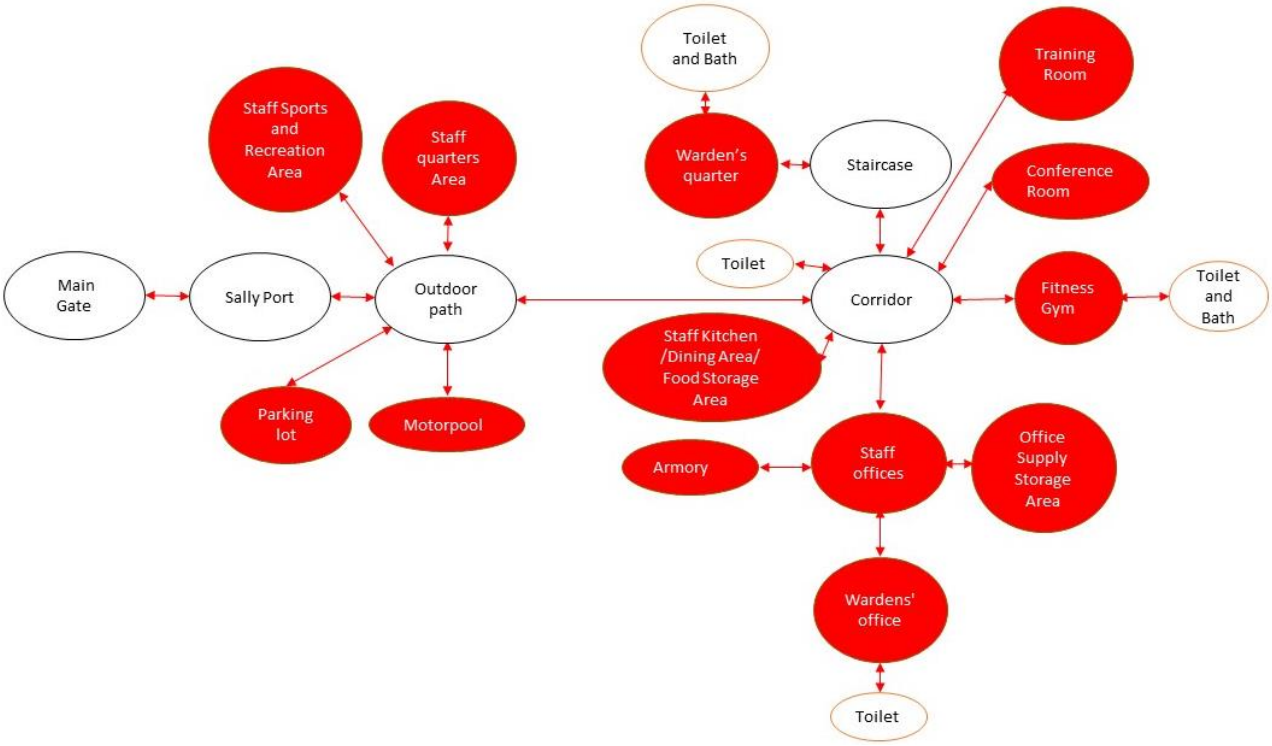


Figure 8: Example of a Bubble Diagram for a Large Facility - Administration

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
BJMP- Regional Office I

FEASIBILITY STUDY REPORT

[Project Name]

Location

Date

TABLE OF CONTENTS

SUMMARY 2
INTRODUCTION 4
RATIONALE OF THE FEASIBILITY STUDY 4
BACKGROUND 4
ASSESSMENT OF THE PROPOSED LOT 5
Size 5
Accessibility 5
Natural Environment 5
Essential Services 5
Social Environment 5
Proximity to Services and Other Institutions 6
Support from LGU and other stakeholders 6
CONCLUSION 6
ANNEXES 6

SUMMARY

This section shall include information for readers who may not want to read the entire document but who still need a summary of the proposal. Although this section appears first in the document, it is usually written last.

The summary should remain on a separate page and not exceed one page.

The summary should contain the conclusions for the following elements:

- Size
- Location
- Accessibility

INTRODUCTION

Introduce your current jail here:

Name / type	e.g.: Manila City Jail
Area Covered	e.g.: Manila City
Ideal Capacity	e.g.: 1200
Current Population	e.g.: Male 1350, Female: 256
Date	

This is reproduced / updated from the Jail Project Proposal

Rationale of the Feasibility Study

The Feasibility Study aims at estimating how much a proposed lot for the construction of a new jail of the extension of an existing one matches the vision defined in the Project Proposal and the requirements defined in the brief.

BACKGROUND

Capacity of the proposed jail **As defined in the Project proposal**	
Category of the proposed jail46	
Location (Barangay)	
Contacts (Barangay / LGU)	

Explain the type of donation agreement to be established between BJMP and the LGU (Usufruct or donation)

[46] A: below 100 PDL Capacity, B: 101-500 PDL Capacity, C: 501-1000 PDL Capacity, D: 1001-2000 PDL Capacity.

ASSESSMENT OF THE PROPOSED LOT

Size

Size in Ha	
Comment on suitability in terms of size including the expected height of the various buildings (in storey)	

Accessibility

Road conditions	
Public transport services	

Natural Environment

Soil structure	
Groundwater depth and quality[47]	
Distance to fault line[48]	
Risk assessment; vulnerability to floods, typhoons, storm surge or other calamities	

Essential Services

Water Networks (distance, type)	
Electricity Networks (distance to transformer)	
Communication (phone and internet)	

Social Environment

Security threat (external security threats like armed groups)	
Presence of informal settlers	
Protest groups	

[47] Consult Hydro-geological maps and/or relevant agencies.

[48] Consult map

Proximity to Services and Other Institutions

Courts	
Hospitals	
Friendly forces (BFP, PNP, AFP)	
Market	

Support from LGU and other stakeholders

CONCLUSION

Analysis of potential consequences of issues identified, especially considering:

- The size of the lot
- Its location
- Its accessibility

and possible remedies and alternatives.

ANNEXES

Maps

Etc.

PREPARED BY:

NAME (TWG SEC)
DESIGNATION

DATE:

CONFORMED/REVIEWED BY:

NAME (WARDEN)
DESIGNATION

APPROVED/DISAPPROVED:

NAME (RD)
DESIGNATION

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 Mindanao Avenue, Project 8, Quezon City
Trunklines: (+632) 927 - 6383; 453 - 1196
Email Adress: director@bjmp.gov.ph Website: www.bjmp.gov.ph

Feasibility Study Checklist

Assessment of the proposed lot/s

Elements to be assessed	Possible Sources of Data
<u>Real Property and Site Description</u> • Legal description (if available) – info such as shape and boundaries, geodetic surveys • Informal description (in the absence of legal) – street number and name or the distance from a certain landmark • Direction (using the internet such as google earth image) • Lot plan / Vicinity Map /Location Map • Size in sq. m. and/or hectares • Land Use • Milestones and Status of negotiation with LGU regarding acquisition of the lot • Demographics of the catchment area where the lot is situated (current population, growth). Double-check with the project proposal data • Analysis of the sufficiency of the size of the plot against the brief requirements particularly from the Space Matrix	• Survey Maps • Vicinity or Location Map • Lot Plan • Land Use Map • Land title • Sketch Plan • LGU Planning Office • Internet • Barangay Officials • Community • Proposed Jail's Construction Brief and Space Matrix • National Statistics Office
<u>Accessibility</u> • Means of transportation • Access roads / Routes • Easements / Setbacks • Rights-of-way • Describe road conditions • Analysis of the level of accessibility of the proposed lot and its consequences during construction and to the future jail's operations, if any. *Examples:* ○ *Higher construction costs* ○ *Less PDL family contact* ○ *Personnel will be affected, more absences and tardiness*	• Actual Site inspections and lot verification • Interviews from local officials and neighbors

○ *Request for the construction of the road from DPWH – entails coordination and administrative works* ○ List down proposed actions to mitigate the potential consequences of difficult access.	
Natural Environment • Soil structure • Groundwater depth and quality • Distance to a fault line • Disaster risk assessment; vulnerability to floods, typhoons, storm surge or other calamities • List down all risks due to identified natural environment conditions and corresponding proposed and/or required actions to mitigate risks	• Actual Site inspections • NAMRIA, PHILVOLCS, MGB, DOST, NDRRMC • Topograpic Map • Hydrogeological Maps • Geohazard Map
Essential Services • Water sources (distance, type) • Electricity networks • Communication (phone and internet connectivity) • Wastewater and drainage systems (sewers, canals/drainage lines) • List down all risks related to the lack or the absence of essential services and propose actions to mitigate them	• Actual Site inspections • Interviews from: ○ LGU authorities ○ Barangay officials ○ Utility companies and service providers
Social Environment • Security Conditions such as threats from the following: ○ Presence of armed groups ○ Presence of informal settler ○ Protest Groups ○ List down all risks related to social environment and propose actions to mitigate them	• Actual Site inspections • Interviews from: ○ LGU authorities ○ Barangay officials ○ Friendly Forces
Proximity to Services and Other Institutions • Courts • Hospital • Friendly Forces • Market • Other institutions deemed essential to BJMP, if any	• Actual Site inspections • Interviews from: ○ LGU authorities ○ Barangay officials

List down all risks related to the proposed site's distance to each institution and the corresponding required actions to mitigate them	
• In case there are several proposed lots to choose from, conduct an assessment of each location for every above-mentioned parameter • Rank the lots according to suitability. • In the event of not finding an acceptable location from available options, propose alternative locations together with the same assessment process done for all other options.	

SPACE MATRIX

Type A

ARCHITECTURAL PROGRAM									
XXXX JAIL									
{insert date}									
	FUNCTIONAL COMPONENTS								
COMMITMENT		**SIZE (m)**			**UNIT SIZE (sq m)**	**QTY**	**NET AREA (sq m)**	**REMARKS / COMMENTS**	
1.1	Holding Cell	10	x	10	100	1	100		
1.2	Reception / Counter / Processing Area		x						
1.5	Diagnostic Room / Body-Search / Orientation Area		x						
1.10	Post-holding Cell								
1.11	PCCU (PDL Classification Counseling Unit)								
1.12	Quarantine Room								
	Ordinary Toilet								
	PWD-accessible Toilet								
	Ordinary Toilet and Bath								
	PWD-accessible Toilet and Bath								
ACCOMMODATION									
2.1	Sleeping and Dining Area								
2.2	Cell Toilet and Bath								
2.3	Single-accommodation Cell								
2.4	Recreation Area								
VISITATION									
3.1	Visitors Holding area								
3.2	Visitors Processing Area								
3.3	Searching Area for Visitors								
3.4	Strip-searching Area								
3.5	Visitors Area for Contact Visit								
3.6	Visitors Area for Official Visit								
3.7	Commissary								
3.8	Teleconferencing Room (e-Dalaw)								
3.9	Conjugal Visit Room								
3.10	Visitors Area for Non-Contact Visit								
	Ordinary Toilet								
	PWD-accessible Toilet								
	Ordinary Toilet and Bath								
	PWD-accessible Toilet and Bath								

HEALTH SERVICES												
4.1	Patient Reception Area											
4.2	Consultation Room / Dental Office / Nurse Station / Equipment Area / Supply-Room / Pharmacy											
4.13	Isolation Cells for TB and MDR-TB											
4.14	Isolation Cells for Other Infectious Diseases											
4.15	Sputum Collection Area											
	Ordinary Toilet											
	PWD-accessible Toilet											
	Ordinary Toilet and Bath											
	PWD-accessible Toilet and Bath											
FOOD SERVICES												
5.1	Kitchen Area											
5.2	Food Distribution Area											
5.3	Food Storage Area											
5.4	Kitchen-waste Collection Area											
5.5	Fuel Storage Area											
5.6	Kitchen-staff Office											
5.8	Kitchen Water-storage											
	Ordinary Toilet											
	PWD-accessible Toilet											
DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES												
6.1	Outdoor Access											
6.2	Laundry Area											
6.3	Worship Area											
6.4	Training Room / ALS Room / Library											
6.9	Livelihood Area											
	Ordinary Toilet											
	PWD-accessible Toilet											

ADMINISTRATION												
7.1	Warden's Quarter											
7.2	Warden's Office											
7.3	Staff Quarters											
7.4	Staff Offices											
7.5	Office Supply Storage Area											
7.6	Armory											
7.7	Conference Room / Staff Training Room											
7.10	Staff Kitchen/Dining Room/Food Storage area											
7.11	Fitness Room											
7.13	Parking Lot											
	Ordinary Toilet											
	PWD-accessible Toilet											
	Ordinary Toilet and Bath											
	PWD-accessible Toilet and Bath											
SECURITY												
8.1	Command Control											
8.2	Guard House											
8.3	Sally Port											
8.4	Guard Tower											
8.5	Dogwalk											
	Ordinary Toilet											
	PWD-accessible Toilet											
ESSENTIAL SERVICES												
9.1	Power room											
SOLID WASTE MANAGEMENT												
10.1	Garbage collection area											

Type B

ARCHITECTURAL PROGRAM								
XXXX JAIL								
{insert date}								
	FUNCTIONAL COMPONENTS							
COMMITMENT		**SIZE (m)**			**UNIT SIZE (sq m)**	**QTY**	**NET AREA (sq m)**	**REMARKS / COMMENTS**
1.1	Holding Cell	10	x	10	100	1	100	
1.2	Reception / Counter / Processing Area		x					
1.6	Diagnostic Room / Body-Search Area							
1.9	Orientation Room							
1.10	Post-holding Cell							
1.11	PCCU (PDL Classification Counseling Unit)							
1.12	Quarantine Room							
	Ordinary Toilet							
	PWD-accessible Toilet							
	Ordinary Toilet and Bath							
	PWD-accessible Toilet and Bath							
ACCOMMODATION								
2.1	Sleeping and Dining Area							
2.2	Cell Toilet and Bath							
2.3	Single-accommodation Cell							
2.4	Recreation Area							
VISITATION								
3.1	Visitors Holding area							
3.2	Visitors Processing Area							
3.3	Searching Area for Visitors							
3.4	Strip-searching Area							
3.5	Visitors Area for Contact Visit							
3.6	Visitors Area for Official Visit							
3.7	Commissary							
3.8	Teleconferencing Room (e-Dalaw)							
3.9	Conjugal Visit Room							
3.10	Visitors Area for Non-Contact Visit							
	Ordinary Toilet							
	PWD-accessible Toilet							
	Ordinary Toilet and Bath							
	PWD-accessible Toilet and Bath							

HEALTH SERVICES												
4.1	Patient Reception Area											
4.3	Consultation Room / Nurse Station / Health Staff Office											
4.7	Dental Office / Maternal / Pre-natal Care Area											
4.10	Equipment Area / Supply Room / Pharmacy											
4.13	Isolation Cells for TB and MDR-TB											
4.14	Isolation Cells for Other Infectious Diseases											
4.15	Sputum Collection Area											
	Ordinary Toilet											
	PWD-accessible Toilet											
	Ordinary Toilet and Bath											
	PWD-accessible Toilet and Bath											
FOOD SERVICES												
5.1	Kitchen Area											
5.2	Food Distribution Area											
5.3	Food Storage Area											
5.4	Kitchen-waste Collection Area											
5.5	Fuel Storage Area											
5.6	Kitchen-staff Office											
5.8	Kitchen Water-storage											
	Ordinary Toilet											
	PWD-accessible Toilet											
DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES												
6.1	Outdoor Access											
6.2	Laundry Area											
6.3	Worship Area											
6.4	Training Room / ALS Room / Library											
6.9	Livelihood Area											
	Ordinary Toilet											
	PWD-accessible Toilet											

ADMINISTRATION												
7.1	Warden's Quarter											
7.2	Warden's Office											
7.3	Staff Quarters											
7.4	Staff Offices											
7.5	Office Supply Storage Area											
7.6	Armory											
7.7	Conference Room / Staff Training Room											
7.10	Staff Kitchen/Dining Room/Food Storage area											
7.11	Fitness Room											
7.13	Parking Lot											
7.14	Motor pool											
	Ordinary Toilet											
	PWD-accessible Toilet											
	Ordinary Toilet and Bath											
	PWD-accessible Toilet and Bath											
SECURITY												
8.1	Command Control											
8.2	Guard House											
8.3	Sally Port											
8.4	Guard Tower											
8.5	Dogwalk											
	Ordinary Toilet											
	PWD-accessible Toilet											
ESSENTIAL SERVICES												
9.1	Power room											
SOLID WASTE MANAGEMENT												
10.1	Garbage collection area											

Type C

ARCHITECTURAL PROGRAM

XXXX JAIL

{insert date}

FUNCTIONAL COMPONENTS

	COMMITMENT	SIZE (m)			UNIT SIZE (sq m)	QTY	NET AREA (sq m)	REMARKS / COMMENTS
1.1	Holding Cell	10	x	10	100	1	100	
1.3	Reception / Counter Area		x					
1.4	Processing Area / Desk Photo-Booth							
1.7	Body-search Area							
1.8	Diagnostic Room							
1.9	Orientation Room							
1.10	Post-holding Cell							
1.11	PCCU (PDL Classification Counseling Unit)							
1.12	Quarantine Room							
	Ordinary Toilet							
	PWD-accessible Toilet							
	Ordinary Toilet and Bath							
	PWD-accessible Toilet and Bath							
ACCOMMODATION								
2.1	Sleeping and Dining Area							
2.2	Cell Toilet and Bath							
2.3	Single-accommodation Cell							
2.4	Recreation Area							
VISITATION								
3.1	Visitors Holding area							
3.2	Visitors Processing Area							
3.3	Searching Area for Visitors							
3.4	Strip-searching Area							
3.5	Visitors Area for Contact Visit							
3.6	Visitors Area for Official Visit							
3.7	Commissary							
3.8	Teleconferencing Room (e-Dalaw)							
3.9	Conjugal Visit Room							
3.10	Visitors Area for Non-Contact Visit							
	Ordinary Toilet							
	PWD-accessible Toilet							
	Ordinary Toilet and Bath							
	PWD-accessible Toilet and Bath							

HEALTH SERVICES													
4.1	Patient Reception Area												
4.4	Consultation Room												
4.5	Nurse Station												
4.6	Health Staff Office												
4.8	Dental Office												
4.9	Maternal / Pre-natal Care Area												
4.10	Equipment Area / Supply Room / Pharmacy												
4.13	Isolation Cells for TB and MDR-TB												
4.14	Isolation Cells for Other Infectious Diseases												
4.15	Sputum Collection Area												
4.16	Patients' Ward												
4.17	Laboratory												
4.18	Medical Imaging, X-Ray												
4.19	Temporary Observation Ward												
	Ordinary Toilet												
	PWD-accessible Toilet												
	Ordinary Toilet and Bath												
	PWD-accessible Toilet and Bath												
FOOD SERVICES													
5.1	Kitchen Area												
5.2	Food Distribution Area												
5.3	Food Storage Area												
5.4	Kitchen-waste Collection Area												
5.5	Fuel Storage Area												
5.6	Kitchen-staff Office												
5.7	Kitchen-aide Cell												
5.8	Kitchen Water-storage												
	Ordinary Toilet												
	PWD-accessible Toilet												
DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES													
6.1	Outdoor Access												
6.2	Laundry Area												
6.3	Worship Area												
6.5	Training Room												
6.6	ALS Room/Library												
6.9	Livelihood Area												
	Ordinary Toilet												
	PWD-accessible Toilet												

ADMINISTRATION													
7.1	Warden's Quarter												
7.2	Warden's Office												
7.3	Staff Quarters												
7.4	Staff Offices												
7.5	Office Supply Storage Area												
7.6	Armory												
7.8	Conference Room												
7.9	Staff Training Room												
7.10	Staff Kitchen/Dining Room/Food Storage area												
7.12	Staff Sports and Recreational Area												
7.13	Parking Lot												
7.14	Motor pool												
	Ordinary Toilet												
	PWD-accessible Toilet												
	Ordinary Toilet and Bath												
	PWD-accessible Toilet and Bath												
SECURITY													
8.1	Command Control												
8.2	Guard House												
8.3	Sally Port												
8.4	Guard Tower												
8.5	Dogwalk												
	Ordinary Toilet												
	PWD-accessible Toilet												
ESSENTIAL SERVICES													
9.1	Power room												
SOLID WASTE MANAGEMENT													
10.1	Garbage collection area												

Type D

ARCHITECTURAL PROGRAM								
XXXX JAIL								
{insert date}								
	FUNCTIONAL COMPONENTS							
COMMITMENT		SIZE (m)			UNIT SIZE (sq m)	QTY	NET AREA (sq m)	REMARKS / COMMENTS
1.1	Holding Cell	10	x	10	100	1	100	
1.3	Reception / Counter Area		x					
1.4	Processing Area / Desk Photo-Booth							
1.7	Body-search Area							
1.8	Diagnostic Room							
1.9	Orientation Room							
1.10	Post-holding Cell							
1.11	PCCU (PDL Classification Counseling Unit)							
1.12	Quarantine Room							
	Ordinary Toilet							
	PWD-accessible Toilet							
	Ordinary Toilet and Bath							
	PWD-accessible Toilet and Bath							
ACCOMMODATION								
2.1	Sleeping and Dining Area							
2.2	Cell Toilet and Bath							
2.3	Single-accommodation Cell							
2.4	Recreation Area							
VISITATION								
3.1	Visitors Holding area							
3.2	Visitors Processing Area							
3.3	Searching Area for Visitors							
3.4	Strip-searching Area							
3.5	Visitors Area for Contact Visit							
3.6	Visitors Area for Official Visit							
3.7	Commissary							
3.8	Teleconferencing Room (e-Dalaw)							
3.9	Conjugal Visit Room							
3.10	Visitors Area for Non-Contact Visit							
	Ordinary Toilet							
	PWD-accessible Toilet							
	Ordinary Toilet and Bath							
	PWD-accessible Toilet and Bath							

HEALTH SERVICES												
4.1	Patient Reception Area											
4.4	Consultation Room											
4.5	Nurse Station											
4.6	Health Staff Office											
4.8	Dental Office											
4.9	Maternal / Pre-natal Care Area											
4.11	Equipment Area											
4.12	Supply Room / Pharmacy											
4.13	Isolation Cells for TB and MDR-TB											
4.14	Isolation Cells for Other Infectious Diseases											
4.15	Sputum Collection Area											
4.16	Patients' Ward											
4.17	Laboratory											
4.18	Medical Imaging, X-Ray											
4.19	Temporary Observation Ward											
	Ordinary Toilet											
	PWD-accessible Toilet											
	Ordinary Toilet and Bath											
	PWD-accessible Toilet and Bath											
FOOD SERVICES												
5.1	Kitchen Area											
5.2	Food Distribution Area											
5.3	Food Storage Area											
5.4	Kitchen-waste Collection Area											
5.5	Fuel Storage Area											
5.6	Kitchen-staff Office											
5.7	Kitchen-aide Cell											
5.8	Kitchen Water-storage											
	Ordinary Toilet											
	PWD-accessible Toilet											
DEVELOPMENT PROGRAMS AND LIVELIHOOD ACTIVITIES												
6.1	Outdoor Access											
6.2	Laundry Area											
6.3	Worship Area											
6.5	Training Room											
6.7	ALS Room											
6.8	Library											
6.9	Livelihood Area											
	Ordinary Toilet											
	PWD-accessible Toilet											

ADMINISTRATION												
7.1	Warden's Quarter											
7.2	Warden's Office											
7.3	Staff Quarters											
7.4	Staff Offices											
7.5	Office Supply Storage Area											
7.6	Armory											
7.8	Conference Room											
7.9	Staff Training Room											
7.10	Staff Kitchen/Dining Room/Food Storage area											
7.12	Staff Sports and Recreational Area											
7.13	Parking Lot											
7.14	Motor pool											
	Ordinary Toilet											
	PWD-accessible Toilet											
	Ordinary Toilet and Bath											
	PWD-accessible Toilet and Bath											
SECURITY												
8.1	Command Control											
8.2	Guard House											
8.3	Sally Port											
8.4	Guard Tower											
8.5	Dogwalk											
	Ordinary Toilet											
	PWD-accessible Toilet											
ESSENTIAL SERVICES												
9.1	Power room											
SOLID WASTE MANAGEMENT												
10.1	Garbage collection area											

PICTURES TAKEN DURING THE WORKSHOPS






















Why do we need design standards ?




Objective:
Establish detailed guide to designers regarding construction of jail facilities coinciding Philippine jail setting.
Assist the Regional Engineers in coming up with +/- 80% project costing











LETTER ORDERS

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 BJMP Building, Mindanao Avenue, Project 8, Quezon City
Trunklines: (+632) 927-6383; 927-5877
Email Address: director@bjmp.gov.ph Website: www.bjmp.gov.ph

BJMPDPRM-
LETTER ORDERS
NUMBER **2017-1539**

30 October 2017

1. The following-named personnel are hereby directed to attend the *Jail Planning and Design Workshop* at CIRQUE Service Residences, Circulo Verde, # 70 Calle Industria, Brgy. Bagumbayan, Quezon City on **08-09 November 2017,** to wit:

JCSUPT IGNACIO S PANTI	- NHQ
JSSUPT PAULINO H MORENO JR	- NHQ
JSSUPT EDWIN B RIEL	- NHQ
JSSUPT ARNOLD F BUENACOSA	- NHQ
JSSUPT LUISITO C MUÑOZ	- NHQ
JSUPT JOHNSON M CALUB	- NHQ
JSUPT MA ANNIE A ESPINOSA	- NHQ
JSUPT RANDELL H LATOZA	- NCR
JSUPT ELENA B ROCAMORA	- NCR
JCINSP RICKY HEART L PEGALAN	- NCR
JSINSP ALBERTO M MARIANO	- NHQ
JSINSP JOHN PAUL DG BORLOGAN, MD	- NHQ
JSINSP MARK SYLVESTER C TAN	- R-IVA
JSINSP JESUS DM MANGUIAT	- R-IVA
JSINSP PRUDENCIO B DULNUAN JR	- R-III
JINSP JIMLANI J SAMPANG	- NHQ
JINSP WILLIAM MARC BENEDICK F TALLUNGAN	- NHQ
JINSP ROGELIO L ALIP	- R-III
JINSP ALI P MACATANONG	- ARMM
JINSP EDILBERTO L TUMOLVA	- R-IVA
JINSP JOHNY RAYMUNDO	- NCR
JINSP CECILIA T PANGILINAN	- NCR
JO2 Alicon M Dimala	- ARMM
JO1 John Edward R Delliro	- MIMAROPA
JO1 Nover L Casareno	- NHQ
Mr. Marcos B Villalon	- NHQ
Ms. Marie Louise E Engracial	- NHQ

BY AUTHORITY OF THE CHIEF, BJMP:

RUEL SILVA RIVERA
Jail Chief Superintendent
Chief of Directorial Staff of
the Jail Bureau

OFFICIAL:

PAULINO H MORENO JR
Jail Senior Superintendent
Director for Personnel
and Records Management

DISTRIBUTION:
"C"

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 Mindanao Avenue, Quezon City
Trunklines: (+632) 927-6383; 927-5505
Email Address: itu@bjmp.gov.ph Website: www.bjmp.gov.ph

BJMPDPRM-
LETTER ORDERS
NUMBER **2018-017**

09 January 2018

1. The following-named personnel are hereby directed to attend the *Seminar/Workshop 2 for the Inmates Classisfications and Capacity: A Guide for Jail Design* at B Hotel Tent, No. 14 Scout Rallos Street, Brgy. Laging Handa, Quezon City on **Thursday, 18 January 2018**, to wit:

JCSUPT IGNACIO S PANTI	- NHQ
JSUPT MA ANNIE A ESPINOSA	- NHQ
JSUPT RUFINO SANTIAGO JR	- NHQ
JSUPT RANDEL H LATOZA	- NCR
JSUPT ELENA B ROCAMORA	- NHQ
JCINSP RICKY HEART L PEGALAN	- NCR
JCINSP MARIA IGNACIA MONTERON	- NCR
JCINSP LLOYD GONZAGA	- NCR
JSINSP JOHN PAUL DG BORLONGAN, MD	- NHQ
JSINSP ALBERTO M MARIANO	- NHQ
JSINSP JAYREX JOSEPH BUSTINERA	- NCR
JINSP JIMLANI J SAMPANG	- NHQ
JINSP WILLIAM MARC BENEDICK F TALLUNGAN	- NHQ
SJO4 Angelina V Ibañez	- NCR
SJO2 Felix Marcos Jr	- NCR
JO2 Zandro Jhun B Fernando	- NHQ
JO1 Allan Christian C Benitez	- NHQ
Mr. Marcos B Villalon	- NHQ

BY AUTHORITY OF THE CHIEF, BJMP:

RUEL SILVA RIVERA
Jail Chief Superintendent
Chief of Directorial Staff of
the Jail Bureau

OFFICIAL:

PAULINO T MORENO JR
Jail Chief Superintendent
Director for Personnel
and Records Managementd

DISTRIBUTION:
"C"

"Changing Lives, Building a Safer Nation"

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 BJMP Building, Mindanao Avenue, Project 8, Quezon City
Trunklines: (+632) 927-5505, 453-1196
Email Address: [illegible] Website: [illegible]

BJMPDPRM-
LETTER ORDERS
NUMBER **2018-145**

14 February 2018

1. The Deputy Chief for Operations of the Jail Bureau, **JCSUPT IGNACIO S PANTI**, together with the following-named personnel, are hereby directed to attend the *Seminar/Workshop 3 for A Guide for Jail Facility Design (Accomodation, Security, and Commitment)* at B Hotel, 14 Scout Rallos Street, Brgy. Laging Handa, Quezon City on **21-22 February 2018**, to wit:

JSSUPT MA ANNIE A ESPINOSA	
JSUPT RANDEL H LATOZA	
JSUPT JUN MELCHOR O BOADILLA	
JCINSP RICKY HEART L PEGALAN	
JCINSP JOHN CONRAD MARCELINO L BASILIO	
JCINSP CHRISTOPHER R PENILLA	- R-IVA
JSINSP NOLITO C ROMERO	- R-V
JSINSP JOHN PAUL DG BORLONGAN, MD	
JSINSP ALBERTO M MARIANO	
JINSP JIMLANI J SAMPANG	
JINSP WILLIAM MARC BENEDICK F TALLUNGAN	
JINSP ROGELIO L ALIP	- R-III
JINSP EDILBERTO TUMOLVA	- R-IVA
JINSP JAYSON NECIO	- R-V
JO1 Kristan Joy L Taruma	
JO1 Flaviano A Panaga Jr	
JO1 Christian Benitez	
JO1 Nover L Casareno	
Mr. Marcos B Villalon	

Attire: *JOR* - *Bush Coat*
JNOR - *GOA*
Time: *0800H-1700H*

BY AUTHORITY OF THE CHIEF, BJMP:

RUEL SILVA RIVERA
Jail Chief Superintendent
Chief of Directorial Staff of
the Jail Bureau

OFFICIAL:

PAUL [illegible] MORENO JR
Jail Chief Superintendent
Director for Personnel and
Records Management

DISTRIBUTION:
"C"

"Changing Lives, Building a Safer Nation"

PRM 18 0303

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 Mindanao Avenue, Project 8, Quezon City
Trunklines: (+632) 927-6383; 453-1196
Email Address: director@bjmp.gov.ph Website: www.bjmp.gov.ph

BJMPDPRM-
LETTER ORDERS
NUMBER **2018-302**

19 March 2018

1. The following-named personnel are hereby directed to attend the *Seminar/Workshop 4 for A Guide for Jail Facility Design (Activities and Outdoor Access, Health Facilities)* at B Hotel, No. 14 Scout Rallos Street, Brgy. Laging Handa, Quezon City on **22-23 March 2018**, to wit:

JCSUPT IGNACIO S PANTI	-	NHQ
JSUPT MA ANNIE A ESPINOSA	-	NHQ
JSUPT RANDEL H LATOZA	-	NCR
JSUPT JUN MELCHOR O BOADILLA	-	NCR
JCINSP JOHN CONRAD MARCELINO L BASILIO	-	NCR
JCINSP RICKY HEART L PEGALAN	-	NCR
JCINSP MARIA JOYCE E LUYAO	-	NCR
JCINSP CHRISTOPHER R PENILLA	-	R-IVA
JSINSP ROGELIO L ALIP	-	R-III
JSINSP ALBERTO M MARIANO	-	NHQ
JSINSP JOHN PAUL DG BORLONGAN, MD	-	NHQ
JINSP JIMLANI J SAMPANG	-	NHQ
JINSP WILLIAM MARC BENEDICK F TALLUNGAN	-	NHQ
SJO4 Melanie A Garcia	-	NCR
SJO4 Angelina V Ibanez	-	NCR
JO3 Emerald C Hombrebueno	-	NHQ
JO1 Nover L Casareno	-	NHQ
JO1 Allan Christian Benitez	-	NHQ
Mr. Marcos B Villalon	-	NHQ

Attire: JOR (Bush Coat)
JNOR (GOA)

2. Per diems, transportation and other incidental expenses are hereby authorized. Submit report and other pertinent documents (such as: travel orders, bus ticket, boarding passes, certificate of appearance, receipts, etc.) after completion of mission in accordance with existing COA and accounting rules and regulations.

BY AUTHORITY OF THE CHIEF, BJMP:

RUEL SILVA RIVERA
Jail Chief Superintendent
Chief of Directorial Staff of
the Jail Bureau

OFFICIAL:

PAULINO H MORENO JR
Jail Chief Superintendent
Director for Personnel
and Records Managementd

DISTRIBUTION:
"C"

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 Mindanao Avénue, Project 8, Quezon City
Trunklines: (+632) 927-5147; 456-1922
Email Address: chiefbjmp@gmail.com Website: www.bjmp.gov.ph

BJMPDPRM-
LETTER ORDERS
NUMBER **2018-394**

13 April 2018

1. The following-named personnel are hereby directed to attend the *Seminar/Workshop 5 for A Guide for Jail Facility Design (Food Services and Administration)* at B Hotel, 14 Scout Rallos Street, Brgy. Laging Handa, Quezon City on **23-25 April 2018**, to wit:

JCSUPT IGNACIO S PANTI	NHQ	JSINSP NOLITO C ROMERO	R-V
JSSUPT MA ANNIE A ESPINOSA	NHQ	JINSP JIMLANI J SAMPANG	NHQ
JSUPT RANDEL H LATOZA	NCR	JINSP ROGELIO L ALIP	R-III
JSUPT MARIE ROSE J LAGUYO	NCR	JINSP WILLIAM MARC BENEDICK F TALLUNGAN	NHQ
JCINSP ELIZABETH A GARCERON	R-IVA	SJO1 Mary Ann B Galapate	NCR
JCINSP JOHN CONRAD MARCELINO L BASILIO	NCR	SJO1 Pamela B Dela Torre	NCR
JCINSP MARIA JOYCE E LUYAO	NCR	JO2 Editha D Lazaro	NCR
JCINSP RICKY HEART L PEGALAN	NCR	JO1 Allan Christian C Benitez	NHQ
JSINSP ALBERTO M MARIANO	NHQ	Mr. Marcos B Villalon	NHQ

2. Per diems, transportation and other incidental expenses are hereby authorized for participants outside NCR. Submit report and other pertinent documents (such as: travel orders, bus ticket, boarding passes, certificate of appearance, receipts, etc.) after completion of mission in accordance with existing COA and accounting rules and regulations.

BY AUTHORITY OF THE CHIEF, BJMP:

RUEL SILVA RIVERA
Jail Chief Superintendent
Chief of Directorial Staff of
the Jail Bureau

OFFICIAL:

PAULINO H MORENO JR
Jail Chief Superintendent
Director for Personnel and
Records Management

DISTRIBUTION:
"C"

"Changing Lives, Building A Safer Nation"

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 BJMP Building, Mindanao Avenue, Project 8, Quezon City
Trunklines: (+632) 927-5505, 453-1196
Email Address: [illegible] Website: [illegible]

BJMPDPRM-
LETTER ORDERS
NUMBER **2018-793**

12 July 2018

1. The following-named personnel are hereby directed to attend the *Seminar/Workshop on Jail Planning and Design (Phase 2)* at B Hotel, No. 14 Scout Rallos Street, Brgy. Laging Handa, Quezon City on **17-19 July 2018**, to wit:

JCSUPT RUEL S RIVERA
JSSUPT MA ANNIE A ESPINOSA
JSUPT RANDEL H LATOZA
JSUPT DEOGRACIAS DE CASTILLO
JCINSP MIGUEL D LANGCAUON
JCINSP CRISTINA PERALTA-CASTILLO
JCINSP RUDILYN B SINOY
JCINSP NEVA RENCHIE DC SALLE
JSINSP ALBERTO M MARIANO
JSINSP NOLITO C ROMERO
JSINSP MARJORIE TECHIE C ORLAIN
JSINSP CRYSTALENE A GONZALES
JSINSP JEZA MAE SARAH C SANCHEZ
JSINSP PRUDENCIO B DULNUAN
JINSP ROGELIO L ALIP
JINSP PRINCESS DG MIGUEL
JO1 Flaviano A Panaga Jr
JO1 Allan Christian Benitez
Mr. Marcos B Villalon
Ms. Marilou C Sanchez

Attire: JOR (Bush Coat)
JNOR (GOA)
NUP (Uniform of the day)

BY AUTHORITY OF THE CHIEF, BJMP:

DENNIS U ROCAMORA, CESE
Jail Chief Superintendent
Officer-in-Charge, Office of the
Chief of Directorial Staff of
the Jail Bureau

OFFICIAL:

PAULINO H MORENO JR
Jail Chief Superintendent
Director for Personnel and
Records Management

DISTRIBUTION:
"C"

"Changing Lives, Building a Safer Nation"

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 Mindanao Avenue, Quezon City
Trunklines: (+632) 927-6383, 927-5505
Email Address: itu@bjmp.gov.ph Website: www.bjmp.gov.ph

BJMPDPRM-
LETTER ORDERS
NUMBER **2018-932**
(Corrected Copy Destroy All Others)

10 August 2018

1. The following-named personnel are hereby directed to attend the *Procedures for Planning of Jail Infrastructures - Wokshop 2 on Feasibility Study* at the B Hotel, No. 14 Scout Rallos Street, Brgy Laging Handa, Quezon City on **15 & 16 August 2018**, to wit:

JCSUPT RUEL S RIVERA	
JSSUPT MA ANNIE A ESPINOSA	
JSUPT RANDEL H LATOZA	NCR
JSUPT ELIZABETH A GARCERON	R-IVA
JCINSP ALBERTO M MARIANO	
JCINSP REYNALDO A PAGUIRIGAN JR	R-IVA
JCINSP NEVA RENCHIE DC SALLE	R-IVA
JCINSP CRISTINA P CASTILLO	R III
JSINSP JOHN PAUL DG BORLONGAN, MD	
JSINSP CRYSTALENE A GONZALES	NCR
JSINSP MARJORY TECHIE C ORLAIN	R-V
JSINSP PRUDENCIO B DULNUAN JR	R-III
JINSP ROGELIO L ALIP	R-III
JINSP CORAZON G PAYUMO	R-III
JINSP PRINCESS D MIGUEL	
JO1 Allan Christian C Benitez	
JO1 Flaviano A Panaga Jr	
Mr Marcos B Villalon	
Ms. Marilou C Sanchez	

Attire: *JOR* - *Bush Coat*
JNOR - *GOA*
NUP - *Uniform of the day*

Workshop will start at exactly 0800H

2. Per diems, transportation and other incidental expenses are hereby authorized. Submit report and other pertinent documents (such as: travel orders, bus ticket, boarding passes, certificate of appearance, receipts, etc.) after completion of mission in accordance with existing COA and accounting rules and regulations.

BY AUTHORITY OF THE CHIEF, BJMP:

DENNIS U ROCAMORA, CESE
Jail Chief Superintendent
Officer-in-Charge, Office of the
Chief of Directorial Staff of
the Jail Bureau

OFFICIAL:

PAULINO H MORENO JR
Jail Chief Superintendent
Director for Personnel and
Records Management

DISTRIBUTION:
"C"

"Changing Lives, Building a Safer Nation"

CORRESPONDENCE WITH UNITED ARCHITECTS OF THE PHILIPPINES

DL COPY

Republic of the Philippines
DEPARTMENT OF THE INTERIOR AND LOCAL GOVERNMENT
BUREAU OF JAIL MANAGEMENT AND PENOLOGY
NATIONAL HEADQUARTERS
144 Mindanao Avenue, Quezon City
Trunklines: (+632) 927-6383; 927-5505
Email Address: itu@bjmp.gov.ph Website: www.bjmp.gov.ph

August 17, 2018

ARCH. BENJAMIN K. PANGANIBAN, JR.
National President, United Architects of the Philippines
53 Scout Rallos St., Brgy Laging Handa, Diliman,
Quezon City

Dear ***Arch. Panganiban***:

Greeting in God's name!

The Bureau of Jail Management and Penology (BJMP), a line agency of the Department of the Interior and Local Government (DILG), is currently establishing its design standards pertaining to construction of jail facilities which will be the major reference of our architects and engineers in coming up with the design concept of our jails nationwide.

We believe that one of the objectives of the United Architects of the Philippines (UAP) is to cooperate and coordinate with other local and international organizations in the field of architecture, environmental designs and science and technology to ensure participation of global concerns. It is in this context that the BJMP is respectfully requesting your organization to spare some time in reviewing the standards set by the agency as there might be areas or components that are not in accord with Architectural Codes or other Building Codes in the Philippines. May we also request the good Architect or any representative of the UAP, to conduct a jail facility visit together with our engineers within Metro Manila to obtain a clearer view of the actual situation of the BJMP facilities to enhance whatever recommendations the organization may provide.

Engr. Alberto M. Mariano of the Directorate for Logistics, with contact numbers (02) 927-6383 loc. 202 and CP No. 09172756532 and/or email address at bjmp.logistics@gmail.com, will be very much willing to have some discussions with you to further enlighten you regarding this request.

Thank you very much and more power!

Very truly yours,

DEOGRACIAS C. TAPAYAN, CESE
Jail Director IV
Chief, BJMP

OFFICE OF THE CHIEF, BJMP
IN REPLYING, PLS CITE:
BJMP18-102919

NATIONAL BOARD OF DIRECTORS
FISCAL YEAR 2018-2019

EXECUTIVE COMMITTEE

BENJAMIN K. PANGANIBAN, JR., FUAP, AA, APEC AR, FRIA
National President

REY S. GABITAN, UAP, PIEP
National Executive Vice President

ROSARIO QUIAMBAO-ROXAS, FUAP
Vice President, Area A

CHONA ELVAS-PONCE, Ph.D., FUAP, CBP
Vice President, Area B

ROLANDO V. IGNACIO, UAP
Vice President, Area C

TRINIDAD G. SALIGUMBA, UAP
Vice President, Area D

RONNIE R. YUMANG, UAP, PIEP, AA
Secretary General

WILFREDO G. GACUTAN, FUAP
National Treasurer

ROLAN PAOLO L. ALBERTO, UAP
National Auditor

RICHARD M. GARCIA, FUAP, PALA, AA
Chancellor, College of Fellows

GUILLERMO H. HISANCHA, FUAP, APEC AR, AA, DFRIA
Immediate Past National President

REGIONAL DISTRICT DIRECTORS

ALAN L. CHAN, UAP
District Director, A1a

CARLOS R. SALVADOR, JR., UAP
District Director, A1b

EDMUNDO R. DE GUZMAN, UAP
District Director, A2a

RAYMOND T. CO, UAP
District Director, A2b

MELBA T. BENAVIDES, UAP
District Director, A3

GLENN J. OPENIANO, UAP, PIEP
District Director, A4

MARIA CARMEN SALES-YATCO, UAP
District Director, A5

ANDREW M. DOMINGO, UAP
District Director, B1

EDGAR S. CALMA, FUAP
District Director, B2

DELANO M. MARZO, UAP
District Director, B3

DENNIS LEO D. DE BELEN, UAP
District Director, B4

ELMER CEZAR A. ZALETA, UAP
District Director, B5

DENNIS BERNARDO, UAP
District Director, C1

FRANCIS J. DELOS REYES, UAP
District Director, C2

MARK SHERWIN C. BUENAVENTURA, UAP
District Director, C3

ROSA LEA VIRGULA-AJESTA, UAP
District Director, C4

MARY JOYCE T. TELIN, UAP
District Director, D1

ILDEFONSO F. TORRES, JR., UAP
District Director, D2

ALBERT S. ROSEL, UAP
District Director, D3

ANACLETO Y. TAMOSO, UAP
District Director, D4

EXECUTIVE DIRECTORS

RENATO A. HERAY, FUAP, AA, PALA, FRIA
Commission on Professional Practice

VIRGILIO D. ANDRES JR., FUAP
Professional Development Commission

JONATHAN V. MANALAD, Ph.D., UAP, PIEP
Commission on Education

CORAZON FABIA-TANDOC, FUAP, AA
Commission on Internal Affairs

GIL V. JAPITANA, UAP
Commission on Governmental and External Affairs

ROBERT BENEDICT C. HERMOSO, FUAP
Sentro ng Arkitekturang Filipino

ANTONIO A. VALDEZ, FUAP
Commission on Convention, Assemblies & Exhibits

UNITED ARCHITECTS OF THE PHILIPPINES
The Integrated and Accredited Professional Organization of Architects (IAPOA)

Our Reference: NP/Letter/2018-342
24 October 2018

JAIL DIRECTOR DEOGRACIAS C. TAPAYAN, CESE
Chief, Bureau of Jail Management and Penology

Dear **Sir,**

Greetings from the United Architects of the Philippines!

With reference to our meeting held on September 6, 2018 with our Bayanihan Arkitektura Committee, we are pleased to provide you with this communication the report prepared by Arch. Rene Richie Corcuera, Chairman of Bayanihan Arkitektura Committee for information, guidance, and reference of your good office.

Should you have any questions or require further assistance, please feel free to reach the undersigned through our UAP National Secretariat at email: uap@united-architects.org or landline number: +632.888.9266 loc 1512/1510.

Thank you and warm regards.

Respectfully yours,

ARCH. BENJAMIN K. PANGANIBAN, JR., FUAP, AA, APEC ARCH., FRIA
National President, FY 2018-2019
United Architects of the Philippines

UNITY. ABILITY. CONTINUITY OF SERVICE
7-Time PRC's Outstanding Accredited Professional Organization of the Year
(2002, 2007, 2008, 2011, 2014, 2017, 2018)
First-ever recipient of DTI-CIAP's Outstanding Accredited Professional Organization (2017)
2009 Father Neri Satur Award for Environmental Heroism

UNION INTERNATIONALE DES ARCHITECTES · ARCHITECTS REGIONAL COUNCIL ASIA · EASTERN REGIONAL ORGANIZATION FOR PLANNING & HOUSING · ASIA-PACIFIC ECONOMIC COOPERATION

UAP CHAPTERS - AREA A (District A1a) PANGASINAN-DAGUPAN, BAGUIO, ILOCOS-CIUDAD FERNANDINA, LA UNION, ILOCOS NORTE-LAOAG CITY, SUMMER CAPITAL, PANGASINAN SCALE, YLOCOS VIGAN, LA UNION-AGUILA, CORDILLERA • (District A1b) CAGAYAN VALLEY, ISABELA SIERRA MADRE, NUEVA VIZCAYA, CAGAYAN NORTH • (District A2a) NUEVA ECIJA CABANATUAN, BULACAN, BARASOAIN, STA. MARIA-BULACAN EAST, DEL PILAR-BULACAN, MALOLOS REPUBLIKA • (District A2b) ZAMBALES-OLONGAPO, TARLAC, PAMPANGA-SAN FERNANDO, BALANGA-BATAAN, ANGELES CITY, SINUKWAN-PAMPANGA, CLARK • ANGELES CITY-ALAYA, CABALEN PAMPANGA • (District A3) QUEZON CITY, QC SILANGAN, QC CAPITOL, QC TANDANG SORA, HONGKONG, QC CENTRAL, QC SOUTH TRIANGLE, LOS ANGELES • (District A4) DILIMAN, NEW MANILA, CAMANAVA HILAGA, QC ELLIPTICAL, NOVA CENTRAL, KSA EASTERN PROVINCE , KSA WESTERN REGION KSA RIYADH, UAE DUBAI, UAE ABU DHABI,

PICTURES TAKEN AT THE OFFICE OF THE UNITED ARCHITECTS OF THE PHILIPPINES









This handbook is a product of the

BJMP-ICRC Working Team in Upgrading
BJMP Jail Facilities.