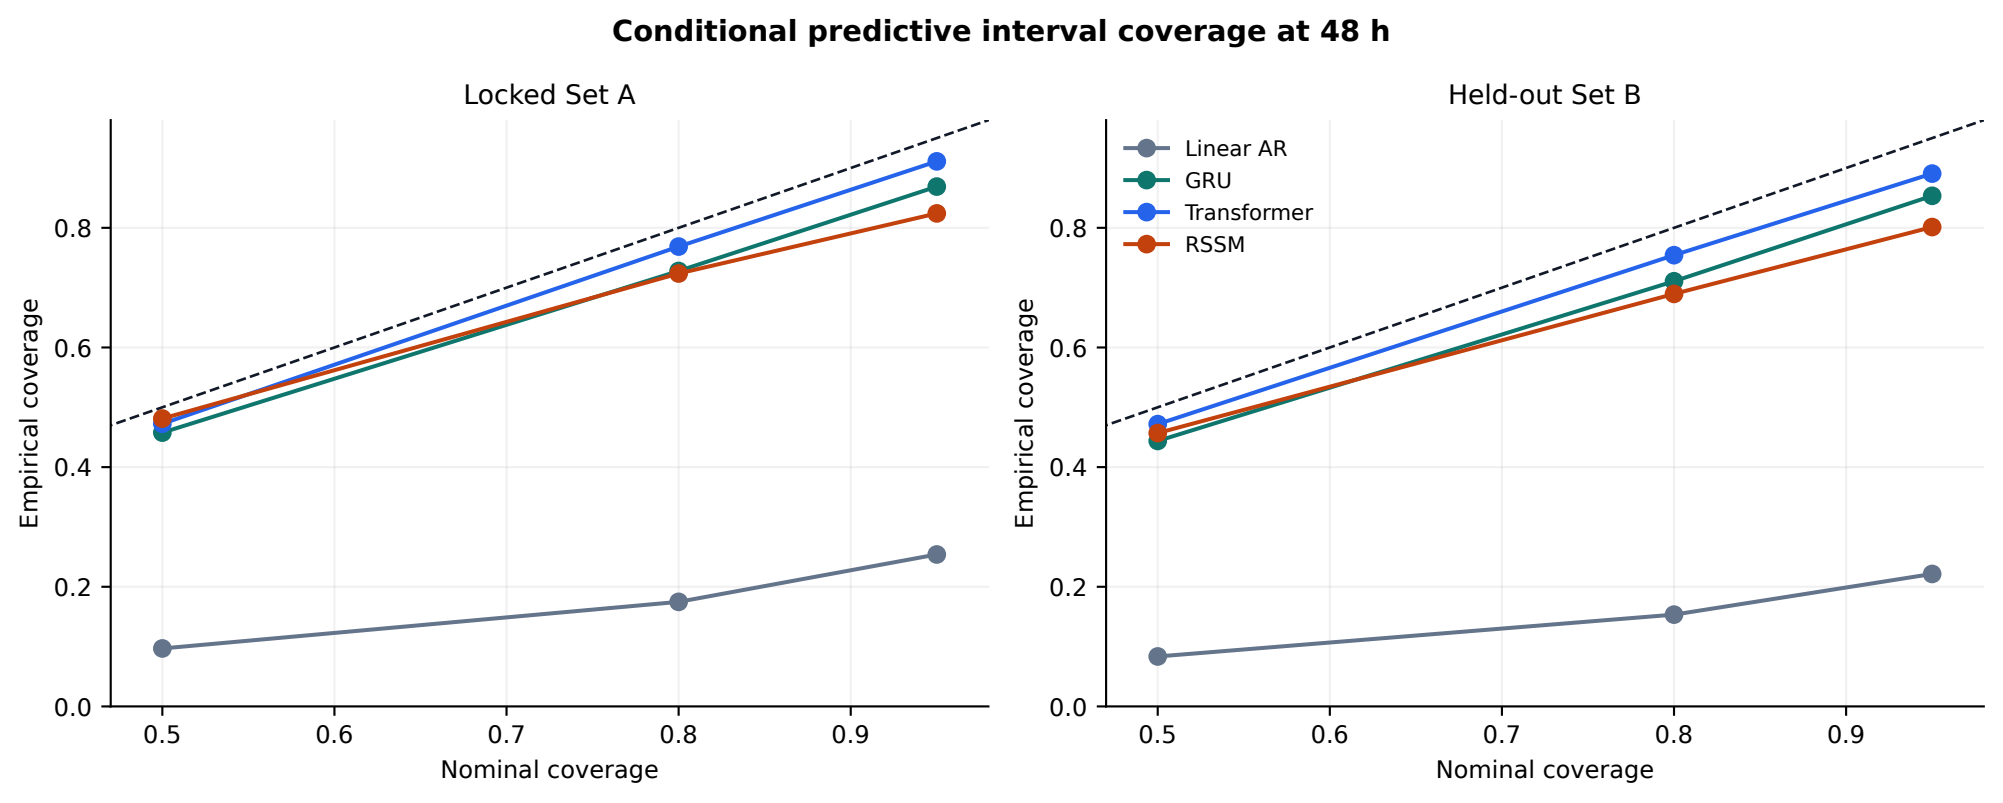
Conditional predictive interval coverage at 48 h
Locked Set A
Held-out Set B
Linear AR
GRU
Transformer
RSSM
Empirical coverage
Nominal coverage
0.0
0.2
0.4
0.6
0.8
0.5
0.6
0.7
0.8
0.9