Migrate from a switched cluster with SAT storage by reusing the storage switches

ONTAP Systems

Amanda Stroman
May 12, 2021

This PDF was generated from https://docs.netapp.com/us-en/ontap-systems/switch-cisco-9336c-shared/9336c_migrate_from_a_switched_cluster_with_sat_storage_by_reusing_the_storage_switches.html on June 15, 2021. Always check docs.netapp.com for the latest.

Table of Contents

Migrate from a switched cluster with SAT storage by reusing the storage switches 1

Migrate from a switched cluster with SAT storage by reusing the storage switches

Migrate the storage switches

By reusing the storage switches the storage switches of HA pair 1 become the shared switches.
Cabling diagram for switch-attached

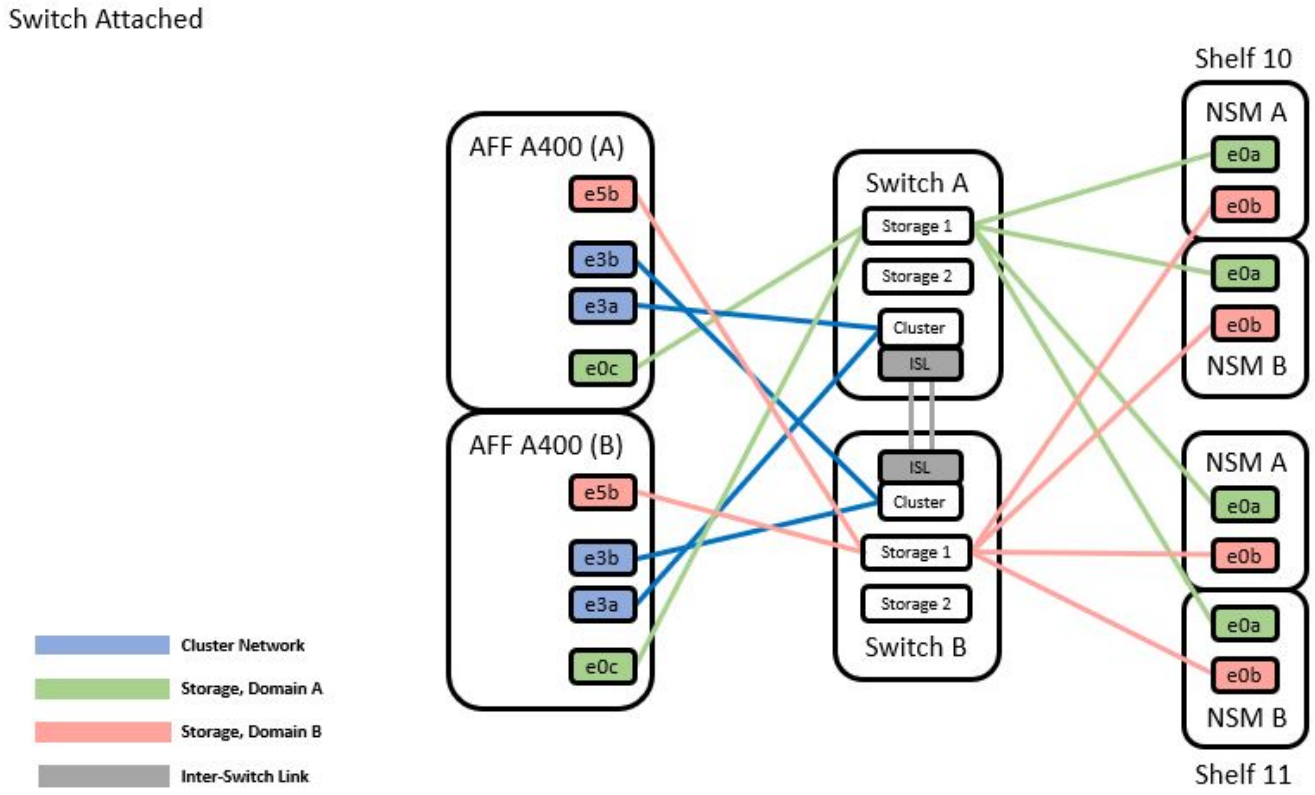

Steps

1. Verify that the storage configuration of HA pair 1 (and HA pair 2) is correct and error free:
   `system switch ethernet show`

```
storage::*> system switch ethernet show
Switch                    Type               Address          Model
------------------------- ------------------ ---------------- ----------
sh1
                          storage-network    172.17.227.5     C9336C

     Serial Number: FOC221206C2
      Is Monitored: true
            Reason: None
  Software Version: Cisco Nexus Operating System (NX-OS) Software, Version
                    9.3(5)
       Version Source: CDP
sh2
                          storage-network    172.17.227.6     C9336C
     Serial Number: FOC220443LZ
      Is Monitored: true
            Reason: None
  Software Version: Cisco Nexus Operating System (NX-OS) Software, Version
                    9.3(5)
    Version Source: CDP
2 entries were displayed.
storage::*>
```

2. Move the HA pair 1, NSM224 path A cables from storage switch A to the NSM224 storage ports for HA pair 1, path A on storage switch A.
3. Move the cable from HA pair 1, node A, path A to the NSM224 storage port for HA pair 1, node A on storage switch A.
4. Move the cable from HA pair 1, node B, path A to the NSM224 storage port for HA pair 1, node B on storage switch A.
5. Verify the storage attached to HA pair 1, storage switch A is healthy:
   `storage port show -port-type ENET`

```
storage::*> storage port show -port-type ENET
                                     Speed                              VLAN
Node     Port     Type     Mode        (Gb/s)        State     Status       ID
------- ------- ------- ---------- ------------ --------- --------- -----
node1
        e0c      ENET     storage            100  enabled   online       30
        e0d      ENET     storage            100  enabled   online       30
        e5a      ENET     storage            100  enabled   online       30
        e5b      ENET     storage            100  enabled   online       30

node2
        e0c      ENET     storage            100  enabled   online       30
        e0d      ENET     storage            100  enabled   online       30
        e5a      ENET     storage            100  enabled   online       30
        e5b      ENET     storage            100  enabled   online       30
```

6. Replace the storage RCF on shared switch A with the shared RCF file. See Install the RCF on a Cisco Nexus 9336C-FX2 shared switch for further details.
7. Verify the storage attached to HA pair 1, storage switch A is healthy:
   `system health alert show -instance`

```
storage::*> system health alert show -instance
There are no entries matching your query.
```

8. Move the HA pair 1, NSM224 path B cables from storage switch B to the shared NS224 storage ports for HA pair 1, path B to storage switch B.
9. Move the cable from HA pair 1, node A, path B to the shared storage port for HA pair 1, node A, path B on storage switch B.
10. Move the cable from HA pair 1, node B, path B to the shared storage port for HA pair 1, node B, path B on storage switch B.
11. Verify the storage attached to HA pair 1, storage switch B is healthy:
    `system health alert show -instance`

```
storage::*> system health alert show -instance
There are no entries matching your query.
```

12. Replace the storage RCF file on shared switch B with the shared RCF file. See Install the RCF on a Cisco Nexus 9336C-FX2 shared switch for further details.
13. Verify the storage attached to HA pair 1, storage switch B is healthy:
    `system health alert show -instance`

```
storage::*> system health alert show -instance
There are no entries matching your query.
```

14. Verify the storage configuration of HA pair 1 is correct and error free:
    `system switch ethernet show`

```
storage::*> system switch ethernet show
Switch                    Type                 Address          Model
------------------------- -------------------- ---------------- ----------
sh1
                          storage-network      172.17.227.5     C9336C

    Serial Number: FOC221206C2
     Is Monitored: true
           Reason: None
 Software Version: Cisco Nexus Operating System (NX-OS) Software, Version
                   9.3(5)
   Version Source: CDP
sh2
                          storage-network      172.17.227.6     C9336C
    Serial Number: FOC220443LZ
     Is Monitored: true
           Reason: None
 Software Version: Cisco Nexus Operating System (NX-OS) Software, Version
                   9.3(5)
   Version Source: CDP
2 entries were displayed.
storage::*>
```

15. Install the ISLs between shared switch A and shared switch B:

```
sh1# configure
Enter configuration commands, one per line. End with CNTL/Z.
sh1 (config)# interface e1/35-36
sh1 (config-if-range)# no lldp transmit
sh1 (config-if-range)# no lldp receive
sh1 (config-if-range)# switchport mode trunk
sh1 (config-if-range)# no spanning-tree bpduguard enable
sh1 (config-if-range)# channel-group 101 mode active
sh1 (config-if-range)# exit
sh1 (config)# interface port-channel 101
sh1 (config-if)# switchport mode trunk
sh1 (config-if)# spanning-tree port type network
sh1 (config-if)# exit
sh1 (config)# exit
```

16. Migrate the cluster networking from the existing cluster switches to the shared switches using the switch replacement procedure and the shared RCF. The new shared switch A is "cs1". The new shared switch B is "cs2". See Replace a Cisco Nexus 9336C-FX2 shared switch and Install the RCF on a Cisco Nexus 9336C-FX2 shared switch for further details.
17. Verify that the switched networking config is valid:
    `network port show`
18. Remove the unused cluster switches.
19. Remove the unused storage switches.

Copyright Information

Copyright © 2021 NetApp, Inc. All rights reserved. Printed in the U.S. No part of this document covered by copyright may be reproduced in any form or by any means-graphic, electronic, or mechanical, including photocopying, recording, taping, or storage in an electronic retrieval system-without prior written permission of the copyright owner.

Software derived from copyrighted NetApp material is subject to the following license and disclaimer:

THIS SOFTWARE IS PROVIDED BY NETAPP “AS IS” AND WITHOUT ANY EXPRESS OR IMPLIED WARRANTIES, INCLUDING, BUT NOT LIMITED TO, THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, WHICH ARE HEREBY DISCLAIMED. IN NO EVENT SHALL NETAPP BE LIABLE FOR ANY DIRECT, INDIRECT, INCIDENTAL, SPECIAL, EXEMPLARY, OR CONSEQUENTIAL DAMAGES (INCLUDING, BUT NOT LIMITED TO, PROCUREMENT OF SUBSTITUTE GOODS OR SERVICES; LOSS OF USE, DATA, OR PROFITS; OR BUSINESS INTERRUPTION) HOWEVER CAUSED AND ON ANY THEORY OF LIABILITY, WHETHER IN CONTRACT, STRICT LIABILITY, OR TORT (INCLUDING NEGLIGENCE OR OTHERWISE) ARISING IN ANY WAY OUT OF THE USE OF THIS SOFTWARE, EVEN IF ADVISED OF THE POSSIBILITY OF SUCH DAMAGE.

NetApp reserves the right to change any products described herein at any time, and without notice. NetApp assumes no responsibility or liability arising from the use of products described herein, except as expressly agreed to in writing by NetApp. The use or purchase of this product does not convey a license under any patent rights, trademark rights, or any other intellectual property rights of NetApp.

The product described in this manual may be protected by one or more U.S. patents, foreign patents, or pending applications.

RESTRICTED RIGHTS LEGEND: Use, duplication, or disclosure by the government is subject to restrictions as set forth in subparagraph (c)(1)(ii) of the Rights in Technical Data and Computer Software clause at DFARS 252.277-7103 (October 1988) and FAR 52-227-19 (June 1987).

Trademark Information

NETAPP, the NETAPP logo, and the marks listed at http://www.netapp.com/TM are trademarks of NetApp, Inc. Other company and product names may be trademarks of their respective owners.