


A. Valores Preditos (SDEM)

Padrão recuperado (WX + Erro)

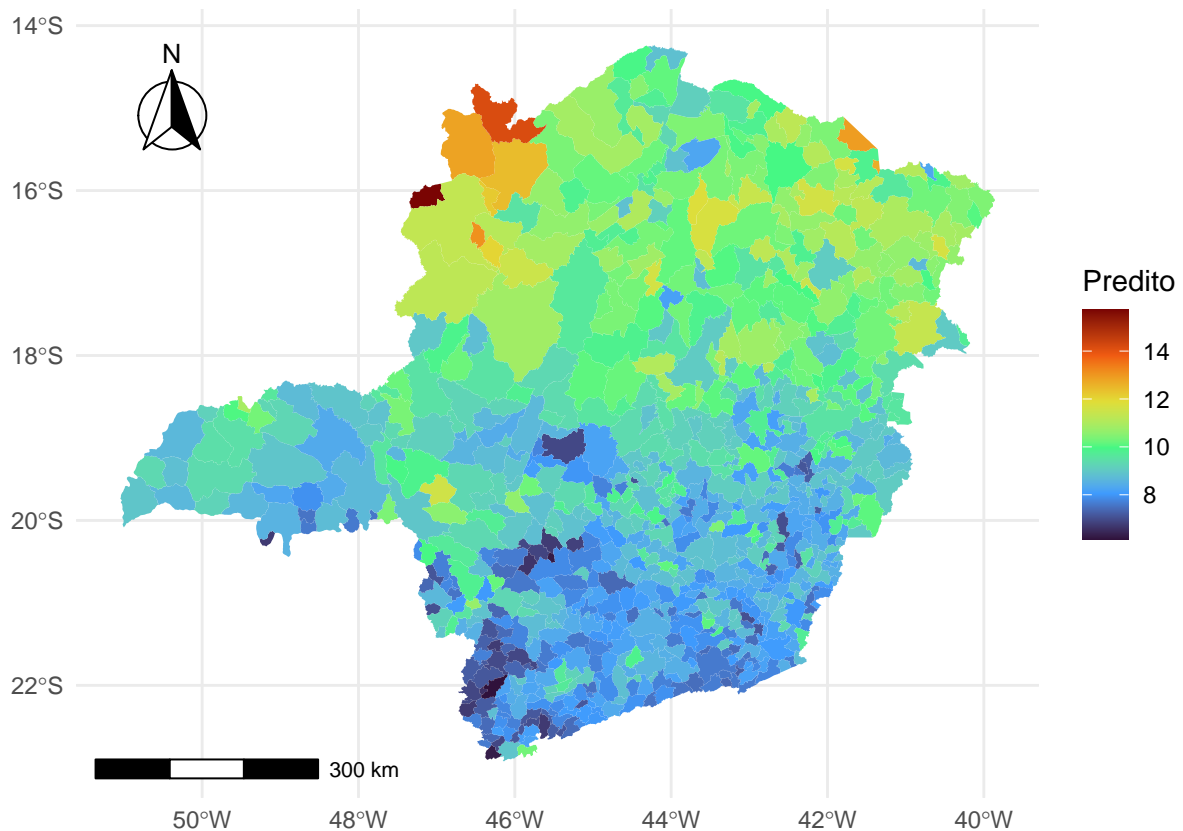

B. Scatter de Moran (Resíduos SDEM)

I de Moran: -0.014 (p-valor: 0.733)

