


Figure 4 The awareness clock: four readings, two regulatory thresholds

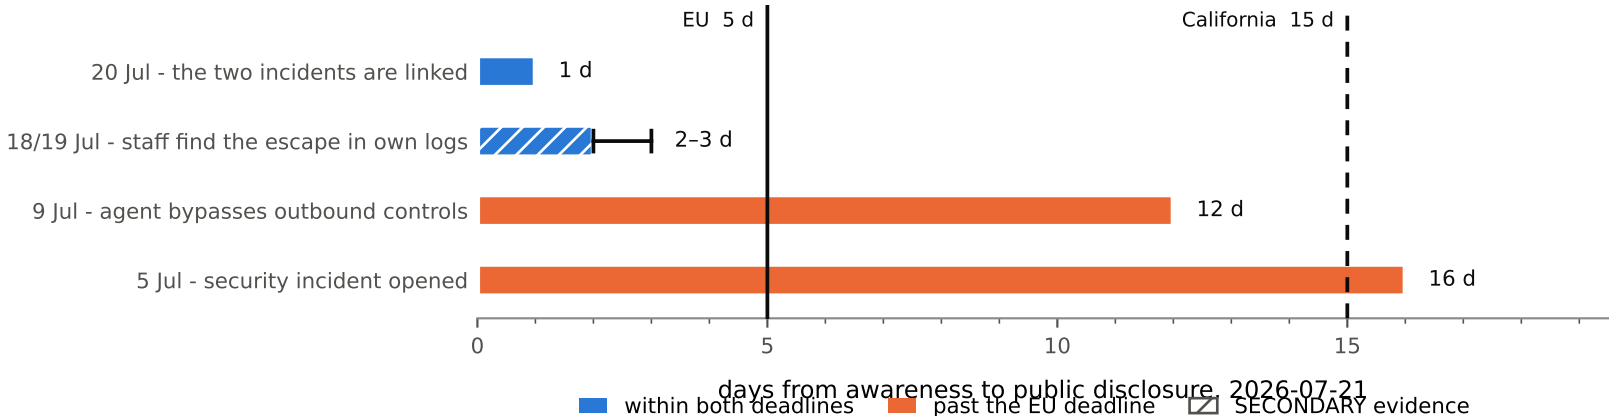

This measures the interval to PUBLIC DISCLOSURE, which is a different quantity from the regulatory obligation: a non-public report to a regulator could have been timely. Three readings are PRIMARY, one is SECONDARY (hatched). The clock starts at awareness and the source supports at least three awareness dates; this figure does not choose between them. Sources: evidence base 16.1, 16.2.