
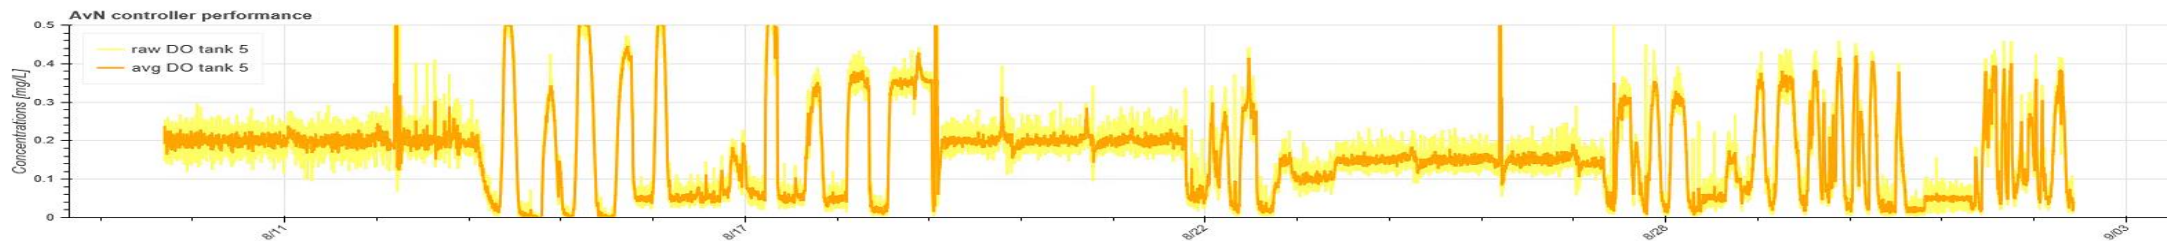
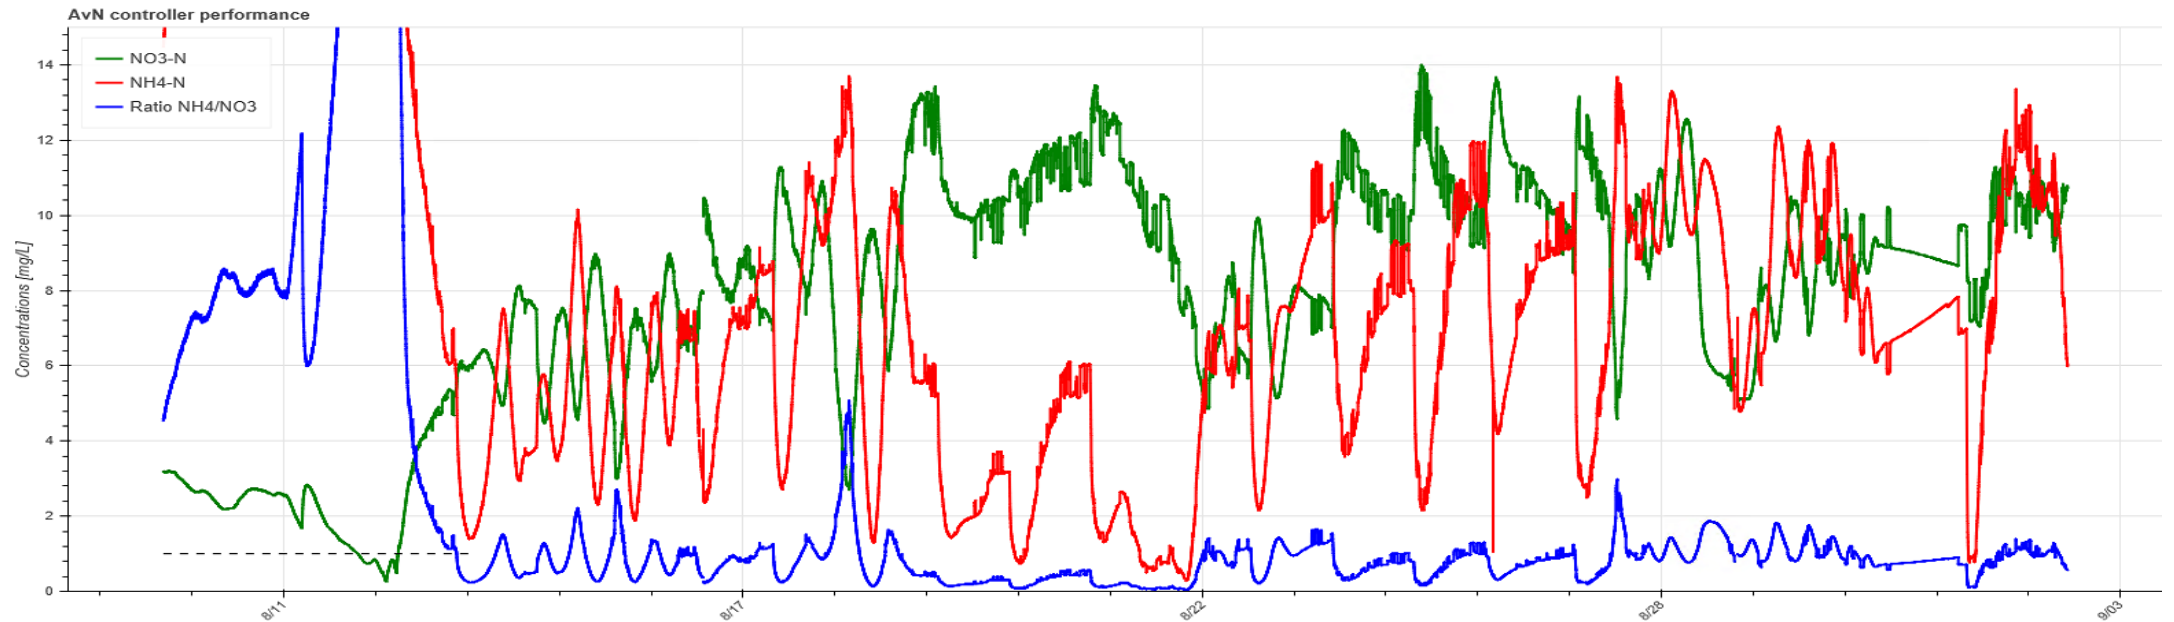


Results: August 11th – September 2nd

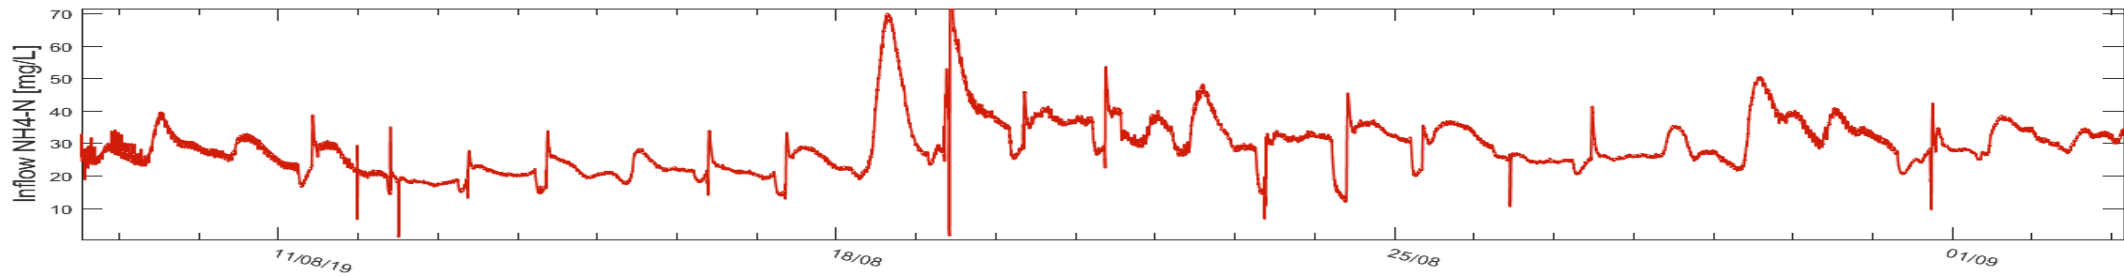

Without AvN controller
Constant DOsp = 0.2 mg/L

With AvN controller
Tuning issues + SCADA freezes setpoint at random (manual intervention required)

Without AvN controller
Constant DOsp = 0.2 mg/L

With AvN controller
SCADA still freezes

Without AvN controller
Constant DOsp = 0.15 mg/L

With AvN controller
SCADA works correctly + Tuning of the controller

PUMP STOP

With AvN controller
Tuned control