




SITE PLAN
AREA= 850 SQ.FT.

AREA TRIANGULATIONS

SN.	DESCRIPTION	AREA (SQ.FT)
1	A	612.5 SQ.FT.
2	B	736 SQ.FT.
TOTAL =		1348.5 SQ.FT.

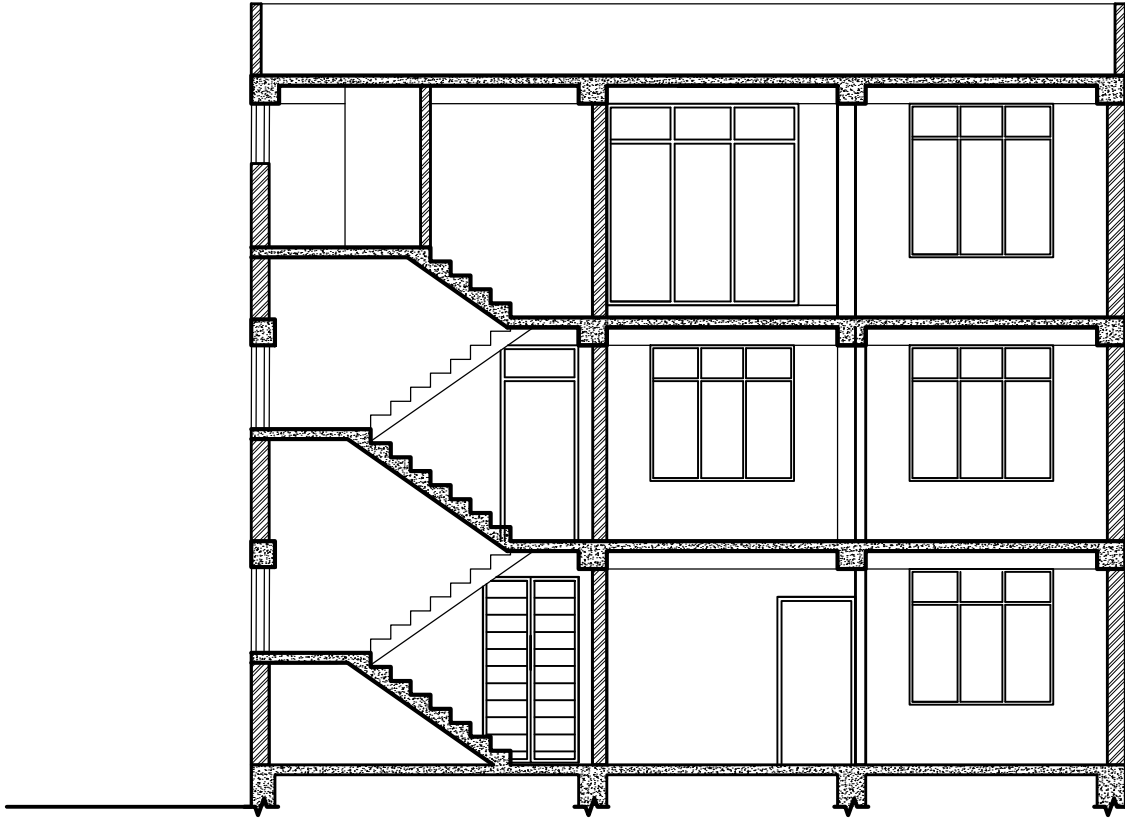


SECTION AT X-X

+ 31'-9" Parapet Lvl
+28'-9" 3RD Floor Lvl
+27'-7" 2nd Floor Lintel Lvl


+ 21'-2" 2nd Floor Sill Lvl
+18'-8" 2ND Floor Lvl
+17'-6" 1st Floor Lintel Lvl

+ 11'-10" First Floor Sill Lvl
+9'-4" First Floor Lvl
+8'-2" Lintel Lvl


+ 2'-6" Sill Lvl
± 0'-0" Plinth Lvl
-1'-9" Ground Lvl

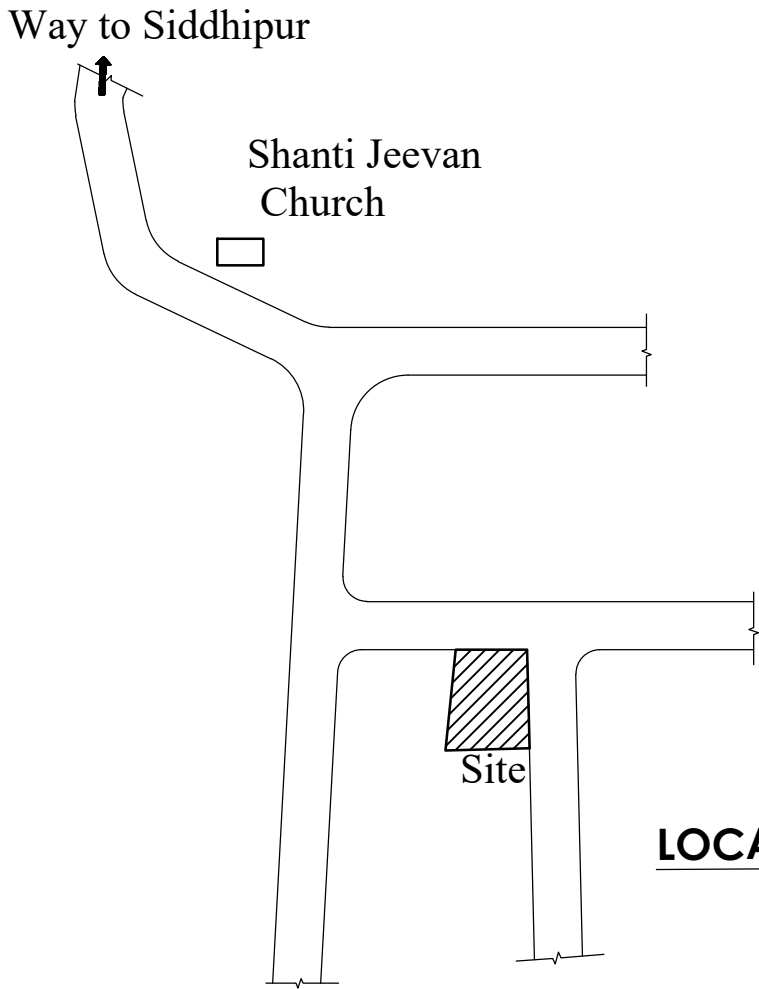


LOCATION PLAN (NOT IN SCALE)

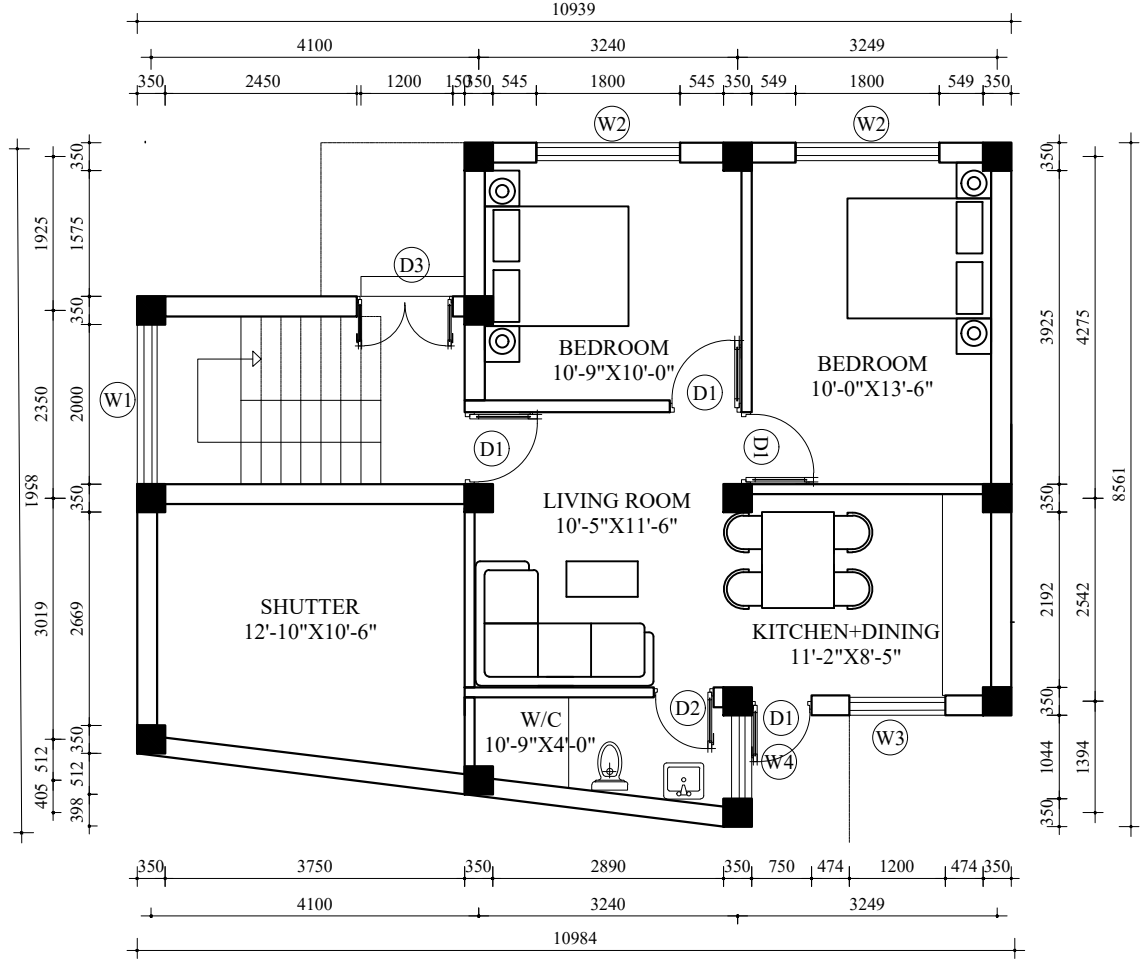


GROUND FLOOR PLAN
AREA: 850 SQ. FT

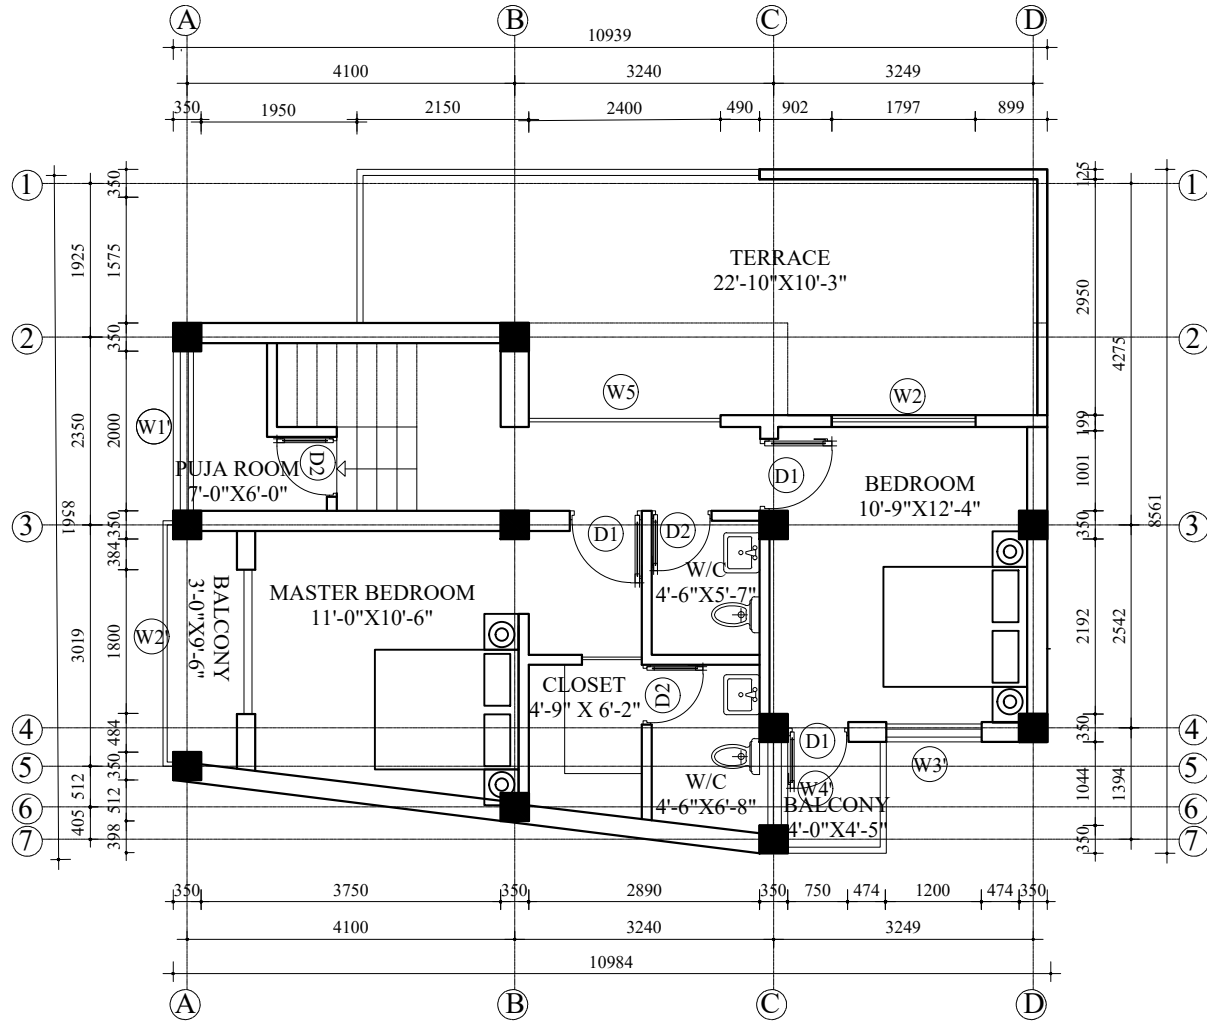

2ND FLOOR PLAN
AREA: 635 SQ. FT

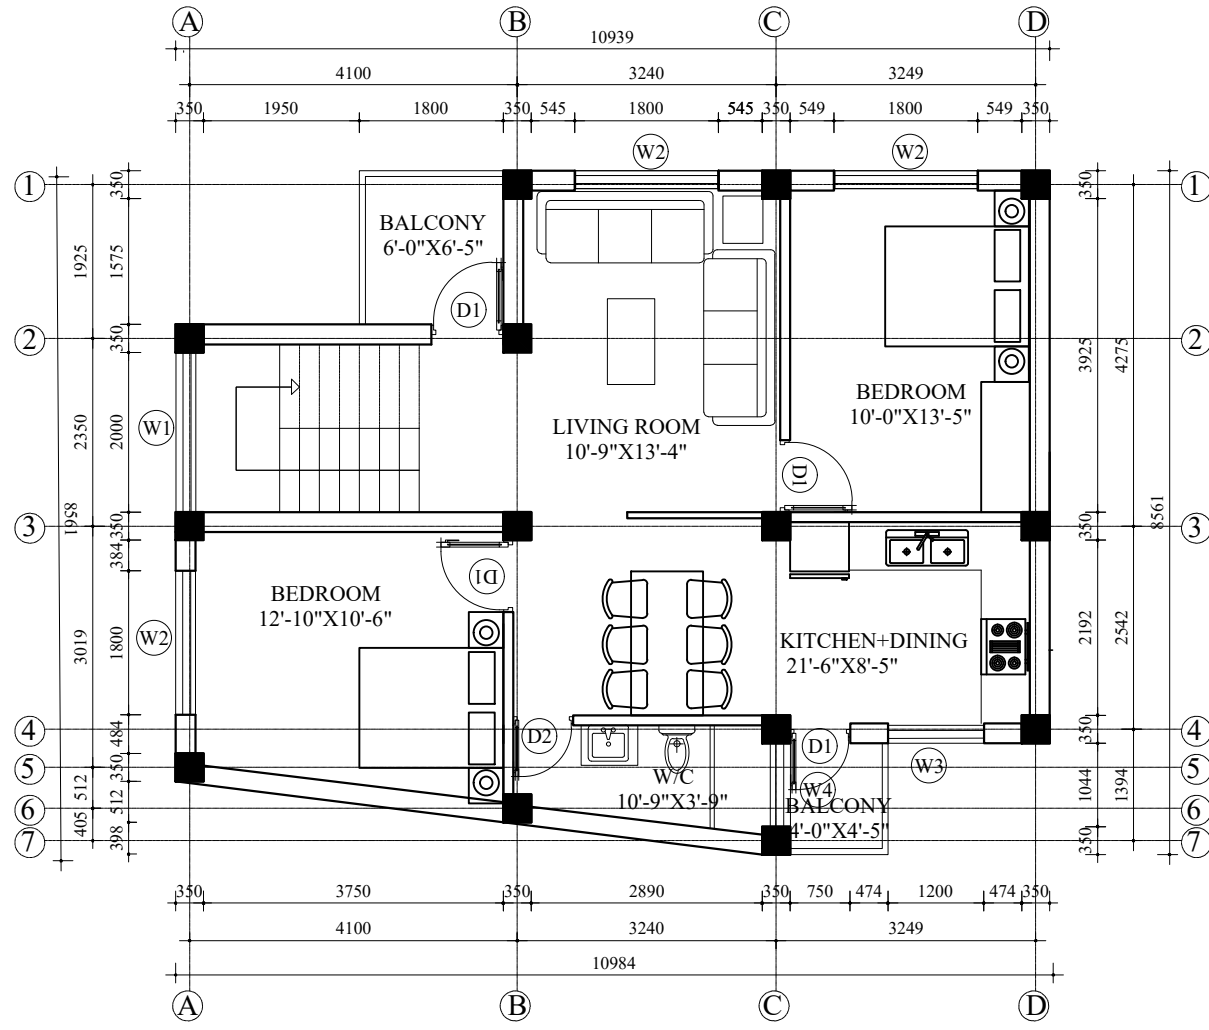

1ST FLOOR PLAN
AREA: 900 SQ. FT

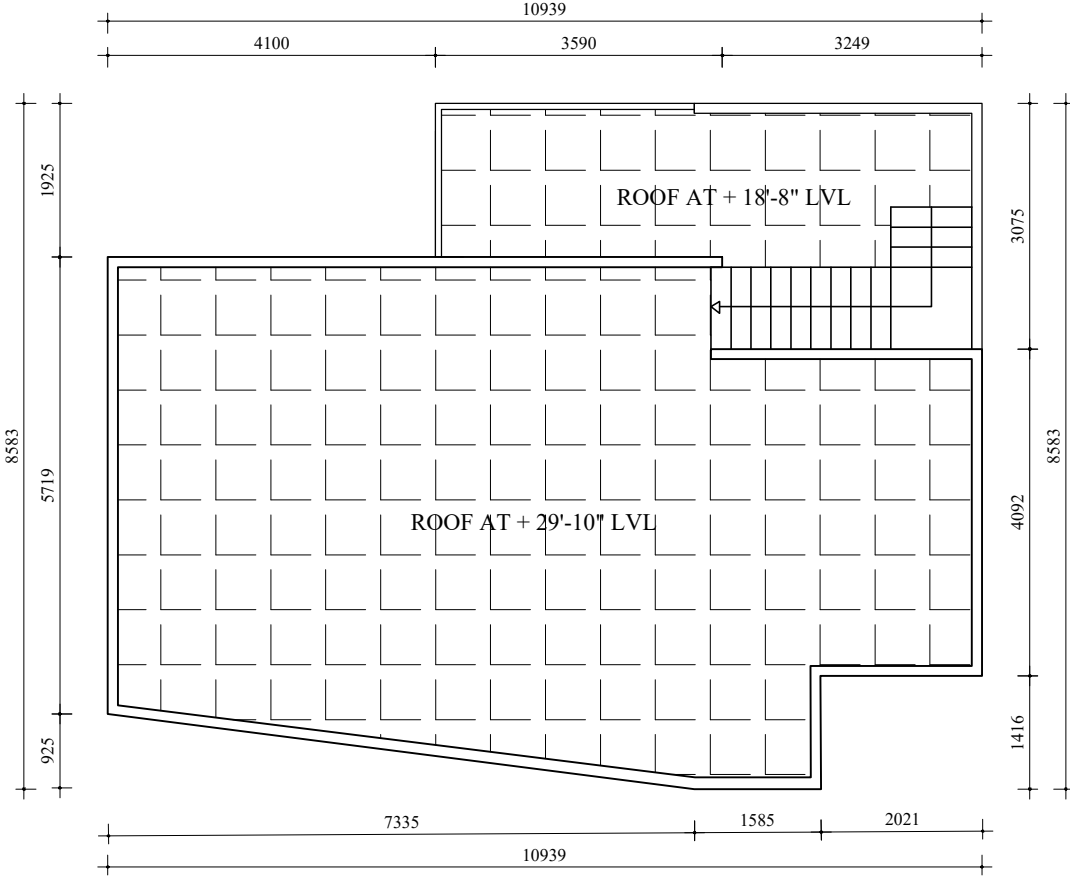


ROOF PLAN



NORTH ELEVATION


EAST ELEVATION

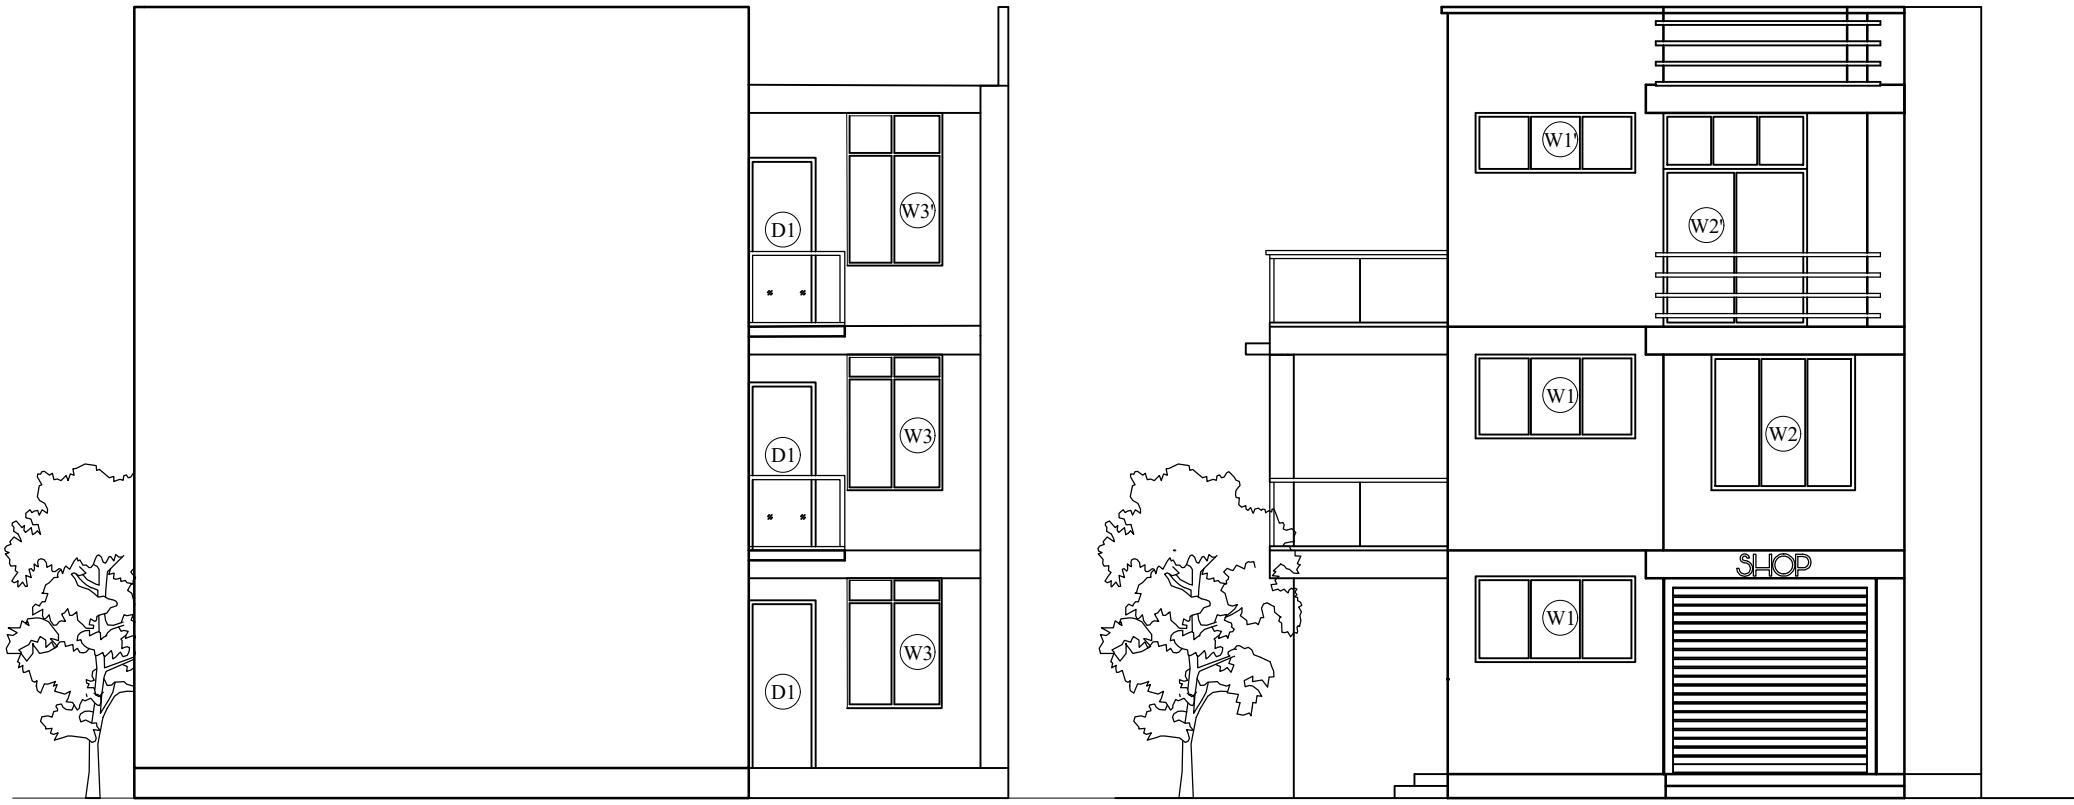

SOUTH ELEVATION

WEST ELEVATION

FOR OFFICIAL USE ONLY

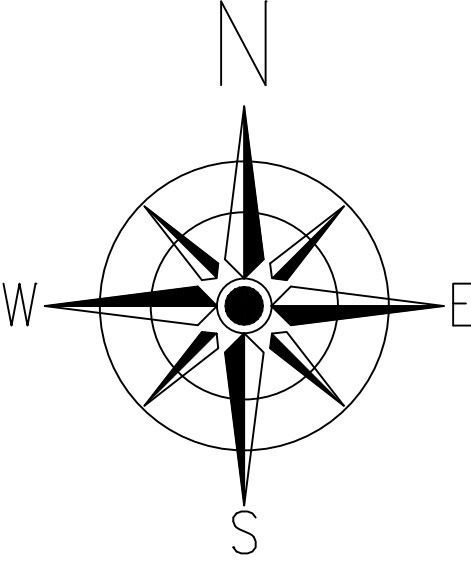

OWNER SIGNATURE


MANITA KAFLE

BUILDING TYPE: RESIDENTIAL LOCATION: MAHALAXMI WARD NO-07
PLOT NO: 1890 AREA: 125.19 SQ.M. (0-3-3-3)


DETAILS: STRUCTURAL DRAWING

DRAWN BY: ANANTA GAUTAM CHECKED BY: AMIR DUWADI


DATE: 16 Dec 2021 SCALE: 1:8 NEC NO: 1674 "A" S. No.: S-1/2

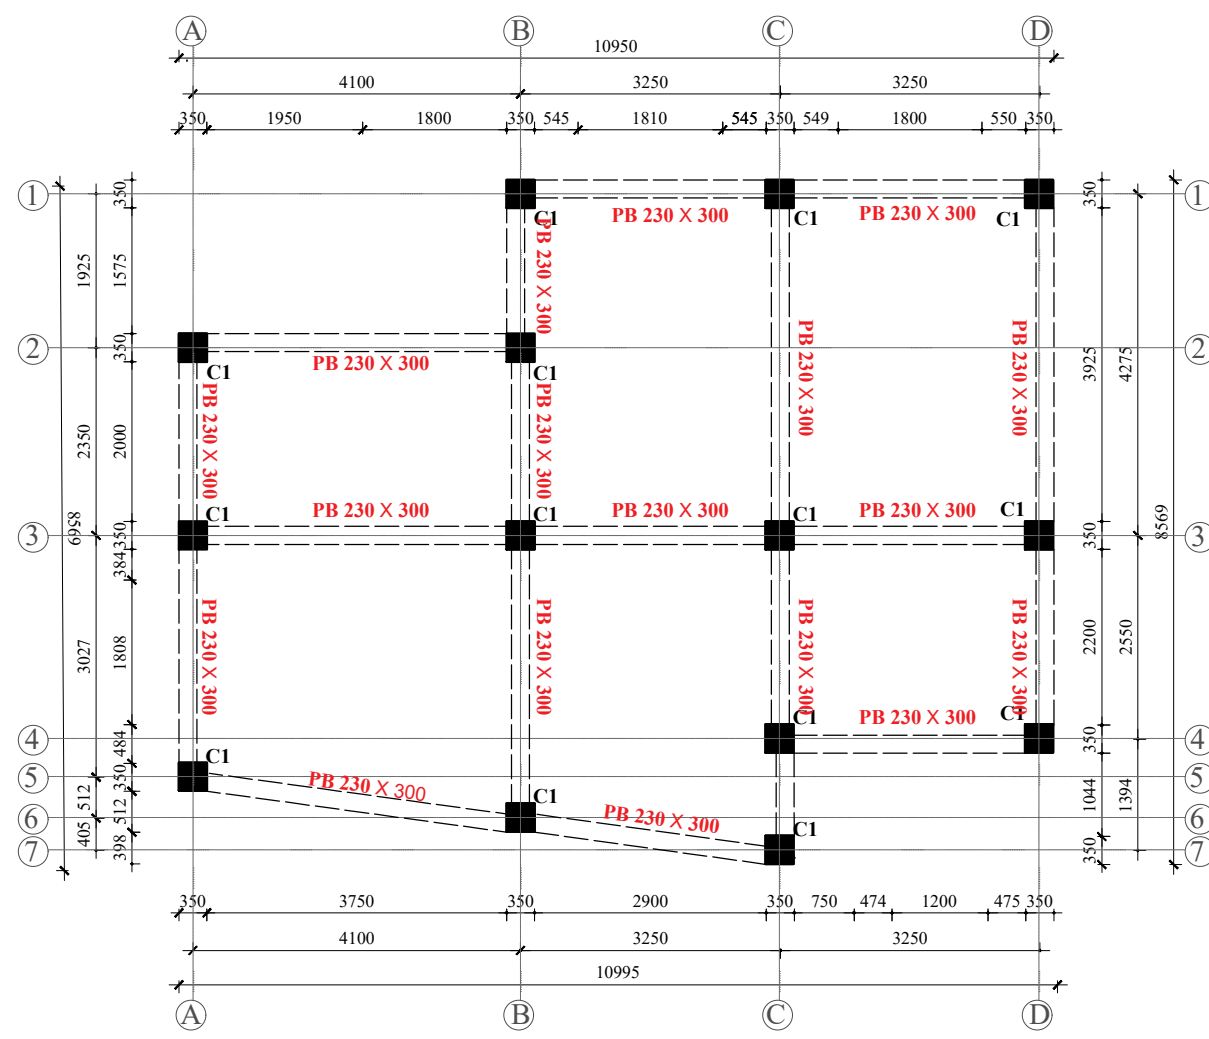




COLUMN & PLINTH BEAM PLAN
SCALE :- 1" = 8'-0"

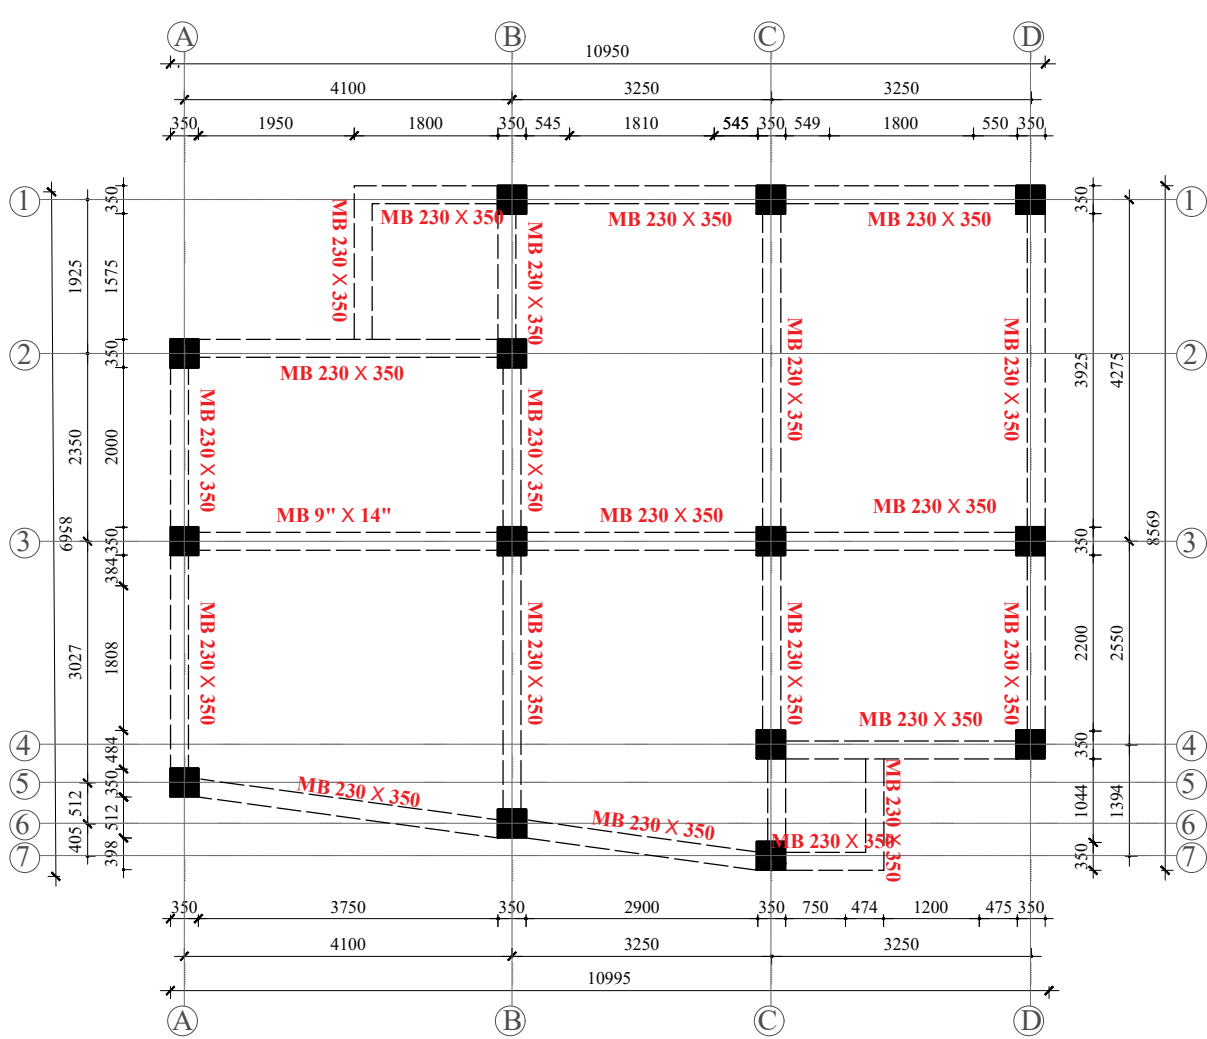


FLOOR BEAM PLAN
SCALE :- 1" = 8'-0"

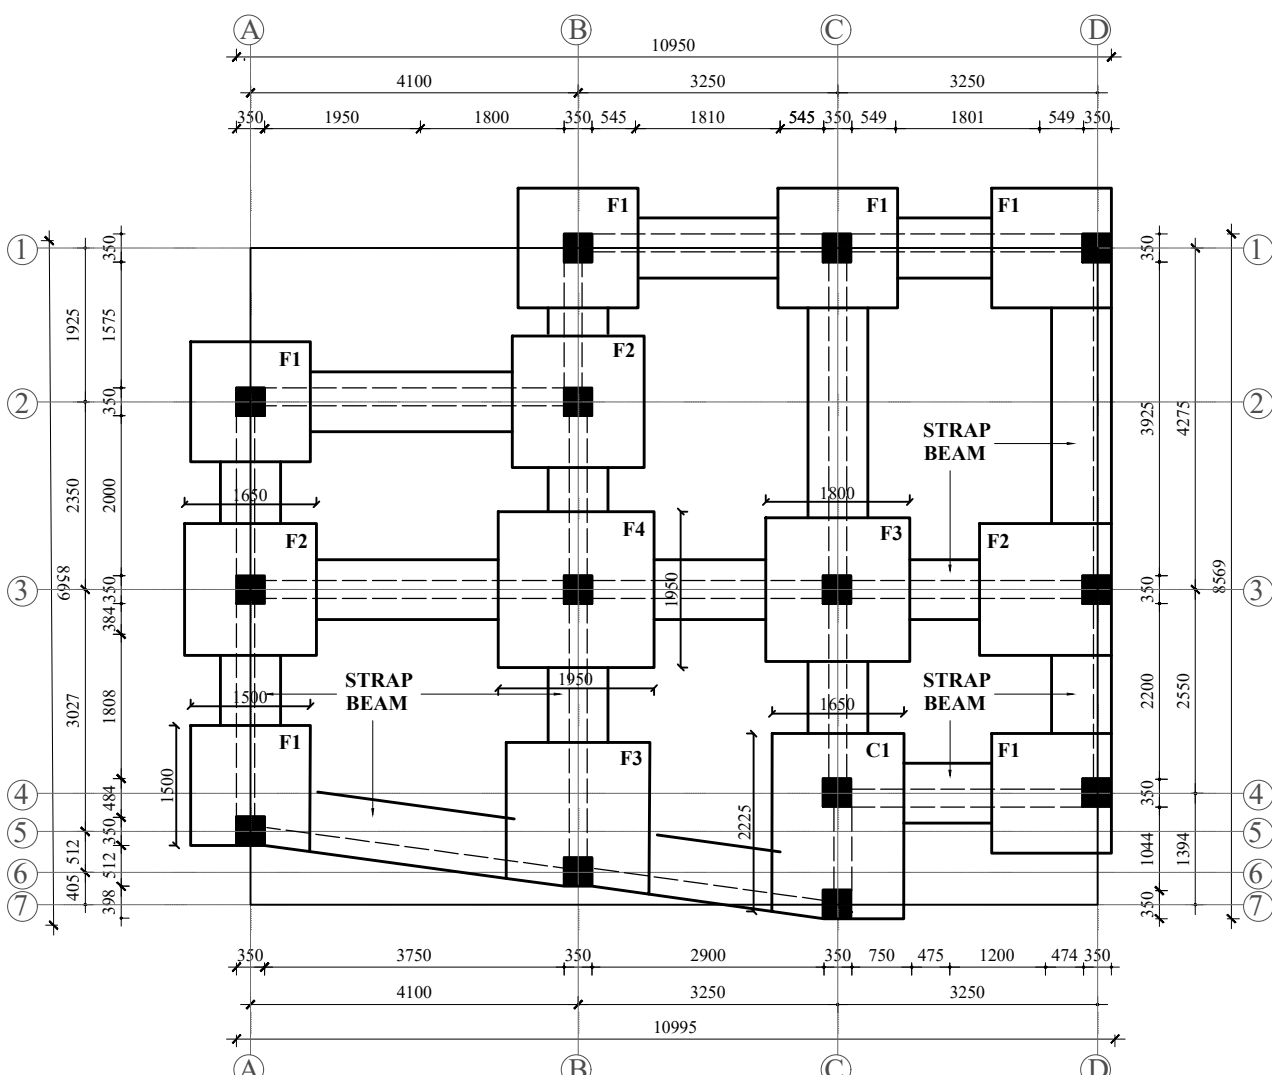


FOUNDATION & TRENCH PLAN
SCALE :- 1" = 8'-0"

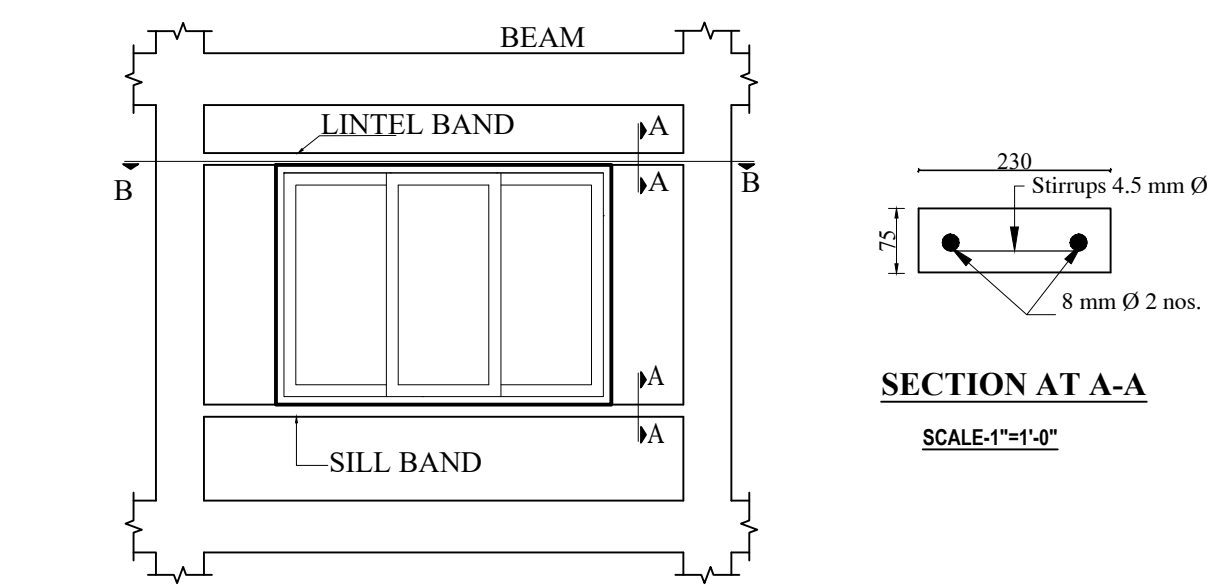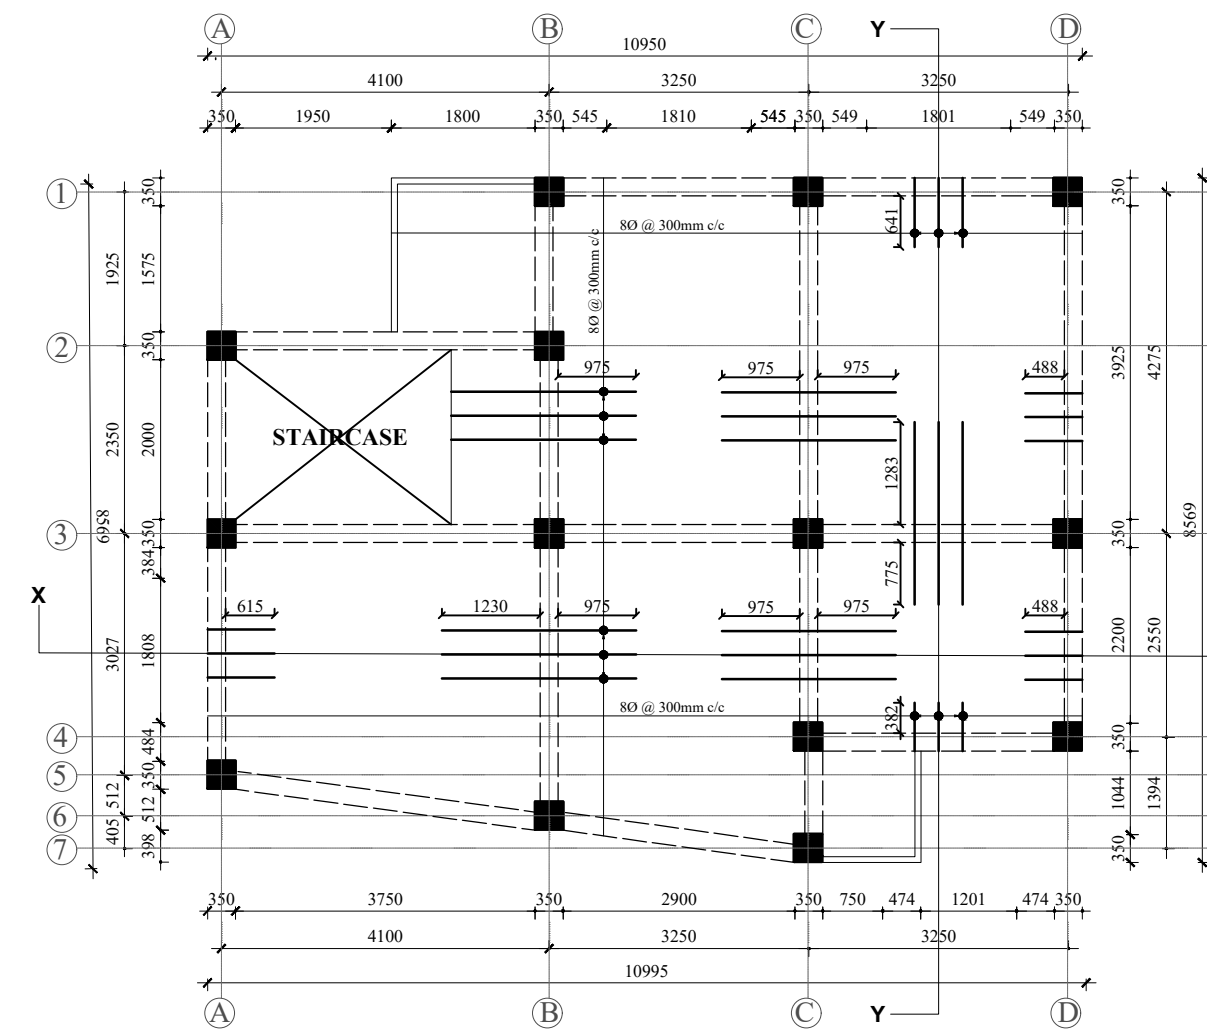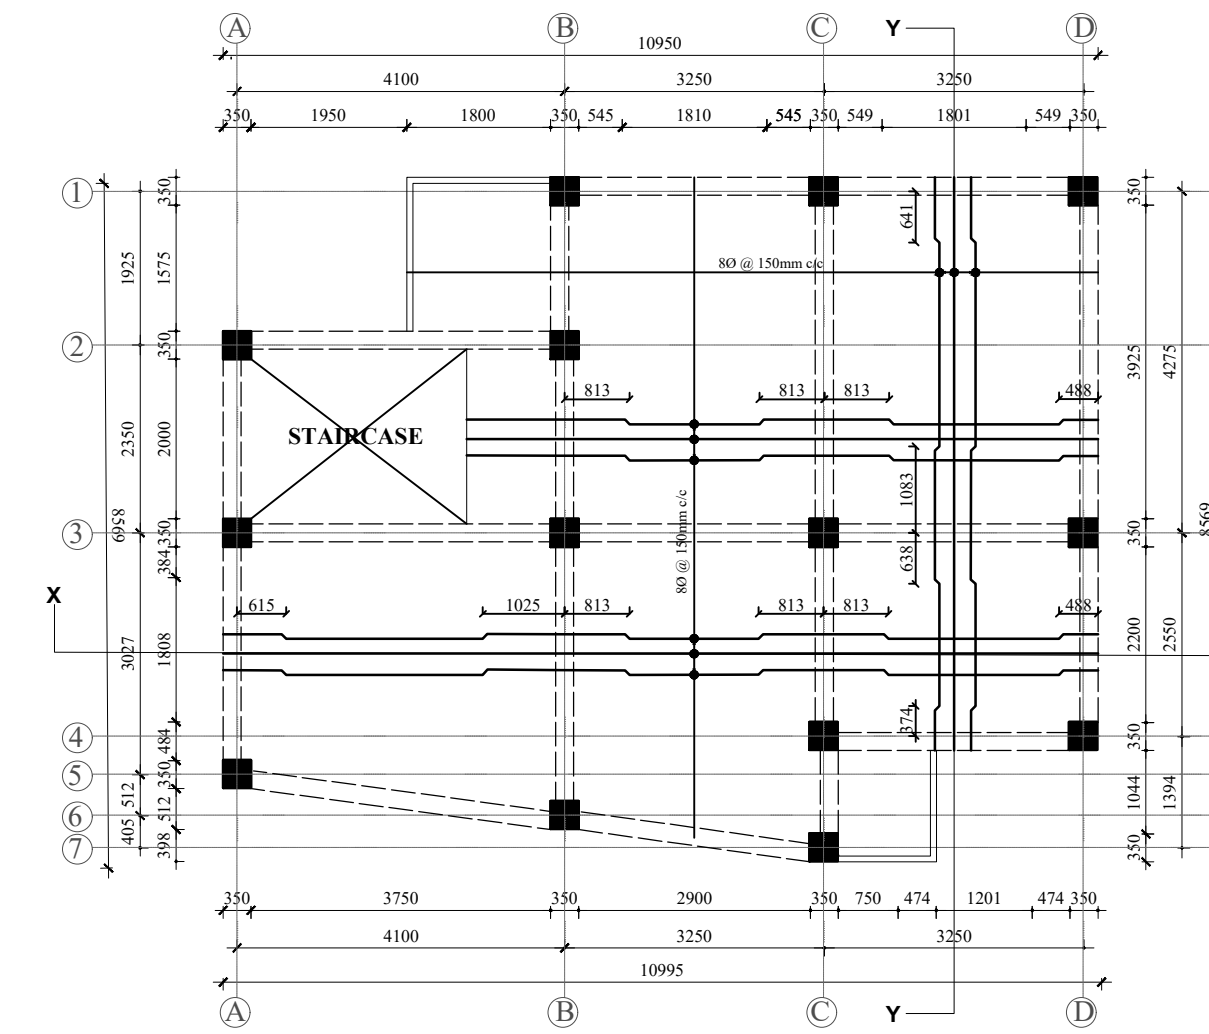


SILL AND LINTEL BAND
SCALE-1/4"=1'-0"

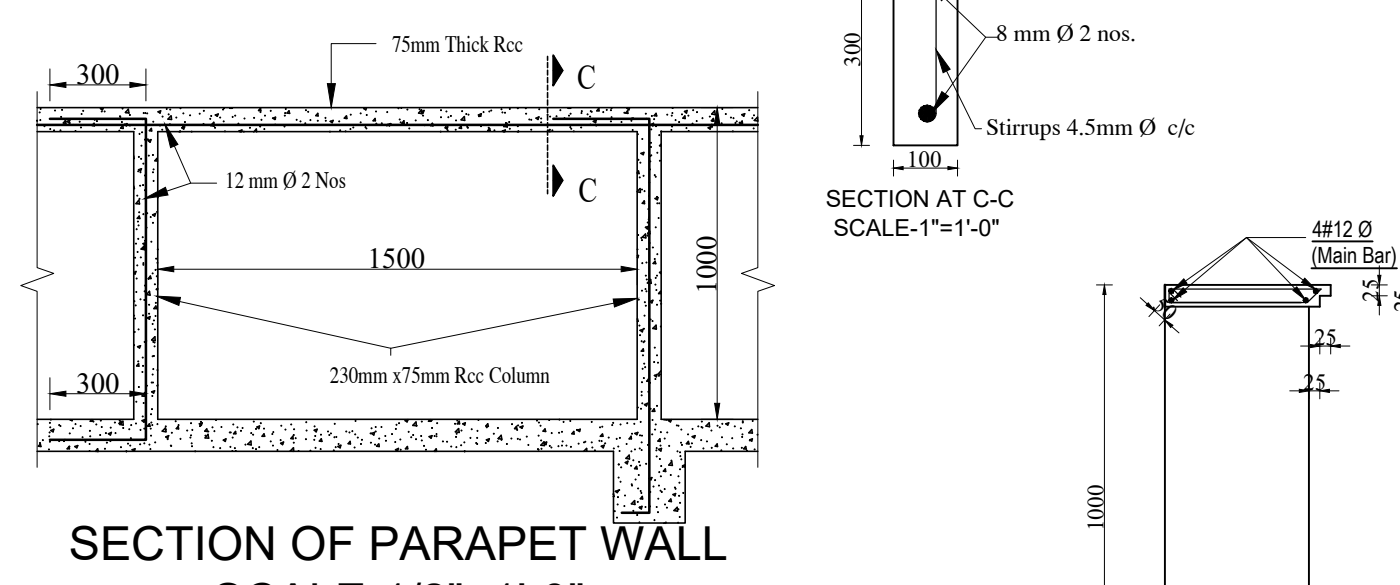


SECTION OF PARAPET WALL
SCALE-1/2"=1'-0"

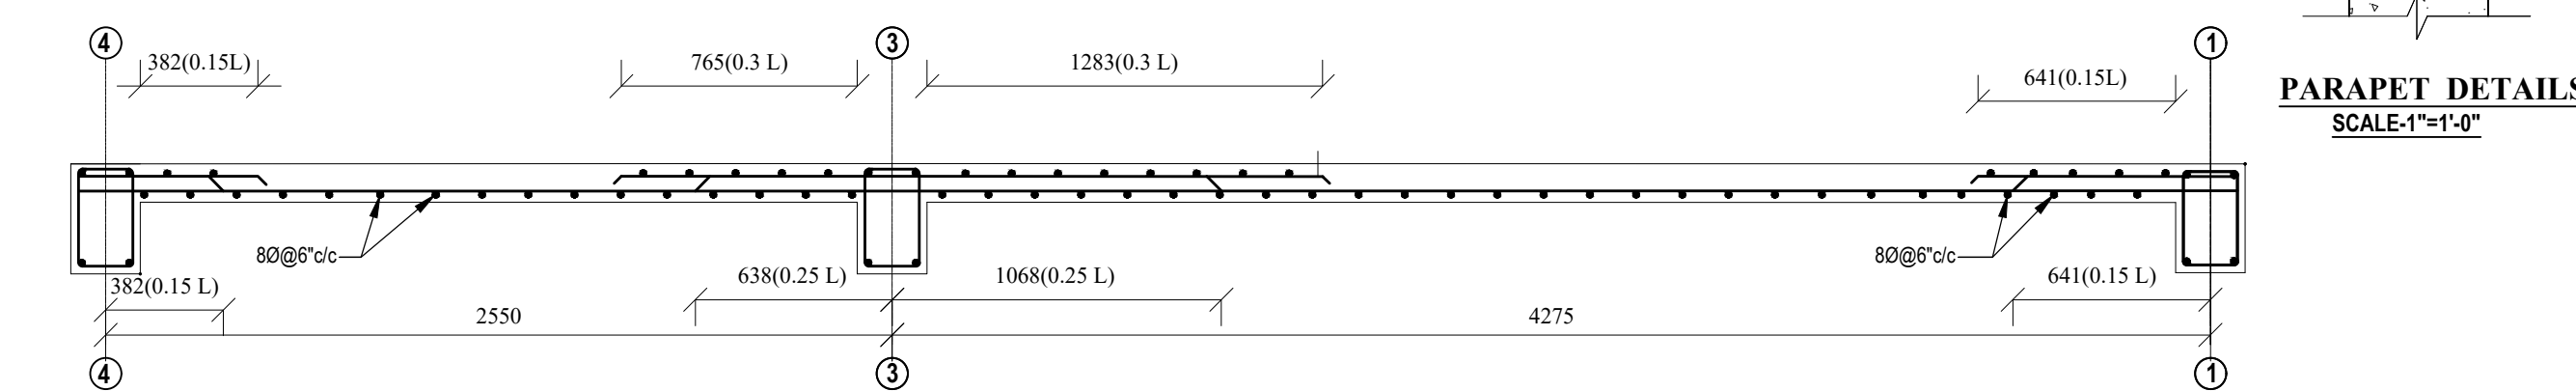


SLAB SECTION AT Y-Y
SCALE :- 1/2" = 1'-0"

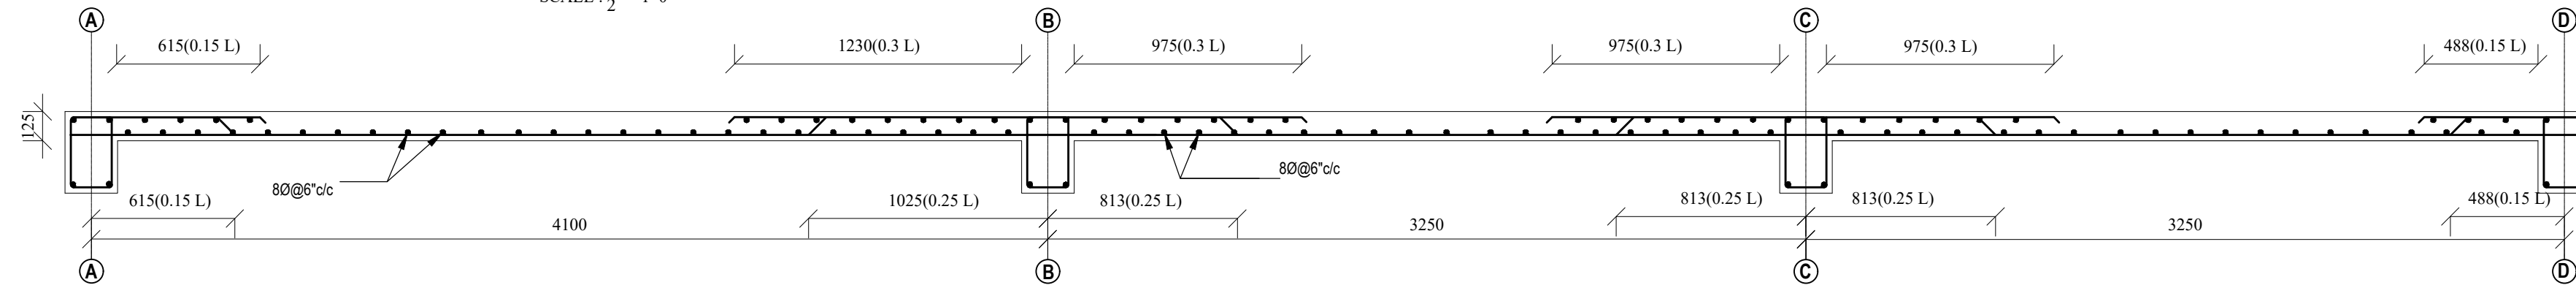


SLAB SECTION AT X-X
SCALE :- 1/2" = 1'-0"

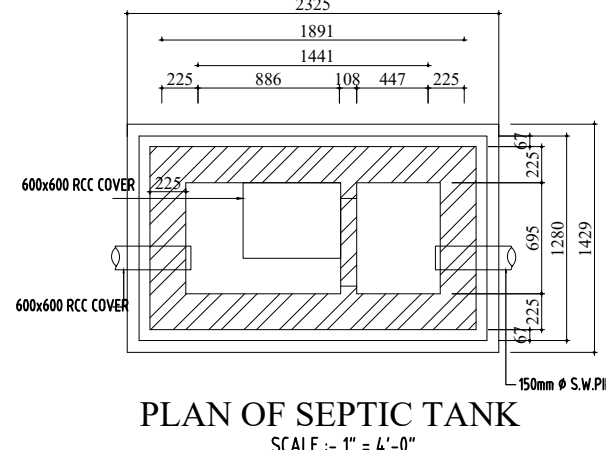


PLAN OF SEPTIC TANK
SCALE :- 1" = 4'-0"

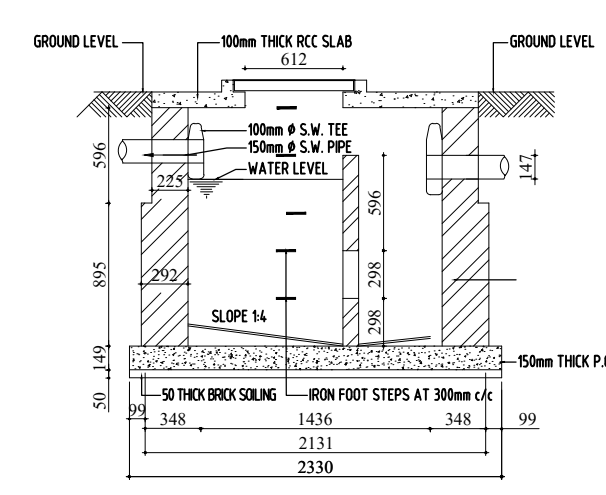

CROSS SECTION OF SEPTIC TANK
SCALE :- 1" = 4'-0"

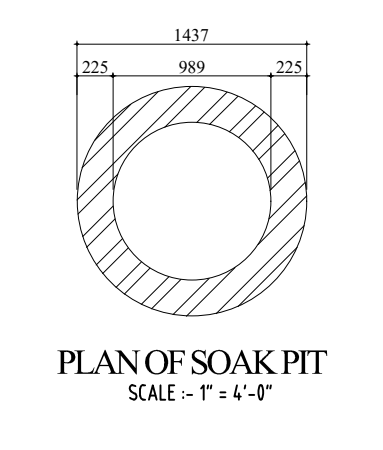

PLAN OF SOAK PIT
SCALE :- 1" = 4'-0"

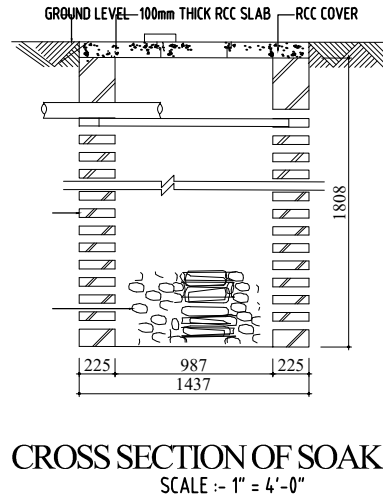

CROSS SECTION OF SOAK PIT
SCALE :- 1" = 4'-0"

COLUMN DETAILS OF BUILDING CONCRETE GRADE: M20 STEEL GRADE: TMT Fe 500

SN	FLOOR DETAIL	SIZE in inch. (bxD)	COLUMN TYPE	REINFORCEMENT BAR		LATERAL TIES		SECTION SHAPE OF TIES
				LONGITUDINAL BAR		IN (h+2)	IN (H-2h)	
1.	BELOW GROUND	350X350	C1	8-Ø16	Ø8@100mm/c	Ø8@100mm/c	Ø8@100mm/c	
2.	GROUND FLOOR	350X350	C1	8-Ø16	Ø8@100mm/c	Ø8@100mm/c	Ø8@100mm/c	
3.	FIRST FLOOR	350X350	C1	4-Ø16+4-Ø12	Ø8@100mm/c	Ø8@100mm/c	Ø8@100mm/c	
4.	SECOND FLOOR	350X350	C1	4-Ø16+4-Ø12	Ø8@100mm/c	Ø8@100mm/c	Ø8@100mm/c	

FOOTING DETAIL FOR MEDIUM SOIL

CONCRETE GRADE: M20			STEEL GRADE:TMT Fe 500				
S.No	Type	BEARING CAPACITY =130KN/SQM	Footings Size	Footings depth		Reinforcement bar	
			(LXB)	d (mm)	D (mm)	X-direction A _{1x}	Y-direction A _{1y}
1.	F1		1500 X 1500	500	550	Ø12@125mm/c	Ø12@125mm/c
2.	F2		1650 X 1650	500	550	Ø12@125mm/c	Ø12@125mm/c
3.	F3		1800 X 1800	500	550	Ø12@125mm/c	Ø12@125mm/c
4.	F4		1950 X 1950	500	550	Ø12@125mm/c	Ø12@125mm/c
5.	C1	1650 X 2228	400	450	Ø12@150mm/c	Ø12@150mm/c	

STRUCTURE NOTES :

FOUNDATION

CONCRETE & REINFORCING STEEL

- Concrete Grade M20 for all members
- Reinforcing steel shall be new TMT bars having a minimum Yield Strength of 500 MPa.
- The cover to main reinforcing steel be in accordance with IS 456 : 2000 & specified clear cover of concrete :

Slab : 15mm

Beam : 25mm

Foundation : 50mm-75mm

Column : 40mm

Staircase/ RCC wall : 20mm

For concrete members in contact of soil = 50-75mm

Min.reinforcing laps shall be in accordance with IS 456 : 2000 & as specified on structural drawing.

Minimum development length for reinforcing bars shall be as follows :

Dia (mm)

Ld (mm)

8 480

10 600

12 720

16 960

20 1200

25 1500

28 1680

Provide corner bars to match horizontal reinforcing steel in slab.

Bars in columns shall be spliced only at mid height of column.



Bars splicing in beam shall be avoided in the span where intermediate beam is connected and shall be only as shown in typical drawing.

Clear vertical distance between two layers of bars=25mm.

Provide shear reinforcement at 100 c/c at lap locations

Bar bending schedule shall be submitted by the Contractor for approval before casting concrete.

FOR OFFICIAL USE ONLY

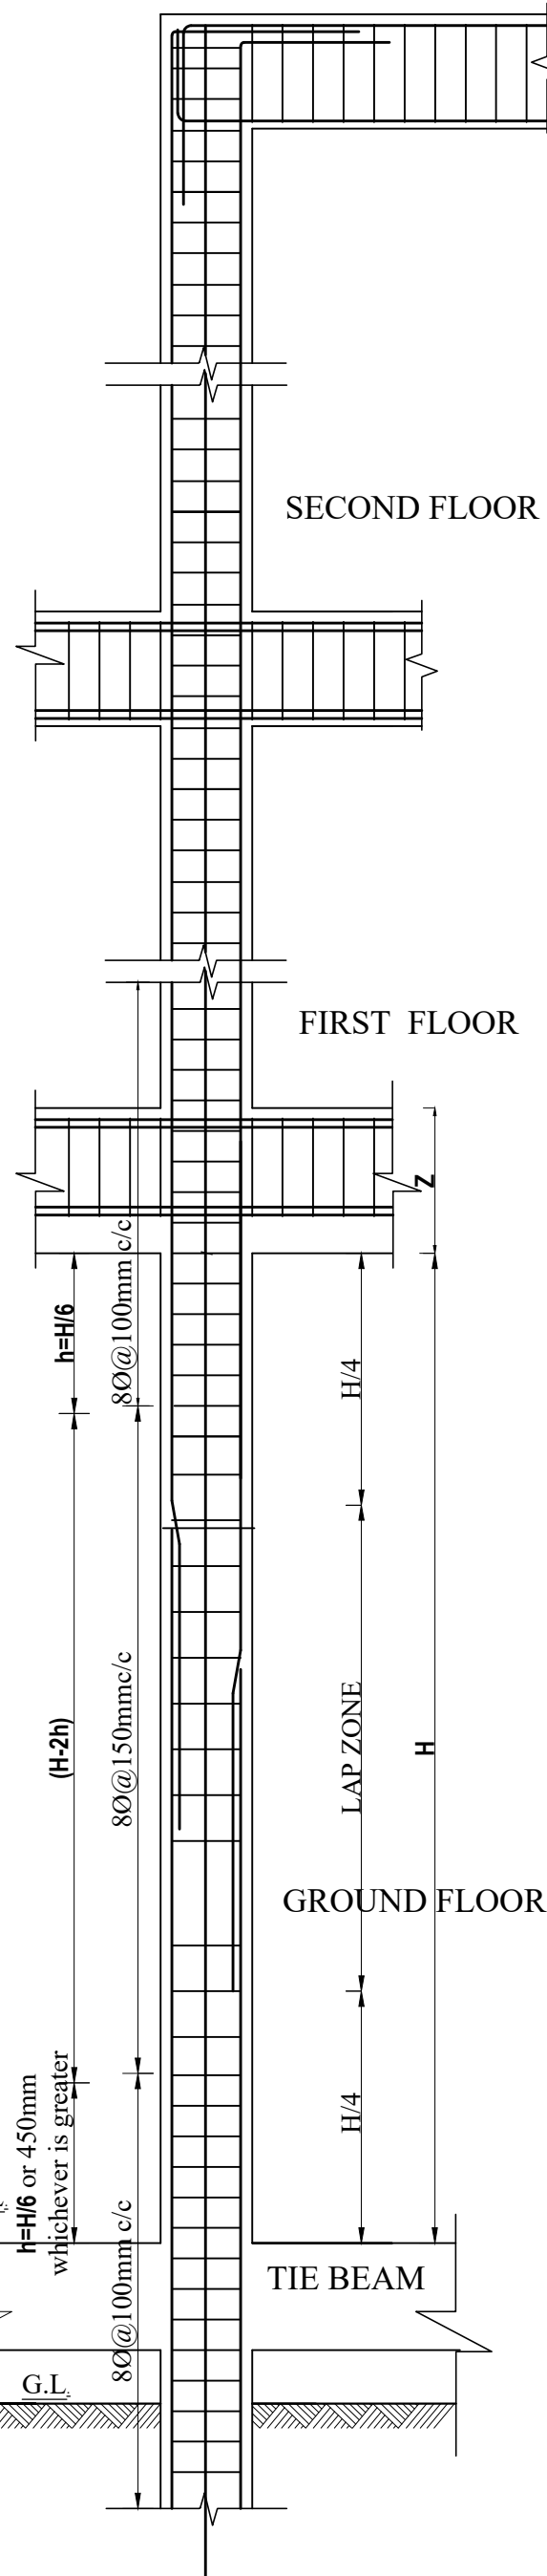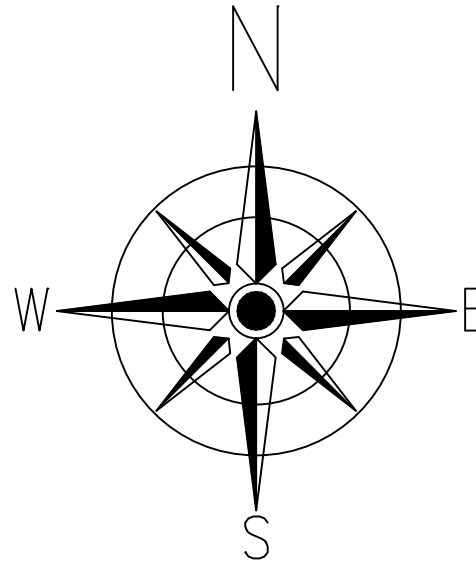

LONGITUDINAL SECTION OF
TYPICAL COLUMN
SCALE-1/2"=1'-0"

OWNER SIGNATURE

MANITA KAFLE

BUILDING TYPE: RESIDENTIAL

PLOT NO: 1890

DETAILS: STRUCTURAL DRAWING

DRAWN BY: ANANTA GAUTAM

CHECKED BY: AMIR DUWADI

DATE: 16 Dec 2021

SCALE: 1:8

NEC NO: 1674 "A"

S. No.: S-1/2

SIGNATURE

MANITA KAFLE

LOCATION: MAHALAXMI WARD NO-07

AREA: 125.19 SQ.M. (0-3-3-3)

DETAILS: STRUCTURAL DRAWING

DRAWN BY: ANANTA GAUTAM


CHECKED BY: AMIR DUWADI

DATE: 16 Dec 2021


SCALE: 1:8

NEC NO: 1674 "A"


S. No.: S-1/2

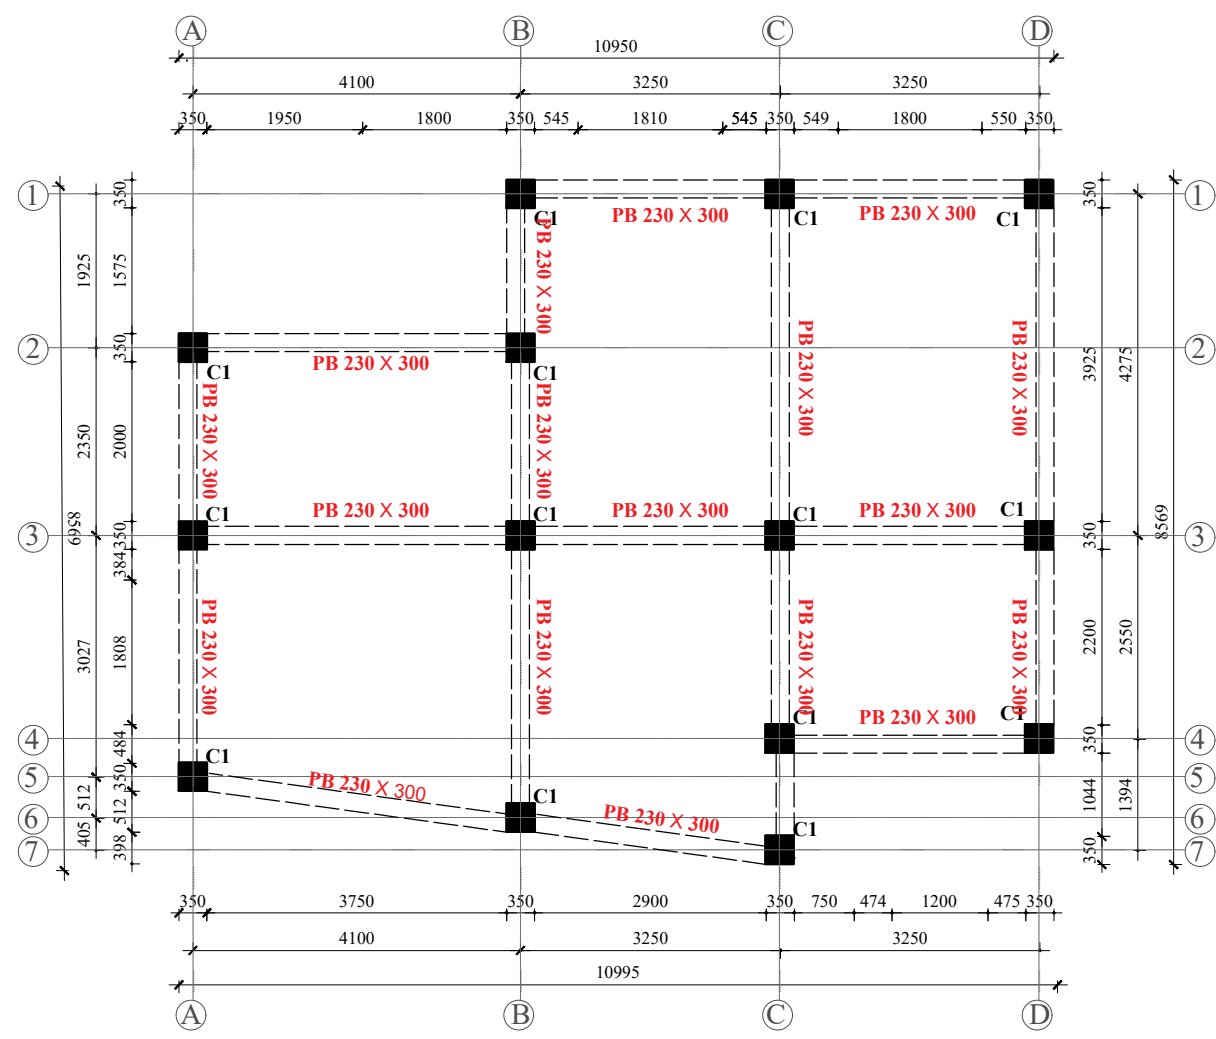



COLUMN & PLINTH BEAM PLAN
SCALE :- 1" = 8'-0"

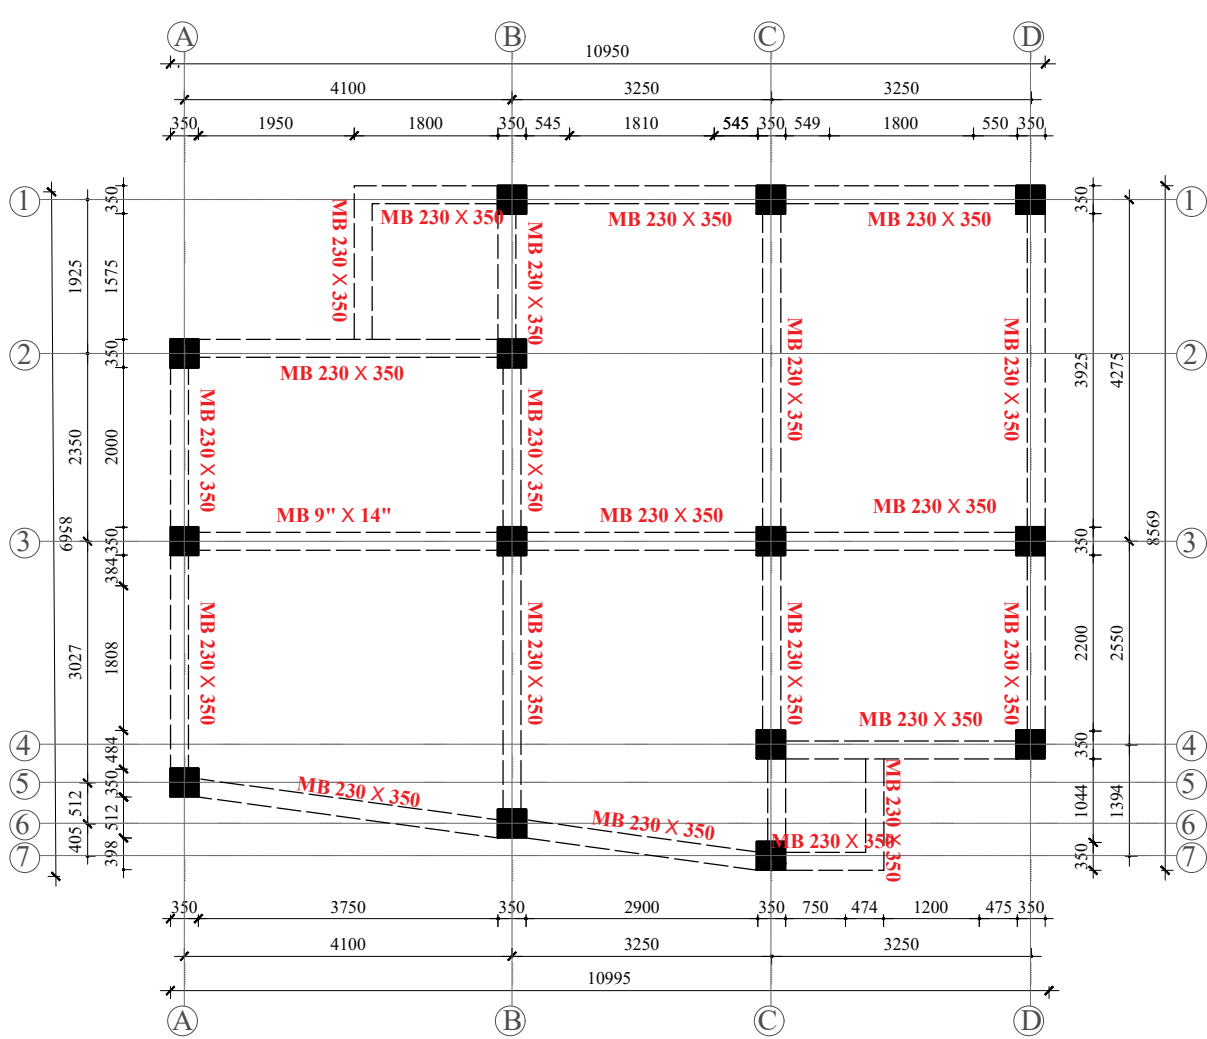

FLOOR BEAM PLAN
SCALE :- 1" = 8'-0"

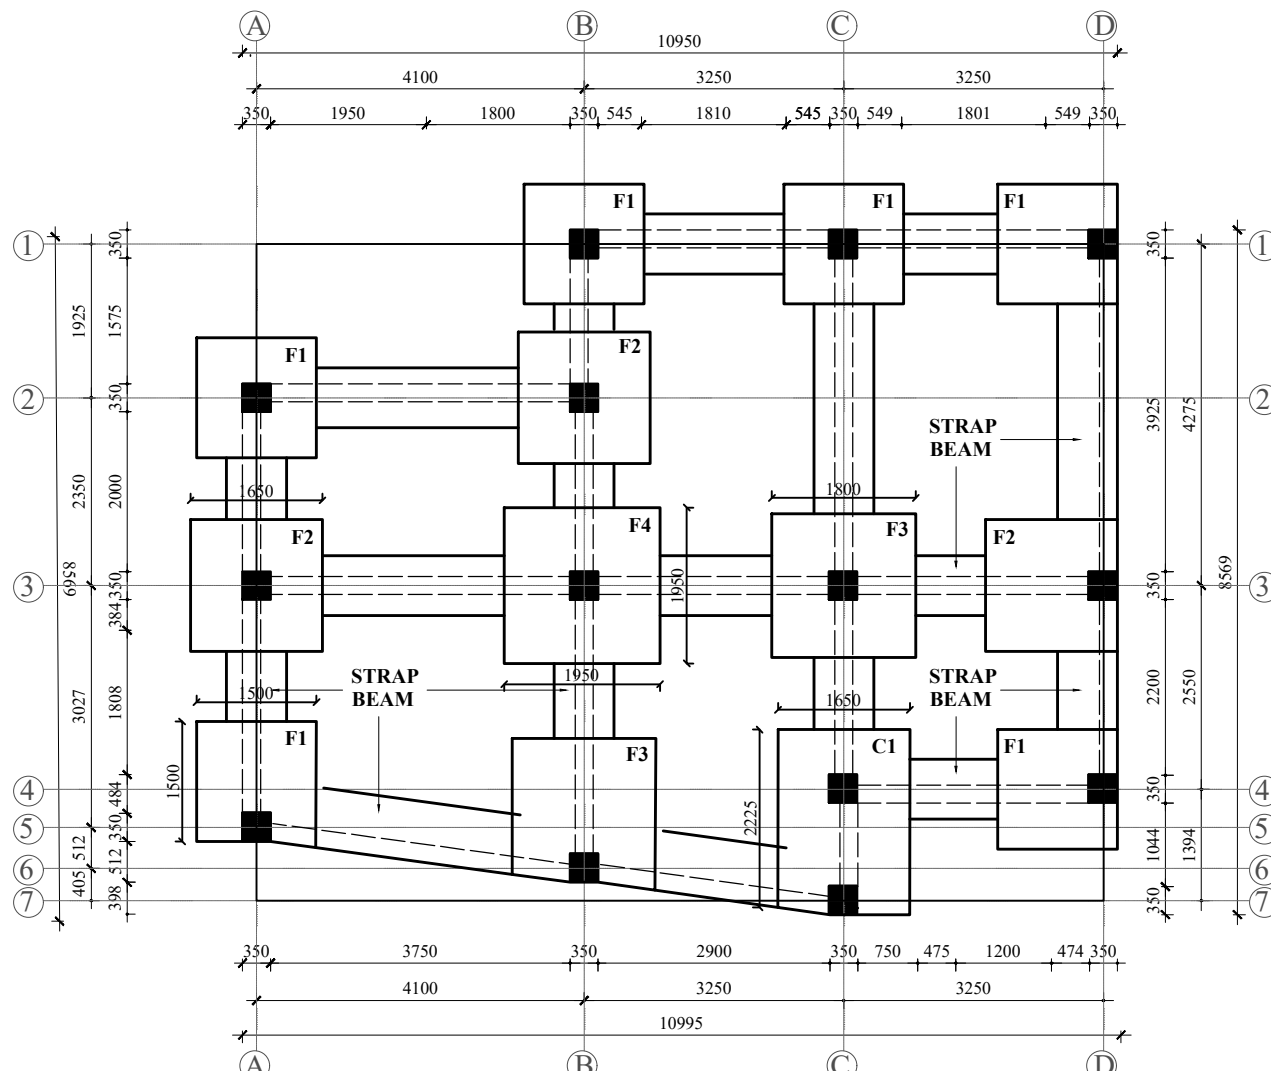


FOUNDATION & TRENCH PLAN
SCALE :- 1" = 8'-0"

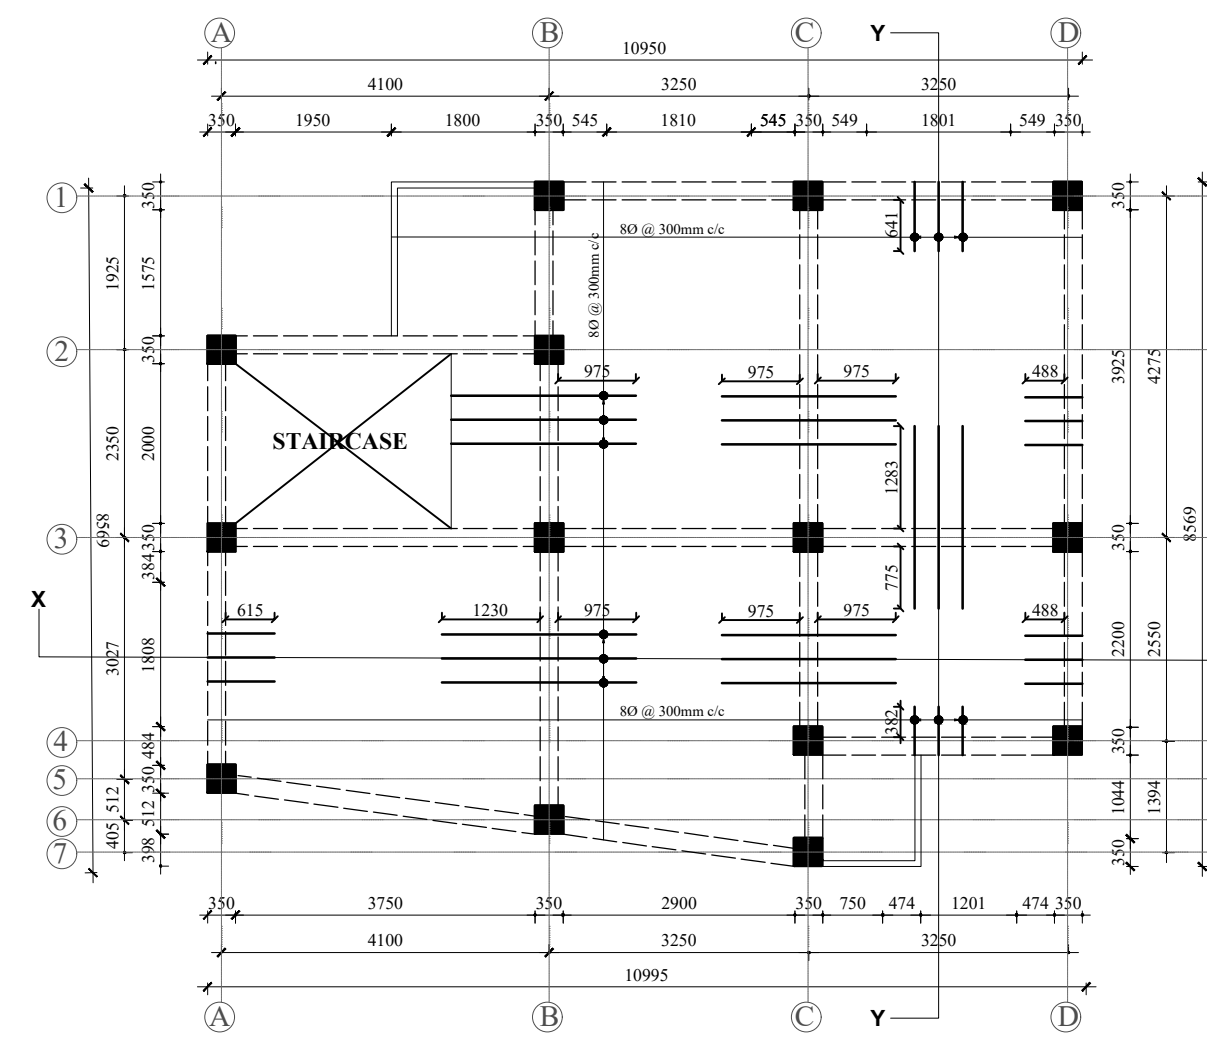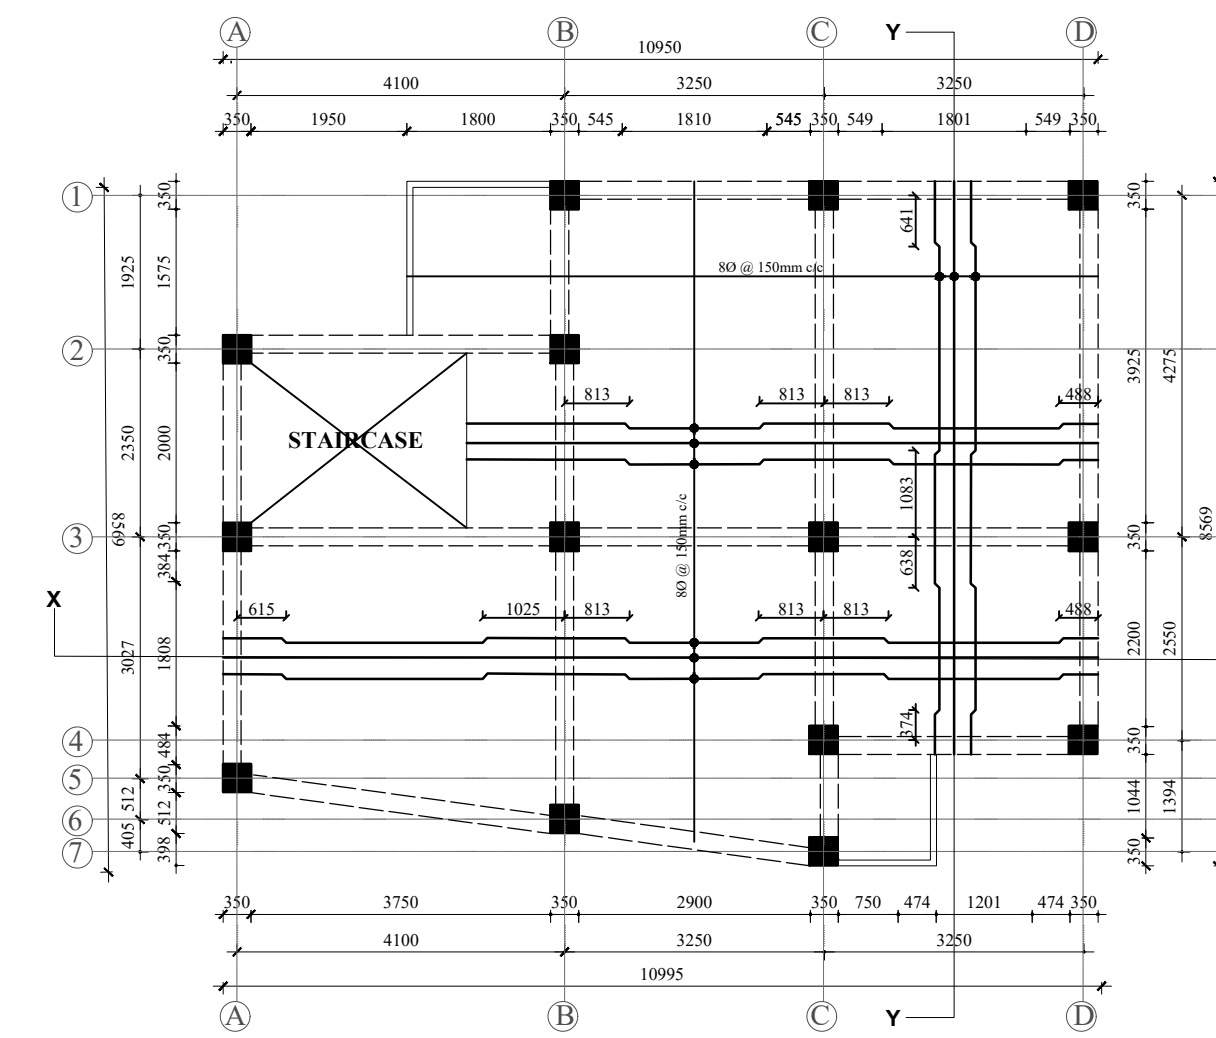


COLUMN DETAILS OF BUILDING			CONCRETE GRADE: M20		STEEL GRADE: TMT Fe 500		
SN	FLOOR DETAIL	SIZE in inch. (bXD)	COLUMN TYPE		LATERAL TIES		SECTION SHAPE OF TIES
			REINFORCEMENT BAR	LONGITUDINAL BAR	IN (h+z)	IN (H-2h)	
1.	BELOW GROUND	350X350	C1	8-Ø16	Ø8@100mm/c	Ø8@100mm/c	  + 
2.	GROUND FLOOR	350X350	C1	8-Ø16	Ø8@100mm/c	Ø8@100mm/c	
3.	FIRST FLOOR	350X350	C1	4-Ø16+4-Ø12	Ø8@100mm/c	Ø8@100mm/c	
4.	SECOND FLOOR	350X350	C1	4-Ø16+4-Ø12	Ø8@100mm/c	Ø8@100mm/c	


FOOTING DETAIL FOR MEDIUM SOIL		CONCRETE GRADE: M20		STEEL GRADE: TMT Fe 500	
S.No	Type	Bearing Capacity =130KN/SQM	Footings Size	Footings depth	Reinforcement bar
			(LXB)	d (mm) D (mm)	X-direction Y-direction
1.	F1		1500 X 1500	500	Ø12@125mm/c
2.	F2		1650 X 1650	500	Ø12@125mm/c
3.	F3		1800 X 1800	500	Ø12@125mm/c
4.	F4		1950 X 1950	500	Ø12@125mm/c
5.	C1		1650 X 2228	400	Ø12@150mm/c

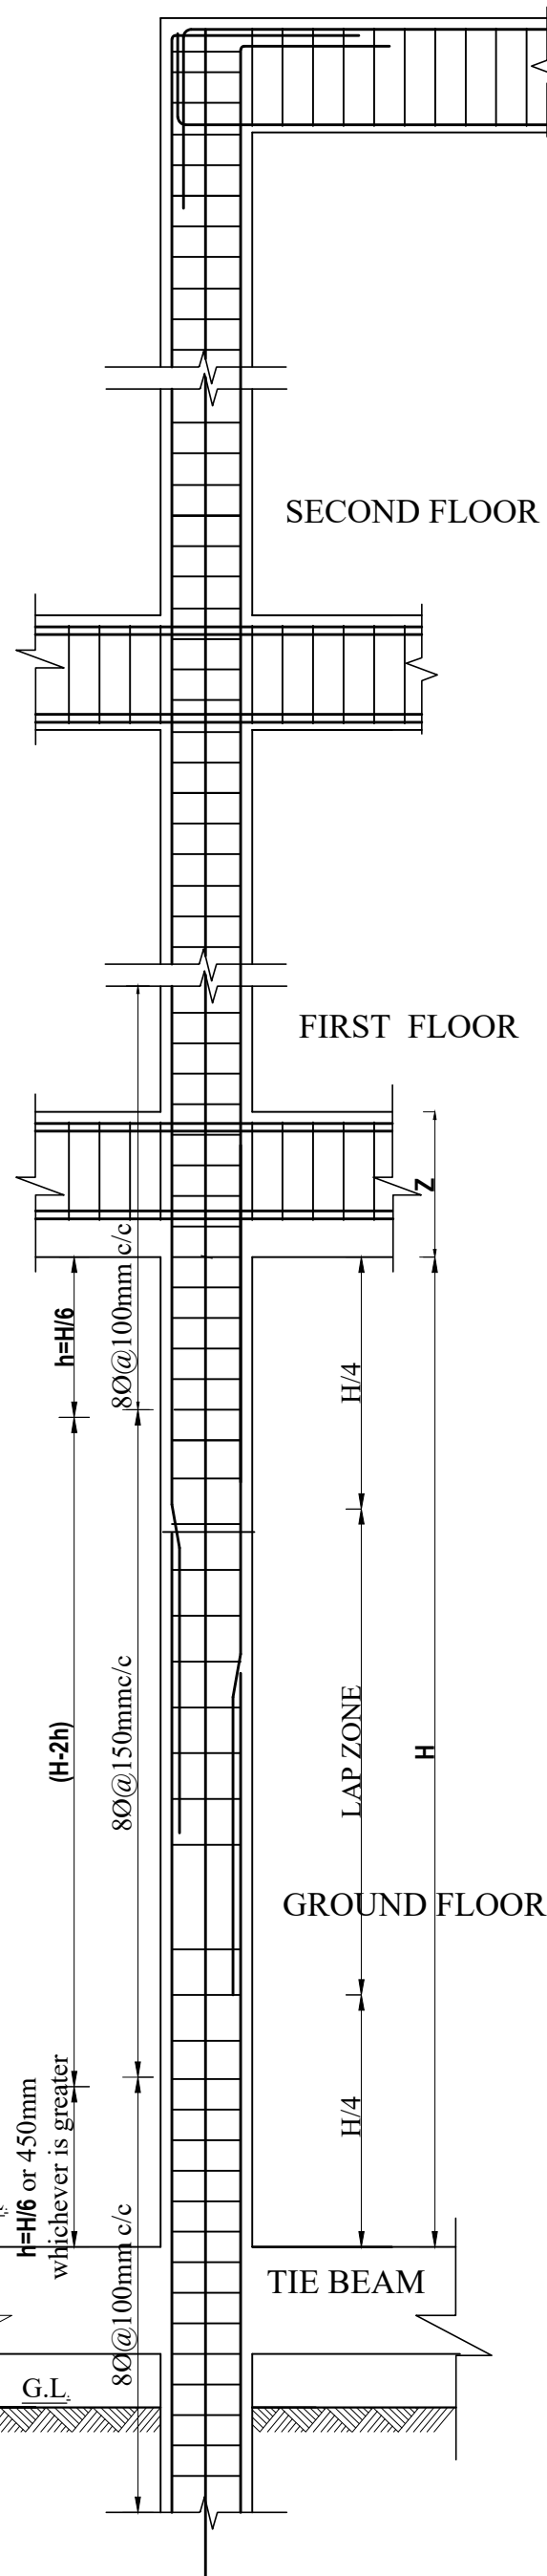


LONGITUDINAL SECTION OF
TYPICAL COLUMN
SCALE:-1/2"=1'-0"

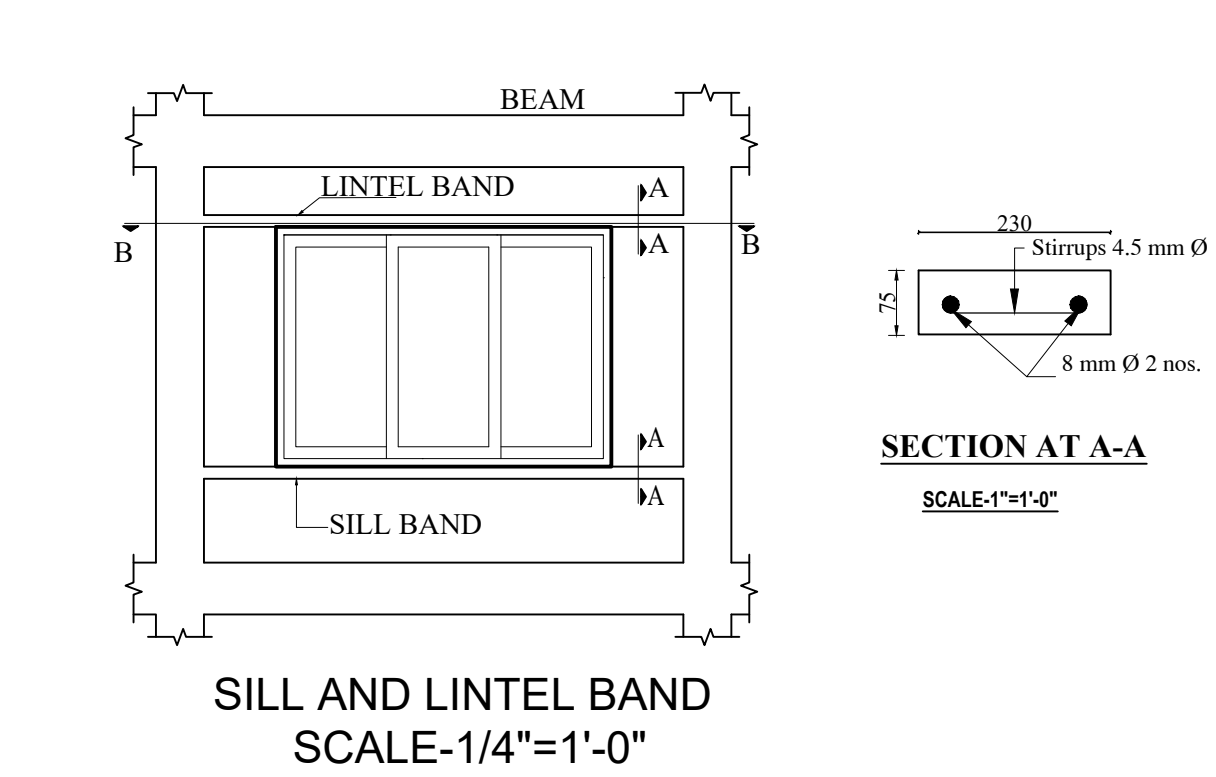


SILL AND LINTEL BAND
SCALE-1/4"=1'-0"

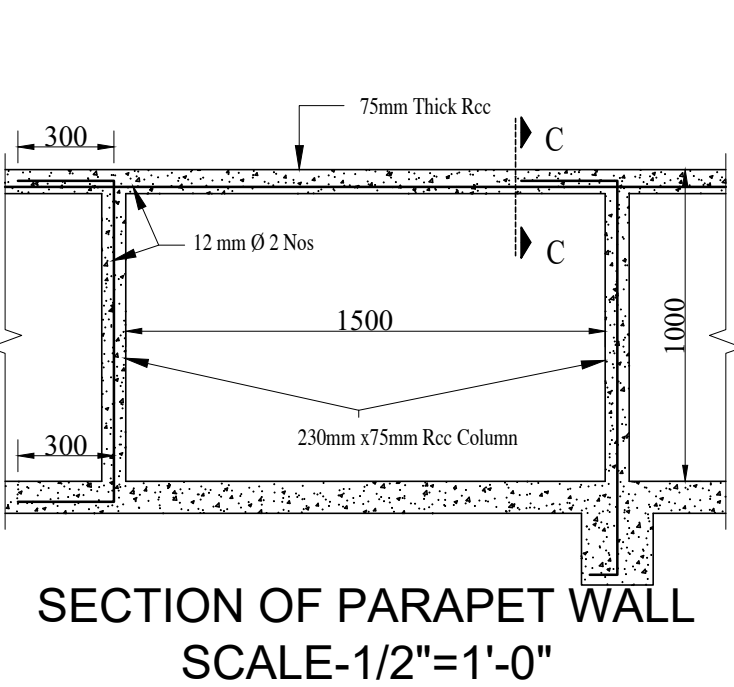


SECTION OF PARAPET WALL
SCALE-1/2"=1'-0"

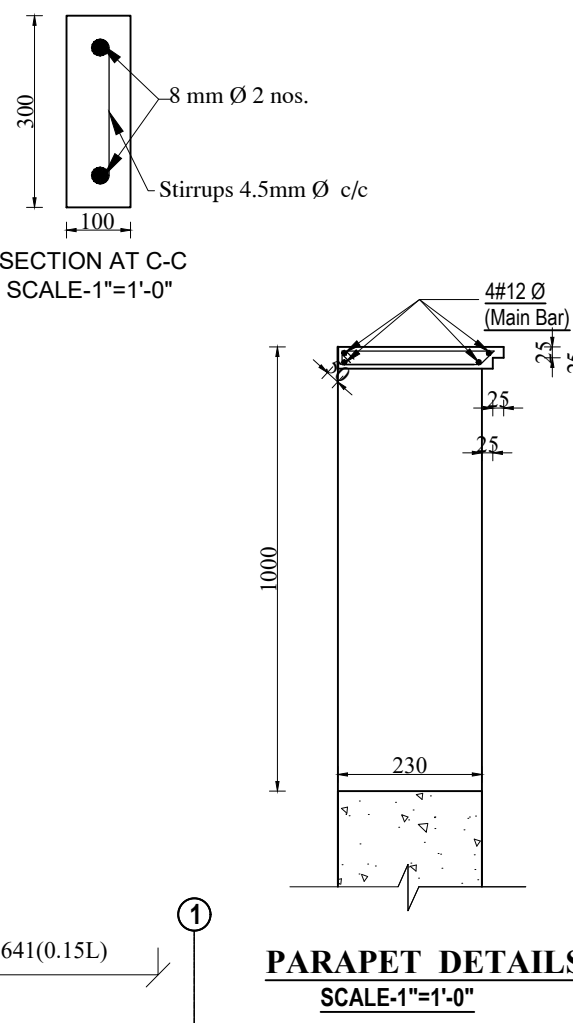


PARAPET DETAILS
SCALE-1"=1'-0"

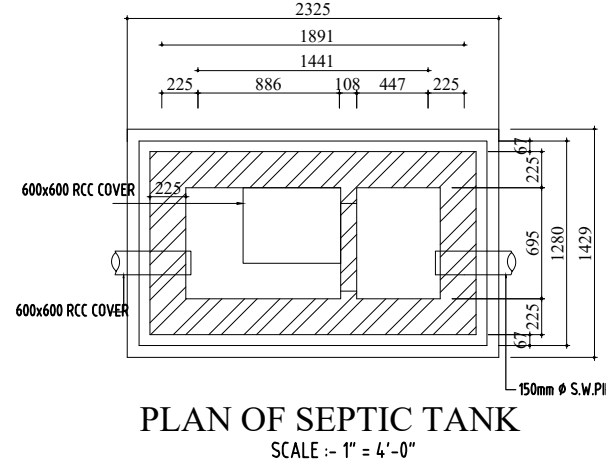


PLAN OF SEPTIC TANK
SCALE :- 1" = 4'-0"

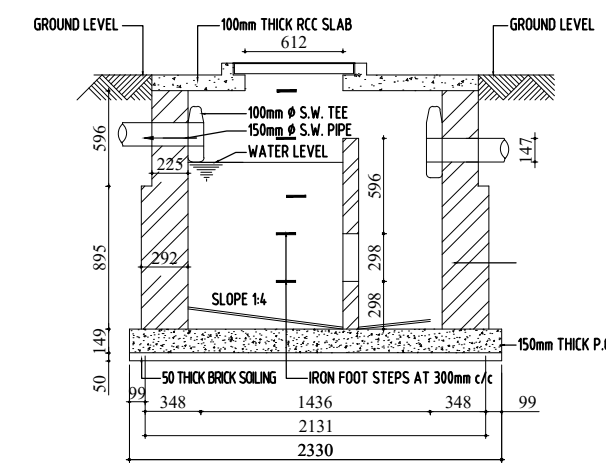


CROSS SECTION OF SEPTIC TANK
SCALE :- 1" = 4'-0"

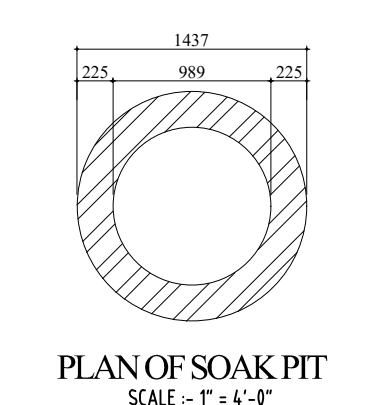


PLAN OF SOAK PIT
SCALE :- 1" = 4'-0"

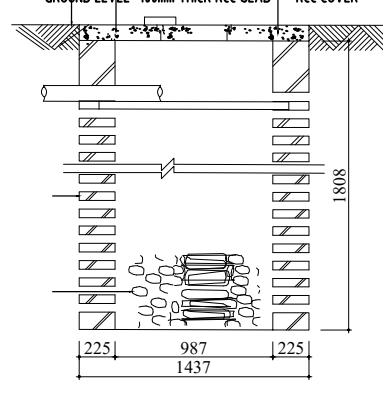

CROSS SECTION OF SOAK PIT
SCALE :- 1" = 4'-0"

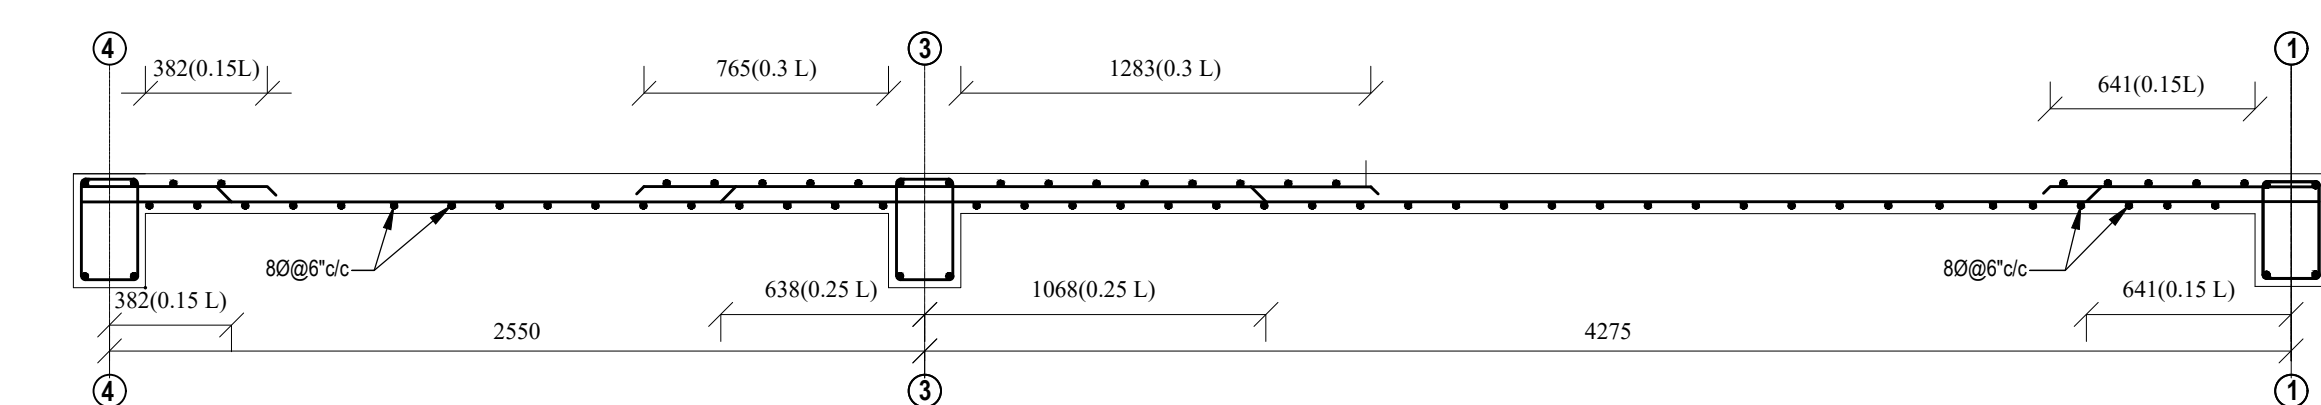

SLAB SECTION AT Y-Y
SCALE : 1/2" = 1'-0"

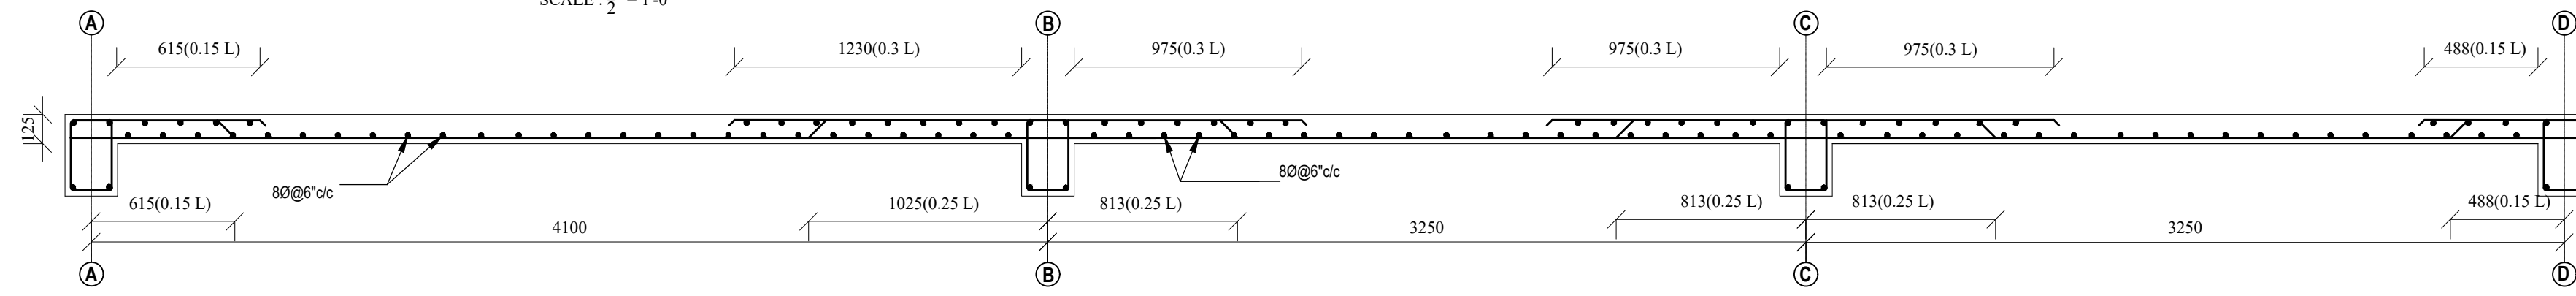

SLAB SECTION AT X-X
SCALE : 1/2" = 1'-0"

STRUCTURE NOTES :

FOUNDATION

CONCRETE & REINFORCING STEEL

- Concrete Grade M20 for all members
- Reinforcing steel shall be new TMT bars having a minimum Yield Strength of 500 MPa.
- The cover to main reinforcing steel be in accordance with IS 456 : 2000 & specified clear cover of concrete :

Slab : 15mm

Beam : 25mm

Foundation : 50mm-75mm

Column : 40mm

Staircase/ RCC wall : 20mm

For concrete members in contact of soil = 50-75mm

- Min.reinforcing laps shall be in accordance with IS 456 : 2000 & as specified on structural drawing.

- Minimum development length for reinforcing bars shall be as follows :

Dia (mm) Ld (mm)

8 480

10 600

12 720

16 960

20 1200

25 1500

28 1680

- Provide corner bars to match horizontal reinforcing steel in slab.

- Bars in columns shall be spliced only at mid height of column.


- Bars splicing in beam shall be avoided in the span where intermediate beam is connected and shall be only as shown in typical drawing.

- Clear vertical distance between two layers of bars=25mm.

- Provide shear reinforcement at 100 c/c at lap locations

- Bar bending schedule shall be submitted by the Contractor for approval before casting concrete.

FOR OFFICIAL USE ONLY

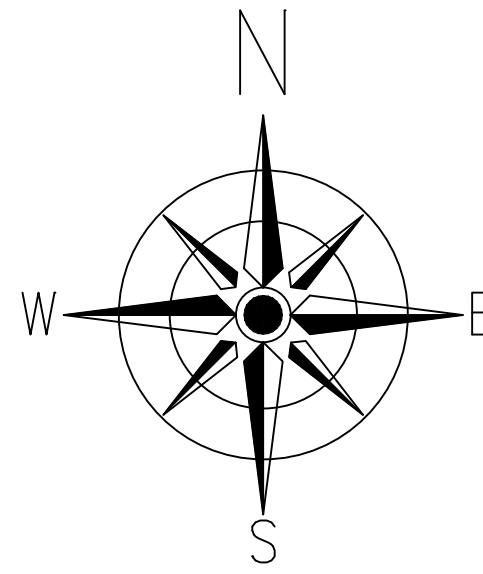

OWNER SIGNATURE

MANITA KAFLE

BUILDING TYPE: RESIDENTIAL

PLOT NO: 1890

DETAILS: STRUCTURAL DRAWING

DRAWN BY: ANANTA GAUTAM

DATE: 16 Dec 2021

SCALE: 1:8

NEC NO: 1674 "A"

S. No.: S-1/2

SIGNATURE

LOCATION: MAHALAXMI WARD NO-07

AREA: 125.19 SQ.M. (0-3-3-3)

CHECKED BY: AMIR DUWADI