

Date	Rabbit ID/USDA #	BW (kg)	% BV removal	Bleed %			Group	Tele ID	EMI info/Particle Conc	
9/13/23	B-22C15/115	1.73	45%	20.00%	15.00%	10.00%	Red cells in albumin	8427	N/A	0.65ml Red
	Baseline	End of Shock (+ min)	End of Res	remove + return PRC in LR in 10 min			End of Bleed	1H post bleed	24H Post Res	48H Post Res
Lac (ABG/VBG)	2	19	19	9.1	6.7	3.6	3.3	1.1	1.3	
CBC	PLT: 275 RBC: 5.51 Hgb: 11.6 Hct: 35.8	PLT: 215 RBC: 3.33 Hgb: 7.3 Hct: 21.4	PLT: 169 RBC: 2.65 Hgb: 5.8 Hct: 17				PLT: 96 RBC: 2.56 Hgb: 6.3 Hct: 18.5	PLT: 111 RBC: 2.89 Hgb: 6.3 Hct: 18.5	PLT: 250 RBC: 3.24 Hgb: 7.1 Hct: 20.7	PLT: RBC: Hct:
HR	259	256	287	288	264	295	291	210	226	
MAP (Syst/Dia)	71 88/58	37 52/27	45 61/33	49 67/33	47 65/31	59 78/50	53 74/42	58 77/42	51 78/43	
TEG CKH TFC5000	CK R: 12.1 CK K: 3.2 CK a: 50.4 CK MA: 57.7 CKH R: CFF MA: LY30: 0	CK R: 15.5 CK K: 5.8 CK a: 35 CK MA: 57 CKH R: CFF MA: LY30: /	CK R: 21 CK K: 4.6 CK a: 41.2 CK MA: 60.2 CKH R: CFF MA: LY30: /				CK R: 27.2 CK K: 10.4 CK a: 21.1 CK MA: 45.7 CKH R: CFF MA: LY30: /	CK R: 17.3 CK K: 2.08 CK a: 57.3 CK MA: 67.6 CKH R: CFF MA: LY30: 0	CK R: CK K: CK a: CK MA: CKH R: CFF MA: LY30:	
	MA HKH: <42 ActF: 10.2 ADP: <10 AA: 12.4 Inhibition/Aggregation ADP: x x AA: x x	MA HKH: 43.2 ActF: - ADP: - AA: - Inhibition/Aggregation ADP: - AA: -	MA HKH: ActF: ADP: AA: Inhibition/Aggregation ADP: AA: /				MA HKH: 52.1 ActF: 10.8 ADP: 18.7 AA: 33.4 Inhibition/Aggregation ADP: 80.9/19.1 AA: 45.3/154.7	MA HKH: 69.4 ActF: 10.8 ADP: 36.2 AA: 67.2 Inhibition/Aggregation ADP: 79.4/20.6 AA: 36.4/63.6	MA HKH: ActF: ADP: AA: Inhibition/Aggregation ADP: AA:	
	APTT: 140.9 PT: 16.8 TT: 17.1 Fibr: 1.07	APTT: 128.9 PT: 12.4 TT: 21.2 Fibr: 2.43	APTT: 96.8 PT: 13.9 TT: 17.5 Fibr: 1.76				APTT: 110.9 PT: 10.8 TT: 18.2 Fibr: 1.25	APTT: 110.9 PT: 12.8 TT: 16.1 Fibr: 1.38	APTT: 134.4 PT: 8 TT: 18.7 Fibr: 2.48	APTT: PT: Fibr:
	CMP	✓	✓	✓				✓	✓	✓
Surgecut	1 min 49 sec							2 min 45 sec	15 sec	
Ultra centrifuge platelet poor plasma	✓							✓	✓	
Time	9:08 am	9:54 am	10:04 am	11:04	12:04	1:04	1:14 pm	2:14 pm	10:04 am	
Hemorrhage start time:										
20 -> 24 22 ml										

Hemorrhage start time:

20 → 24.22 ml
15 → 18.15 ml
10 → 12.11 ml
5.4 + 9.5 ml

RADIOMETER ABL90 SERIES

ABL90 1393-090R0199N0004 06:53 AM 9/13/2023
 PATIENT REPORT Syringe - S 65uL Sample # 19221

Identifications

Patient ID
 Patient last name
 Patient first name
 Sample type Not specified
 T 37.0 °C

Blood gas values

pH 7.488 [-]
 pCO₂ 37.6 mmHg [-]
 pO₂ 89.1 mmHg [-]

Oximetry values

ctHb 11.5 g/dL [-]
 Hct_c 35.1 %
 ‡ sO₂ > 100.0 % [-]
 FO₂Hb 98.8 % [-]
 FCOHb 2.3 % [-]
 ‡ FHHb < 0.0 % [-]
 ‡ FMetHb < 0.0 % [-]

Electrolyte values

cK⁺ 4.3 meq/L [-]
 cCl⁻ 147 meq/L [-]
 cCa²⁺ 3.35 meq/L [-]
 cCl⁻ 107 meq/L [-]

Metabolic values

cGlu 154 mg/dL [-]
 cLac 2.0 mmol/L [-]

Calculated values

cHCO₃⁻(P)_c 28.5 mmol/L
 p50_e 23.70 mmHg
 ABE_c 4.9 mmol/L

Notes


‡ Value(s) above the reportable range
 ‡ Value(s) below the reportable range
 c Calculated value(s)
 e Estimated value(s)
 FHHb 0094: Value below reportable range < 0.0
 FMetHb 0094: Value below reportable range < 0.0
 sO₂ 0093: Value above reportable range > 100.0


RESULT


Animal ID	Owner name	Owner first name
Name	Species Rabbit	
Date of birth		

Sample ID BPRC15_BL	Analysis Date 09/12/2023 10:18:30	Operator JOY
-------------------------------	---	------------------------

Analyser Alarms		QCi
------------------------	--	-----

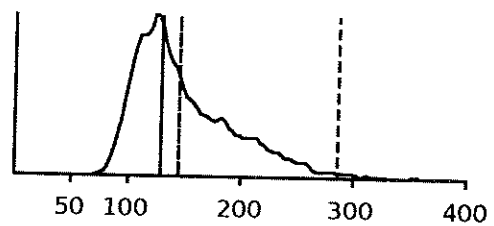WBC	4.5	10 ³ /mm ³	Normal range 2.5 13.8	
LYM%	--,--	%		WBC 
MON%	--,--	%		
GRA%	--,--	%		
(EOS%)	--,--	%		
LYM#	--,--	10 ³ /mm ³		
MON#	--,--	10 ³ /mm ³		
GRA#	--,--	10 ³ /mm ³		
EOS#	--,--	10 ³ /mm ³		

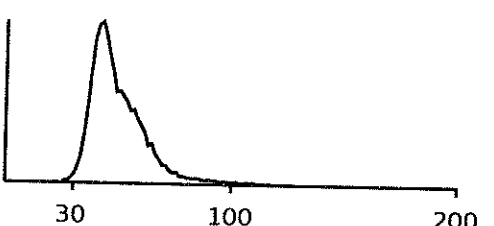RBC	5.51	10 ⁶ /mm ³	4.80 7.20	
HGB	11.6	g/dl	10.6 16.0	RBC 
HCT	35.8	%	33.9 50.1	
MCV	65	μm ³	62 79	
MCH	21.1	pg	19.0 25.6	
MCHC	32.5	g/dl	28.4 35.0	
RDW	--,--	%		

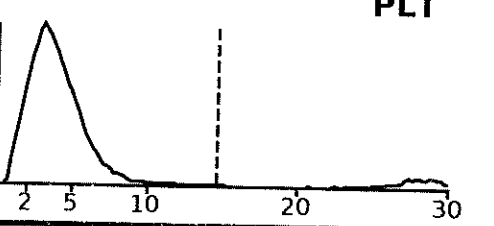PLT	275	10 ³ /mm ³	0 962	
MPV	--,--	μm ³		PLT 

RESULTS

ANIMAL NAME:Bprc15_bl

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:2

AGEGroup:Juvenile

SAMPLE TYPE:Plasma

REAGENT BATCH NO.:9230932

PLATE ID:019809230932

OPERATOR ID:

LAB.:

TEST TIME:2023-09-13 08:07

MACHINE ID:120007423

PRINT TIME:2023-09-13 08:08

Ver:V1.00.01.09/1.00.01.50



Assay	Result	Ref	Low	Normal	High
ALB	4.2g/dL	H 2.2-3.7			
TP	5.9g/dL	5.5-7.2			
GLOB	1.8g/dL	L 2.5-4.8			
A/G	2.33				
TB	0.1mg/dL	0.0-0.8			
GGT	6U/L	0-14			
AST	65U/L	0-98			
ALT	73U/L	5-106			
ALP	148U/L	H 20-145			
TBA	22.39umol/L				
AMY	283U/L	200-378			
LPS	88U/L	0-100			
LDH	180U/L	H 34-129			
CK	> 4000U/L	H 138-2705			
Crea	0.5mg/dL	L 0.7-1.8			
UA	<10.00umol/L	0.00-130.00			
BUN	13.94mg/dL	10.12-28.10			
BUN/CREA	116.939	21.000-236.000			
GLU	173.57mg/dL	H 75.14-171.19			
TC	85.40mg/dL	34.65-94.33			
TG	217.93mg/dL	H 26.10-153.12			
tCO2	22.3mmol/L	13.0-27.0			
Ca	12.71mg/dL	5.60-13.84			
PHOS	7.01mg/dL	H 1.21-4.90			

CK> detection limit. Please dilute sample and re-test

WAT:0

EMP:0

CHE:0

1346G6882

RESULTS

ANIMAL NAME:Bprc15_bl

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:11

AGEGroup:Juvenile

SAMPLE TYPE:Whole Blood

REAGENT BATCH NO.:9220088

PLATE ID:006509220088

OPERATOR ID:

LAB.:

TEST TIME:2023-09-12 11:46

MACHINE ID:120007423

PRINT TIME:2023-09-12 11:47

Ver:V1.00.01.09/1.00.01.50




Assay	Result	Ref	Low	Normal	High
APTT	140.9s				
PT	16.8s				
TT	17.7s				
Fib	1.09g/L				

WAT:0

EMP:0

CHE:0

9223G3621

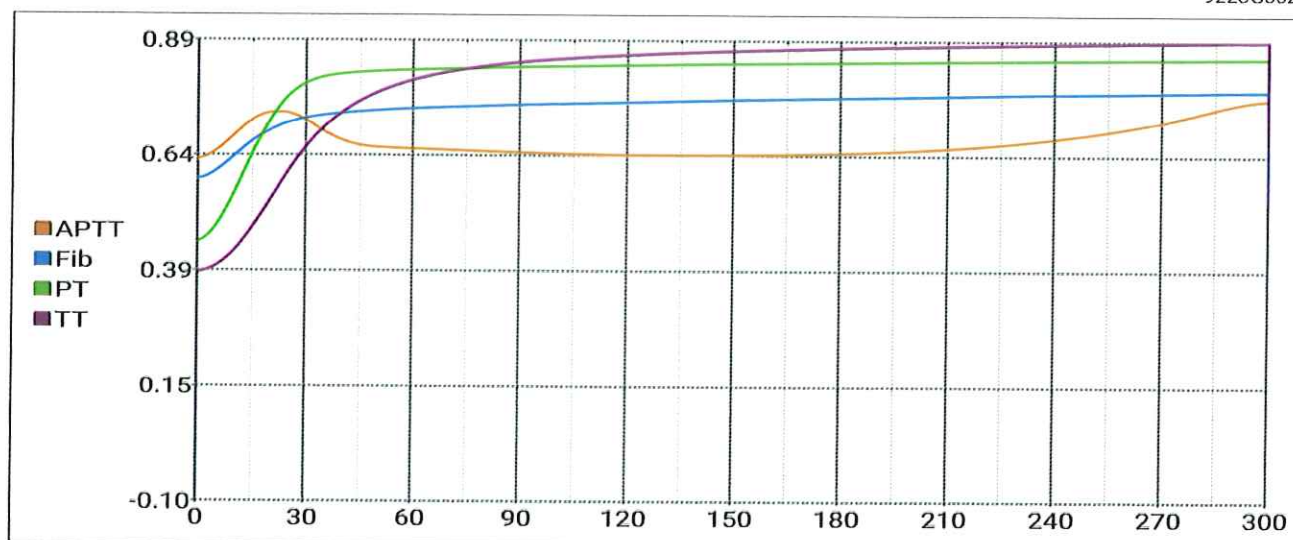


Note: The project curves from top to bottom are:APTT,Fib,PT,TT.

TEG® Analysis

Generated: 9/12/2023 11:36:27AM

Database: C:\Program Files\TEG\Patients.teg

Patient: BPRC15 ID: Rabbit Birthdate: Age: SSN: Gender:	Sample Date: 9/12/2023 Time on: 10:56 AM Off: 11:37 AM Duration: 41 min
Sample type: Citrated kaolin Description: Baseline	Channel: 1 Sample status: Finished Temp: 37
Additional notes:	Site ID:
	Operator ID: Temporary Operator
	Ordered by:
	Platelet drugs administered: No Bleeding state:
	Patient temperature:
	Accession #:
	Analyzer SN: S101707022

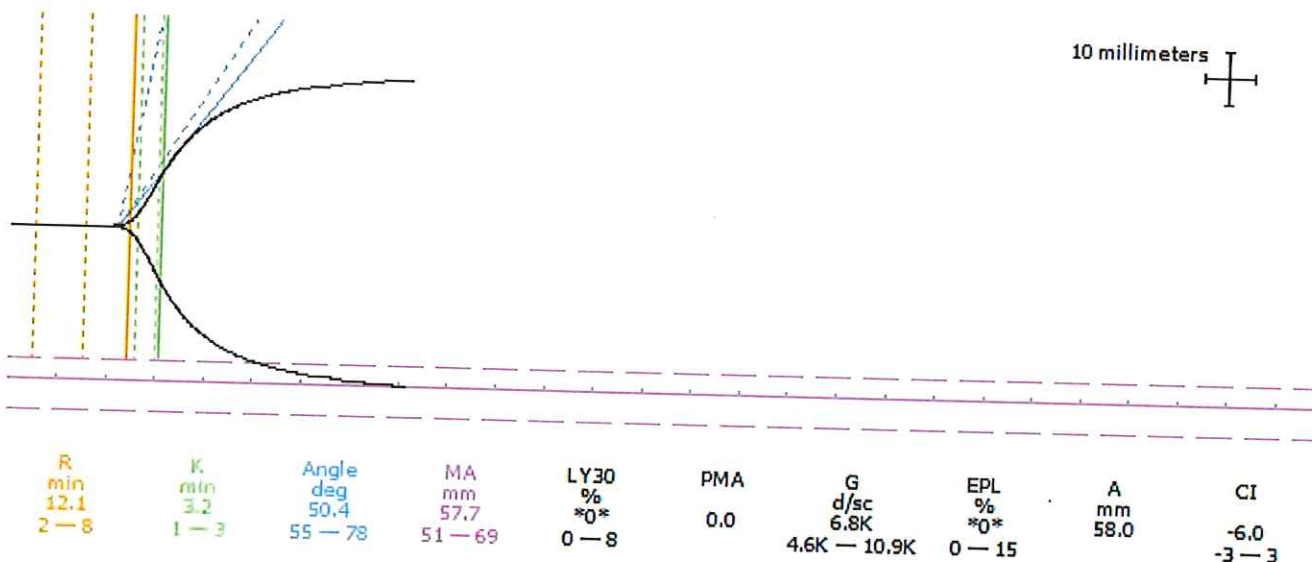

Result reported:

Reported date:

Reported by:

Physician interpretation

Sample data:		Units:	Normal values:		CPT/Billing codes:
R:	12.1	min	<high>	(2 — 8)	85347 Activated clotting time (R)
K:	3.2	min	<high>	(1 — 3)	
Angle:	50.4	deg	<low>	(55 — 78)	85384 Fibrinogen activity (Angle)
MA:	57.7	mm		(51 — 69)	85576 Platelet aggregation (MA)
LY30:	*0.0*	%		(0 — 8)	
PMA:	0.0				
G:	6.8K	d/sc		(4.6K — 10.9K)	
EPL:	*0.0*	%		(0 — 15)	85390 Fibrinolysis (EPL / LY30)
A:	58.0	mm			
CI:	-6.0		<low>	(-3 — 3)	85999 Prothrombotic state (CI)

Interim values are surrounded by asterisks - Results final

RADIOMETER ABL90 SERIES

ABL90 I393-090R0199N0004 09:15 AM 9/13/2023
 PATIENT REPORT Syringe - S 65uL Sample # 19226

Identifications

Patient ID
 Patient last name
 Patient first name
 Sample type Not specified
 T 37.0 °C

Blood gas values

pH	7.304		[	-	]
pCO ₂	34.8	mmHg	[	-	]
pO ₂	91.4	mmHg	[	-	]

Oximetry values

ctHb	7.2	g/dL	[	-	]
Hct _c	21.9	%			
sO ₂	98.2	%	[	-	]
FO ₂ Hb	96.6	%	[	-	]
FCOHb	2.3	%	[	-	]
FHHb	1.8	%	[	-	]
‡ FMetHb	< 0.0	%	[	-	]

Electrolyte values

cK ⁺	3.6	meq/L	[	-	]
cNa ⁺	146	meq/L	[	-	]
cCa ²⁺	2.71	meq/L	[	-	]
cCl ⁻	102	meq/L	[	-	]

Metabolite values

cGlu	369	mg/dL	[	-	]
cLac	19	mmol/L	[	-	]

Calculated values




cHCO ₃ ⁻ (P) _c	17.3	mmol/L
p50 _e	28.33	mmHg
ABE _c	-8.3	mmol/L

Notes

‡ Value(s) below the reportable range
 c Calculated value(s)
 e Estimated value(s)
 FMetHb 0094: Value below reportable range < 0.0

Solution pack lot: PD-04 Sensor cassette run #:
 Printed 9:15:31AM 9/13/2023 2704-401

RESULT

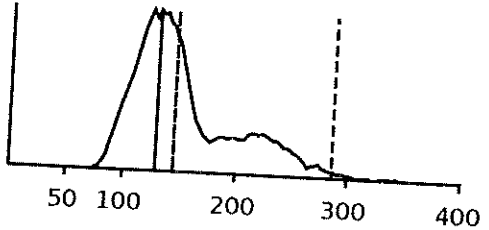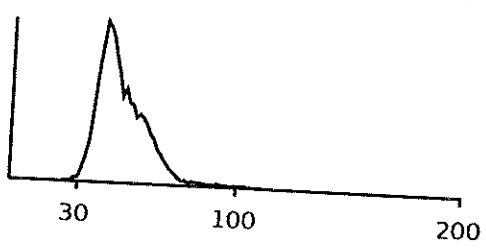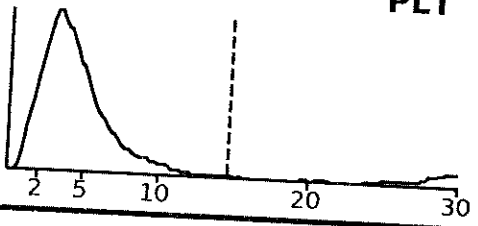Animal ID	Owner name	Owner first name
Name	Species Rabbit	
Date of birth		
Sample ID BPRC15_EOS	Analysis Date 09/13/2023 09:35:20	Operator MEB
Analyser Alarms Analysis Alarms		
WBC	4.2	10 ³ /mm ³
LYM%	---	%
MON%	---	%
GRA%	---	%
(EOS%)	---	%
LYM#	---	10 ³ /mm ³
MON#	---	10 ³ /mm ³
GRA#	---	10 ³ /mm ³
EOS#	---	10 ³ /mm ³
		Normal range 2.5 13.8
		WBC
		
RBC	3.33	L 10 ⁶ /mm ³
HGB	7.3	L g/dl
HCT	21.4	L %
MCV	64	μm ³
MCH	22.1	pg
MCHC	34.3	g/dl
RDW	---	%
		4.80 7.20 10.6 16.0 33.9 50.1 62 79 19.0 25.6 28.4 35.0
		RBC
		
PLT	218	10 ³ /mm ³
MPV	---	μm ³
		0 962
		PLT
		

Printed on 09/13/2023 09:35:23

Printed by MEB

ESV60 N° 012EVOH15667

RESULTS

ANIMAL NAME:Bprc15_eos

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:10

AGEGroup:Juvenile

SAMPLE TYPE:Plasma

REAGENT BATCH NO.:9230932

PLATE ID:019809230932

OPERATOR ID:

LAB.:

TEST TIME:2023-09-13 10:44

MACHINE ID:120007423

PRINT TIME:2023-09-13 10:44

Ver:V1.00.01.09/1.00.01.50



Assay	Result	Ref	Low	Normal	High
ALB	3.1g/dL	2.2-3.7			
TP	4.4g/dL	L 5.5-7.2			
GLOB	1.3g/dL	L 2.5-4.8			
A/G	2.37				
TB	<0.0mg/dL	0.0-0.8			
GGT	<2U/L	0-14			
AST	397U/L	H 0-98			
ALT	104U/L	5-106			
ALP	112U/L	20-145			
TBA	8.22umol/L				
AMY	254U/L	200-378			
LPS	83U/L	0-100			
LDH	560U/L	H 34-129			
CK	> 4000U/L	H 138-2705			
Crea	1.2mg/dL	0.7-1.8			
UA	<10.00umol/L	0.00-130.00			
BUN	26.93mg/dL	10.12-28.10			
BUN/CREA	90.506	21.000-236.000			
GLU	383.82mg/dL	H 75.14-171.19			
TC	82.96mg/dL	34.65-94.33			
TG	226.37mg/dL	H 26.10-153.12			
tCO2	15.6mmol/L	13.0-27.0			
Ca	10.13mg/dL	5.60-13.84			
PHOS	9.52mg/dL	H 1.21-4.90			

CK> detection limit. Please dilute sample and re-test

WAT:0

EMP:0

CHE:0

9390J6248

RESULTS

UMB

ANIMAL NAME:Bprc15_eos

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:7

AGEGroup:Juvenile

SAMPLE TYPE:Whole Blood

REAGENT BATCH NO.:9230926

PLATE ID:006509230926

OPERATOR ID:

LAB.:

TEST TIME:2023-09-13 10:05

MACHINE ID:120007423

PRINT TIME:2023-09-13 10:05

Ver:V1.00.01.09/1.00.01.50




Assay	Result	Ref	Low	Normal	High
APTT	128.9s				
PT	12.4s				
TT	21.2s				
Fib	2.93g/L				

WAT:1

EMP:0

CHE:0

7219E3934

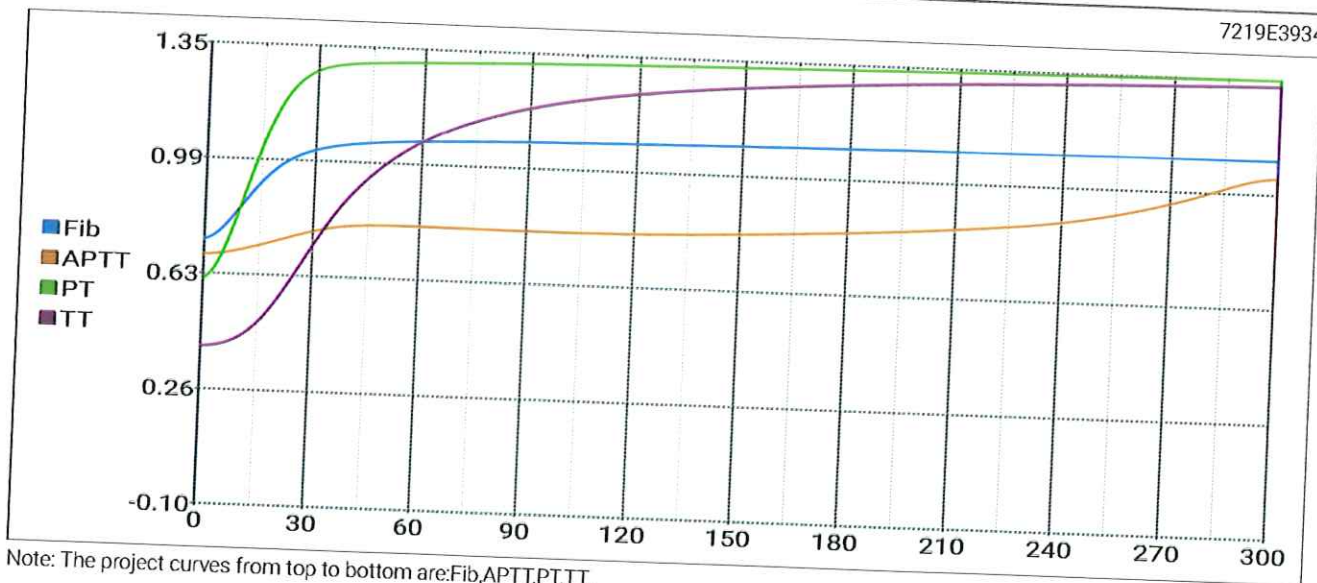

TEG® Analysis

Generated: 9/13/2023 12:41:26PM

Database: C:\Program Files\TEG\Patients.teg

Patient: BPRC15

ID: Rabbit

Birthdate:

Age:

SSN:

Gender:

Sample type: Citrated kaolin with heparinase

Description: EOS

Additional notes:

Sample Date: 9/13/2023

Time on: 10:23 AM

Off: 11:17 AM

Duration: 54 min

Channel: 1

Sample status: Finished

Temp: 37

Site ID:

Operator ID: Temporary Operator

Ordered by:


Platelet drugs administered: No

Bleeding state:

Patient temperature:

Accession #:

Analyzer SN: S101707022

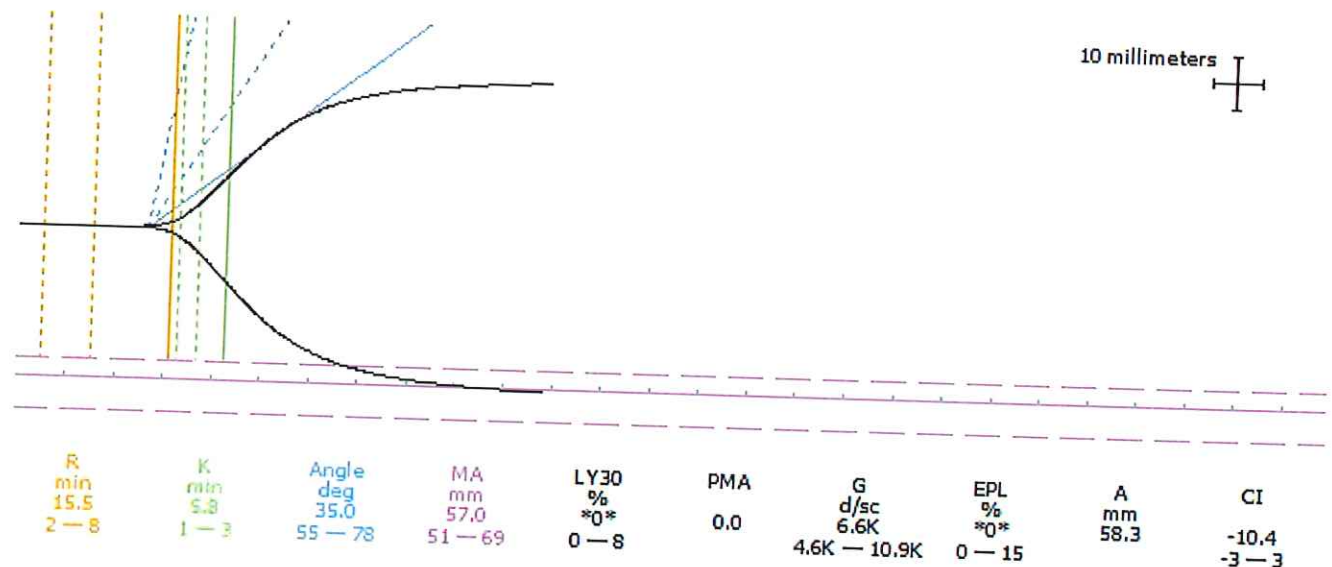

Result reported:

Reported date:

Reported by:

Physician interpretation

Sample data:		Units:	Normal values:		CPT/Billing codes:
R:	15.5	min	<high>	(2 — 8)	85347 Activated clotting time (R)
K:	5.8	min	<high>	(1 — 3)	
Angle:	35.0	deg	<low>	(55 — 78)	85384 Fibrinogen activity (Angle)
MA:	57.0	mm		(51 — 69)	85576 Platelet aggregation (MA)
LY30:	*0.0*	%		(0 — 8)	
PMA:	0.0				
G:	6.6K	d/sc		(4.6K — 10.9K)	
EPL:	*0.0*	%		(0 — 15)	85390 Fibrinolysis (EPL / LY30)
A:	58.3	mm			
CI:	-10.4		<low>	(-3 — 3)	85999 Prothrombotic state (CI)

Interim values are surrounded by asterisks - Results final

RADIOMETER ABL90 SERIES

ABL90 I393-090R0199N0004

09:26 AM

9/13/2023

PATIENT REPORT

Syringe - S 65uL

Sample #

19230

Identifications

Patient ID

Patient last name

Patient first name

Sample type

Not specified

FOR

T

37.0 °C

Blood gas values

pH 7.267 [-]

pCO₂ 36.3 mmHg [-]

pO₂ 96.2 mmHg [-]

Oximetry values

cHb 5.7 g/dL [-]

Hct_c 17.5 % [-]

sO₂ 99.0 % [-]

FO₂Hb 97.4 % [-]

FCOHb 2.3 % [-]

FHHb 1.0 % [-]

‡ FMetHb < 0.0 % [-]

Electrolyte values

cK⁺ 3.0 meq/L [-]

cNa⁺ 146 meq/L [-]

cCa²⁺ 2.69 meq/L [-]

cCl⁻ 103 meq/L [-]

Metabolite values

cGlu 329 mg/dL [-]

cLac 19 mmol/L [-]

Calculated values

cHCO₃⁻(P)_c 16.5 mmol/L

p50_e 29.45 mmHg

ABE_c -9.6 mmol/L

Notes

‡ Value(s) below the reportable range

c Calculated value(s)

e Estimated value(s)

FMetHb 0094: Value below reportable range < 0.0

Solution pack lot: PD-04

Sensor cassette run #:


Printed 9:26:35AM 9/13/2023

2704-401


RESULT

Animal ID	Owner name	Owner first name
Name	Species Rabbit	
Date of birth		
Sample ID BPRC15_EOR	Analysis Date 09/13/2023 09:41:30	Operator MEB

Analyser Alarms		
Analysis Alarms		

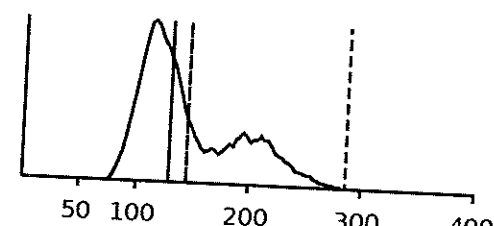WBC	3.6	$10^3/\text{mm}^3$	Normal range 2.5 13.8	
LYM%	---	%		WBC 
MON%	---	%		
GRA%	---	%		
(EOS%)	---	%		
LYM#	---	$10^3/\text{mm}^3$		
MON#	---	$10^3/\text{mm}^3$		
GRA#	---	$10^3/\text{mm}^3$		
EOS#	---	$10^3/\text{mm}^3$		

RBC	2.65	L $10^6/\text{mm}^3$	4.80 7.20	
HGB	5.8	L g/dl	10.6 16.0	RBC 
HCT	17.0	L %	33.9 50.1	
MCV	64	μm^3	62 79	
MCH	21.8	pg	19.0 25.6	
MCHC	33.9	g/dl	28.4 35.0	
RDW	---	%		

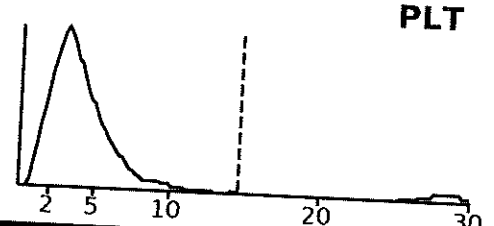PLT	169	$10^3/\text{mm}^3$	0 962	
MPV	---	μm^3		PLT 

Printed on 09/13/2023 09:41:33

Printed by MEB

ESV60 N° 012EVOH15667

RESULTS

ANIMAL NAME:Bprc15_eor

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:11

AGEGroup:Juvenile

SAMPLE TYPE:Plasma

REAGENT BATCH NO.:9231004

PLATE ID:019809231004

OPERATOR ID:

LAB.:

TEST TIME:2023-09-13 10:58

MACHINE ID:120007423

PRINT TIME:2023-09-13 10:58

Ver:V1.00.01.09/1.00.01.50



Assay	Result	Ref	Low	Normal	High
ALB	2.5g/dL	2.2-3.7			
TP	3.5g/dL	L 5.5-7.2			
GLOB	1.0g/dL	L 2.5-4.8			
A/G	2.61				
TB	<0.0mg/dL	0.0-0.8			
GGT	<2U/L	0-14			
AST	373U/L	H 0-98			
ALT	89U/L	5-106			
ALP	91U/L	20-145			
TBA	5.80umol/L				
AMY	208U/L	200-378			
LPS	60U/L	0-100			
LDH	470U/L	H 34-129			
CK	> 4000U/L	H 138-2705			
Crea	1.4mg/dL	0.7-1.8			
UA	<10.00umol/L	0.00-130.00			
BUN	25.24mg/dL	10.12-28.10			
BUN/CREA	74.639	21.000-236.000			
GLU	326.77mg/dL	H 75.14-171.19			
TC	59.42mg/dL	34.65-94.33			
TG	200.38mg/dL	H 26.10-153.12			
tCO2	15.2mmol/L	13.0-27.0			
Ca	9.10mg/dL	5.60-13.84			
PHOS	8.08mg/dL	H 1.21-4.90			

CK> detection limit. Please dilute sample and re-test

WAT:0

EMP:0

CHE:0

3315F7111

RESULTS

ANIMAL NAME:Bprc15_eor

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:8

AGEGroup:Juvenile

SAMPLE TYPE:Whole Blood

REAGENT BATCH NO.:9230926

PLATE ID:006509230926

OPERATOR ID:

LAB.:

TEST TIME:2023-09-13 10:16

MACHINE ID:120007423

PRINT TIME:2023-09-13 10:16

Ver:V1.00.01.09/1.00.01.50




Assay	Result	Ref	Low	Normal	High
APTT	96.8s				
PT	13.9s				
TT	17.5s				
Fib	1.76g/L				

WAT:2

EMP:0


CHE:0

7666G4595

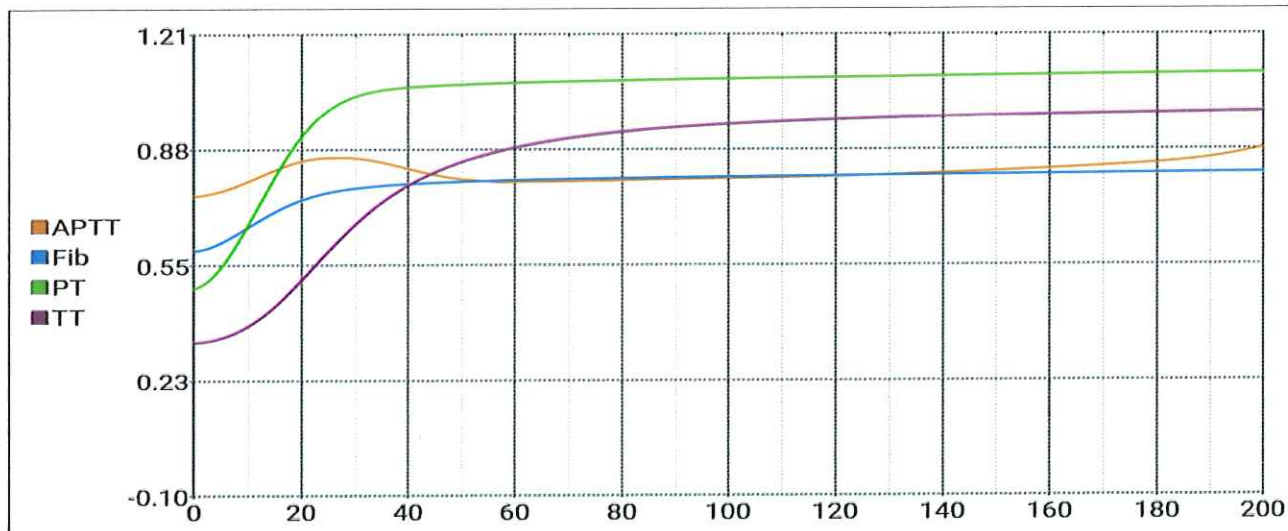

Note: The project curves from top to bottom are:APTT,Fib,PT,TT.

Sample: 9/13/2023 10:25AM-11:17AM

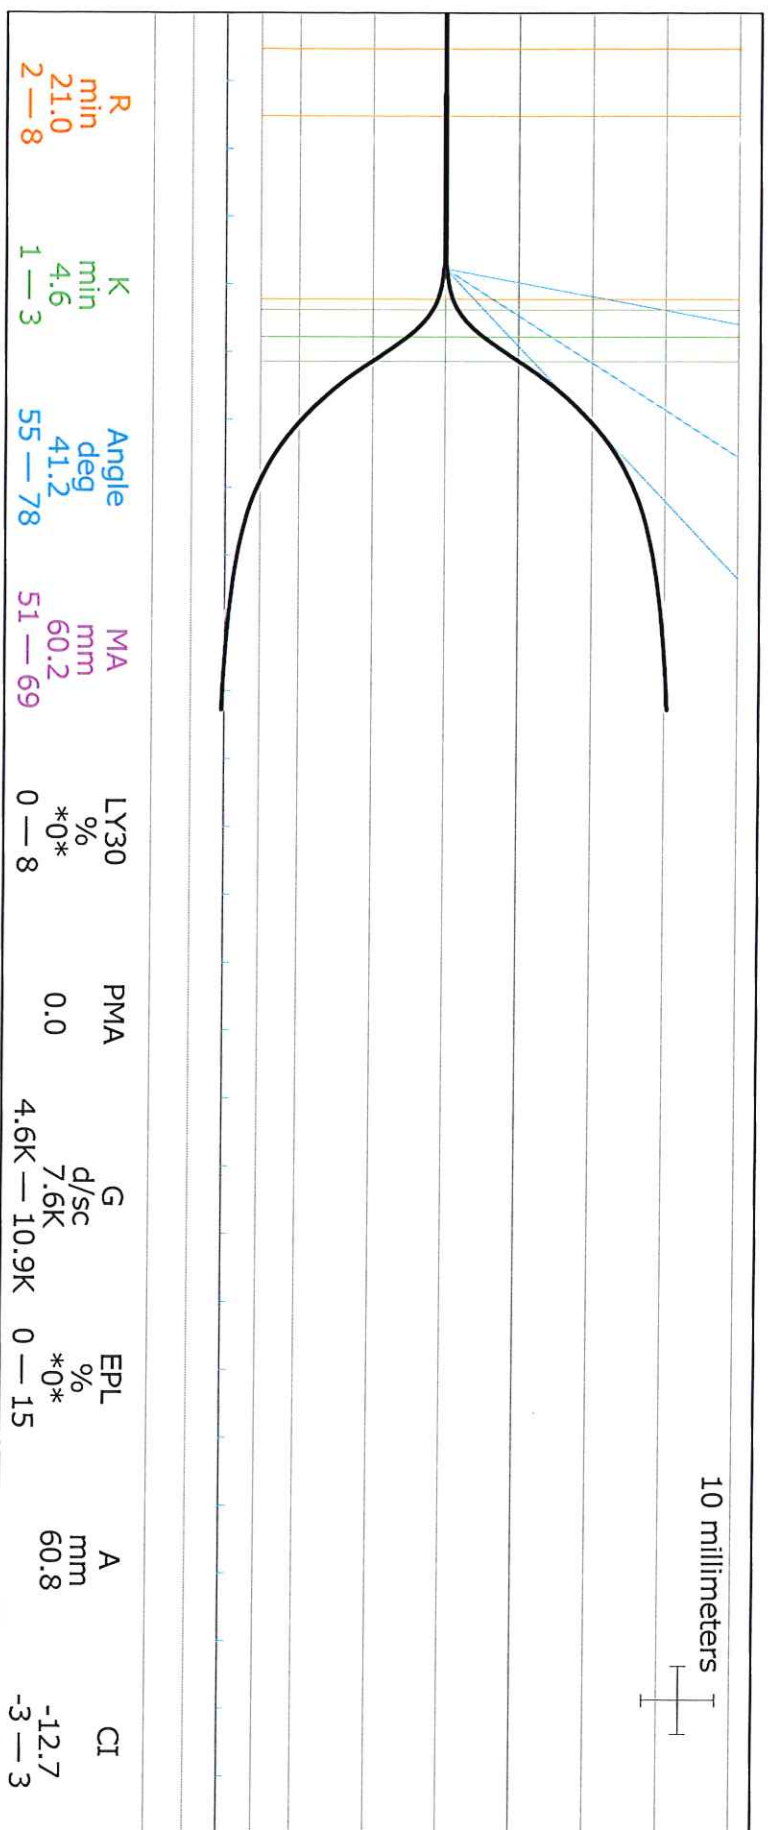

DIOMETER ABL90 SERIES

3-090R0199N0004
REPORT

Syringe - S 65uL

10:28 AM
Sample #

9/13/2023
19236

ations
ID
last name
first name
ple type

Not specified
37.0 °C

od gas values

7.417

34.0 mmHg

96.8 mmHg

pH

pCO₂

pO₂

Oximetry values

ctHb

Hct_c

↓ sO₂

FO₂Hb

FCOHb

↓ FHHb

↓ FMetHb

Electrolyte values

cK⁺

cNa⁺

cCa²⁺

cCl⁻

Metabolite values

cGlu

cLac

Calculated values

cHCO₃⁻(P)_c

p50_θ

ABE_c

Notes

↓

↓

c

θ

FHHb

FMetHb

sO₂

Value(s) above the reportable range
Value(s) below the reportable range
Calculated value(s)
Estimated value(s)

0094: Value below reportable range < 0.0
0094: Value below reportable range < 0.0
0093: Value above reportable range > 100.0

Solution pack lot: PD-04
Printed 10:28:27AM 9/13/2023

Sensor cassette run #:
2704-401

RADIOMETER ABL90 SERIES

ABL90 I393-090R0199N0004
PATIENT REPORT Syringe - S 65uL 11:34 AM 9/13/2023
Sample # 19241

Identifications

Patient ID
Patient last name
Patient first name
Sample type
T

Not specified
37.0 °C

2nd

Blood gas values

pH	7.475		[	-	]
pCO ₂	33.0	mmHg	[	-	]
pO ₂	117	mmHg	[	-	]

Oximetry values

? ctHb	6.3	g/dL	[	-	]
? Hct _c	19.4	%			
? sO ₂	> 100.0	%	[	-	]
? FO ₂ Hb	> 100.0	%	[	-	]
? FCOHb	2.1	%	[	-	]
? FHHb	< 0.0	%	[	-	]
? FMethHb	< 0.0	%	[	-	]

Electrolyte values

cK ⁺	3.4	meq/L	[	-	]
cNa ⁺	145	meq/L	[	-	]
cCa ²⁺	3.03	meq/L	[	-	]
cCl ⁻	105	meq/L	[	-	]

Metabolite values

cGlu	216	mg/dL	[	-	]
cLac	6.7	mmol/L	[	-	]

Calculated values

cHCO ₃ ⁻ (P) _c	24.3	mmol/L
? p50 ₀	23.90	mmHg
? ABE _c	0.7	mmol/L

Notes

‡	Value(s) above the reportable range
‡	Value(s) below the reportable range
‡	Calculated value(s)
c	Estimated value(s)
e	0581: OXI spectrum mismatch
ctHb	0581: OXI spectrum mismatch
FCOHb	0094: Value below reportable range < 0.0
FHHb	0581: OXI spectrum mismatch
FHHb	0094: Value below reportable range < 0.0
FMethHb	0581: OXI spectrum mismatch
FMethHb	0093: Value above reportable range > 100.0
FO ₂ Hb	0581: OXI spectrum mismatch
FO ₂ Hb	0093: Value above reportable range > 100.0
sO ₂	0581: OXI spectrum mismatch
sO ₂	

Run #:

Solution pack lot:
Printer:

RADIOMETER ABL90 SERIES

ABL90 I393-090R0199N0004 12:25 PM 9/13/2023
 PATIENT REPORT Syringe - S 65uL Sample # 19242

Identifications

Patient ID
 Patient last name
 Patient first name
 Sample type Not specified
 T 37.0 °C 3rd

Blood gas values

pH 7.492 [-]
 pCO₂ 32.6 mmHg [-]
 pO₂ 95.7 mmHg [-]

Oximetry values

ctHb 5.6 g/dL [-]
 Hct_C 17.1 %
 ‡ sO₂ > 100.0 % [-]
 ‡ FO₂Hb > 100.0 % [-]
 FCOHb 2.1 % [-]
 ‡ FHHb < 0.0 % [-]
 ‡ FMetHb < 0.0 % [-]

Electrolyte values

cK⁺ 3.4 meq/L [-]
 cNa⁺ 145 meq/L [-]
 cCa²⁺ 2.86 meq/L [-]
 cCl⁻ 110 meq/L [-]

Metabolite values

cGlu 144 mg/dL [-]
 cLac 3.6 mmol/L [-]

Calculated values

cHCO₃⁻(P)_C 24.9 mmol/L
 p50_θ 23.49 mmHg
 ABE_C 1.4 mmol/L

Notes

‡ Value(s) above the reportable range
 ‡ Value(s) below the reportable range
 c Calculated value(s)
 θ Estimated value(s)
 FHHb 0094: Value below reportable range < 0.0
 FMetHb 0094: Value below reportable range < 0.0
 FO₂Hb 0093: Value above reportable range > 100.0
 sO₂ 0093: Value above reportable range > 100.0

Solution pack lot: PD-04 Sensor cassette run #:
 Printed 12:25:34PM 9/13/2023 2704-401

RADIOMETER ABL90 SERIES

ABL90 I393-090R0199N0004 12:34 PM 9/13/2023
 PATIENT REPORT Syringe - S 65uL Sample # 19243

Identifications

Patient ID

Patient last name

Patient first name

Sample type

Not specified

FDB

T

37.0 °C

Blood gas values

pH	7.460		[	-	]
pCO ₂	37.6	mmHg	[	-	]
pO ₂	92.5	mmHg	[	-	]

Oximetry values

cHb	6.3	g/dL	[	-	]
Hct _c	19.3	%			
§ sO ₂	> 100.0	%	[	-	]
FO ₂ Hb	99.6	%	[	-	]
FCOHb	2.1	%	[	-	]
§ FHHb	< 0.0	%	[	-	]
§ FMetHb	< 0.0	%	[	-	]

Electrolyte values

cK ⁺	3.4	meq/L	[	-	]
cNa ⁺	145	meq/L	[	-	]
cCa ²⁺	3.02	meq/L	[	-	]
cCl ⁻	105	meq/L	[	-	]

Metabolite values

cGlu	162	mg/dL	[	-	]
cLac	3.3	mmol/L	[	-	]

Calculated values

cHCO ₃ ⁻ (P) _c	26.7	mmol/L
p50 _e	24.45	mmHg
ABE _c	2.7	mmol/L

Notes

§ Value(s) above the reportable range
 § Value(s) below the reportable range
 c Calculated value(s)
 e Estimated value(s)
 FHHb 0094: Value below reportable range < 0.0
 FMetHb 0094: Value below reportable range < 0.0
 sO₂ 0093: Value above reportable range > 100.0


Solution pack lot: PD-04 Sensor cassette run #: 2704-401
 Printed 12:34:25PM 9/13/2023

RESULT


Animal ID	Owner name	Owner first name
Name	Species Rabbit	
Date of birth		
Sample ID BPRC15_EOB	Analysis Date 09/13/2023 12:54:49	Operator JOY

Analyser Alarms Analysis Alarms


WBC	3.5	$10^3/\text{mm}^3$	Normal range 2.5 13.8
LYM%	---	%	
MON%	---	%	
GRA%	---	%	
(EOS%)	---	%	
LYM#	---	$10^3/\text{mm}^3$	
MON#	---	$10^3/\text{mm}^3$	
GRA#	---	$10^3/\text{mm}^3$	
EOS#	---	$10^3/\text{mm}^3$	

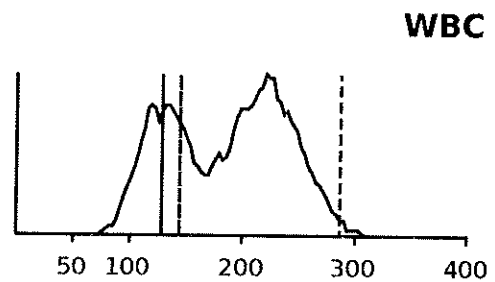

RBC	2.86	L	$10^6/\text{mm}^3$	4.80 7.20
HGB	6.3	L	g/dl	10.6 16.0
HCT	18.5	L	%	33.9 50.1
MCV	65		μm^3	62 79
MCH	21.9		pg	19.0 25.6
MCHC	34.0		g/dl	28.4 35.0
RDW	---		%	

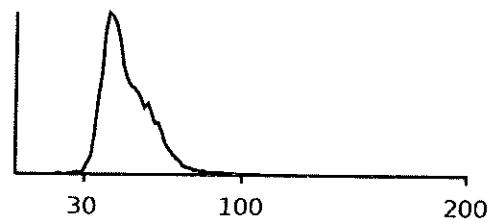

PLT	96	$10^3/\text{mm}^3$	0 962
MPV	---	μm^3	

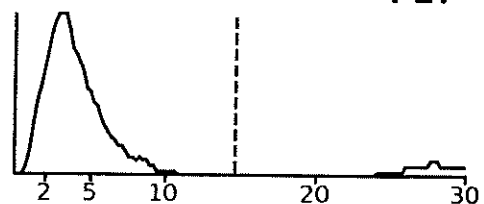

RESULTS

ANIMAL NAME:Bprc15_eob

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:18

AGEGroup:Juvenile

SAMPLE TYPE:Plasma

REAGENT BATCH NO.:9230932

PLATE ID:019809230932

OPERATOR ID:

LAB.:

TEST TIME:2023-09-13 13:44

MACHINE ID:120007423

PRINT TIME:2023-09-13 13:44

Ver:V1.00.01.09/1.00.01.50



Assay	Result	Ref	Low	Normal	High
ALB	3.3g/dL	2.2-3.7			
TP	4.2g/dL	L 5.5-7.2			
GLOB	0.8g/dL	L 2.5-4.8			
A/G	4.04				
TB	0.0mg/dL	0.0-0.8			
GGT	<2U/L	0-14			
AST	158U/L	H 0-98			
ALT	58U/L	5-106			
ALP	72U/L	20-145			
TBA	21.51umol/L				
AMY	224U/L	200-378			
LPS	53U/L	0-100			
LDH	270U/L	H 34-129			
CK	> 4000U/L	H 138-2705			
Crea	0.8mg/dL	0.7-1.8			
UA	<10.00umol/L	0.00-130.00			
BUN	26.67mg/dL	10.12-28.10			
BUN/CREA	126.748	21.000-236.000			
GLU	193.12mg/dL	H 75.14-171.19			
TC	40.37mg/dL	34.65-94.33			
TG	233.68mg/dL	H 26.10-153.12			
tCO2	20.7mmol/L	13.0-27.0			
Ca	10.86mg/dL	5.60-13.84			
PHOS	7.52mg/dL	H 1.21-4.90			

CK> detection limit. Please dilute sample and re-test

WAT:0

EMP:0

CHE:0

9799H7083

RESULTS



ANIMAL NAME:Bprc15_eob

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:17

AGEGroup:Juvenile

SAMPLE TYPE:Whole Blood

REAGENT BATCH NO.:9230926

PLATE ID:006509230926

OPERATOR ID:

LAB.:

TEST TIME:2023-09-13 13:29

MACHINE ID:120007423

PRINT TIME:2023-09-13 13:29

Ver:V1.00.01.09/1.00.01.50


Assay	Result	Ref	Low	Normal	High
APTT	111.9s				
PT	10.8s				
TT	18.2s				
Fib	1.25g/L				

WAT:2

EMP:0

CHE:0

6835H6148

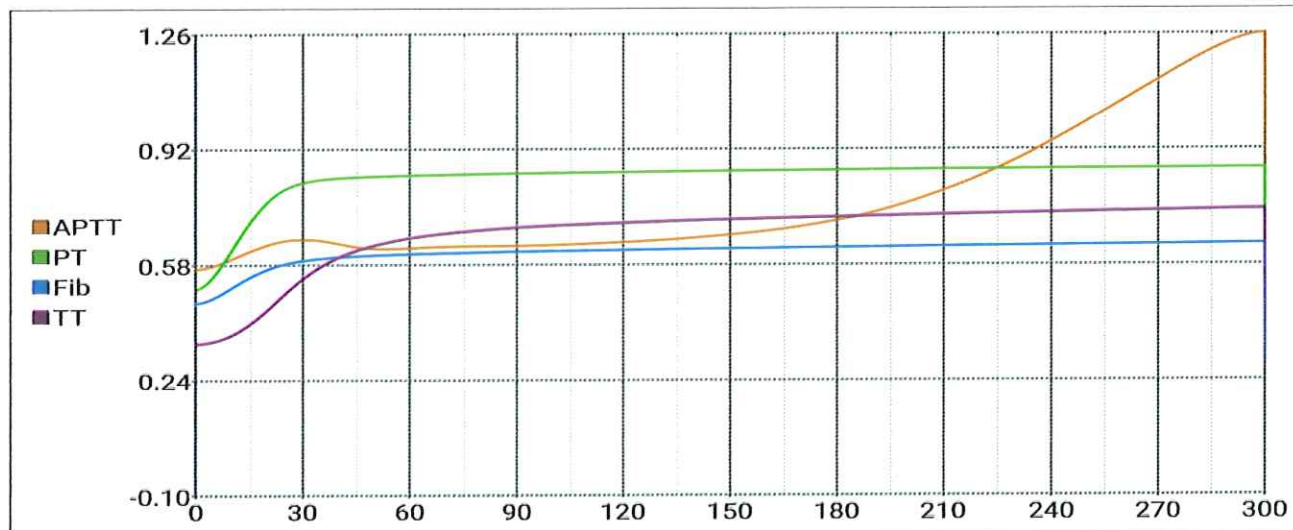

Note: The project curves from top to bottom are:APTT,PT,Fib,TT.

RADIOMETER ABL90 SERIES

ABL90 I393-090R0199N0004 01:39 PM 9/13/2023
 PATIENT REPORT Syringe - S 65uL Sample # 19247

Identifications

Patient ID

Patient last name

Patient first name

Sample type

Not specified

T

37.0 °C

Blood gas values

pH	7.467		[	-	]
pCO ₂	38.0	mmHg	[	-	]
pO ₂	89.3	mmHg	[	-	]

Oximetry values

cHb	6.4	g/dL	[	-	]
Hct _c	19.5	%			
‡ sO ₂	> 100.0	%	[	-	]
FO ₂ Hb	98.8	%	[	-	]
FCOHb	2.4	%	[	-	]
‡ FHHb	< 0.0	%	[	-	]
‡ FMetHb	< 0.0	%	[	-	]

Electrolyte values

cK ⁺	3.8	meq/L	[	-	]
cNa ⁺	145	meq/L	[	-	]
cCa ²⁺	3.11	meq/L	[	-	]
cCl ⁻	108	meq/L	[	-	]

Metabolite values

cGlu	154	mg/dL	[	-	]
cLac	1.1	mmol/L	[	-	]

Calculated values

cHCO ₃ ⁻ (P) _c	27.4	mmol/L
p50 _θ	24.20	mmHg
ABE _c	3.4	mmol/L

Notes

‡ Value(s) above the reportable range
 ‡ Value(s) below the reportable range
 c Calculated value(s)
 θ Estimated value(s)
 FHHb 0094: Value below reportable range < 0.0
 FMetHb 0094: Value below reportable range < 0.0
 sO₂ 0093: Value above reportable range > 100.0


Solution pack lot: PD-04 Sensor cassette run #:
 Printed 1:40:02PM 9/13/2023 2704-401

RESULT


Animal ID	Owner name	Owner first name
Name	Species Rabbit	
Date of birth		
Sample ID BPRC15_1H	Analysis Date 09/13/2023 14:01:45	Operator JOY

Analyser Alarms Analysis Alarms


WBC	4.0	$10^3/\text{mm}^3$	Normal range 2.5 13.8
LYM%	---	%	
MON%	---	%	
GRA%	---	%	
(EOS%)	---	%	
LYM#	---	$10^3/\text{mm}^3$	
MON#	---	$10^3/\text{mm}^3$	
GRA#	---	$10^3/\text{mm}^3$	
EOS#	---	$10^3/\text{mm}^3$	

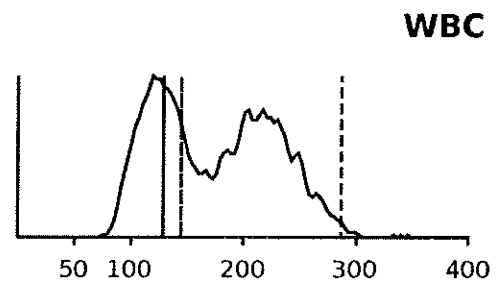

RBC	2.89	L $10^6/\text{mm}^3$	4.80 7.20
HGB	6.3	L g/dl	10.6 16.0
HCT	18.5	L %	33.9 50.1
MCV	64	μm^3	62 79
MCH	21.9	pg	19.0 25.6
MCHC	34.1	g/dl	28.4 35.0
RDW	---	%	

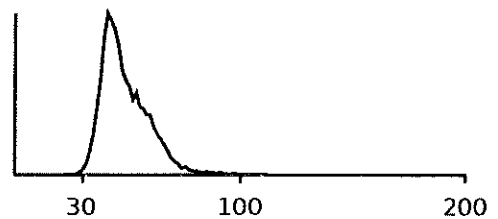

PLT	111	$10^3/\text{mm}^3$	0 962
MPV	---	μm^3	

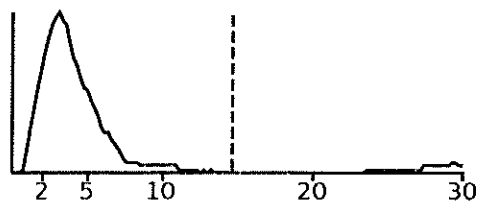

RESULTS

UMB

ANIMAL NAME:Bprc15_1h

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:20

AGEGroup:Juvenile

SAMPLE TYPE:Plasma

REAGENT BATCH NO.:9231004

PLATE ID:019809231004

OPERATOR ID:

LAB.:

TEST TIME:2023-09-13 14:44

MACHINE ID:120007423

PRINT TIME:2023-09-13 14:44

Ver:V1.00.01.09/1.00.01.50



Assay	Result	Ref	Low	Normal	High
ALB	3.4g/dL	2.2-3.7			
TP	4.3g/dL	L 5.5-7.2			
GLOB	0.9g/dL	L 2.5-4.8			
A/G	3.63				
TB	0.1mg/dL	0.0-0.8			
GGT	<2U/L	0-14			
AST	167U/L	H 0-98			
ALT	68U/L	5-106			
ALP	67U/L	20-145			
TBA	17.10umol/L				
AMY	255U/L	200-378			
LPS	45U/L	0-100			
LDH	383U/L	H 34-129			
CK	> 4000U/L	H 138-2705			
Crea	0.8mg/dL	0.7-1.8			
UA	<10.00umol/L	0.00-130.00			
BUN	28.21mg/dL	H 10.12-28.10			
BUN/CREA	141.249	21.000-236.000			
GLU	169.85mg/dL	75.14-171.19			
TC	47.93mg/dL	34.65-94.33			
TG	309.20mg/dL	H 26.10-153.12			
1CO2	19.8mmol/L	13.0-27.0			
Ca	10.73mg/dL	5.60-13.84			
PHOS	7.05mg/dL	H 1.21-4.90			

CK> detection limit. Please dilute sample and re-test

WAT:0

EMP:0

CHE:0

3315D0666

RESULTS

ANIMAL NAME:Bprc15_1h

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:19

AGEGroup:Juvenile

SAMPLE TYPE:Whole Blood

REAGENT BATCH NO.:9230926

PLATE ID:006509230926

OPERATOR ID:

LAB.:

TEST TIME:2023-09-13 14:29

MACHINE ID:120007423

PRINT TIME:2023-09-13 14:29

Ver:V1.00.01.09/1.00.01.50




Assay	Result	Ref	Low	Normal	High
APTT	110.3s				
PT	12.8s				
TT	16.1s				
Fib	1.38g/L				

WAT:1

EMP:0

CHE:0

5992G9777

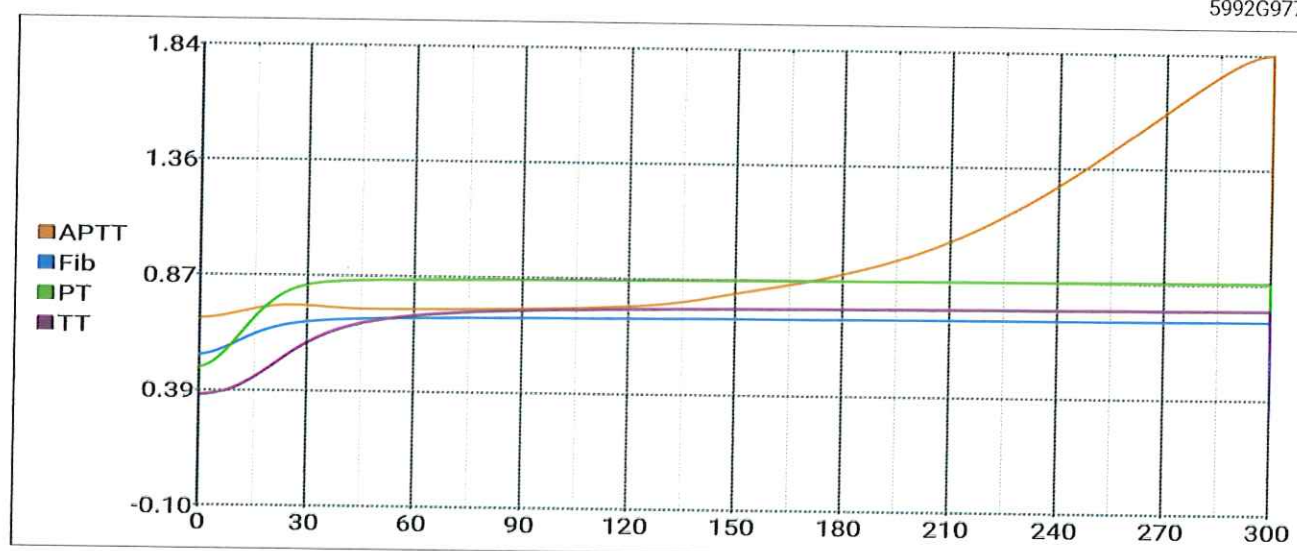


Note: The project curves from top to bottom are:APTT,Fib,PT,TT.

TEG® Analysis

Generated: 9/13/2023 4:11:16PM

Database: C:\Program Files\TEG\Patients.teg

Patient: BPRC15 ID: Rabbit Birthdate: Age: SSN: Gender:	Sample Date: 9/13/2023 Time on: 02:52 PM Off: 04:00 PM Duration: 68 min
Sample type: Citrated kaolin with heparinase Description: 1 hr post	Channel: 1 Sample status: Finished Temp: 37
Additional notes:	Site ID:
	Operator ID: Temporary Operator
	Ordered by:
	Platelet drugs administered: No Bleeding state:
	Patient temperature:
Accession #:	
Analyzer SN: S101707022	

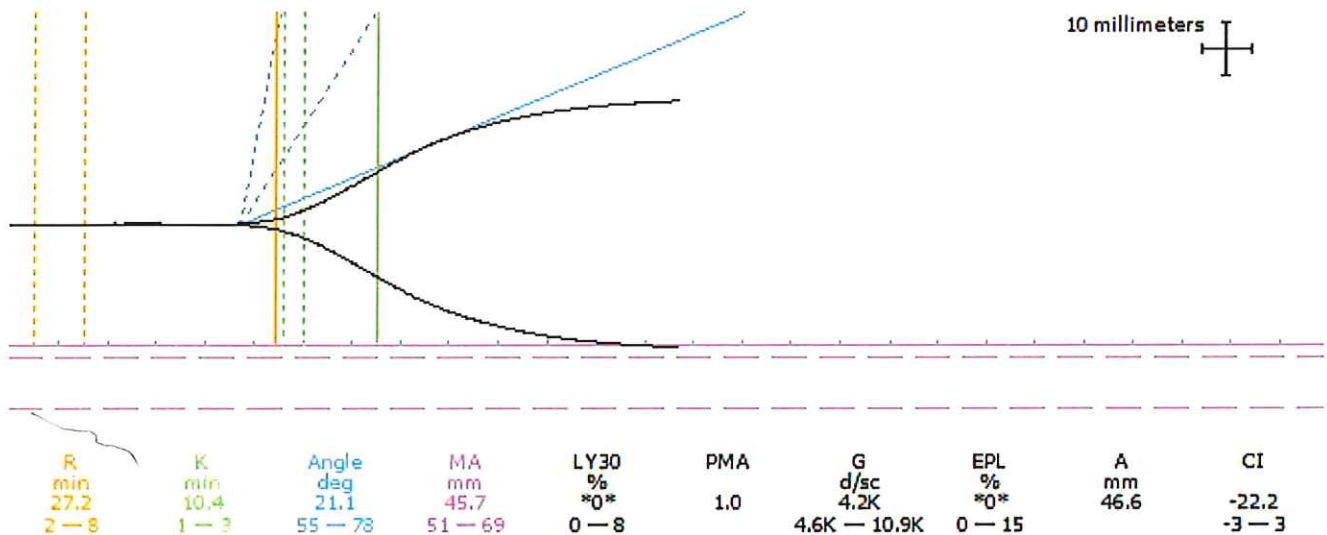

Result reported:	Reported date:
	Reported by:
	Physician interpretation

Sample data:	Units:	Normal values:	CPT/Billing codes:
R: 27.2	min	<high> (2 — 8)	85347 Activated clotting time (R)
K: 10.4	min	<high> (1 — 3)	
Angle: 21.1	deg	<low> (55 — 78)	85384 Fibrinogen activity (Angle)
MA: 45.7	mm	<low> (51 — 69)	85576 Platelet aggregation (MA)
LY30: *0*	%	(0 — 8)	
PMA: 1.0			
G: 4.2K	d/sc	<low> (4.6K — 10.9K)	
EPL: *0*	%	(0 — 15)	85390 Fibrinolysis (EPL / LY30)
A: 46.6	mm		
CI: -22.2		<low> (-3 — 3)	85999 Prothrombotic state (CI)

Interim values are surrounded by asterisks - Results final

RADIOMETER ABL90 SERIES

ABL90 I393-090R0199N0004 08:22 AM 9/14/2023
 PATIENT REPORT Syringe - S 65uL Sample # 19256

Identifications

Patient ID

Patient last name

Patient first name

Sample type

T

Not specified

37.0 °C

24HR

Blood gas values

pH	7.491		[	-	]
pCO ₂	37.3	mmHg	[	-	]
pO ₂	69.8	mmHg	[	-	]

Oximetry values

ctHb	5.8	g/dL	[	-	]
Hct _c	17.7	%			
sO ₂	96.6	%	[	-	]
FO ₂ Hb	93.7	%	[	-	]
FCOHb	2.6	%	[	-	]
FHHb	3.3	%	[	-	]
FMetHb	0.4	%	[	-	]

Electrolyte values

cK ⁺	5.0	meq/L	[	-	]
cNa ⁺	142	meq/L	[	-	]
cCa ²⁺	3.34	meq/L	[	-	]
cCl ⁻	104	meq/L	[	-	]

Metabolite values

cGlu	153	mg/dL	[	-	]
cLac	1.3	mmol/L	[	-	]

Calculated values

cHCO ₃ ⁻ (P) _c	28.4	mmol/L
p50 _c	19.68	mmHg
ABE _c	4.7	mmol/L

Notes

c Calculated value(s)

Solution pack lot: PD-04




Printed 8:22:58AM 9/14/2023

Sensor cassette run #:

2704-401

RESULT

Animal ID	Owner name	Owner first name
Name	Species Rabbit	
Date of birth		
Sample ID BPRC15_24H	Analysis Date 09/14/2023 09:01:30	Operator JOY

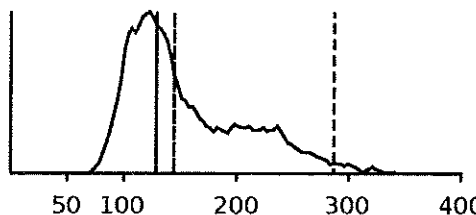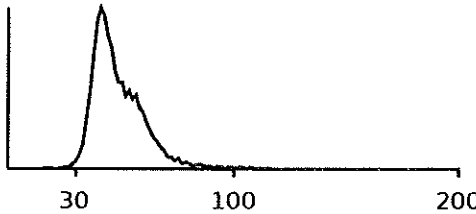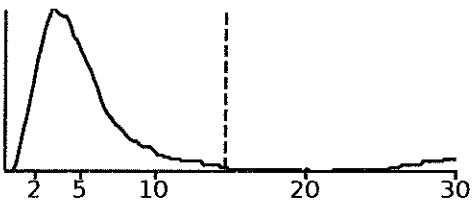Analyser Alarms			Analysis Alarms		MIC, SCH	
					Normal range	
WBC	4.7	10 ³ /mm ³	2.5	13.8		
LYM%	--,--	%				
MON%	--,--	%				
GRA%	--,--	%				
(EOS%)	--,--	%				
LYM#	--,--	10 ³ /mm ³				
MON#	--,--	10 ³ /mm ³				
GRA#	--,--	10 ³ /mm ³				
EOS#	--,--	10 ³ /mm ³				
					WBC	
						
RBC	3.24	L 10 ⁶ /mm ³	4.80	7.20		
HGB	7.1	L g/dl	10.6	16.0		
HCT	20.7	L %	33.9	50.1		
MCV	64	μm ³	62	79		
MCH	22.0	pg	19.0	25.6		
MCHC	34.4	g/dl	28.4	35.0		
RDW	--,--	%				
					RBC	
						
PLT	250	10 ³ /mm ³	0	962		
MPV	--,--	μm ³				
					PLT	
						

RESULTS



ANIMAL NAME:Bprc15_24h

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:6

AGEGroup:Juvenile

SAMPLE TYPE:Plasma

REAGENT BATCH NO.:9231004

PLATE ID:019809231004

OPERATOR ID:

LAB.:

TEST TIME:2023-09-14 09:31

MACHINE ID:120007423

PRINT TIME:2023-09-14 09:33

Ver:V1.00.01.09/1.00.01.50

Assay	Result	Ref	Low	Normal	High
ALB	3.5g/dL	2.2-3.7			
TP	5.2g/dL	L 5.5-7.2			
GLOB	1.7g/dL	L 2.5-4.8			
A/G	2.04				
TB	0.0mg/dL	0.0-0.8			
GGT	2U/L	0-14			
AST	92U/L	0-98			
ALT	112U/L	H 5-106			
ALP	86U/L	20-145			
TBA	23.37umol/L				
AMY	386U/L	H 200-378			
LPS	57U/L	0-100			
LDH	176U/L	H 34-129			
CK	> 4000U/L	H 138-2705			
Crea	0.8mg/dL	0.7-1.8			
UA	<10.00umol/L	0.00-130.00			
BUN	15.99mg/dL	10.12-28.10			
BUN/CREA	83.259	21.000-236.000			
GLU	169.87mg/dL	75.14-171.19			
TC	152.30mg/dL	H 34.65-94.33			
TG	813.52mg/dL	H 26.10-153.12			
tCO2	20.3mmol/L	13.0-27.0			
Ca	12.25mg/dL	5.60-13.84			
PHOS	7.96mg/dL	H 1.21-4.90			

CK> detection limit. Please dilute sample and re-test

WAT:0

EMP:0

CHE:0

2195E8403

RESULTS

ANIMAL NAME:Bprc15_24h

OWNER NAME:

Animal:Rabbit

Medical ID:

SAMPLE ID:5

AGEGroup:Juvenile

SAMPLE TYPE:Whole Blood

REAGENT BATCH NO.:9230769

PLATE ID:006509230769

OPERATOR ID:

LAB.:

TEST TIME:2023-09-14 09:13

MACHINE ID:120007423

PRINT TIME:2023-09-14 09:13

Ver:V1.00.01.09/1.00.01.50




Assay	Result	Ref	Low	Normal	High
APTT	134.6s				
PT	8.0s				
TT	18.7s				
Fib	2.48g/L				

WAT:0

EMP:0

CHE:0

2156J7222

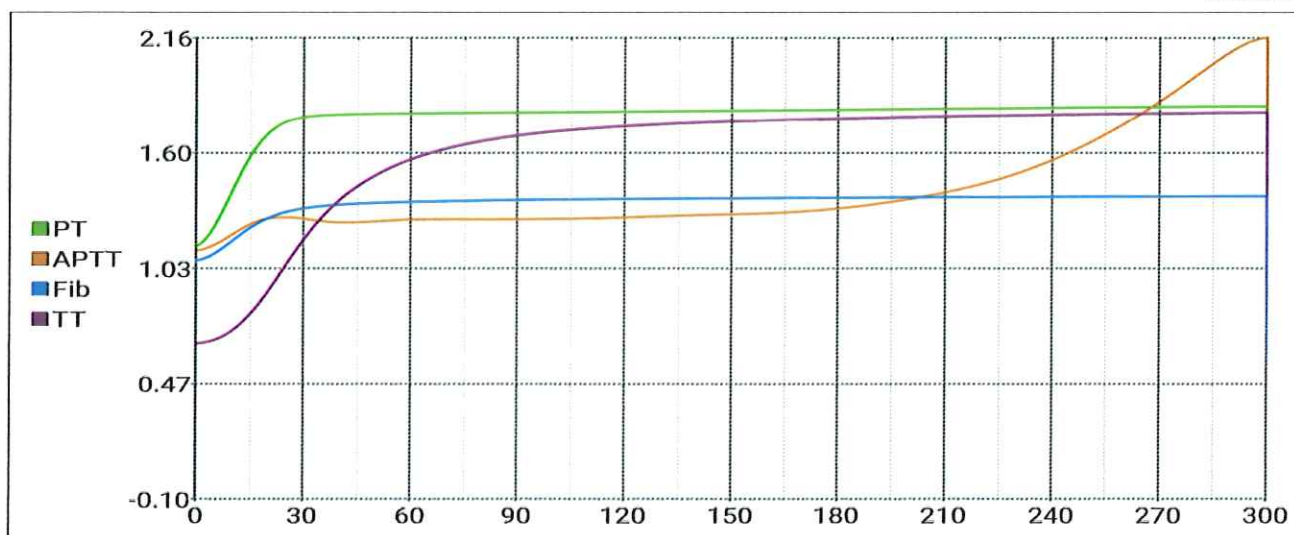


Note: The project curves from top to bottom are:PT,APTT,Fib,TT.

TEG® Analysis

Generated: 9/14/2023 11:19:01AM

Database: C:\Program Files\TEG\Patients.teg

Patient: BPRC15 ID: Rabbit Birthdate: Age: SSN: Gender:	Sample Date: 9/14/2023 Time on: 09:14 AM Off: 10:12 AM Duration: 58 min
Sample type: Citrated kaolin with heparinase Description: 24hr	Channel: 1 Sample status: Finished Temp: 37
Additional notes:	Site ID: Operator ID: Temporary Operator
	Ordered by:
	Platelet drugs administered: No Bleeding state:
	Patient temperature:
	Accession #: Analyzer SN: S101707022

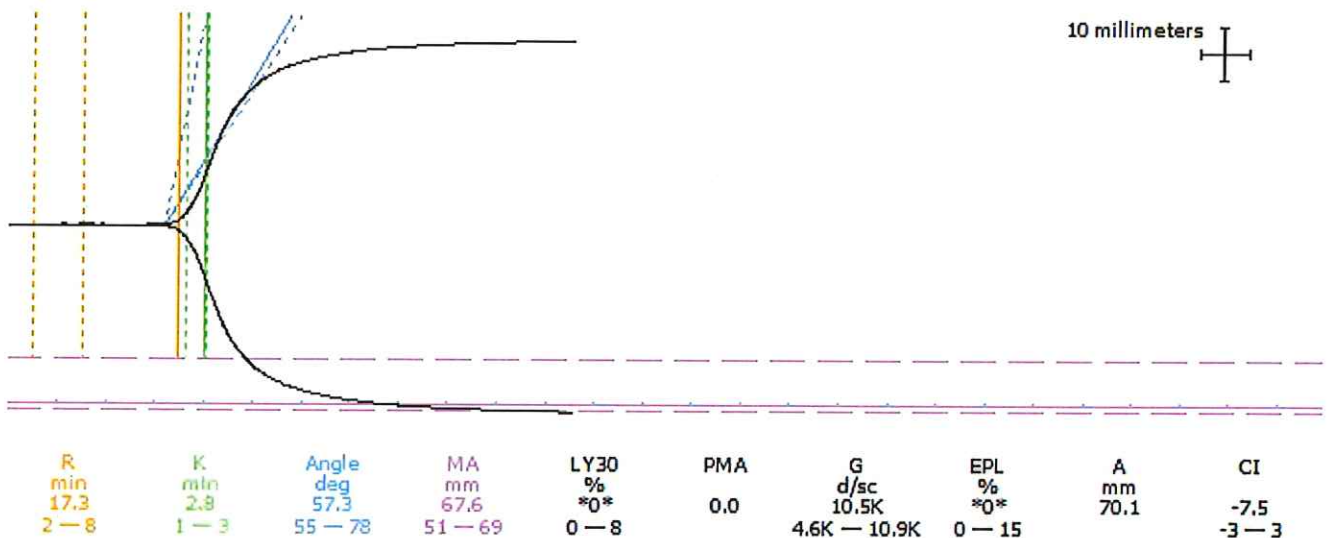

Result reported:	Reported date:
	Reported by:
	Physician interpretation

Sample data:	Units:	Normal values:	CPT/Billing codes:
R: 17.3	min	<high> (2 — 8)	85347 Activated clotting time (R)
K: 2.8	min	(1 — 3)	
Angle: 57.3	deg	(55 — 78)	85384 Fibrinogen activity (Angle)
MA: 67.6	mm	(51 — 69)	85576 Platelet aggregation (MA)
LY30: *0.0*	%	(0 — 8)	
PMA: 0.0			
G: 10.5K	d/sc	(4.6K — 10.9K)	
EPL: *0.0*	%	(0 — 15)	85390 Fibrinolysis (EPL / LY30)
A: 70.1	mm		
CI: -7.5		<low> (-3 — 3)	85999 Prothrombotic state (CI)

Interim values are surrounded by asterisks - Results final