

Virtual Auditing and Diagnostic of Energy Waste in Building Environments

Nilavra Pathak
Information Systems
University of Maryland
Baltimore County
nilavra1@umbc.edu

David Iachut
Computer Science
University of Maryland
Baltimore County
dlachut1@umbc.edu

Nirmalya Roy
Information Systems
University of Maryland
Baltimore County
nroy@umbc.edu

Nilanjan Banerjee
Computer Science
University of Maryland
Baltimore County
nilanb@umbc.edu

Ryan Robucci
Computer Engineering
University of Maryland
Baltimore County
robucci@umbc.edu

ABSTRACT

The Heating, Ventilation, and Cooling (HVAC) constitutes majority of the utility bill and energy waste in built environments. In this paper, we envision a city wide virtual energy auditing system for residential homes which would help identify the wasteful homes and provide a detailed diagnostic to assess the reason behind the waste, particularly the heating or cooling loss. In general, the HVAC usage depends on several factors such as the outdoor weather conditions, thermostat settings, nature of the insulation, and building construction materials to preserve its thermal mass and capacity. We investigate the lagged correlations between these different factors in a built environment, their influence on the HVAC cycles, and develop a building parametric model to enumerate the heating or cooling loss and identify the causes behind those losses in built environments. We also compare our data-driven technique with a low-cost in-house built IR thermal camera based system to detect more finer building leakages and insulation problems. We posit the cost-benefit analysis of our proposed device free and device augmented approaches and discuss their feasibility for auditing energy waste in future at large scale in smart city environment.

1. INTRODUCTION

Nowadays the utility providers in most of the cities send feedback along with the monthly utility bills to the customers to help understand their daily usage and motivate them to change their behavior at their will. While the approach is effective for a few energy conscious customers, in general it does not work for a larger population. The reason behind the failure of raising the energy awareness successfully across a broad range of customers is that the feedback through the monthly utility bill does not provide the detailed

description of any energy holes, or persistent insulation problems etc., in a home environment. While the appliance level energy disaggregation helps enumerate the users' more or less consumption patterns on a daily basis, the energy losses if dissipate from the other sources such as bad insulation, air leakages and drafty windows remain unnoticeable and extend a bigger impression on the overall consumption and utility bill. Estimating the building parameters such as thermal mass and conductance help gauge the actual causes of energy losses whereas the outdoor weather plays a crucial role on energy consumption patterns of the users, and particularly the on-off behavior of the HVAC. The existing approach does not traditionally consider the building parameters, thermostat setting, HVAC cycles etc., for virtual energy auditing and diagnostic in case of energy waste in built environment. We hypothesize that the reasons of energy losses which are not so apparent and quantifiable using the existing building energy systems may evolve across the following dimensions.

- *Building Parameter Identification.* Building parameters like thermal mass and conductance (insulation) constitute the characteristics of construction specific materials and help identify the causation of any shorter or longer energy perseverance and loss of any built infrastructure. Thermal mass of a building acts like a capacitor which helps store the heat (or cold) and control the building ability to preserve heat (or cold) during the day and night time. Therefore, we plan to investigate the building thermal and construction specific parameters which help design advanced analytics that can enlighten the structural and thermal deficits of any built environment.
- *Thermostat Settings Metric.* Different users may have different preferences to set the thermostat temperature based on the indoor home temperature, users comfort level, and outdoor weather conditions. In general the utility providers do not bookkeep the thermostat set point and indoor house temperature. We propose to investigate the impact of differences in set point and indoor temperature on the HVAC cycles needed to reach the specific set point temperature as controlled by the residents. Considering a neighborhood with similar sizes and properties of homes and building construction materials, we investigate how the consumption based on HVAC operating cycles changes across multiple homes in a day over a

Permission to make digital or hard copies of all or part of this work for personal or classroom use is granted without fee provided that copies are not made or distributed for profit or commercial advantage and that copies bear this notice and the full citation on the first page. To copy otherwise, to republish, to post on servers or to redistribute to lists, requires prior specific permission and/or a fee.

Copyright 20XX ACM X-XXXXX-XX-X/XX/XX ...\$15.00.

specific season. We postulate that the abnormal consumption are not only associated with just user comfort level, habits and personal preferences, but also with the other causations such as bad insulation, drafty windows, and inherent thermal properties of the building structure etc.

- *Thermal Imaging-based Analytics.* In this work we advocate employing a non-intrusive energy waste auditing method relying on the existing set up in current built environment without intruding another new system. Nevertheless due to the proliferation of low-cost tiny sensor systems we believe that portable thermal imaging system based on IR camera could be deployed in conjunction with our building parametric methodology to focus and pinpoint the energy holes at scale.

The thermostat settings metric provides the range of values for the set points which are typically user preference driven. Past work quantifies the habit of HVAC usage or the change of temperature as the statistical correlation coefficient between the binned outdoor temperature and the air-conditioner duty-cycle [5]. They applied a regression model to identify the set point metric but did not consider the indoor temperature. We posit a generalized habits metric which identifies the different settings and the time of change based on the indoor and outdoor temperature and HVAC duty cycles. Our preliminary analysis shows that detecting the habits and thermostat set point is a non-trivial research task and simple correlation based regression model based on the duty cycle and outdoor temperature may not always reflect the user habits and help infer the set point accurately. Therefore, we hypothesize to consider the indoor temperature which is highly correlated with set point setting in our proposed parametric building thermal model.

In summary, we take a bold step in this paper and posit that if no physical instrumentations are available is it possible to detect the poor insulation problems at scale in built environments? We advocate a device free modeling approach considering the thermostat setting and outdoor temperature to enumerate the number and duration of HVAC cycles, and characterize the severity of insulation problems of a cluster of similar homes in a specific neighborhood. While employing thermal camera or any other professional instrumentation designed specifically for detecting bad insulation albeit helps to gain a deeper understanding of the specific energy holes but incurs significant cost and deployment challenges in case of large scale deployment and long term usage. To enable virtual energy waste auditing and diagnostic at scale without percolating the onerous steps of deploying and scanning each room with an IR camera, we propose a non-intrusive parametric building energy dissipation model. Our model considers the nature of HVAC cycles, indoor temperature, thermostat setting to assess energy holes problems. We evaluate our proposed approach using real data traces from 14 homes and shows that our instrumentation free building parametric approach is quite capable of detecting, differentiating and assessing the bad or good insulated homes and energy holes at least in moderate scale.

Key Contributions: We thus make the following key contributions.

- We posit a simple time series regression model and compare it with an existing Kalman filter based approach to derive building parameters. We propose a thermal mass metric which quantifies the idea about heat storing capacity and rate of heat loss of a house.
- We propose a change point detection based auto-regressive periodic data model considering the outdoor temperature, in-

door temperature, and HVAC cycles which helps to aptly capture a change in thermostat setting.

- We design a low-cost IR camera based system and collected data in real environment to compare and study the feasibility of our device-free and device-augmented energy waste auditing and diagnostic method.

2. BACKGROUND

2.1 Datasets

We conducted using three different datasets for our experimentation. Our experiments are primarily based on datasets from homes in Austin and a smaller dataset from a house in Baltimore. Both places have hot humid climates where in Austin has very long, hot summers; warm transitional seasons; and short, mild winters where snowfall is exceptionally rare. Baltimore on the other hand lies in humid subtropical climate zone, with four distinct seasons. Winters are chilly but variable and is affected by Polar air masses and summers have hot days. We also use a smaller dataset provided in the earlier work, from a house in Denmark.

Pecan Street Dataset: [9] The Pecan street dataset consists of a large number of home's itemized energy, gas, water consumption data along with a variety of other data like indoor temperature, off-grid power data, metadata of the homes in three different cities. We chose the dataset for gas and power consumption from single-family homes in Austin which have indoor temperature data and metadata and a sizable dataset for a common duration. Consumption and indoor data has a minute-wise granularity. The weather data is available at an hourly rate which is interpolated to a half hourly and 15 minute rate, under the assumption outdoor temperature changes slowly over time. Our preliminary study is limited to 14 homes which meet the requirement. The size of the individual homes' datasets vary from several months to two years depending on the available data.

CTSM Dataset: [8] The Continuous Time Stochastic Modeling toolbox provides a dataset for heat dynamics modeling for a house in Denmark in winter months. The data consist of heater consumption, indoor and outdoor temperature, and solar radiation data collected at a 15 min interval.

Collected Data: We have setup testbed in a single-family home in Baltimore. The house was constructed in 1950, has a floor area of 1152 sq ft divided into 2 stories with a basement having a bedroom, and has four residents. A house has a NEST thermostat in the dining area of the house along with multi-sensors [7] in different rooms to measure the individual room-wise temperature and humidity. Each multi-sensor collects a single-point temperature value every minute. The multi-sensors transmit these values using the Z-Wave wireless protocol to a Raspberry Pi 3 base station. Having collected the data, the base station uploads it to our server for further analysis. In tandem with the multi-sensor data, we probe the NEST thermostat with an API call to capture the thermostat temperature data and another API call is made to collect outdoor weather data. We also use a thermal sensor unit which can rotate 360 degrees and capture aligned thermal and Pi RGB images, and is described in full detail in Section 3.4 .

2.2 Thermostat Model:

We assume the thermostat to have a bang-bang control with a hysteresis setting as described in [5]. This means if a thermostat has a setpoint of T_0 and the heating or cooling system is functional, then the indoor temperature is expected to be with a certain range

δ , where the indoor temperature T is $T_l < T < T_h$, $T_l = T_0 - \delta$ and $T_h = T_0 + \delta$.

2.3 House Model:

A number of factors influence the heat dynamics of a house. Primarily, the indoor and outdoor temperature of the house is a major controlling reason for AC or heater consumption. Thermal mass is the ability of a building to store and release heat and is important for better comfort and improved HVAC efficiency. The building materials determine the thermal mass of a building and the selection of ideal thermal mass for a building depends on the local climate. Thermal mass stores heat the solar energy in the day and radiates at night. Modeling the building heat dynamics of a house has been stated in great details in [1]. The most basic state space equation for building heat dynamics is given as -

$$\frac{dT_i}{dt} = \frac{1}{CR}(T_a - T_i) + \frac{1}{C}Q_h + \frac{A_w}{C}Q_s + \frac{1}{C}Q_{other} + \epsilon \quad (1)$$

In Equation 1, shows the dynamics of the change in indoor temperature. The difference in temperature between indoor(T_i) and outdoor temperature (T_a) and, the total heat inflow, adds up to the change in indoor temperature with time. The Q_h is the heat introduced in the house by the heater, Q_s is the solar radiation and Q_{other} is the heat dissipated from appliances, human bodies etc. The heaters or air-conditioners and the temperature gradient act as the most important regulating factor for the heat dynamics, and the effect of others is negligible and ignored.

2.4 Non Intrusive Load Monitoring

Non-Intrusive Load Monitoring (NILM) [10] is the task of identifying the individual appliances energy consumption. While utility providers may have access to buildings' energy consumption, access to individual appliances' load measurement will require further instrumentation. As HVAC consumption consist of the dominant load in the aggregated signal, identifying just the AC usage using NILM is simpler [11]. NILM is pre-cursor approach for the Virtual Audit System.

2.5 Low-Cost Continuous Thermal Sensing

Our low cost thermal imaging system has resemblances with the system proposed in [?]. The authors develop a low-cost thermal scanning sensor that can continuously measure heat radiation from surfaces in a building over extended periods of time. The sensor is battery operated and communicates wirelessly and can be placed in each room. A CAD model of the building was developed with multiple scanners, that can stitch together a thermal mapping of each surface providing. The structure scanner captures thermal data by iteratively moving a pan and tilt servo to scan across a 2-dimensional hemisphere that is used for stitching and constructing the thermal layout of the objects.

3. VIRTUAL AUDIT SYSTEM:

We present a Virtual Audit System for residential buildings to identify the causes for HVAC energy waste and provide proper feedback to customers. Two important factors for energy waste are poor building construction and bad thermostat settings. If a house has poor thermostat settings, then the utility providers can provide feedback to adjust setpoints. On the other hand, for the homes which are have poor construction, we can provide a detailed diagnostic for a home to isolate the constructional reasons behind abnormal usage.

HomeID	GAM	GLM	EKF	C	R
94	0.008	0.026	0.006	14.556	0.386
410	0.009	0.009	0.008	33.858	0.595
484	0.007	0.007	0.007	108.078	0.472
871	0.010	0.010	0.011	20.633	0.874
1314	0.006	0.006	0.007	1092.865	0.019
1507	0.008	0.008	0.009	257.370	0.1507
1714	0.011	0.011	0.013	72.967	0.191
2470	0.009	0.009	0.009	101.546	1.232
2814	0.008	0.008	0.009	60.881	0.183
3367	0.007	0.007	0.007	944.656	0.130
5371	0.023	0.023	0.0208	80.065	0.284
6673	0.0074	0.0074	0.0074	90.806	0.348
7989	0.003	0.006	0.010	16.215	0.289
8600	0.009	0.009	0.010	934.0354	0.038

Table 1: Comparative Results of Parameter Estimation and Building Modeling on Pecan Street Data(NMSE)

3.1 Building Parameter Identification:

Building construction materials can be the potential determining factors for energy usage. Identifying building characteristics like insulation or resistance of walls and thermal mass or capacitance are the factors which has effect on the rate of heater/AC cycles being used. We investigated the techniques mentioned in [1] to find the greybox models for a building. A building heat consumption can be represented by an equivalent electrical circuit for which the equivalent state space equations are derived. With the fewer number of input parameters shown in the work its difficult to get a fully detailed model. We compare the state space model based parameter estimation with Kalman Filter against a proposed discriminative regression learning based approach.

The equation relating thermal energy to thermal mass is given as $Q = C\Delta T$, where where Q is the thermal energy transferred, C is the thermal mass of the building, and ΔT is the change in temperature. Finding the thermal mass will help compare buildings. Apart from the thermal mass the resistance or conductance of a building is a measure for insulation. We begin our investigation with a simple model for a house where we consider only two components of the circuit conductance(R) and thermal mass(C). The exact solar radiation can't be quantified without exact sensor data so we begin our study to find alternative approaches to modeling the building heat dynamics. The heat dynamics of the is given by the state space equations as follows -

$$\frac{dT_i}{dt} = \frac{1}{CR}(T_a - T_i) + \frac{1}{C}\Phi_h + \frac{A_w}{C}\Phi_s + \sigma_i \frac{d\omega_i}{dt} \quad (2)$$

$$Y_{i,t} = T_{i,t} + \epsilon_t \quad (3)$$

The equations (2) and (3) are the state-vector equations and the measurement equations respectively. The thermal resistance is given by R and the thermal mass by C. More detailed thermal mass and resistance for building materials can be obtained where the individual thermal mass can be taken under consideration like that for building envelope, the walls and furniture etc. We found that the simplest model can be exactly achieved with slightly better residual loss using a regression model - (Generalized Linear Model(GLM)). One of the advantages of GLM is the training process is simpler and it is easier to model and represent abstract information for example cloud cover and time of day features and help construct a discriminative model.

The state space equation can be discretized as

$$\frac{dT_i}{dt} = \frac{1}{CR}(T_a - T_i) + \frac{1}{C}\Phi_h + \frac{A_w}{C}\Phi_s + \sigma_i \frac{d\omega_i}{dt} \quad (4)$$

$$T_i(t+1) = (1 - \frac{1}{CR})T_i(t) +$$

$$(\frac{1}{C}\Phi_h(t) + \frac{A_w}{C}\Phi_s(t) + \frac{1}{CR}T_a(t)) \quad (5)$$

$$T_i(t+1) = c_1T_i(t) + c_2\Phi_h(t) + c_3\Phi_s(t) + c_4T_a(t) + \epsilon$$

$$1 - C_1 = C_4 \quad (6)$$

The discretization of the state space equation gives us an approximate equation which is given in Eqn 6. This can be seen as a constrained regression equation and instead of using the a complex Extended Kalman Filter based approach we can solve it using regression techniques. We compared the errors in residuals among Extended Kalman Filter(EKF), constrained Generalized Linear Model(GLM) and Generalized Additive Model(GAM). We found that the GAM gives comparatively less error in estimation than either of them as shown in Table 3.1. We compared regression models in Table 3.1 and found that GLM gives us better results for most of the cases. While GAM outperforms the rest some of the times, it is easier to obtain the co-efficients from GLM. We also list the parameters Thermal Mass(C) and Insulation(R) for each of the homes. While CTSM outperforms GLM some of the times, its mostly for smaller datasets and it even fails to converge sometimes if the data is too large. A sample output showing the residuals of CTSM and GLM has been shown in Figure 1a.

The main dataset for comparison is Pecan Street's Dataset. We found that the regression models perform better for them than the CTSM model which results in high residual errors for this dataset. The other problem is CTSM seems to work better for smaller samples while more parameters can be added in case of GAM models where in case of absence of certain parameters like Solar radiation complex features like Time of Day, Cloud cover etc. can be added. Also, the initialization for the parameters require specification of the range of values for the parameters need to be specified. CTSM suffers from convergence error on large datasets, like that from Pecan Street Dataport.

Thermal Mass Metric: Thermal Energy of a house is theoretically quantified as the product of the Thermal Mass and the change in temperature which is the energy loss for a particular change in temperature. This is a better metric for comparison and can be better evaluated from the dataset. So the time to heat or cool a house upto a Thermostat setpoint and also the heat dynamics during non-heating hours can be used as two different metrics for comparative purposes. One of the drawbacks of these methods is the reliance on indoor temperature for model development which may not be available all the time. Rather it's easier to obtain the Thermostat Metrics which are the different durations in which thermostat settings are changed and the setpoints of those settings. In the next section, we investigate the different approaches to find the Thermostat Metrics. While the capacitance and resistance provide a vague idea regarding building parameters it does not provide the idea about any comparative basis regarding how long it takes to heat or cool a house and how long it can retain or lose heat. In [?], provides a similar take on Thermal Mass Metric however the metric requires data regarding building construction material. It mentions about the charge and discharge of thermal mass relative to season, which is heaty cooling down the mass on a summer night and warming it up on a winter day. Hence the metric should address both the abilities. Apart from temperature more parameters can be taken into consideration like humidity, cloud cover and wind speed as that may have influence on user comfort.

3.2 Finding the thermostat setting of homes

Utility providers may not have access to the buildings' indoor temperature. However, they do have access to the heat consumption data and weather information which can help decide in a locality which houses have more consumption. It is easier to get a survey regarding the thermostat settings for ground truth evaluation. We take the motivation for two different thermostat metrics have been suggested in [5] - Thermostat Habits Metrics and Thermostat Setpoints Metrics. The habits metrics has been described as the habitual changes in thermostat setpoints which can be obtained from outdoor temperature and thermostat cycle.

3.2.1 Thermostat Habit Metrics:

People use different settings for thermostats as per their comfort and energy savings requirements. The different user habits for thermostat settings has a direct relationship with HVAC usage and the . The duty cycle of a thermostat is the fraction of time in a given ON/OFF cycle that the air conditioner/heater is turned on. The previous work in [5], normalized usage data at a half-hour resolution giving the idea about the fraction of the half hour it was ON. The external temperature data has a hourly resolution which was interpolated to get a half-hour resolution. The Statistical Habits Metrics used were correlation (Pearson product-moment coefficient) between the binned temperature data and the binned usage data is one such metric. As there is expected to be some time-delay between outdoor temperature and thermostat response due to thermal mass of the house the correlation was computed in time-shift. The survey responses were quantified as: $\sigma(T0)$ standard deviation of the four survey-reported values of summer weekday T0; $\text{spread}(T0)$ is the difference between the maximum and minimum values of these four values; $\Delta T0$ is the difference between the workday value and the sleeping hours value. It was found most of the houses that have a high habits metric indeed have a low $\Delta T0$ and can be used for classifying houses and find which houses are likely to change thermostat settings more often and have large difference in settings values.

The lagged correlation between the outdoor Temperature and binned duty cycle is a good indicator of the thermostat habits. The lagged correlation helps develop ideas about thermal mass. We tested the efficacy of this approach, but computing correlation between the outdoor temperature and duty cycle at a daily basis. We found that the R value changes from day to day depending on usage and the lag value is also variable. Also as per the definition of Thermostat Habits, its the sudden change of thermostat changing and its habitual change which the previous work does not attempt to address. In Figure 1, a sample dataset from two homes and the correlation between outdoor temperature and duty cycle of AC, from a single day's usage has been shown.

3.2.2 Thermostat Setpoint Metrics:

The thermostat setpoint is an indicator of the amount of energy being used and also the indoor temperature. In the previous work the setpoint is computed using Robust Regression . The heat introduced by air-conditioner(negative heat) or heater is correlated with the indoor and outdoor temperature, which can be related with the duty cycle. The intercept for the regression is the setpoint metric for the thermostat. Conceptually, the thermostat settings metric is the representation of the thermostat setpoint. If the thermostat setpoint is set to either of heating or cooling mode, the thermostat setpoint is expected to be the indicator of the indoor temperature and a base line for the indoor temperature measurement. The thermostat setpoint is changed depending on the time of the day and can be changed by users to a certain degree as per comfort.

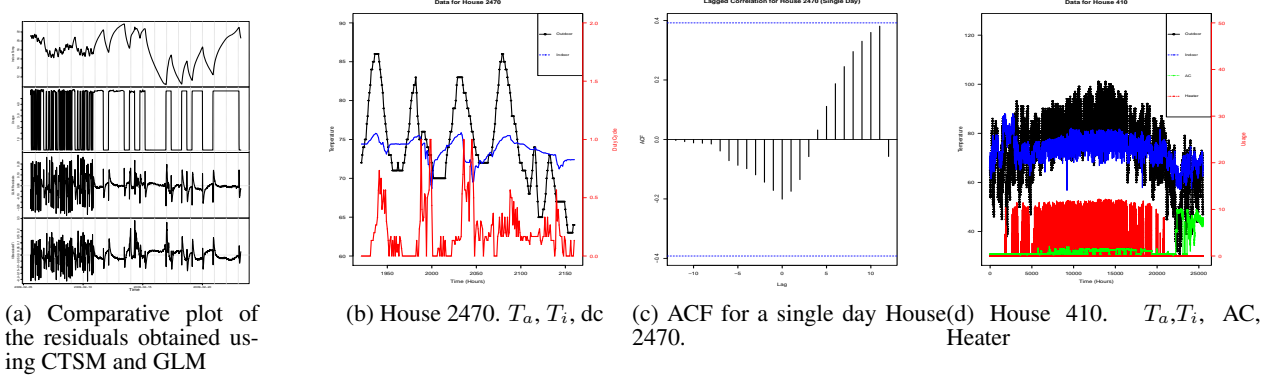


Figure 1: Sample Dataset of two homes

The relationship between duty-cycle dc and the setpoint T_0 is given as,

$$T_a \sim \left(\frac{Q_c}{K}\right)dc + \left(T_0 - \frac{Q_{other}}{K}\right) \quad (7)$$

The suggested method for finding the setpoint metric is by constructing a robust linear model with a bisquared function. The coefficient is given by regression is the Setpoint metric which is the part $(T_0 - \frac{Q_{other}}{K})$. For the regression to work, data needs to be split properly depending on the Thermostat settings and also it requires a certain amount of usage or else the regression won't work. This requires laborious pre-processing and selecting proper duration in which the method is applicable. Such a method is a serious drawback for generalizability and large scale analytics.

3.2.3 A combined approach for Thermal Mass & Thermostat Metrics:

We found that finding either of the metrics independent of one another becomes complex. Firstly, the task of finding the Thermostat Habits can be generalizable as consumers are more likely to keep similar settings over a period of time when the weather has similarities. We found in certain cases usage varies over the day and also even in the same time of day, which is attributed by thermal mass. When a house is heated or cooled, the thermal mass stores the heat which causes the lag in usage. The ideal thermal mass for winter time will capture heat during day and store it at night and in summer will shade the house from summer sun. The first problem that we want to address is detecting change in thermostat set points, given the outdoor temperature and usage pattern. We use the indoor temperature as for groundtruth valuation. The time series data itself has some auto-regressive effect which we want to utilize and added to that we want to combine periodicity for generalization. For computing the Thermostat settings values, some ground truth is needed and the problem can be better obtained addressed using the indoor temperature data.

3.3 Modeling Consumption patterns from thermostat settings

The indoor temperature is expected to be within the hysteresis range of the setpoint and the thermostat settings can be expected to be the indicator of indoor temperature. Hence given the thermostat metrics, which are the setpoints and duration of change is provided. The dataset will require heater or AC usage and the starting point will be after one complete cycle of usage, where the indoor temperature can be assumed to be $T_0 - \delta$, where T_0 is the thermostat

setting and δ is the hysteresis band. The duration of each continuous cycle can be chosen as a parameter as that is the time it takes from $T_0 + \delta$ to go down to $T_0 - \delta$, when AC is on and vice versa for heating. The whole problem can be framed as a function of time rather than indoor temperature.

3.4 IR Based Building characteristics

After the identifying the potentially wasteful homes, we address the problem of detecting leakages and develop more detailed heat dynamics models of the homes. We compare two different datasets - one is the individual room-wise temperature data and the other is an image sensing unit using IR camera.

3.4.1 Individual Roomwise Data for Modeling Heat Dynamics:

We have setup temperature and humidity sensors in different parts of the house and have a NEST thermostat installed. The temperatures from different parts of the house is shown in Figure 2b. It can be seen that different parts of the house has different dynamics of temperature. This is dependent on a number of factors like exposure to sun, local heaters being used. The objective here is to get a detailed model of the house in terms of individual room-wise parameter identification considering local factors. This in turn can help us isolate the leakages or poor thermal capacity or even the

3.4.2 Imaging Device

The physical component of the thermal imaging system is a custom-created imaging device as pictured in Figure 2a. Our prototypes are built from a Raspberry Pi Zero, a Raspberry Pi Camera Module, and a low-resolution IR camera, powered by a 5V battery, rotating on a DC motor, in a 3D printed housing. This sensor's purpose is to collect data from which to create a longitudinal thermal map of a room and from which to detect the variations representing leakages and other energy waste.

There are two cameras in the imaging device. The IR camera is Melexis MLX90621 [3], which is a low resolution ($16\times$) and low power consumption of $< 9mA$ when active and $< 7\mu A$ otherwise. It can detect ambient temperature between $-40^\circ C$ and $85^\circ C$ and object temperatures between $-50^\circ C$ and $300^\circ C$ with a resolution of $0.02^\circ C$. The Raspberry Pi Camera Module [4] is a RGB camera and collects images at 720×480 resolution. The 3D printed housing holds the cameras in a consistent relative position and orientation. The Raspberry Pi Zero controls the device and rotates the sensor unit (at 15min-1hour interval as per setting) for a number of steps sufficient to rotate at least $360^\circ C$. For every step, the Pi collects a

simultaneous image from each camera. After the batch of rotations completes, the imaging device uploads the collected images to a server for processing.

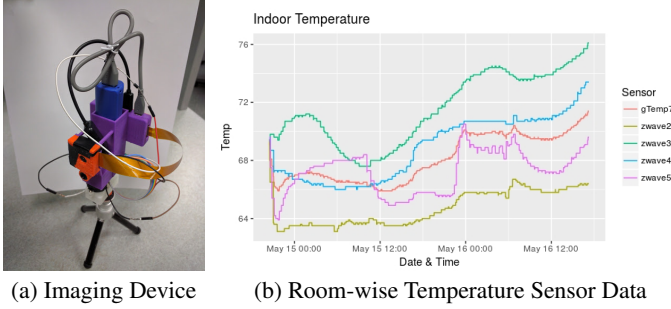


Figure 2: Imaging Device and Room-wise Temperature Data

3.4.3 Image Processing

On the image processing server, we use the RGB and IR image sets to generate a unified thermal map of the room. The first image processing step uses OpenCV to generate a panorama from the RGB images and record the homography matrices used for those image transformations. This process allows us to avoid the need for a heavier, more expensive stepper motor, because those homography matrices encode the relationships between sequential images. The second step uses those matrices to produce an IR panorama of the room. The 3D printed housing of the imaging device maintains a fixed relationship between the positions and perspectives of the two cameras in each prototype. We calculate the mapping between the cameras once and, at processing time, use this transformation in addition to the homographies calculated in the RGB stitching process. Thus, we map each IR image on to its corresponding RGB image, then stitch those transformed IR images to create an IR panorama of the room.

We propose to use the IR camera in tandem with a digital camera to detect and appropriately map the heatmap's points of interest in contrast to the presence of buildings air leakages, heat dissipation associated with different objects and appliances while achieving high precision and detection accuracy. While the specific color codes of heatmaps help detect the moderate, extreme or regular hot and cold surfaces, augmenting this with digital images helps detect any unusual usage behaviors, and operating conditions of everyday appliances in a smart home environment. For example, if a room has multiple windows and doors with air leakages or multiple similar small to medium load appliances, solely the heatmaps may not provide the home owners the adequate information as needed to detect any abnormal energy usage. While the IR camera albeit helps detect the region of interest but fails to provide the detailed identifications of the similar type of objects and appliances.

We employ the digital stitching procedure [?] to create the thermal panorama. We first stitch the digital images and maintain the respective control points for the stitching procedure which we reemploy to process the stitched thermal image generation. Next we augment the digital image in the background of the stitched thermal image based on the respective control points. We use a hybrid image construction methodology where the mask image or the thermal image is passed through a low pass filter and the digital image is passed through a high frequency filter to construct the digital image augmented heatmaps. We then apply a image segmentation algorithm to determine the different heatzone clusters in the stitched image. The temperature of each cluster is then compared

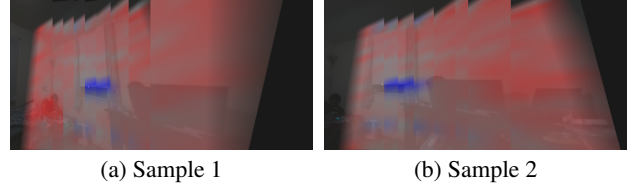


Figure 3: Overlapped Room Image and IR image

with entries in a lookup table to determine the state of a specific appliance.

3.4.4 Initial Image Analytics

There are three possible types of thermal regions in an image - background, cold region and hot region. The image that needs to be segmented is the stitched IR image and the objective is to create a thermal mask which separates the hot and cold regions from the background. Since the thermal image is being used for segmentation, the results are subject to the choice of color palette and range selection. We ensure that the background has darker tones than the hot or cold surfaces which helps achieve the desired segmentation after image binarization using Otsu's method [14]. We apply a 7×7 neighborhood 2-D median filter to eliminate small blobs and isolate the few major thermal zones. Initial experiment suggested that it is easy to detect human presence and objects as long as the wall temperature do not mask them. In Figure 3, shows two sample stitched images during different time duration. It can be seen that there is a slight cool area detected near the window given in a deeper shade of blue.

The challenges in stitching mainly stem from our simple approach. Better image stitching can solve the problem. Alternatively, rotating the unit on a stepper motor, instead of DC motor, can be another solution which can up the unit price by \$8. We're doing feature-detection based stitching, which has a lot more difficulty with close-up objects and with blank, featureless walls and the unit positioning is another factor. Ideally keeping the unit centered in the room may solve the problem however that can cause logistical problems.

4. CONCLUSION

In this paper, we propose a city wide Virtual Audit System to identify energy waste in residential homes and provide a detailed feedback on the reason for such a loss. We identify the building parameters, the thermostat settings and settings habits and isolate which of these factors is contributing to energy waste. We also propose an intrusive thermal imaging based system to identify leakages and potential poor insulation in buildings.

5. REFERENCES

- [1] Bacher, Peder, and Henrik Madsen. Identifying suitable models for the heat dynamics of buildings. *Energy and Buildings* 43.7 (2011): 1511-1522.
- [2] Rao, Vaishakh, and Anthony Rowe. Low-cost continuous thermal sensing. *Proceedings of the Third ACM Workshop on Embedded Sensing Systems for Energy-Efficiency in Buildings*. ACM, 2011.
- [3] <https://www.melexis.com/en/product/MLX90621/Far-Infrared-Sensor-Array-High-Speed-Low-Noise>
- [4] Sylvia J. Smullin, Thermostat metrics derived from HVAC cycling data for targeted utility efficiency

- programs , Energy and Buildings, Volume 117, 1 April 2016, Pages 176-184.
- [5] Robert A. Taylor, Mark Miner, A metric for characterizing the effectiveness of thermal mass in building materials, Applied Energy, Volume 128, 1 September 2014, Pages 156-163, ISSN 0306-2619.
 - [6] Wood, Simon. Generalized additive models: an introduction with R. CRC press, 2006.
 - [7] <https://aeotec.freshdesk.com/support/solutions/articles/6000167331-multisensor-gen5-technical-specification->
 - [8] <http://ctsm.info/pdfs/examples/building2.pdf>
 - [9] <http://www.pecanstreet.org/>
 - [10] G. W. Hart, Nonintrusive appliance load monitoring, in Proceedings of the IEEE, vol. 80, no. 12, pp. 1870-1891, Dec 1992.
 - [11] Perez, Krystian X., et al. Nonintrusive disaggregation of residential air-conditioning loads from sub-hourly smart meter data. Energy and Buildings 81 (2014): 316-325.
 - [12] Lund, Robert, et al. Changepoint detection in periodic and autocorrelated time series. Journal of Climate 20.20 (2007): 5178-5190.
 - [13] <http://www.pyimagesearch.com/2016/01/11/opencv-panorama-stitching/>
 - [14] Otsu, Nobuyuki. A threshold selection method from gray-level histograms. Automatica 11.285-296 (1975): 23-27.