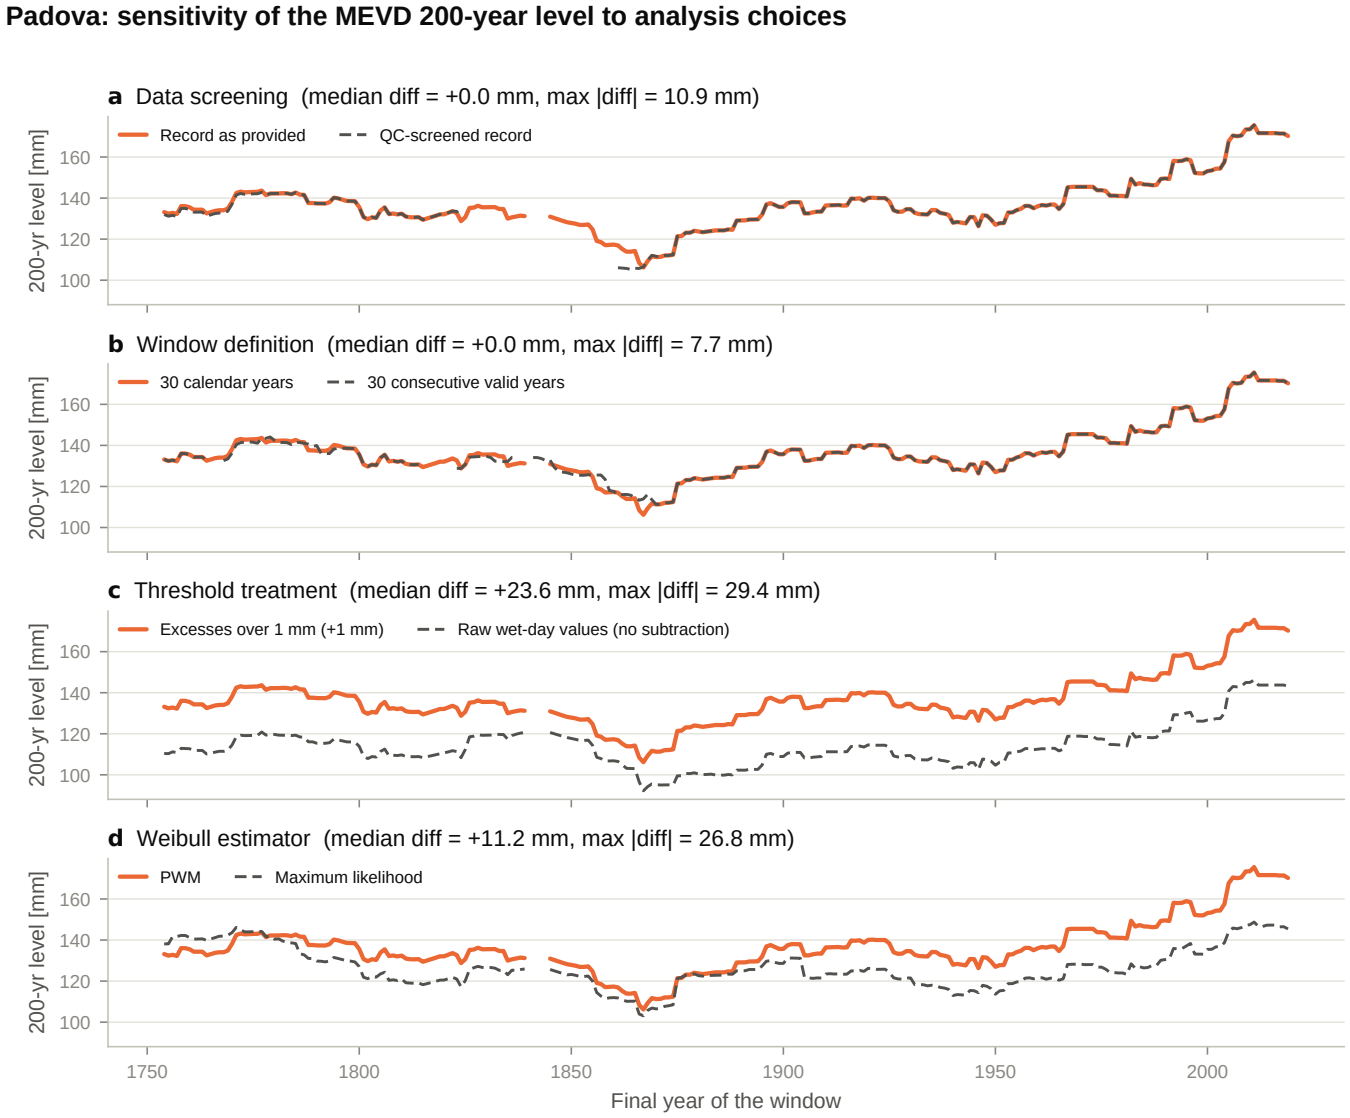
Padova: sensitivity of the MEVD 200-year level to analysis choices
a Data screening (median diff = +0.0 mm, max |diff| = 10.9 mm)
Record as provided
QC-screened record
b Window definition (median diff = +0.0 mm, max |diff| = 7.7 mm)
30 calendar years
30 consecutive valid years
c Threshold treatment (median diff = +23.6 mm, max |diff| = 29.4 mm)
Excesses over 1 mm (+1 mm)
Raw wet-day values (no subtraction)
d Weibull estimator (median diff = +11.2 mm, max |diff| = 26.8 mm)
PWM
Maximum likelihood
200-yr level [mm]
100
120
140
160
1750
1800
1850
1900
1950
2000
Final year of the window