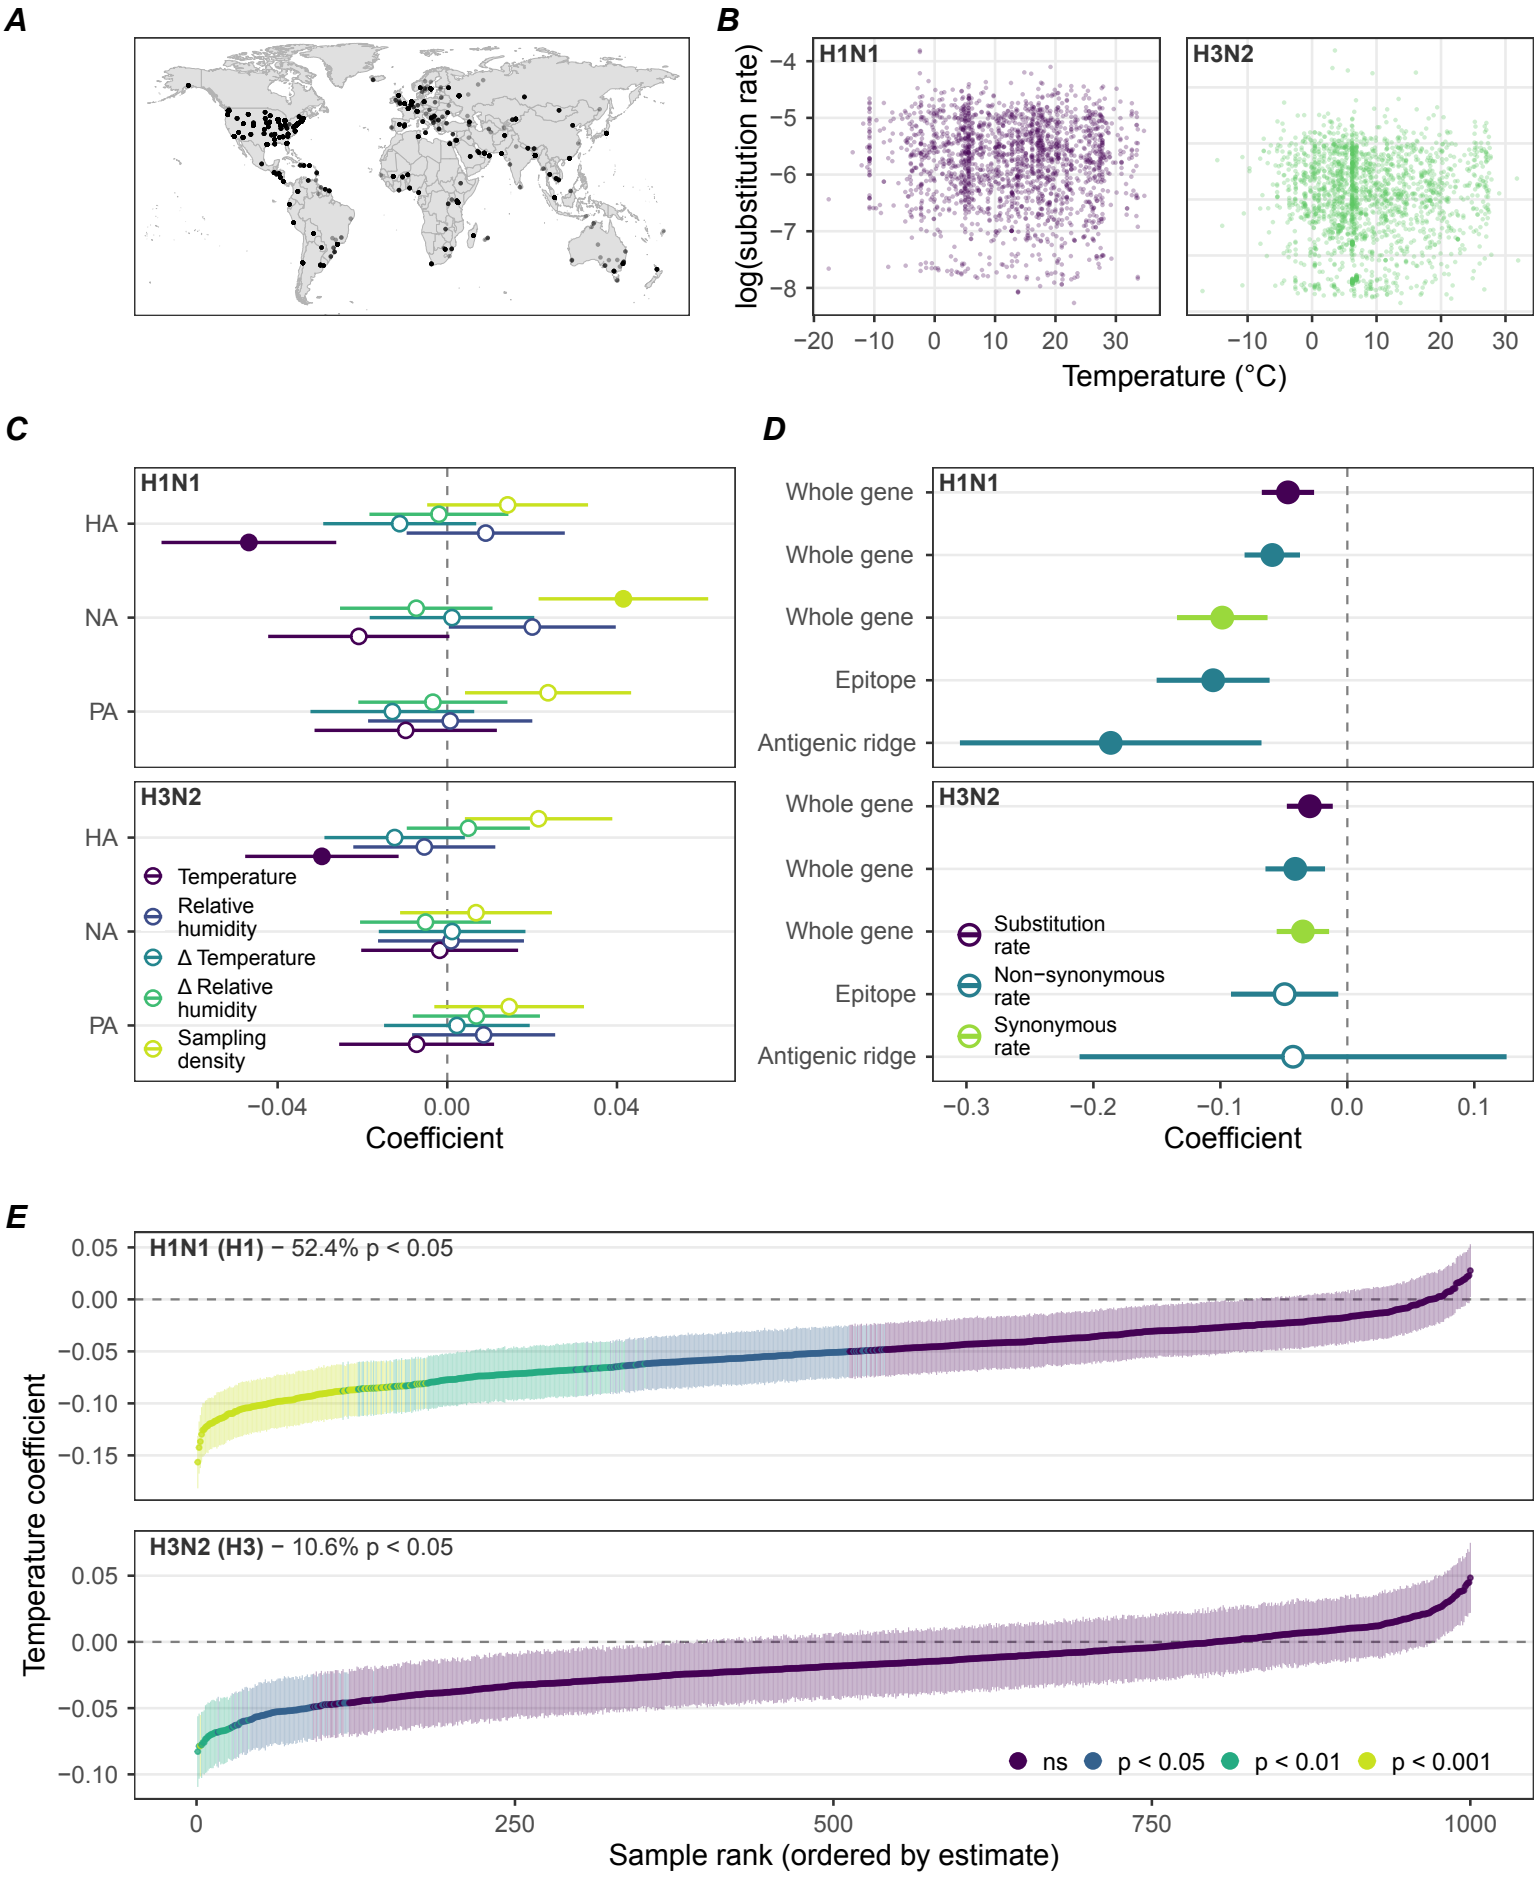

A
B
H1N1
H3N2
log(substitution rate)
−4
−5
−6
−7
−8
−20
−10
0
10
20
30
Temperature (°C)
C
D
H1N1
HA
NA
PA
H3N2
Temperature
Relative humidity
Δ Temperature
Δ Relative humidity
Sampling density
−0.04
0.00
0.04
Coefficient
Whole gene
Epitope
Antigenic ridge
Substitution rate
Non−synonymous rate
Synonymous rate
−0.3
−0.2
−0.1
0.0
0.1
E
H1N1 (H1) − 52.4% p < 0.05
H3N2 (H3) − 10.6% p < 0.05
Temperature coefficient
0.05
0.00
−0.05
−0.10
−0.15
ns
p < 0.05
p < 0.01
p < 0.001
0
250
500
750
1000
Sample rank (ordered by estimate)