

Standard Name 488 of 509

↑

19106/230150D-B

↓

Visual Hue Request:

New Std	Retrieve Std	Store Std	List Std	Update Std
---------	--------------	-----------	----------	------------

Instrument Setup:%R LAV SCI UV Cal

Date: 19-May-23 Time: 11:27:50

Batch Name 2 of 3

↑

120130IR-02 83696 EXP2300605 TRAVERSE G

↓

New Bat	Retrieve Bat	Store Bat	List Bat	Update Bat
---------	--------------	-----------	----------	------------

Instrument Setup: %R LAV SCI UV Cal


Date: 07-Aug-23 Time: 11:30:58

CMC DE Pass/Fail Tolerance: 1.00

I:c Ratio: (2.00 1.00)

Measured by:

Batch Name	III/Obs	DL*	Da*	Db*	DL*/ISL	DC*/cSC	DH*/SH	CMC DE	M.I.	P/E	Color	Comments	
R2218265 23120130IR-02 83696 EXP2300605 TRAVERSE G	D65 10 Deg	-0.37	0.20	-0.06	-0.21	-0.07	0.29	0.36		Pass	too dark	too dull	too blue
R2218265 23120130IR-02 83696 EXP2300605 TRAVERSE G	F11 10 Deg	-0.36	0.14	-0.06	-0.21	-0.09	0.19	0.29	0.06	Pass	too dark	too dull	too blue
R2218265 23120130IR-02 83696 EXP2300605 TRAVERSE G	A 10 Deg	-0.36	0.00	-0.00	-0.20	0.00	0.00	0.20	0.20	Pass	too dark	too bright	too red

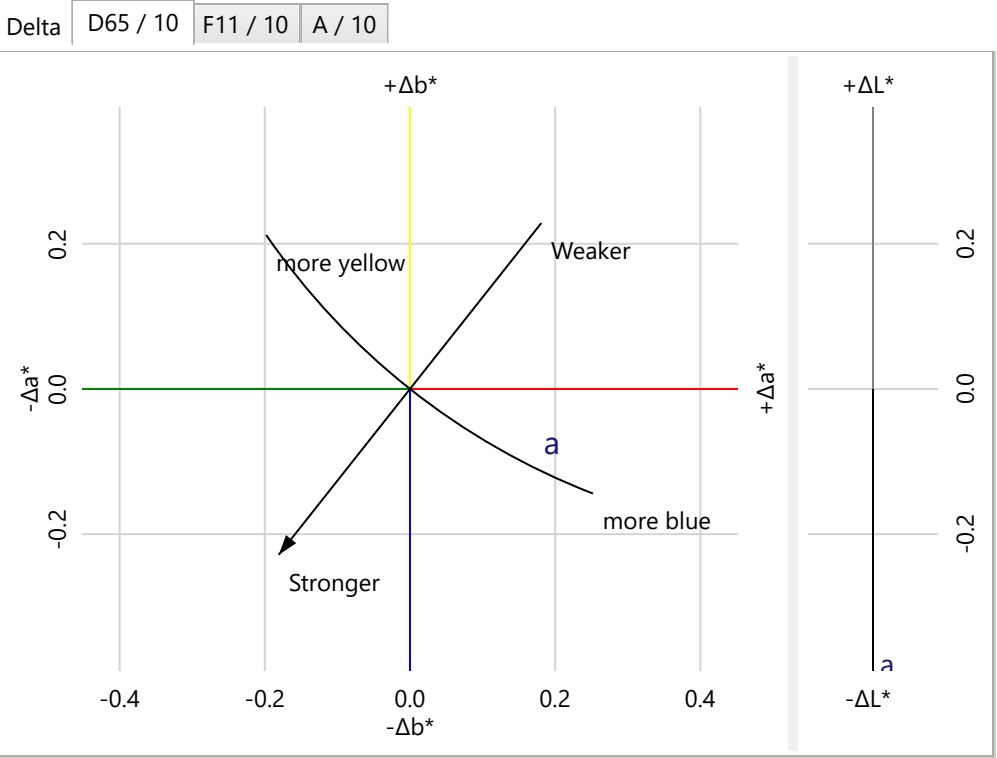

Single/All

CMC Plot

Zoom Out

Zoom In

Print Form