

Standard Name139 of 159

↑

20124/220356S-A

↓

Visual Hue Request:

New StdRetrieve StdStore StdList StdUpdate Std

Instrument Setup:%R LAV SCI UV Cal

Date: 20-Jun-22Time: 13:47:24

Batch Name2 of 2

↑

1741911 53671 EXP2300153 COLLEGE COBAL

↓

New BatRetrieve BatStore BatList BatUpdate Bat

Instrument Setup: %R LAV SCI UV Cal


Date: 16-Mar-23Time: 14:46:03

CMC DE Pass/Fail Tolerance: 1.00

I:c Ratio: (2.00 1.00)

Measured by:

Batch Name	III/Obs	DL*	Da*	Db*	DL*/ISL	DC*/cSC	DH*/SH	CMC DE	M.I.	P/E	Color	Comments	
R2218265 4501741911 53671 EXP2300153 COLLEGE COBAL D65 10 Deg	-0.94	-0.05	0.61	-0.66	-0.27	0.08	0.72			Pass	too dark	too dull	too red
R2218265 4501741911 53671 EXP2300153 COLLEGE COBAL F11 10 Deg	-0.82	-0.39	0.90	-0.63	-0.40	-0.18	0.76	0.42		Warn	too dark	too dull	too green
R2218265 4501741911 53671 EXP2300153 COLLEGE COBAL A 10 Deg	-0.88	-0.33	0.75	-0.69	-0.30	-0.29	0.80	0.58		Warn	too dark	too dull	too green

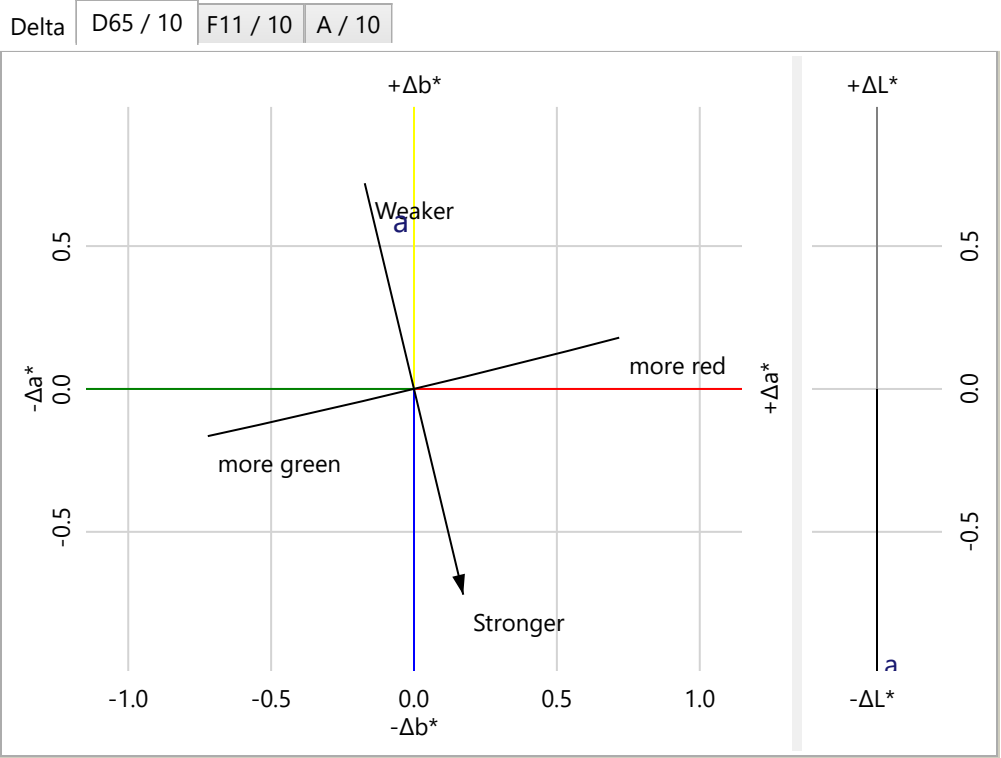

Single/All

CMC Plot

Zoom Out

Zoom In

Print Form