

Standard Name

3 of 23

↑

7091/230195D-A

↓

Visual Hue Request:

New Std

Retrieve Std

Store Std

List Std

Update Std

Instrument Setup:%R LAV SCI UV Cal

Date: 03-Apr-23

Time: 11:59:36

Batch Name

1 of 1

↑

3120147IE-02 83296 EXP2300598 GLAZE PINK

↓

New Bat

Retrieve Bat

Store Bat

List Bat

Update Bat

Instrument Setup: %R LAV SCI UV Cal

Date: 14-Aug-23

Time: 10:57:10


CMC DE Pass/Fail Tolerance:

1.00

I:c Ratio: (2.00 1.00)

Measured by:

Batch Name	III/Obs	DL*	Da*	Db*	DL*/ISL	DC*/cSC	DH*/SH	CMC DE	M.I.	P/F	Color	Comments	
SJS7091 23120147IE-02 83296 EXP2300598 GLAZE PINK	D65 10 Deg	0.34	-0.12	-0.37	0.15	-0.07	-0.20	0.26		Pass	too light	too dull	too blue
SJS7091 23120147IE-02 83296 EXP2300598 GLAZE PINK	F11 10 Deg	0.36	0.00	-0.31	0.16	-0.04	-0.18	0.24	0.15	Pass	too light	too dull	too blue
SJS7091 23120147IE-02 83296 EXP2300598 GLAZE PINK	A 10 Deg	0.30	-0.16	-0.44	0.12	-0.13	-0.21	0.27	0.17	Pass	too light	too dull	too blue

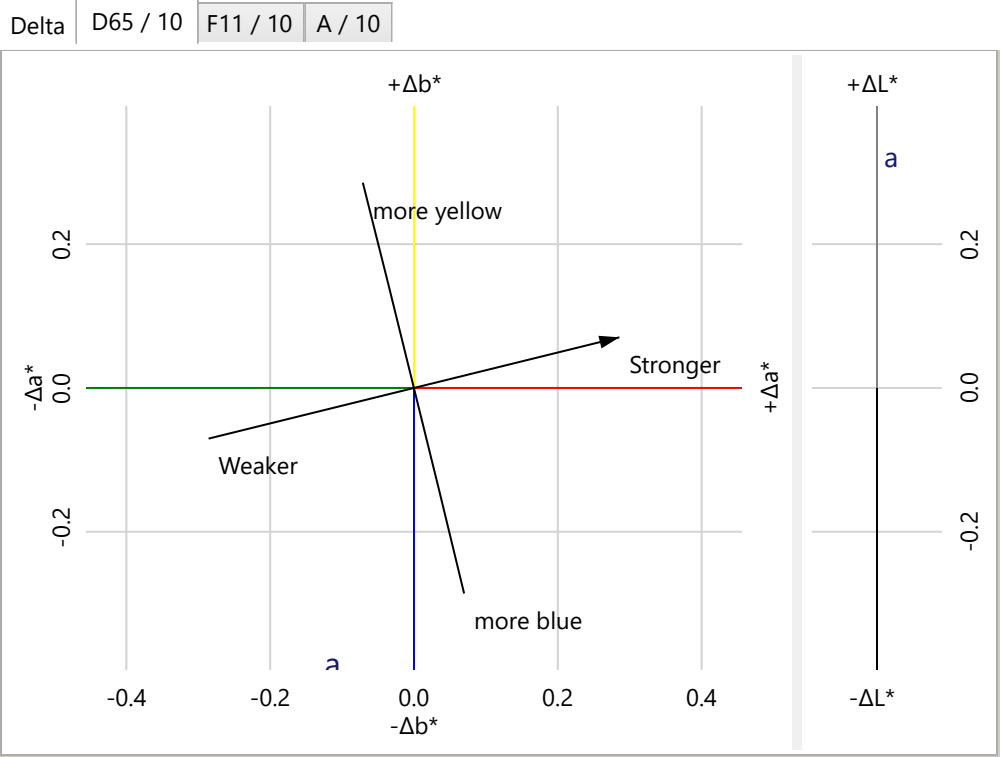

- Single/All
- CMC Plot
- Zoom Out
- Zoom In
- Print Form