
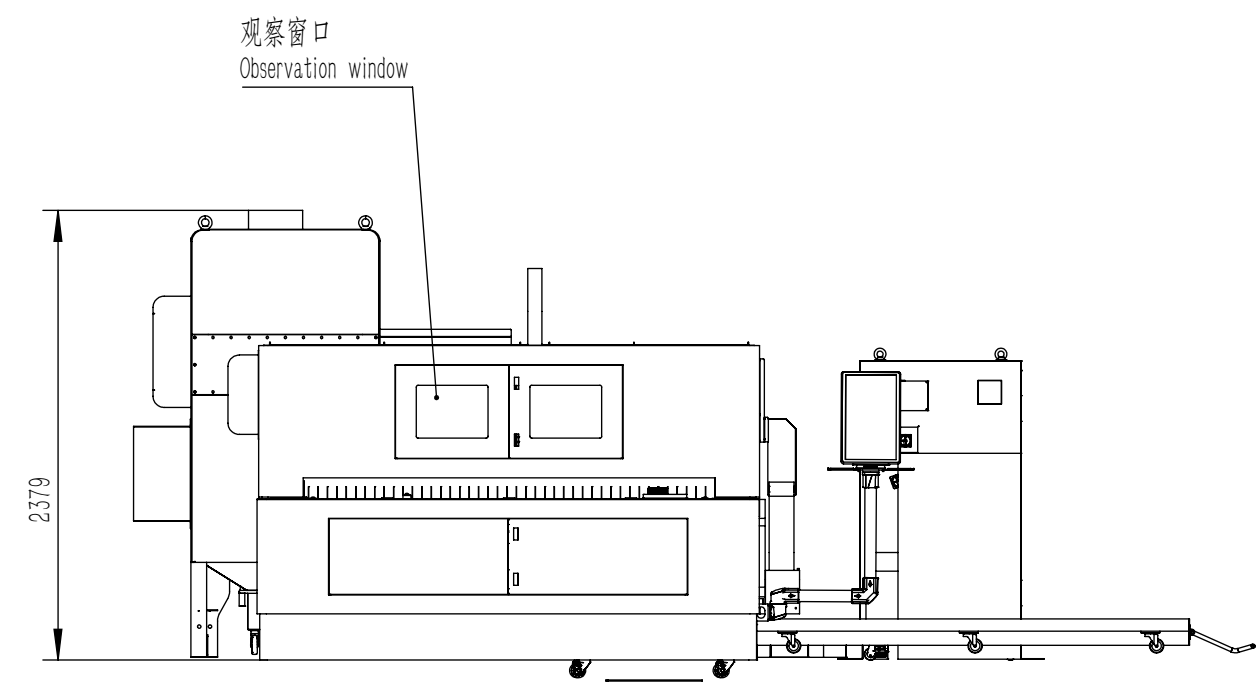


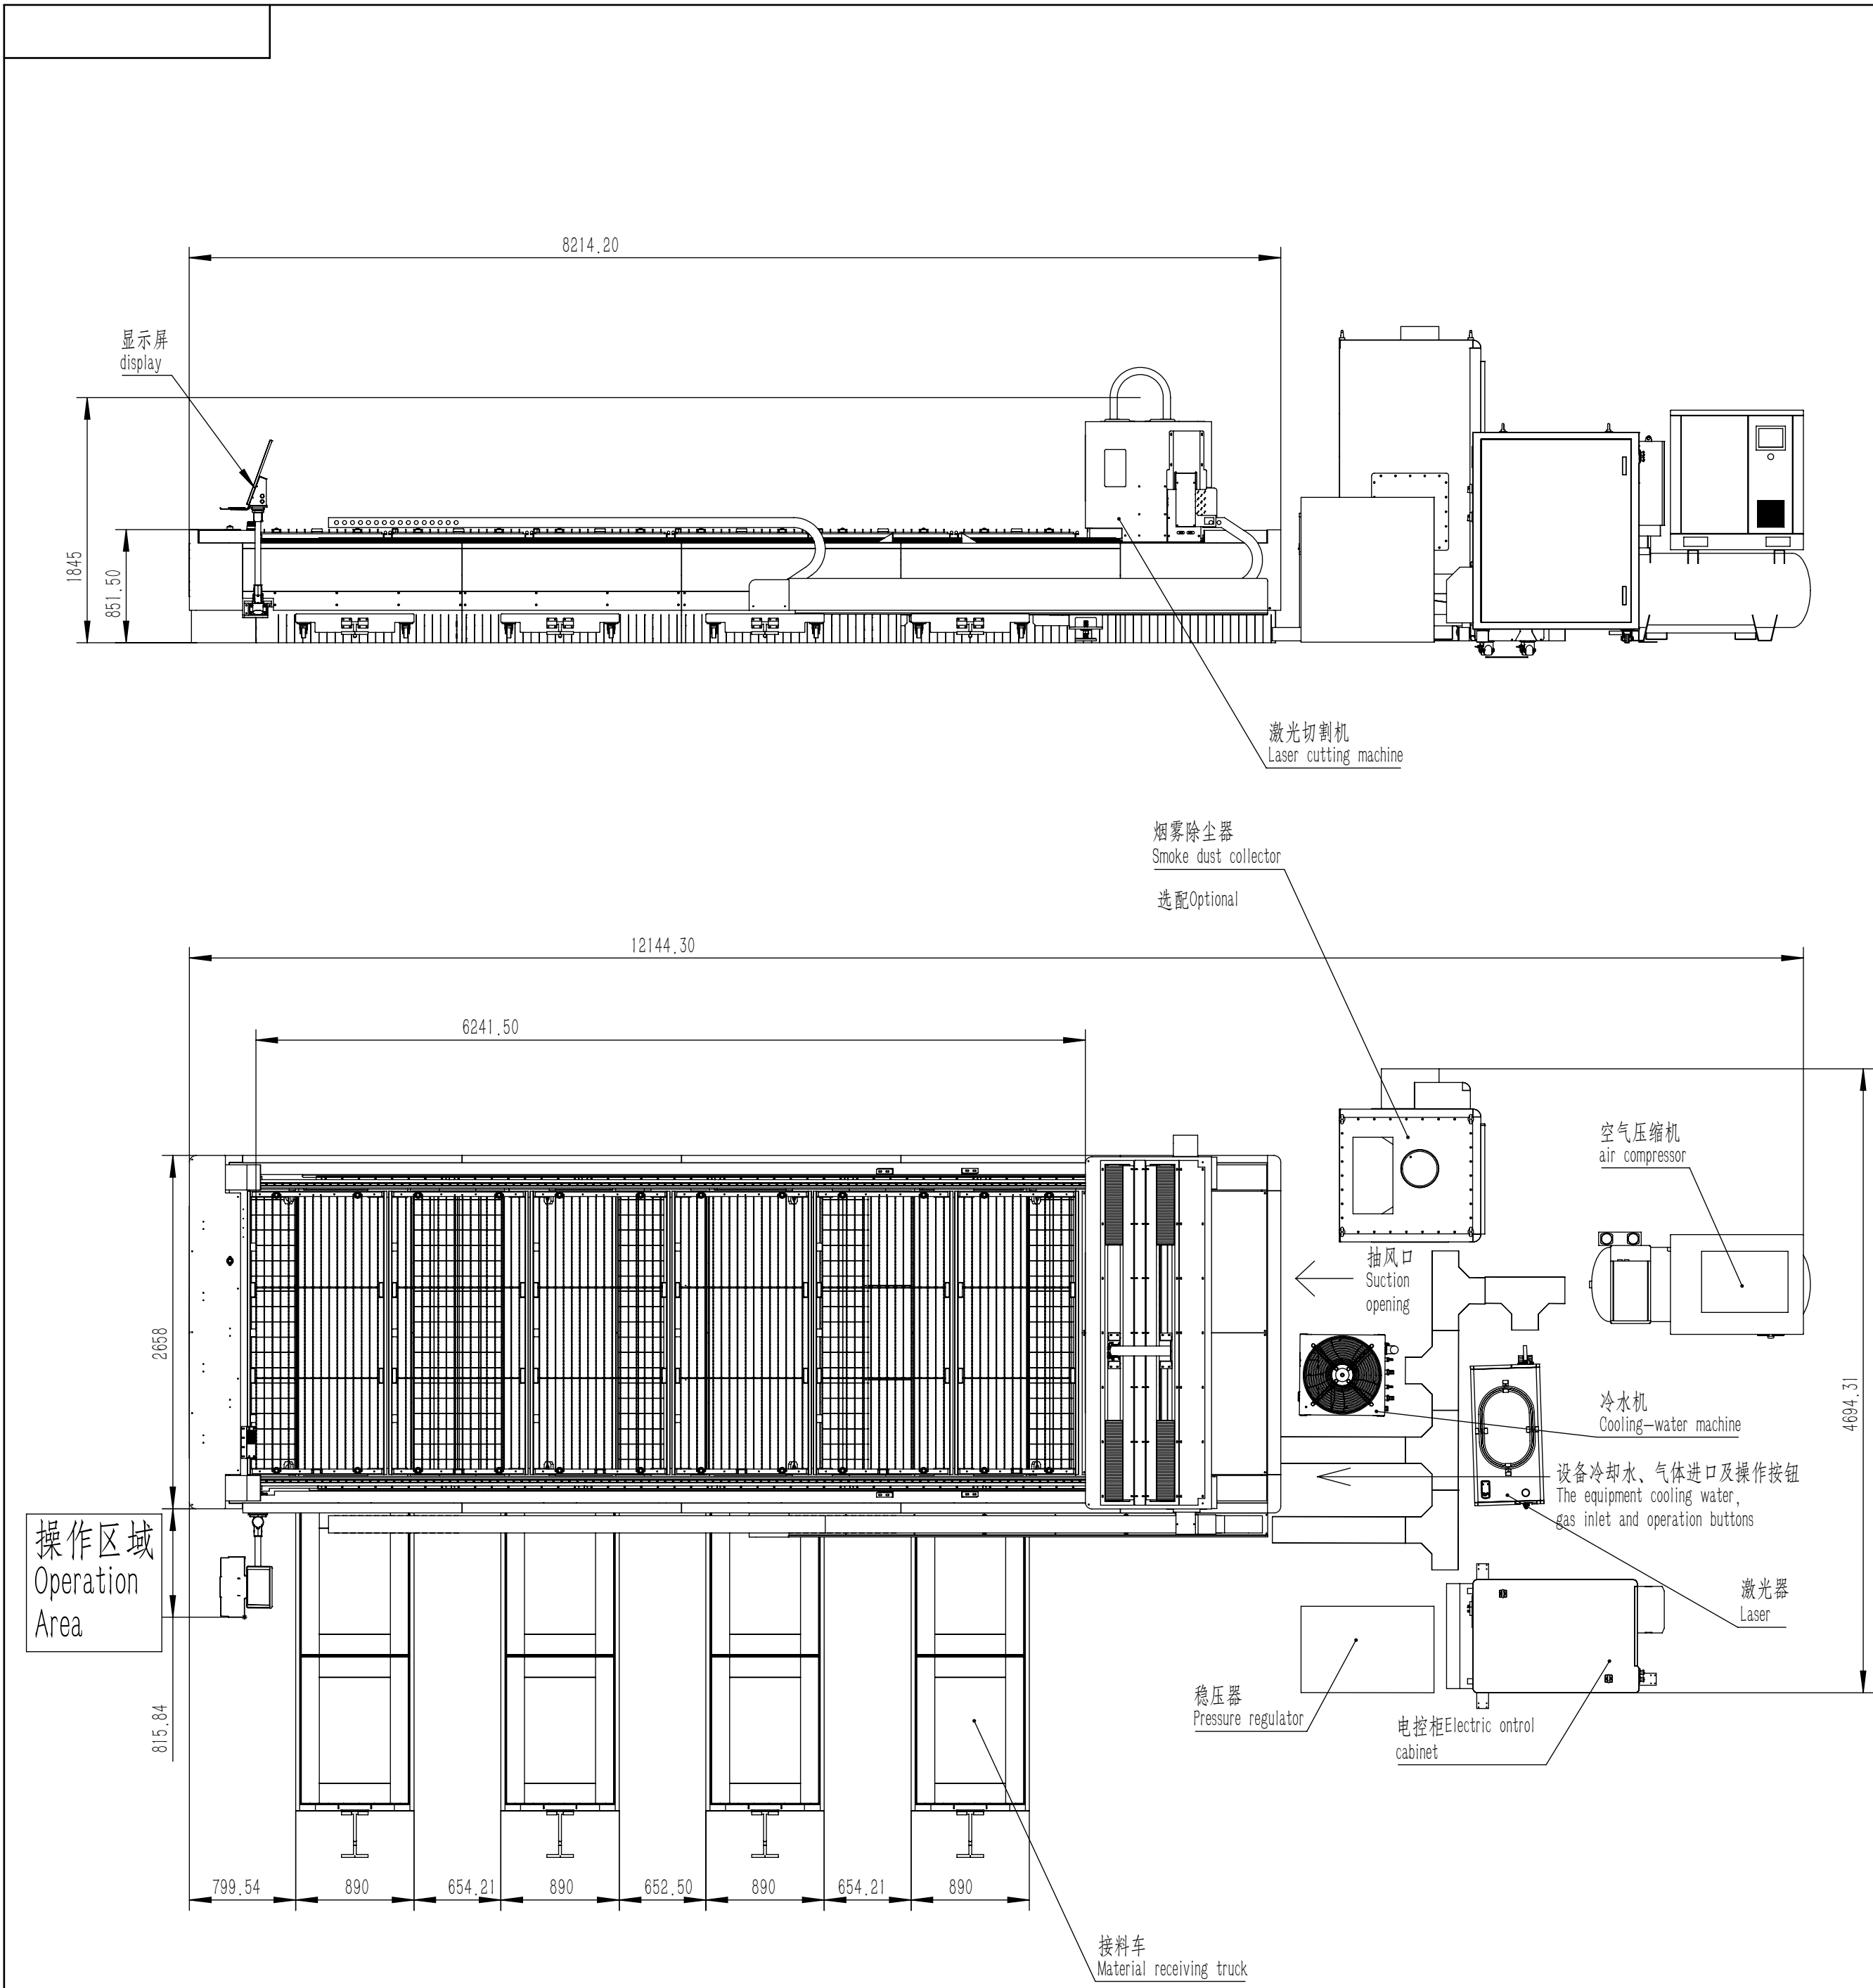

注意Note:
1. 整机应远离振源;
The equipment should be away from the vibration source;
2. 整机现场地面平整度不大于5mm;
Field ground flatness not greater than 5mm;
3. 整机接入电压浮动5%以内。周围500mm内设置接地点, 接地电阻小于4Ω
Power requirement;device access voltage fluctuation does not exceed%5;The grounding resistance is less than 4Ω When the grounding point is set withun 500mm
4. 此图仅供参考, 客户可根据自身需要布置, 如影响线缆长度应及时告知;
This diagram is for reference only. Customers can arrange it according to their own needs. If it affects the length of the cable, they should inform us in a timely manner.
5. 此图中显示的附件支架只是原理图图表。客户可以根据自己的需求来制作。
如果有任何变化, 他们应该及时通知我们
The attachment bracket shown in this figure is only a schematic diagram. The customer can make it according to their own needs. If there are any changes, they should inform us in a timely manner

产品编码:

					材质 <未指定>			济南金强激光数控设备有限公司	
标 记	处 数	更改文件号	签 字	日 期					
设 计			工 艺		比 例	件 数	净 重		
制 图			标准化		1:40	1			
校 核									
审 核			批 准		共 1 页	第 1 页			