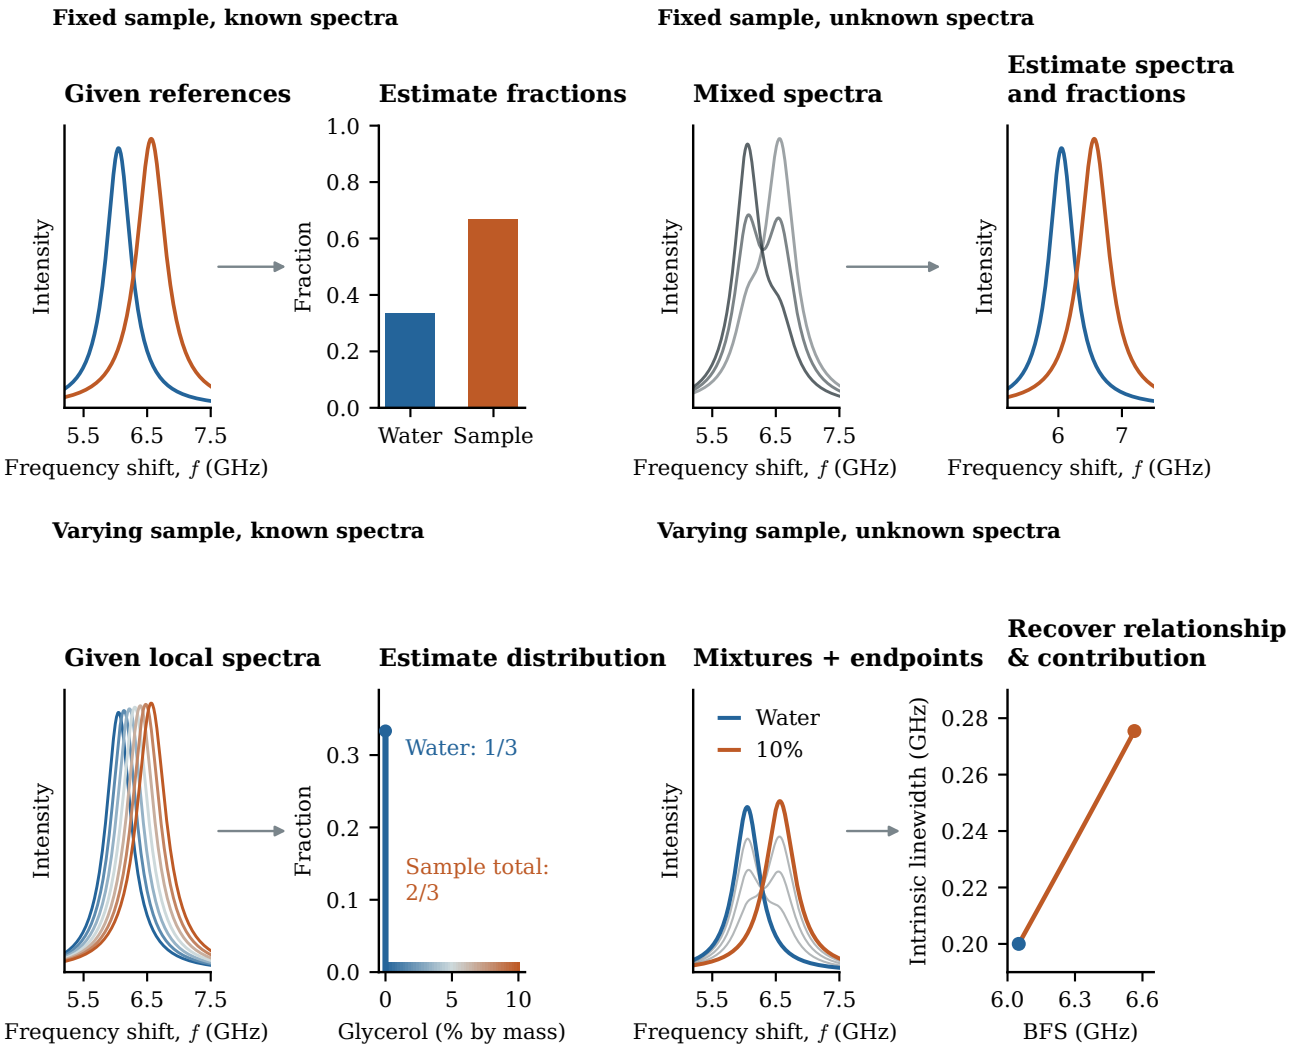
Fixed sample, known spectra
Given references
Estimate fractions
Intensity
Fraction
1.0
0.8
0.6
0.4
0.2
0.0
Water
Sample
5.5
6.5
7.5
Frequency shift, f (GHz)
Fixed sample, unknown spectra
Mixed spectra
Estimate spectra and fractions
Intensity
5.5
6.5
7.5
Frequency shift, f (GHz)
6
7
Frequency shift, f (GHz)
Varying sample, known spectra
Given local spectra
Estimate distribution
Intensity
Fraction
Water: 1/3
Sample total: 2/3
0.3
0.2
0.1
0.0
0
5
10
Glycerol (% by mass)
5.5
6.5
7.5
Frequency shift, f (GHz)
Varying sample, unknown spectra
Mixtures + endpoints
Recover relationship & contribution
Water
10%
Intensity
Intrinsic linewidth (GHz)
0.28
0.26
0.24
0.22
0.20
6.0
6.3
6.6
BFS (GHz)
5.5
6.5
7.5
Frequency shift, f (GHz)