


3-2 Installation Space


- ☑ Do not allow foreign objects such as various fibers, pieces of paper, wood chips (chips) or metal fragments to enter the motor drive or adhere to the cooling fan.
- ☑ The motor should be installed in the environment that complies with Pollution Degree 2 and with clean circulating air. Clean circulating air is defined as air without pollutions and electronic pollutant dust.

The appearances shown in the following figures are for reference only. The actual motor may look different.


Single motor installation

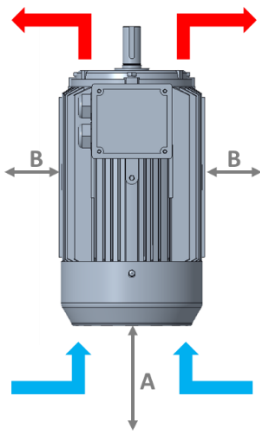

Side-by-side horizontal installation

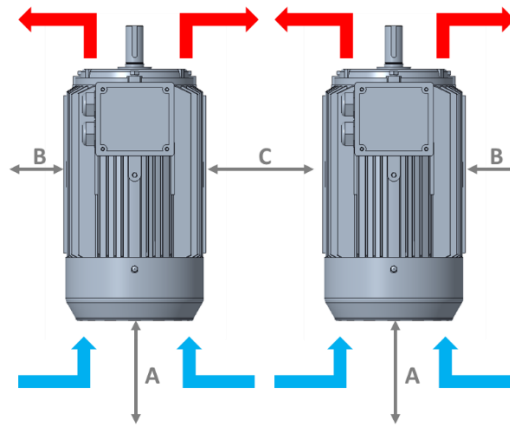

Top Mount

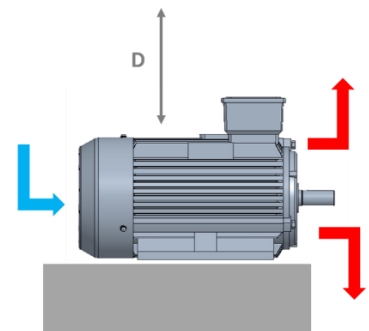

Minimum mounting clearance

Frame	A (m)	B (m)	C (m)	D (m)
F80–F100	1	0.5	1	1
F112–F160	1.5	1	1.5	1.5
F180–F225	2	1.5	2	2
>F225	2.5	2	2.5	2.5