




(Figure 3-22: Multiple Module Parallel System_Wiring between the Display, APF Module and CT)

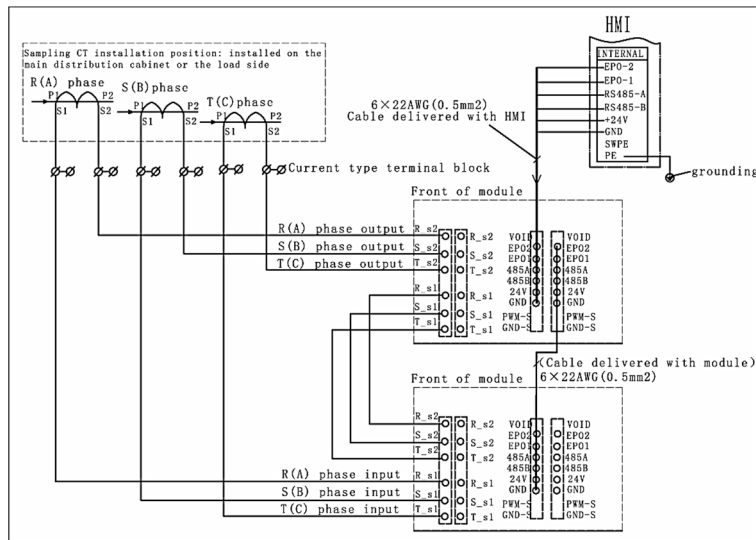


WARNING:

The display communication cables are secondary wires and shall be kept an insulation distance of no less than 100 mm from the main power cables.

7. APF module's supporting structure and installation procedures:

- 1) Fix the module and the installation panel together as shown in **Figure 3-23**.
- 2) Fix the installation panel with the supporting beams on the left and right of the cabinet as shown in **Figure 3-24**.

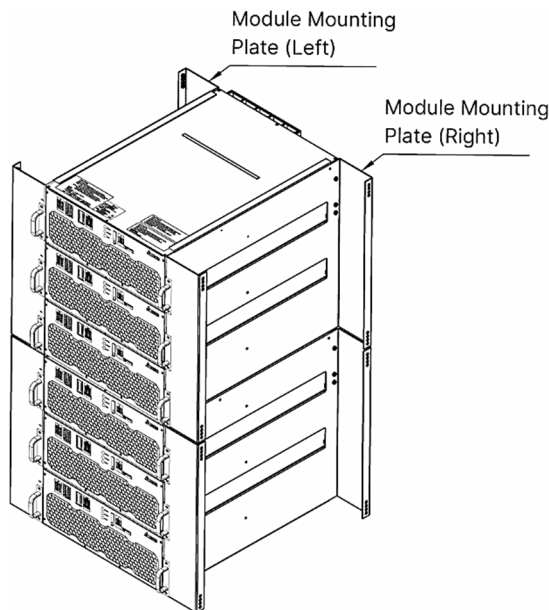

(Figure 3-23: Module Installation Diagram 1)