




(Figure 3-22: Multiple Module Parallel System_Wiring between the Display, SVG Module and CT)

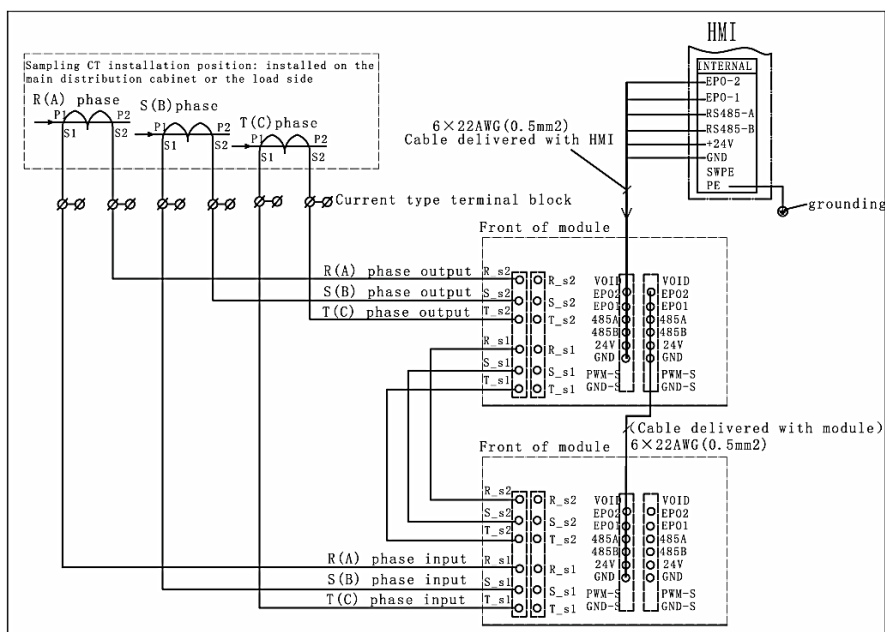

WARNING:

The display communication cables are secondary wires and shall be kept an insulation distance of no less than 100mm from the main power cables.

7. SVG module's supporting structure and installation procedures:

- 1) Fix the module and the installation panel together as shown in **Figure 3-23**.
- 2) Fix the installation panel with the supporting beams on the left and right of the cabinet as shown in **Figure 3-24**.