IndustriConnect: A Model Context Protocol Suite for AI-Assisted Industrial Automation

[Author 1 Name][1] and [Author 2 Name][2]

[1][Department], [University / Institution 1], [City, Country], [author1@example.com]
[2][Department], [University / Institution 2], [City, Country], [author2@example.com]

March 12, 2026

Abstract

AI assistants built on large language models (LLMs) excel at reasoning and workflow orchestration but cannot natively communicate with operational technology (OT) devices. We present **IndustriConnect**, an open-source suite of Model Context Protocol (MCP) servers that exposes ten major industrial protocols—Modbus, OPC UA, MQTT/Sparkplug B, BACnet, DNP3, EtherCAT, EtherNet/IP, PROFIBUS, PROFINET, and Siemens S7comm—as structured AI tools. Each module follows a three-layer architecture: an MCP client issues tool calls, a Python server translates them into native protocol operations, and real or simulated field devices execute them. The suite provides a unified response envelope for cross-protocol consistency, built-in device simulators for hardware-free development, and a companion web console for multi-server management. Together, these components let AI agents read process values, write setpoints, and orchestrate diagnostics across heterogeneous industrial environments without custom integration middleware.

Keywords: Industry MCP; Industry IOT; Industry AI Agents; Industry Protocols.

arXiv categories: eess.SY (primary); cs.SE; cs.AI

1 Introduction

The integration of digital intelligence into industrial environments—broadly captured under the label of Industry 4.0—requires seamless communication between information technology (IT) systems and operational technology (OT) assets [19]. Programmable logic controllers (PLCs), remote terminal units (RTUs), drives, sensors, and gateways remain the backbone of manufacturing, energy, water, and building automation infrastructure. These devices speak domain-specific protocols that were designed decades ago for deterministic, low-latency control rather than for interoperability with general-purpose software [17].

Simultaneously, the emergence of large language model (LLM) based AI assistants represents a step-change in software automation capability. Such systems can reason over heterogeneous data, decompose multi-step tasks, invoke external tools, and adapt behaviour in response to natural language instructions [16]. Applied to industrial settings, these capabilities open the prospect of conversational diagnostics ("What is causing the elevated motor temperature on line 3?"), automated setpoint optimisation, and cross-system data reconciliation—tasks that today require expert human operators or bespoke integration software.

The fundamental obstacle is a *protocol gap*: industrial field devices speak binary, message-framed, or register-map protocols, while AI assistants expect structured, schema-driven function calls. Existing integration platforms such as industrial SCADA historians, OPC UA aggregation servers, or publish-subscribe brokers partially address this by normalising data access, but they are not designed to serve as AI tool interfaces and do not provide the natural composability or discovery mechanisms that LLM-based systems require.

The *Model Context Protocol* (MCP) addresses this composability problem at the AI layer. MCP is a transport-agnostic, schema-driven protocol that allows AI clients to discover, invoke, and reason about external tools through a standardised `call_tool` interface [1]. By wrapping industrial protocol clients as MCP servers, it becomes possible to expose the full read/write/diagnostic surface of a Modbus RTU, an OPC UA server, or a Siemens S7 PLC as first-class AI tools, discoverable and callable by any MCP-compatible assistant without any protocol-level programming on the AI side.

This paper presents **IndustriConnect**, an open-source suite that realises this vision across nine widely deployed industrial protocols. The principal contributions are:

C1. Protocol coverage: Python MCP server implementations for Modbus (TCP/RTU/UDP), MQTT with Sparkplug B, OPC UA, BACnet/IP, DNP3, EtherCAT, EtherNet/IP, PROFIBUS DP/PA, PROFINET, and Siemens S7comm.

C2. Unified response envelope: A common {`success, data, error, meta`} structure returned by every tool, enabling cross-protocol observability, consistent error classification, and built-in latency instrumentation.

C3. Mock-first development methodology: Every protocol module ships with a paired, high-fidelity device simulator that enables full-stack prompt engineering and workflow validation without access to physical hardware.

C4. Industrial-grade reliability: Automatic protocol-limit chunking, exponential-backoff retry policies, per-operation timeouts, typed data encoding/decoding, and JSON tag maps for named access.

C5. Web management console: A browser-based UI (*mcp-manager-ui*) for configuring multiple MCP servers, interacting with LLMs, and inspecting tool schemas and responses.

The remainder of this paper is structured as follows. Section 2 provides background on MCP and industrial automation protocols. Section 3 presents the system architecture and

common design patterns. Section 4 describes each protocol implementation. Section 5 details the mock-first methodology. Section 6 presents the management console. Section 7 discusses representative use cases. Section 8 surveys related work. Section 9 concludes with directions for future work.

2 Background

2.1 Model Context Protocol

The Model Context Protocol (MCP) is an open, transport-agnostic specification for exposing tools, resources, and prompts to AI clients. In its most common deployment pattern, an MCP server process communicates with an MCP client via `stdio`, using JSON-RPC 2.0 message framing. The client—which may be an LLM inference engine, an AI assistant application, or a custom runner—can call `tools/list` to enumerate available tools with their JSON Schema input specifications, then call `tools/call` with the tool name and arguments to invoke them. Results are returned as structured content that the LLM can reason over and incorporate into its response.

This architecture provides three properties that are critical for industrial integration: (i) *discoverability*—the AI agent can enumerate the available operations for any connected device without prior configuration; (ii) *composability*—tool calls can be chained across protocol boundaries within a single reasoning step; and (iii) *schema enforcement*—inputs and outputs are typed, reducing the risk of mal-formed operations on physical devices.

2.2 Industrial Automation Protocol Landscape

Industrial automation protocols can be grouped by era, transport, and application domain [13]:

Fieldbus protocols. Modbus, introduced in 1979, remains the most widely deployed industrial protocol due to its simplicity. It exposes a register/coil model over serial (RTU/ASCII) or TCP connections and lacks intrinsic data typing or hierarchy. PROFIBUS DP/PA and DNP3 are similarly serial-heritage fieldbuses widely used in process automation and power utility SCADA respectively [15].

Industrial Ethernet. EtherNet/IP (Common Industrial Protocol over Ethernet), EtherCAT, and PROFINET are Ethernet-native protocols designed for high-speed deterministic control. EtherNet/IP is dominant in Rockwell/Allen-Bradley ecosystems; EtherCAT is prevalent in motion control; PROFINET is standard in Siemens factory automation.

Unified data access. OPC Unified Architecture (OPC UA) provides a transport-agnostic, information-model-aware protocol supporting hierarchical node browsing, typed data access, method invocation, and publish-subscribe subscriptions [3]. It is increasingly deployed as a normalisation layer over heterogeneous PLCs and sensors.

IIoT messaging. MQTT is a lightweight publish-subscribe protocol originally designed for constrained networks [9]. Sparkplug B extends MQTT with a defined topic namespace, message compression (Protobuf), and a device lifecycle model (birth/death certificates, data messages, commands) suitable for Industrial IoT telemetry pipelines.

Building and utility automation. BACnet/IP (Building Automation and Control Networks) is the dominant protocol for HVAC, lighting, and access control systems in commercial buildings, providing a rich object model with property-level access and network-wide device discovery.

Vendor-proprietary. Siemens S7comm is the native protocol used by S7-300, S7-400, S7-1200, and S7-1500 PLCs, accessed via the ISO-on-TCP transport layer. It exposes data blocks (DBs), process inputs/outputs, memory areas, timers, counters, and system zone lists (SZL).

2.3 OT/IT Convergence and AI Integration Challenges

The convergence of OT and IT is well documented in the literature [2, 4, 8]. However, integrating AI assistants into OT environments introduces specific challenges beyond conventional IT/OT integration:

- **Safety criticality**: Incorrect writes to PLC outputs can cause physical damage or personnel hazards; the AI tool interface must provide explicit write-enable controls and audit trails.
- **Protocol heterogeneity**: A single plant may simultaneously run Modbus RTU devices, OPC UA servers, and Ethernet/IP PLCs; a unified abstraction layer is required.
- **Data typing**: Industrial registers store raw binary data whose interpretation depends on vendor-specific conventions (byte/word order, fixed-point scaling, string encodings); this must be resolved transparently before presenting values to an LLM.
- **Reliability**: Field networks are subject to transient faults; any AI-facing gateway must implement retry logic, timeout management, and connection recovery.
- **Development safety**: Developing and testing AI workflows against live production equipment is impractical; high-fidelity simulators are essential.

IndustriConnect addresses all five challenges through its unified architecture and mock-first development approach described in the following sections.

3 System Architecture

3.1 Three-Layer Architecture

IndustriConnect follows a three-layer architecture shown in Figure 1:

Layer 1 — MCP Client. The topmost layer consists of any MCP-compatible client: Claude Desktop, a custom LLM application, or the *mcp-manager-ui* web console described in Section 6. The client discovers available tools via `tools/list` and invokes them via `tools/call`, receiving structured JSON responses without any knowledge of the underlying industrial protocol.

Layer 2 — Protocol MCP Server. Each protocol is served by a dedicated Python process implementing the MCP server interface via the FastMCP framework. On receiving a `tools/call` request the server: (i) validates input parameters against the tool's JSON Schema; (ii) connects to the target device using the appropriate protocol library; (iii) executes the operation with timeout enforcement and retry logic; (iv) encodes the response in the unified envelope; and (v) returns the result over `stdio`.

Layer 3 — Device or Mock. The bottom layer is either a real industrial device (PLC, RTU, sensor gateway) or one of the protocol-specific mock simulators provided with the suite. The mock simulators implement the server side of each protocol with realistic state and data, enabling complete stack testing without physical hardware.

3.2 FastMCP Framework

All IndustriConnect MCP servers are implemented using FastMCP, a Python library built on the MCP specification that provides:

- **Declarative tool registration** via the `@mcp.tool()` decorator, with automatic JSON Schema generation from Python type hints.

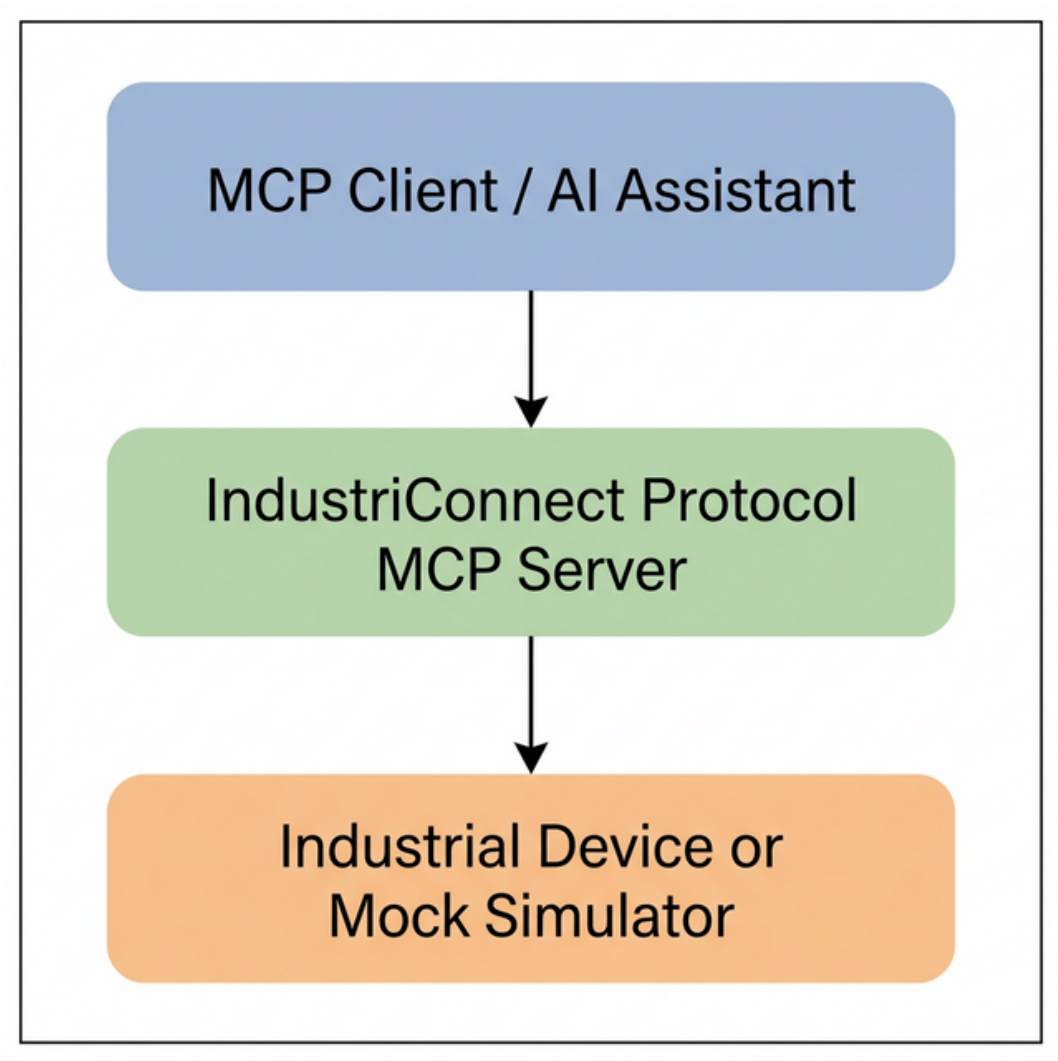

Figure 1: IndustriConnect three-layer architecture. The MCP client (AI assistant or web console) communicates with a protocol-specific MCP server over `stdio`; the server translates tool calls into native protocol operations directed at a real industrial device or its mock equivalent.

- **Async-native execution** using Python's `asyncio`, enabling non-blocking I/O for all protocol operations.
- **Lifespan management** through a context manager pattern that initialises protocol connections on server startup and releases them on shutdown.
- **Stdio transport** compatible with Claude Desktop configuration and standard MCP runners.

Listing 1 illustrates the structure of a representative MCP tool for typed Modbus register reads.

```python
@mcp.tool()
async def read_holding_typed(
    address: int,
    dtype: str,          # int16 | uint16 | int32 | float32 | ...
    ctx: Context,
    count: int = 1,
    byteorder: str = "big",
```

```python
    wordorder: str = "big",
    scale: float = 1.0,
    offset: float = 0.0,
    slave_id: int = DEFAULT_SLAVE_ID,
) -> Dict[str, Any]:
    """Read one or more typed values from Modbus holding registers."""
    t0 = time.monotonic()
    attempts = 0
    for attempt in range(MAX_RETRIES + 1):
        try:
            attempts += 1
            result = await _read_and_decode(
                address, count, dtype, byteorder, wordorder
            )
            return {
                "success": True,
                "data": {"values": result, "address": address},
                "error": None,
                "meta": {
                    "latency_ms": round((time.monotonic() - t0) * 1000,
                        2),
                    "attempts": attempts,
                },
            }
        except ModbusException as exc:
            if attempt == MAX_RETRIES:
                return _error_envelope(str(exc), t0, attempts)
            await asyncio.sleep(RETRY_BACKOFF_BASE ** attempt)
```

Listing 1: Representative MCP tool definition for typed Modbus register read. FastMCP generates the JSON Schema for `tools/list` automatically from the type annotations.

3.3 Unified Response Envelope

Every tool in every protocol module returns a JSON object with the same four-field structure illustrated in Figure 2 and Listing 2.

```json
{
  "success": true,
  "data": {
    "values": [3.14, 2.72],
    "address": 100,
    "dtype": "float32"
  },
  "error": null,
  "meta": {
    "latency_ms": 12.4,
    "attempts": 1,
    "raw": {}
  }
}
```

Listing 2: Unified response envelope — example for a Modbus holding register read.

The `success` boolean allows the LLM to branch on failure without parsing error strings. The `error` field carries a human-readable exception message when `success` is `false`, enabling conversational error reporting. The `meta` field exposes operational telemetry—round-trip latency and retry count—that can be surfaced to operators or logged for observability.

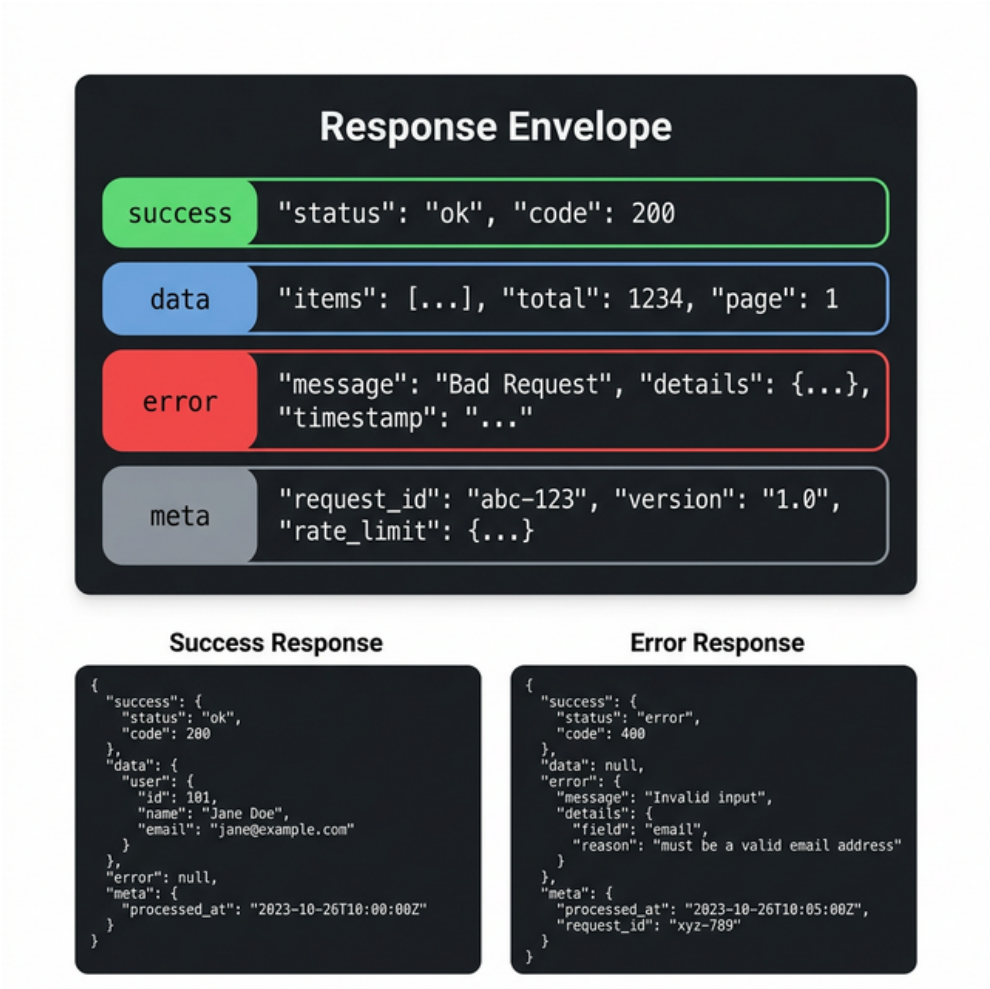

Figure 2: Unified response envelope returned by every IndustriConnect tool. The four fields provide success status, protocol-specific payload, error description, and operational metadata (latency, retry count).

3.4 Configuration Model

Protocol servers are configured entirely through environment variables and optional `.env` files. No protocol-specific configuration is compiled into the server binary. For example, the Modbus server reads:

- `MODBUS_TYPE` — connection type (`tcp`, `udp`, `serial`)
- `MODBUS_HOST`, `MODBUS_PORT` — network target
- `MODBUS_DEFAULT_SLAVE_ID` — default device address
- `MODBUS_MAX_RETRIES`, `MODBUS_TIMEOUT` — reliability
- `MODBUS_WRITES_ENABLED` — write-enable flag (safety gate)
- `REGISTER_MAP_FILE` — optional JSON tag map path

This separation allows the same server binary to target a mock device in development, a staging copy, or a live PLC in production by changing only environment variables—a property that substantially simplifies deployment pipelines [7].

Optional JSON *tag maps* allow operators to define named aliases for raw addresses:

```
{
  "pump_speed_rpm": {
    "type": "holding",
```

Table 1: Protocol module summary. Tool count refers to the number of MCP tools exposed by each server; application domain indicates the primary industrial sector served.

Protocol	Transport	Python Library	Tools	Application Domain
Modbus	TCP / UDP / Serial	`pymodbus`	14+	Manufacturing, process, energy
MQTT + Sparkplug B	TCP (broker)	`paho-mqtt`, `protobuf`	10+	IIoT telemetry, edge computing
OPC UA	TCP (binary)	`asyncua`	8	Unified data access, I4.0
BACnet/IP	UDP/IP	`BACO`	6	Building automation
DNP3	TCP / Serial	`pydnp3`	7	Power utility SCADA
EtherCAT	Ethernet (raw)	`PySOEM`	8	Motion control, robotics
EtherNet/IP	TCP/IP	`pycomm3`	7	Rockwell/Allen-Bradley PLCs
PROFIBUS DP/PA	RS-485 / USB	`pyserial`	6	Process, discrete manufacturing
PROFINET	Ethernet	`scapy`, `lxml`	7	Siemens factory automation
Siemens S7comm	ISO-on-TCP	`python-snap7`	12	Siemens S7 PLCs

```
    "address": 100,
    "dtype": "float32",
    "scale": 0.1,
    "description": "Pump shaft speed in RPM"
  }
}
```

Listing 3: Example tag map entry for named Modbus register access.

Tag maps abstract raw addresses from AI-facing tool calls, enabling prompts such as "read the pump_speed_rpm" rather than "read float32 at holding register 100".

3.5 Reliability Patterns

Industrial field networks are subject to noise, transient faults, and reconnection delays that are uncommon in IT environments. IndustriConnect implements four reliability mechanisms shared across all protocol modules:

Exponential-backoff retry. Each tool retries on transient errors up to `MAX_RETRIES` times with a configurable backoff base (default $b = 2\,\mathrm{s}$), waiting b^k seconds after the k-th failure.

Protocol-limit chunking. Protocols such as Modbus impose maximum payload sizes (125 registers per read, 2000 coils per read). Tools that accept large ranges automatically split the request into legal-sized chunks, reassemble the responses, and return a single result.

Per-operation timeouts. Every protocol call is wrapped with an `asyncio.wait_for` timeout fence, preventing indefinite blocking on unresponsive devices.

Automatic reconnection. Client wrapper classes detect stale connections and re-establish them transparently before retrying the failed operation, so that short network interruptions are invisible to the AI client.

4 Protocol Implementations

Table 1 summarises the nine protocol modules. Figure 3 shows their relationships within the suite. The following subsections describe each module's design decisions.

4.1 Modbus TCP/RTU/UDP

Modbus is implemented using `pymodbus` ($\geq$3.9.2) with full support for TCP, UDP, and serial RTU/ASCII transports, selectable via the `MODBUS_TYPE` environment variable. The server

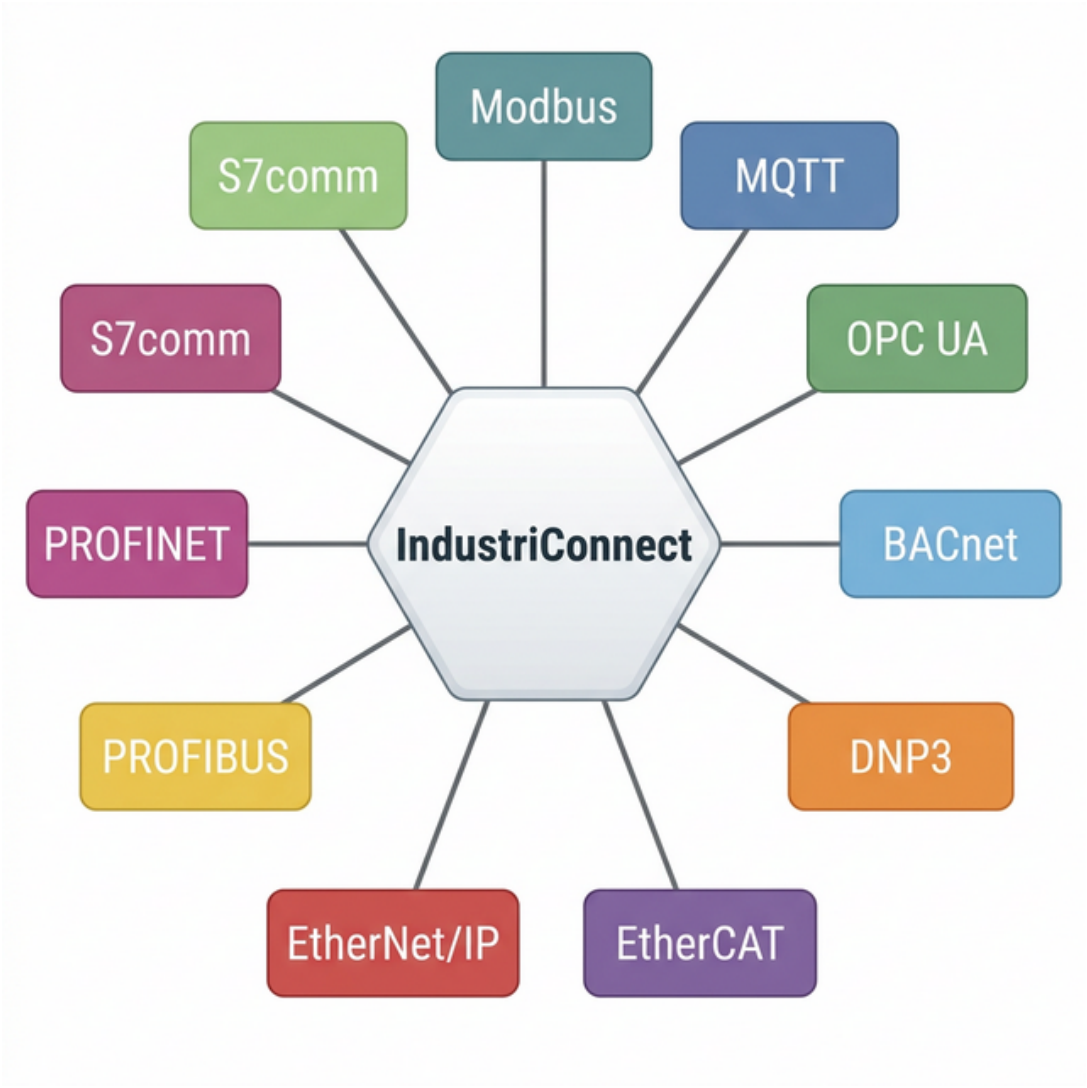

Figure 3: IndustriConnect protocol ecosystem. Each spoke represents a dedicated MCP server module connecting the AI layer to a distinct industrial protocol domain.

exposes tools covering all four Modbus data objects: coils (function codes 1/5/15), discrete inputs (FC 2), holding registers (FC 3/6/16), and input registers (FC 4). Advanced typed read and write tools accept a `dtype` parameter (`int16`, `uint16`, `int32`, `uint32`, `int64`, `uint64`, `float32`, `float64`) and apply configurable byte-order and word-order transformations using `BinaryPayloadDecoder/Builder` from `pymodbus`, along with linear scale-and-offset correction. A `mask_write_register` tool exposes the Modbus function-code 22 bitwise mask operation, enabling atomic bit-field manipulation without read-modify-write races. Device identification is exposed via the MEI 0x2B/0x0E function (FC 43). Tag maps provide symbolic named access over the register address space, enabling prompts at the *process variable* level rather than the register level.

4.2 MQTT + Sparkplug B

The MQTT module wraps `paho-mqtt` with a connection manager that handles broker authentication, TLS configuration, clean-session management, and exponential-backoff reconnection. Standard tools cover `publish_message` (QoS 0–2, retain flag), `subscribe_topic`, `unsubscribe_topic`, `list_subscriptions`, and `get_broker_info`. The Sparkplug B exten-

sion implements the full Eclipse Tahu specification lifecycle: NBIRTH (node birth certificate), DBIRTH (device birth certificate), NDATA (node data update), DDATA (device data update), NCMD (node command), DCMD (device command), NDEATH, and DDEATH. Sparkplug B payloads are encoded and decoded using hand-crafted Protocol Buffer serialisation, supporting metric types `int32`, `float`, `boolean`, and `string`. Sequence numbers are managed automatically with 0–255 rollover. The design enables AI assistants to participate as Sparkplug B edge nodes, publishing structured telemetry and responding to command metrics.

4.3 OPC UA

The OPC UA server wraps the `asyncua` library, providing fully asynchronous node access. Tools include `read_opcua_node`, `write_opcua_node`, `browse_opcua_node_children`, and `call_opcua_method`, enabling AI agents to navigate the OPC UA address space, invoke remote methods on PLCs (e.g., motor start/stop procedures), and read arbitrary node values by NodeId. Batch tools `read_multiple_opcua_nodes` and `write_multiple_opcua_nodes` accept arrays of NodeIds and execute grouped operations in a single tool call, reducing round-trips for telemetry collection scenarios. A `get_all_variables` tool performs full address-space discovery and returns all variable nodes with their names, data types, and current values. OPC UA's native information model provides the data typing and hierarchy that Modbus lacks, making it suitable for the highest-level AI reasoning tasks over heterogeneous PLC data [3].

4.4 BACnet/IP

The BACnet module uses the `BACO` library to implement a BACnet/IP client. `discover_devices` broadcasts Who-Is requests across the subnet and returns a list of device instance numbers with configurable timeout. `read_property` and `write_property` access any object/property combination using the standard quadruple (device_id, object_type, object_instance, property_id), with write priority levels (1–16) supported per the BACnet commandable property model. An optional JSON object map file provides named aliases (e.g., "zone_3_setpoint") that resolve to device/object/property triplets, simplifying AI prompts in building automation scenarios. Change-of-value (COV) subscription and alarm monitoring are identified as the primary directions for future development.

4.5 DNP3

The DNP3 module operates as a DNP3 master station using `pydnp3` over both TCP and serial transports. It exposes read tools for all three standard data object groups: binary inputs (Group 1), analog inputs (Group 30), and counters (Group 20). Control output operations (Group 12 CROB — Control Relay Output Block, and Group 41 Analog Outputs) enable AI-driven setpoint and switch control in power utility SCADA environments. Point maps provide named access analogous to Modbus tag maps. The master/outstation addresses, link-layer timeouts, and retry policy are configurable, and the mock outstation provides a safe sandbox for SCADA workflow development without access to substation equipment.

4.6 EtherCAT

EtherCAT access is implemented via `PySOEM`, a Python binding for the SOEM (Simple Open EtherCAT Master) library. Network scanning discovers connected slaves and reports their vendor ID, product code, revision, and assigned position. Per-slave process data objects (PDOs) support cyclic read/write of mapped I/O variables. Service data objects (SDOs) provide acyclic parameter access by index and subindex for configuration and diagnostics. ESI (Electronic Slave Information) file parsing exposes human-readable parameter descriptions. A configurable cycle time controls the PDO exchange period. Due to raw Ethernet socket requirements, EtherCAT

operations require elevated network privileges (CAP_NET_RAW on Linux) or administrator rights, a constraint documented clearly in the tool descriptions.

4.7 EtherNet/IP

EtherNet/IP (Common Industrial Protocol) access targets Rockwell/Allen-Bradley controllers using the pycomm3 library. The primary tools read_tag and write_tag accept symbolic tag names as used in Logix 5000 ladder logic programs, supporting scalar, array, and structured (User Defined Type, UDT) tags. Array slices can be read by specifying element count and offset. Tag discovery stubs enumerate the controller's tag database for exploration. The design follows the "controller tag" abstraction familiar to Rockwell engineers, hiding the underlying CIP (Common Industrial Protocol) messaging from the AI layer.

4.8 PROFIBUS DP/PA

PROFIBUS is accessed via USB-to-RS-485 or native PROFIBUS adapters using pyserial as the physical transport. The server supports Generic Station Description (GSD) file parsing to resolve slave device capabilities and module configurations. Bus scanning identifies active slave addresses and their diagnostic information. Cyclic I/O data exchange reads input process data and writes output process data for mapped slaves. A PROFIBUS_MOCK=true environment variable activates a software mock mode for development environments without physical bus adapters, reflecting the suite-wide mock-first philosophy.

4.9 PROFINET

PROFINET device discovery uses the DCP (Discovery and Configuration Protocol) implemented with the scapy packet manipulation library, enabling broadcast identification of PROFINET IO devices on the local Ethernet segment. GSDML (PROFINET station description) files are parsed using lxml to extract device metadata, slot/subslot module configurations, and parameter descriptions. Module management tools configure the IO device's application relation, and cyclic I/O communication exchanges process data with configured submodules. PROFINET similarly requires raw Ethernet socket privileges for DCP frame construction.

4.10 Siemens S7comm

S7comm access is provided via python-snap7, a Python binding for the libsnap7 library, targeting S7-300, S7-400, S7-1200, and S7-1500 PLCs. Data block (DB) access tools read_db and write_db transfer raw byte arrays by DB number, offset, and size. read_db_typed accepts a dtype parameter (BOOL, BYTE, CHAR, WORD, INT, DINT, REAL, STRING) and applies S7-specific binary parsing including bit addressing within bytes. Separate tools access process input/output areas, the marker (M) memory area, and timer/counter special function areas. read_szl reads System Zone List records for diagnostics (CPU model, module state, fault history). Tag maps support named DB access patterns. Write operations and system-level commands are individually guarded by environment flags (S7_WRITES_ENABLED, S7_SYSTEM_CMDS_ENABLED) for operational safety.

5 Mock-First Development Methodology

5.1 Rationale

Industrial OT systems present a fundamental challenge for AI workflow development: access to production equipment is restricted for safety, cost, and availability reasons; staging environments are scarce; and physical devices cannot be rolled back after a mis-directed write. The mock-first

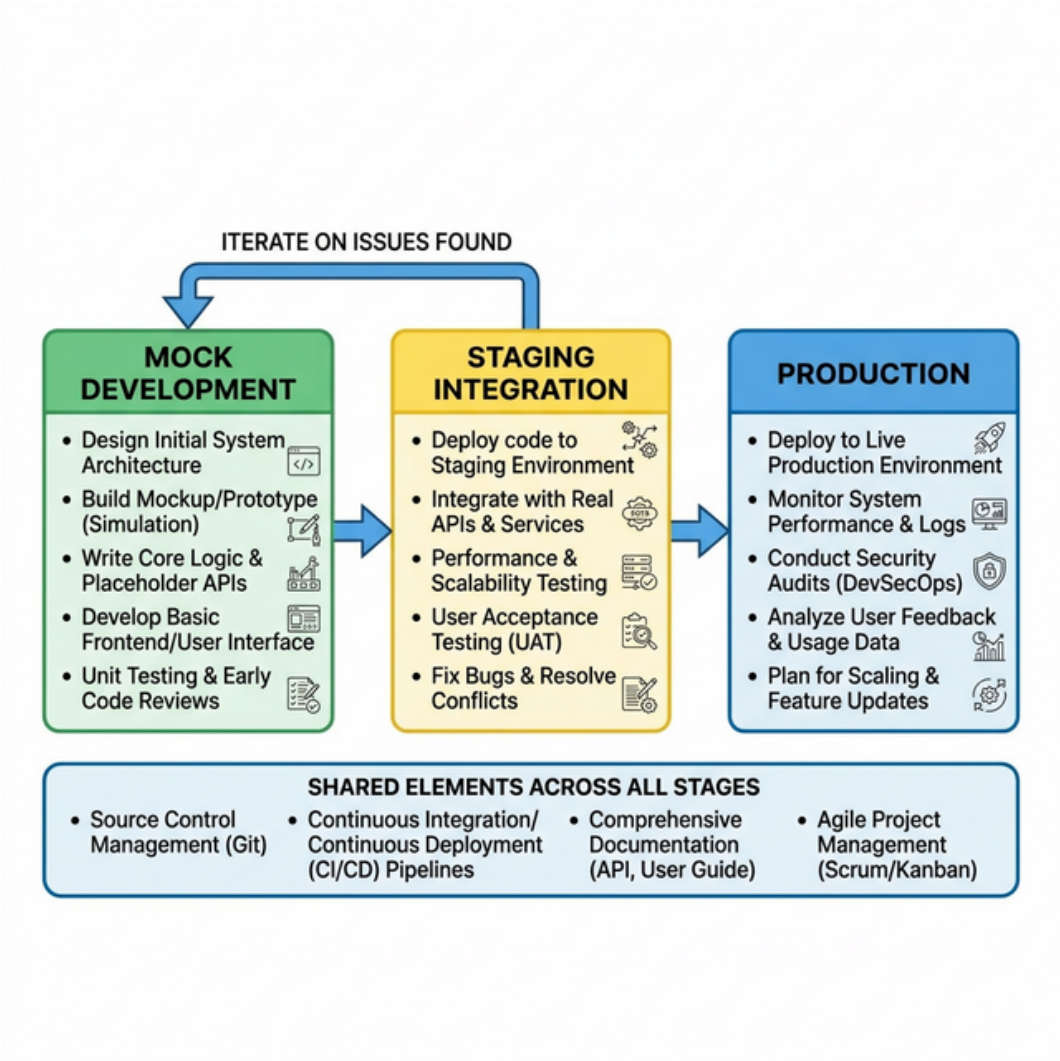

Figure 4: Mock-first development lifecycle. Prompts and workflows are developed and validated against mock simulators before being progressively promoted to staging and production environments.

methodology addresses this by mandating that every protocol module ships with a software-only device simulator that faithfully replicates the server side of the protocol [6].

The consequence for AI development is significant: prompt engineers, data scientists, and system integrators can develop, iterate, and validate complete end-to-end workflows on a laptop without access to any physical hardware. Failures are deterministic, recoverable, and incur no physical risk.

5.2 Mock Device Design

Each mock device is designed according to four principles:

Protocol fidelity. The mock implements the full server-side state machine of the protocol. The Modbus mock server is a fully compliant TCP slave with realistic register state (pump speed, tank level, temperature, status word). The OPC UA mock server builds a rich information model hierarchy with sensor, actuator, and alarm nodes. The MQTT mock deploys a complete broker plus Sparkplug B edge node simulation with periodic data updates.

Process realism. Mock registers are not random; they reflect plausible process behaviour. The Modbus mock simulates pump/tank dynamics. The S7comm mock contains data blocks

structured as a real PLC program would define them. This trains AI prompts on realistic value ranges and update patterns.

Standalone operation. Each mock can be started with a single `uv run <entrypoint>` command, with no dependency on the MCP server or any AI client. This enables unit-level testing of the mock in isolation.

Deterministic reproducibility. Mock state is initialised from fixed defaults and evolves predictably, enabling regression tests that compare AI tool responses across versions.

5.3 Development and Deployment Lifecycle

The recommended three-stage lifecycle, illustrated in Figure 4, is:

1. **Mock stage**: The MCP server targets the mock device. AI prompts are developed, refined, and validated. Errors are debugged without hardware risk.

2. **Staging stage**: The MCP server is reconfigured (by changing environment variables) to target a staging or shadow copy of the production system. Integration-level testing validates that the prompt strategies developed against the mock also work against real protocol behaviour.

3. **Production stage**: The final configuration targets live field devices. Write-enable and system-command flags are explicitly reviewed and set. Monitoring on latency, error rate, and call frequency is established.

6 MCP Manager User Interface

The *mcp-manager-ui* is a browser-based management console that provides a unified interface for working with IndustriConnect protocol servers and other MCP backends. It is implemented as a React + TypeScript single-page application built with Vite, communicating with a lightweight Node.js backend via HTTP REST and WebSocket.

Server management. The sidebar lists configured MCP servers with real-time connection status indicators. Servers are added via a manual configuration form, by importing a Cursor-style JSON config block, or through a JSON editor for advanced users. Each server entry shows its configured protocol, connection state, and tool count.

LLM chat integration. The main panel provides a session-based chat interface. Users select from cloud LLM providers (Anthropic Claude, OpenAI GPT, Google Gemini) or a locally running Ollama instance. API keys are stored in browser local storage or loaded from environment variables. Messages, tool call arguments, and tool responses are displayed inline, giving operators a transparent view of the AI's reasoning and device interactions.

Tool schema inspection. A dedicated tool inspector view renders the JSON Schema for each available tool, enabling operators to understand parameter types and constraints before issuing commands.

The backend Node.js process acts as a secure proxy between the browser and local MCP servers, preventing direct browser access to local process stdio. WebSocket connections provide real-time streaming of LLM tokens and tool results.

7 Use Cases and Evaluation

This section presents four representative use cases that illustrate the capability of IndustriConnect for AI-assisted industrial operations.

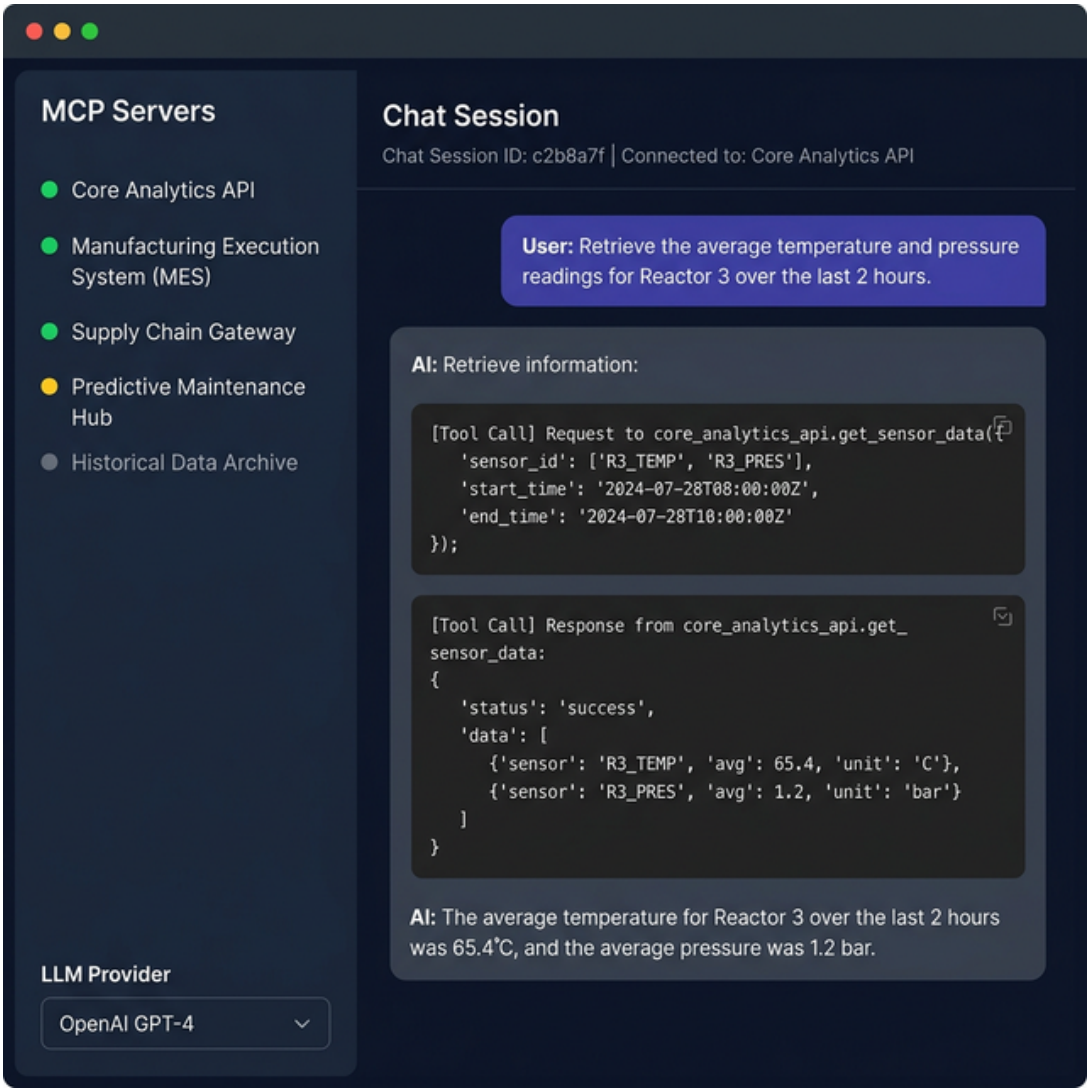

Figure 5: The *mcp-manager-ui* web console. The left sidebar lists configured MCP servers with live connection status indicators; the main panel provides a chat interface connected to the selected LLM; tool call results are displayed as structured cards.

7.1 Predictive Maintenance via Cross-Protocol Data Collection

An AI assistant is connected simultaneously to a Modbus MCP server (targeting a variable-frequency drive) and an OPC UA MCP server (targeting the plant's historian). The operator prompts: "Compare the current drive current draw with the historical baseline for this time of day and report any anomaly." The assistant (i) calls `read_holding_typed` on the Modbus server to fetch instantaneous motor current, (ii) calls `read_multiple_opcua_nodes` on the OPC UA server to retrieve historical statistics, (iii) computes the deviation, and (iv) returns a natural language summary flagging a 15% above-baseline reading as a potential bearing wear indicator.

This scenario demonstrates the composability of cross-protocol tool chains and the value of the unified response envelope: the LLM receives identically structured JSON from both protocols, enabling straightforward numeric comparison without protocol-specific parsing logic.

7.2 IIoT Telemetry Monitoring with MQTT/Sparkplug B

A manufacturing plant publishes machine state via Sparkplug B edge nodes. The AI assistant subscribes to relevant topics using `subscribe_topic`, receives DDATA payloads via the MQTT

MCP server, and decodes the Protobuf metrics to extract throughput, reject rate, and downtime events. The assistant then generates a shift summary report in natural language, identifies which lines underperformed against targets, and proposes corrective actions. The full Sparkplug B lifecycle support means the assistant can also send NCMD messages to trigger remote procedure calls on the edge nodes.

7.3 Cross-Protocol Data Reconciliation

A commissioning engineer suspects that an OPC UA server's cached value for a temperature setpoint differs from the value actually stored in the PLC data block. Using IndustriConnect, the assistant reads the same physical variable via both the OPC UA server (`read_opcua_node`) and directly from the S7comm PLC (`read_db_typed`), compares the results, and reports any discrepancy. This "dual read" pattern, which would require significant custom integration code in a traditional system, is expressed as a natural language question and resolved in a single assistant turn.

7.4 AI-Assisted Fault Diagnosis

An operator reports an intermittent fault on a Siemens PLC line. The AI assistant uses `read_szl` to fetch the PLC's fault buffer (SZL ID 0x00A0), parses the diagnostic records, and identifies a recurring I/O module communication timeout in rack 2, slot 4. It then calls `read_input` for the affected I/O area to confirm the current read failure, and recommends a specific module reseating procedure based on the fault code. This workflow replaces a multi-step manual process requiring direct PLC access with a conversational, tool-driven diagnostic session.

7.5 Discussion

These use cases share a common pattern: the AI assistant decomposes a high-level operator intent into a sequence of structured tool calls, assembles the results, and presents actionable insight in natural language. The latency of IndustriConnect tool calls is dominated by network round-trip time to the field device; in local-network conditions, typical tool call latency ranges from 5 ms (Modbus TCP single register read) to 200 ms (OPC UA full address-space discovery), well within human conversational timescales.

Write operations are guarded by environment flags (`WRITES_ENABLED`) that must be explicitly set for each deployment; this prevents accidental modification of process state during diagnostic sessions. Future work on operation approval flows and audit logging would further strengthen the safety model for production use.

8 Related Work

Industrial protocol libraries. The Python ecosystem provides mature client libraries for individual protocols: `pymodbus` for Modbus, `asyncua` for OPC UA, `python-snap7` for S7comm, and `pycomm3` for EtherNet/IP. IndustriConnect adds the MCP layer above these libraries, exposing them as structured AI tools with a unified interface and consistent reliability patterns.

Industrial middleware and historians. Commercial platforms such as Inductive Automation Ignition, Node-RED, OSIsoft PI, and Kepware KEPServerEX provide protocol normalisation and data historian functions [2]. These systems aggregate data from heterogeneous protocols into a unified store or tag namespace. IndustriConnect is complementary: where historians provide historical data storage and HMI visualisation, IndustriConnect focuses specifically on AI-native, real-time tool-call access. IndustriConnect could be configured to sit alongside a historian, with some tools reading live device data and others querying the historian's OPC UA or REST interface.

IT/OT integration in Industry 4.0. The integration of industrial automation systems with IT infrastructure has been extensively studied in the context of Industry 4.0 [4, 19]. OPC UA has emerged as the preferred normalisation layer [17], and digital twin frameworks increasingly rely on OPC UA or MQTT as their live-data backbone [5, 14]. IndustriConnect treats OPC UA as one of several equally supported protocols rather than an exclusive normalisation point, preserving direct access to legacy fieldbuses that may not have an OPC UA gateway.

LLM agents and tool use. The capability of LLMs to invoke external tools and APIs has been established across many application domains [18]. Function-calling interfaces provided by OpenAI, Anthropic, and Google enable structured tool invocation, but they are provider-specific and not designed for the low-latency, schema-driven interoperability that MCP provides. ReAct-style agent loops [20] and tool-augmented language models [12] demonstrate the reasoning patterns that IndustriConnect is designed to support; the suite provides the protocol-level infrastructure that those patterns require in industrial settings.

Digital twins and simulation. Digital twin research advocates maintaining a live synchronised replica of physical assets for monitoring, prediction, and control [5, 10, 14]. IndustriConnect's mock devices are lightweight process simulators rather than full digital twins, but they serve a complementary function: enabling AI workflow development without physical access, with the possibility of upgrading to a full digital twin back-end in production.

Industrial cybersecurity. Connecting AI systems to OT networks introduces cybersecurity considerations documented in the industrial security literature [11]. IndustriConnect's write-enable flags and mock-first development philosophy partially address operational safety; full security hardening (network segmentation, TLS, authentication, audit logging) is identified as future work.

9 Conclusion and Future Work

This paper has presented **IndustriConnect**, a suite of Model Context Protocol servers that enables AI assistants to communicate with the full breadth of industrial automation protocols through a unified, structured tool interface. The five principal contributions—nine protocol MCP servers, a unified response envelope, a mock-first development methodology, industrial reliability patterns, and a web management console—collectively address the protocol gap that has prevented AI assistants from participating meaningfully in operational technology environments.

The suite demonstrates that MCP's schema-driven, transport-agnostic architecture is well suited to industrial integration: tool schemas give AI agents the structural context to invoke protocol operations correctly; the unified response envelope enables cross-protocol reasoning without protocol-specific parsing; and the mock devices enable complete end-to-end AI workflow development without hardware access or production risk.

Future work falls into four categories:

1. **Security hardening**: TLS support for protocol connections where available (OPC UA, MQTT), stronger authentication, fine-grained write permission models, and operation approval flows with audit logging.

2. **Expanded tool coverage**: Additional Modbus function codes, extended S7comm SZL area support, DNP3 file transfer and time synchronisation, and BACnet COV subscription and alarm management.

3. **Richer mock scenarios**: Fault injection (connection drops, CRC errors, slave exception responses), alarm simulation, degraded-mode operation, and multi-device topologies for realistic end-to-end testing.

4. **Empirical evaluation**: Structured experiments measuring AI task completion rate, tool call accuracy, and latency across the protocol suite on representative hardware, including comparison with human-operator baselines for diagnostic tasks.

IndustriConnect is released as open source and is available at https://github.com/NordicAgents/IndustriConnect. Contributions in the form of additional tool coverage, improved mock scenarios, and protocol extensions are welcomed.

Acknowledgements

The authors thank the maintainers of the open-source protocol libraries on which IndustriConnect depends: `pymodbus`, `asyncua`, `python-snap7`, `pycomm3`, `pydnp3`, `PySOEM`, `BACO`, `paho-mqtt`, and `scapy`.

References

[1] Anthropic. Model context protocol: An open standard for connecting AI assistants to data sources and tools. *Anthropic Technical Report*, 2024. URL https://modelcontextprotocol.io. Technical specification. Cite as primary specification source.

[2] Hugh Boyes, Bil Hallaq, Joe Cunningham, and Tim Watson. The industrial internet of things (IIoT): An analysis framework. *Computers in Industry*, 101:1–12, 2018. doi: 10.1016/j.compind.2018.04.015.

[3] Salvatore Cavalieri and Ferdinando Chiacchio. Analysis of OPC UA performances. *Computer Standards & Interfaces*, 36(1):165–177, 2013. doi: 10.1016/j.csi.2013.06.008.

[4] Armando Walter Colombo, Stamatis Karnouskos, Okyay Kaynak, Yang Shi, and Shen Yin. Industrial cyberphysical systems: A backbone of the fourth industrial revolution. *IEEE Industrial Electronics Magazine*, 11(1):6–16, 2017. doi: 10.1109/MIE.2017.2648857.

[5] Aidan Fuller, Zhong Fan, Charles Day, and Chris Barlow. Digital twin: Enabling technologies, challenges and open research. *IEEE Access*, 8:108952–108971, 2020. doi: 10.1109/ACCESS.2020.2998358.

[6] Michael Grieves and John Vickers. Digital twin: Mitigating unpredictable, undesirable emergent behavior in complex systems. *Transdisciplinary Perspectives on Complex Systems*, pages 85–113, 2017. doi: 10.1007/978-3-319-38756-7_4. Book chapter. Verify citation format for target venue.

[7] Jez Humble and David Farley. Continuous delivery: Reliable software releases through build, test, and deployment automation. *IEEE Software*, 28(2):14–16, 2011. Book review reference. Use primary source if preferred.

[8] Jay Lee, Behrad Bagheri, and Hung-An Kao. A cyber-physical systems architecture for Industry 4.0-based manufacturing systems. *Manufacturing Letters*, 3:18–23, 2015. doi: 10.1016/j.mfglet.2014.12.001.

[9] Bhawana Mishra and Attila Kertesz. The use of MQTT in M2M and IoT systems: A survey. *IEEE Access*, 8:201071–201086, 2020. doi: 10.1109/ACCESS.2020.3035849.

[10] Diego G. S. Pivoto, Luís F. F. de Almeida, Rodrigo da Rosa Righi, João J. P. C. Rodrigues, Alexandre Baratella Lugli, and Antonio M. Alberti. Cyber-physical systems architectures for industrial internet of things applications in Industry 4.0: A literature review. *Journal of Manufacturing Systems*, 58:176–192, 2021. doi: 10.1016/j.jmsy.2020.11.017.

[11] Patricia A. S. Ralston, James H. Graham, and Jeffrey L. Hieb. Cyber security risk assessment for SCADA and DCS networks. *ISA Transactions*, 46(4):583–594, 2007. doi: 10.1016/j.isatra.2007.04.003.

[12] Timo Schick, Jane Dwivedi-Yu, Roberto Dessì, Roberta Raileanu, Maria Lomeli, Luke Zettlemoyer, Nicola Cancedda, and Thomas Scialom. Toolformer: Language models can teach themselves to use tools. *Advances in Neural Information Processing Systems*, 36, 2024. NeurIPS 2023 proceedings. Verify citation type before submission.

[13] Emiliano Sisinni, Abusayeed Saifullah, Song Han, Ulf Jennehag, and Mikael Gidlund. Industrial Internet of Things: Challenges, opportunities, and directions. *IEEE Transactions on Industrial Informatics*, 14(11):4724–4734, 2018. doi: 10.1109/TII.2018.2852491.

[14] Fei Tao, Qinglin Qi, Ang Liu, and Andrew Nee. Digital twins and cyber-physical systems toward smart manufacturing and Industry 4.0: Correlation and comparison. *Engineering*, 5 (4):653–661, 2019. doi: 10.1016/j.eng.2019.01.014.

[15] Eduardo Tovar and Francisco Vasques. Real-time fieldbus communications using Profibus networks. *IEEE Transactions on Industrial Electronics*, 46(6):1241–1251, 1999. doi: 10. 1109/41.814011.

[16] Jason Wei, Xuezhi Wang, Dale Schuurmans, Maarten Bosma, Brian Ichter, Fei Xia, Ed Chi, Quoc Le, and Denny Zhou. Chain-of-thought prompting elicits reasoning in large language models. *Journal of Machine Learning Research*, 24(276):1–43, 2023. Extended journal version. Verify DOI before submission.

[17] Martin Wollschlaeger, Thilo Sauter, and Jürgen Jasperneite. The future of industrial communication: Automation networks in the era of the Internet of Things and Industry 4.0. *IEEE Industrial Electronics Magazine*, 11(1):17–27, 2017. doi: 10.1109/MIE.2017.2649104.

[18] Thorsten Wuest, Daniel Weimer, Christoph Irgens, and Klaus-Dieter Thoben. Machine learning in manufacturing: advantages, challenges, and applications. *Production & Manufacturing Research*, 4(1):23–45, 2016. doi: 10.1080/21693277.2016.1192517.

[19] Li Da Xu, Eric L. Xu, and Ling Li. Industry 4.0: state of the art and future trends. *International Journal of Production Research*, 56(8):2941–2962, 2018. doi: 10.1080/00207543. 2018.1444806.

[20] Shunyu Yao, Jeffrey Zhao, Dian Yu, Nan Du, Izhak Shafran, Karthik Narasimhan, and Yuan Cao. ReAct: Synergizing reasoning and acting in language models. *Transactions on Machine Learning Research*, 2023, 2023. Verify journal and volume before submission.