

1. Ip config for eblock => connect laptop to eblock com1
Change laptop ip => 192.168.37.3
Ncpa.cpl

Connect emonitor via 192.168.37.3, read id, change to 1, restart by switch

eMonitor-V1.7.27

1) 选择产品类型

eBlock200	PCS1000G2
eBlock215	PCS1000plus
eBlock230	eLink3000站控
eBlock372	eLink3000方阵
eBlock418G	变流升压一体机
eBlock745(风冷)	Galaxy1G
eBlock745(水冷)	Galaxy4G
eBlock1000	eLink3000(100C)
eBlock380GX	
eBlock836	
eBlock261	
eBlock250	
eBlock100C	
eBlock418P	

设置为默认


2) 配置并连接

协议类型:

本机IP:

本机TCP端口号:

打开

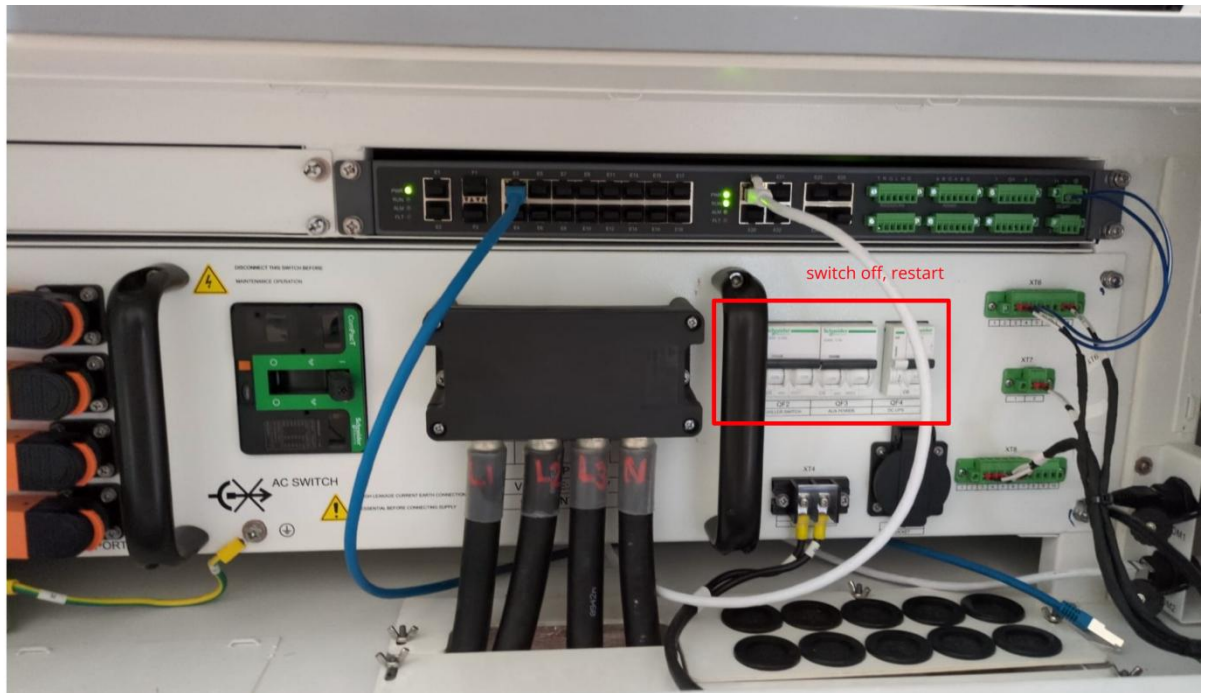


make sure you can ping 192.168.37.11 & 192.168.37.12



2. Configure Elink


Change laptop ip => 192.168.37.222

Connect com1 <=> E19, com2 <=> E3, laptop <=> E22


Ping 192.168.37.3


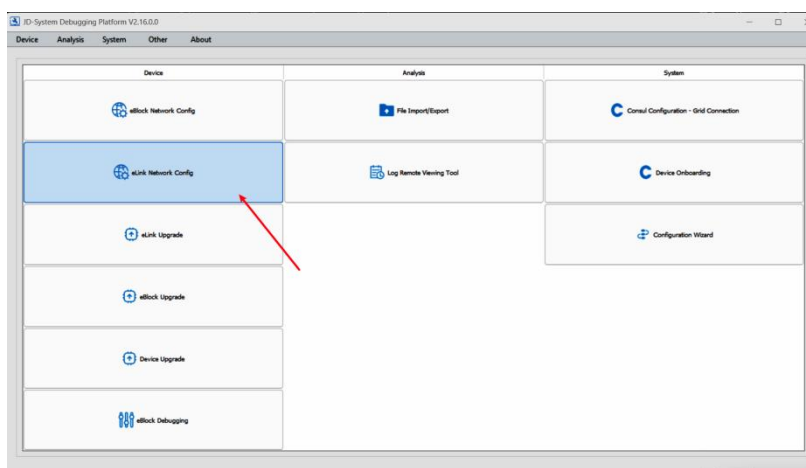


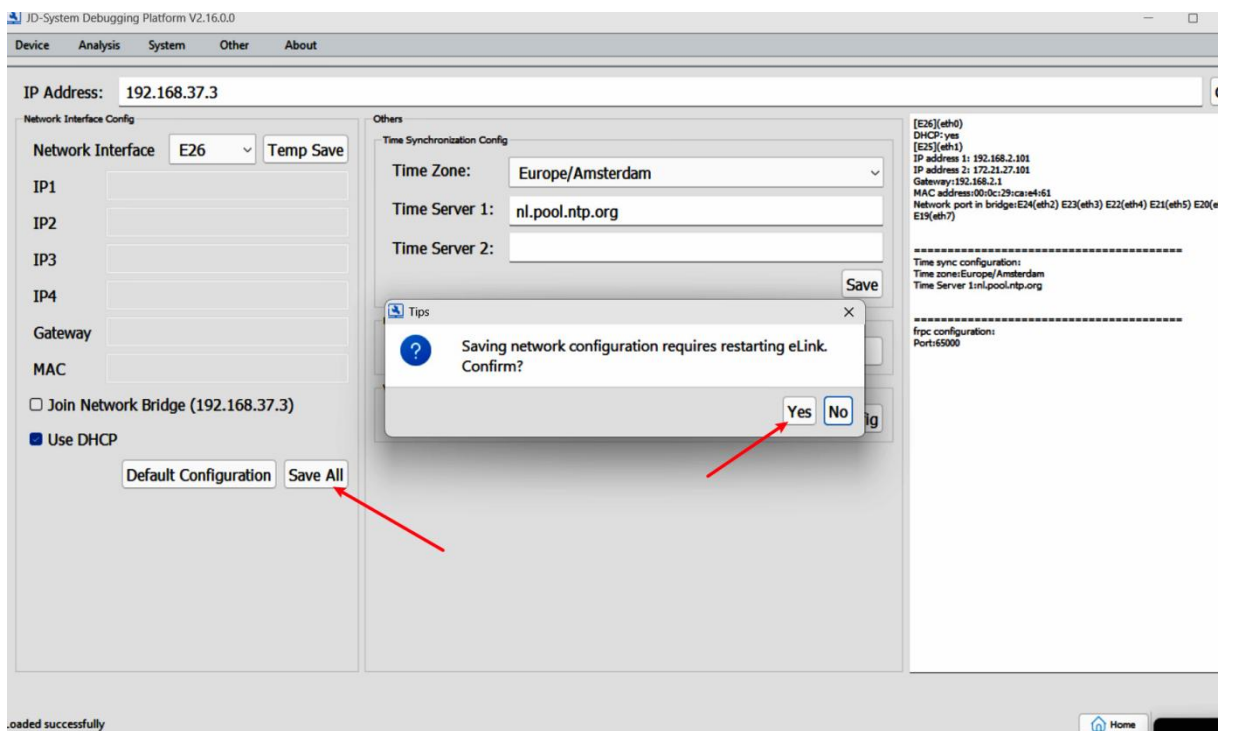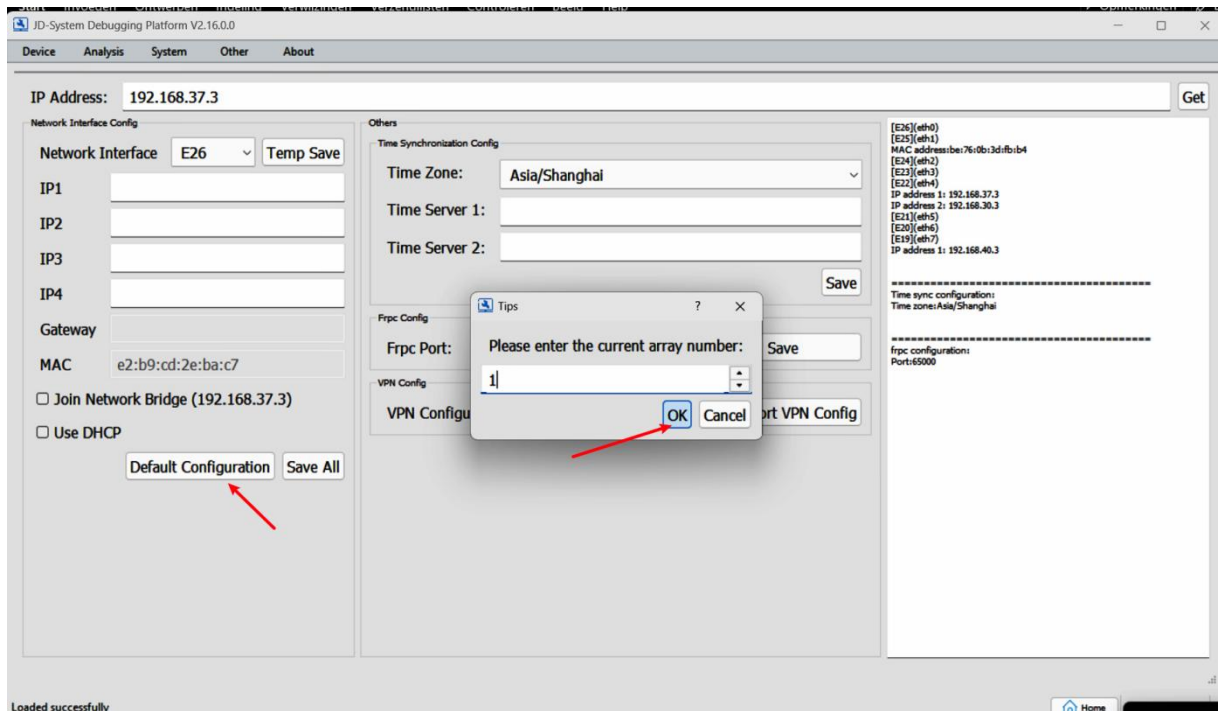


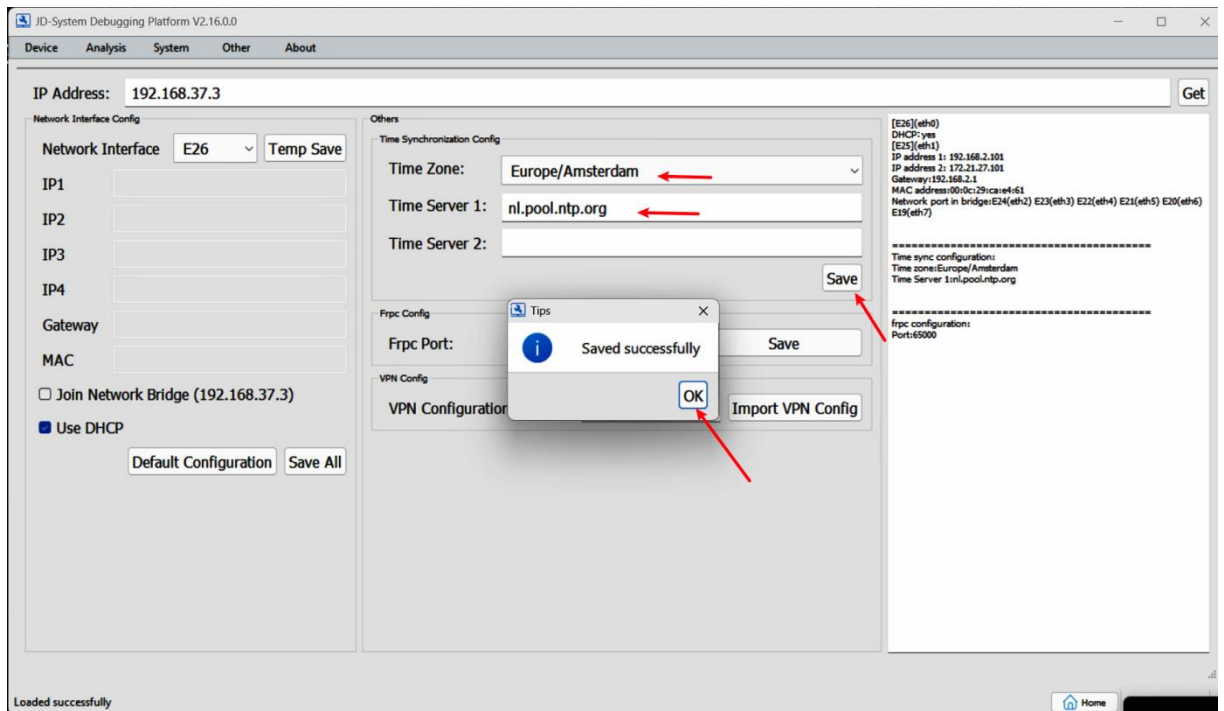


3. Consul config


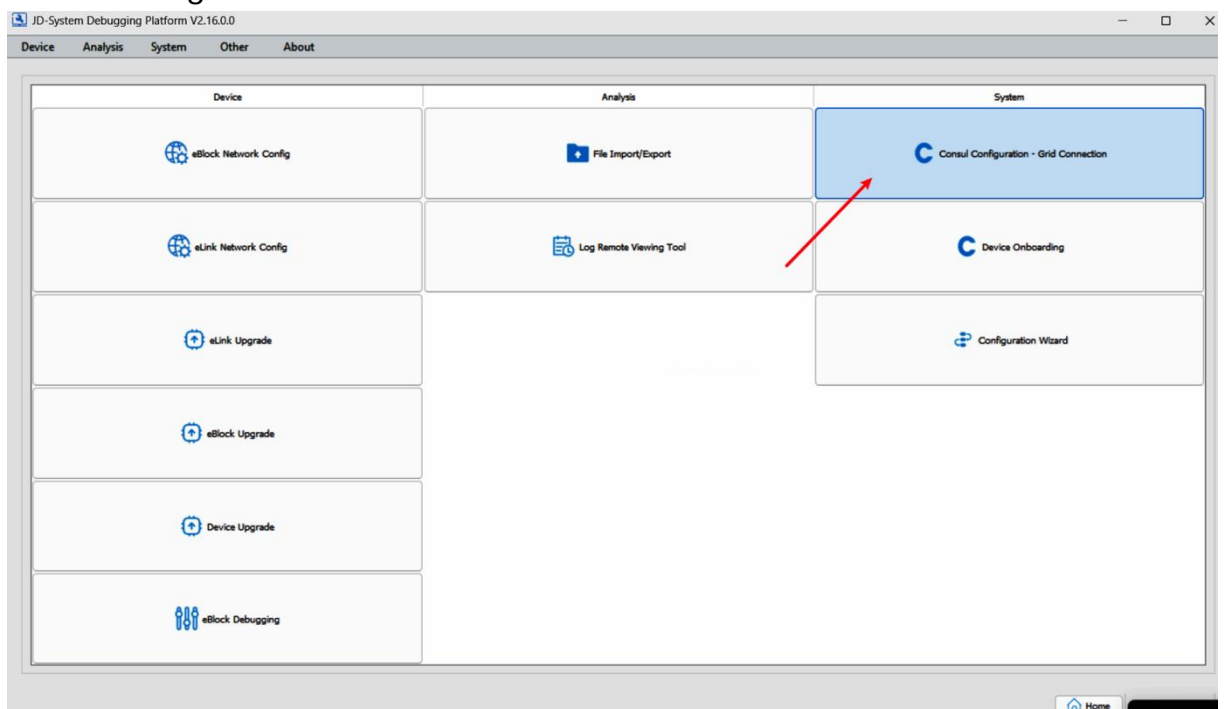


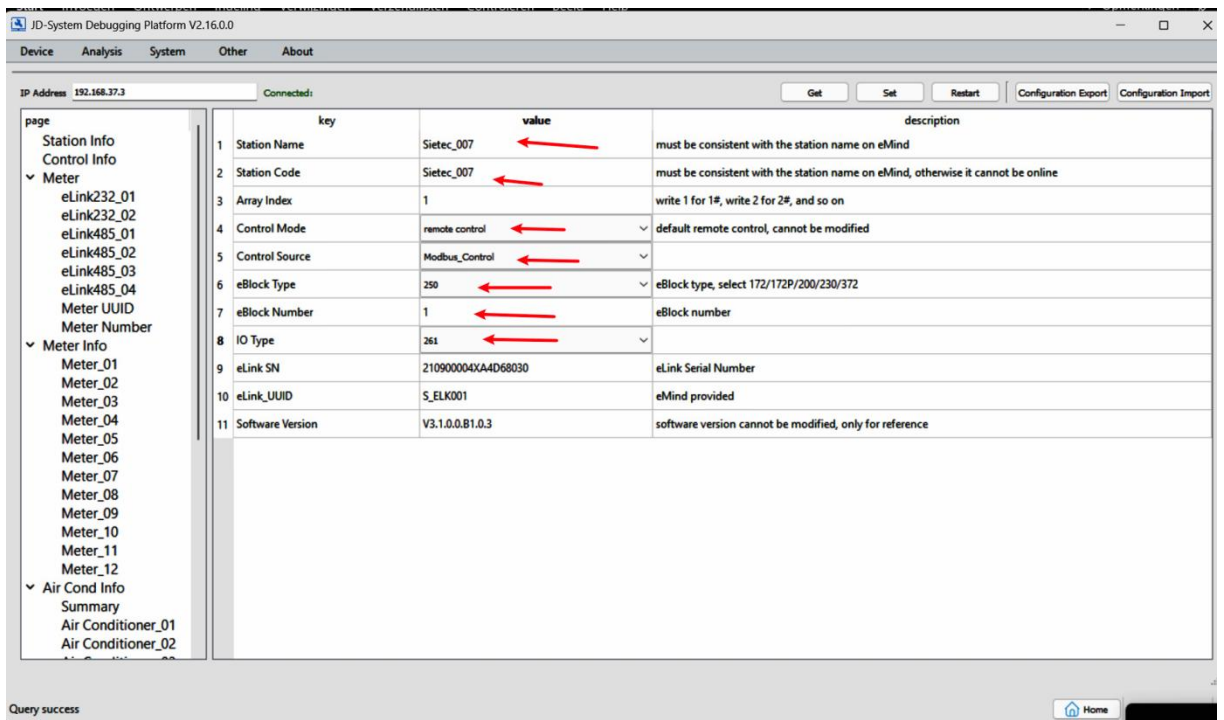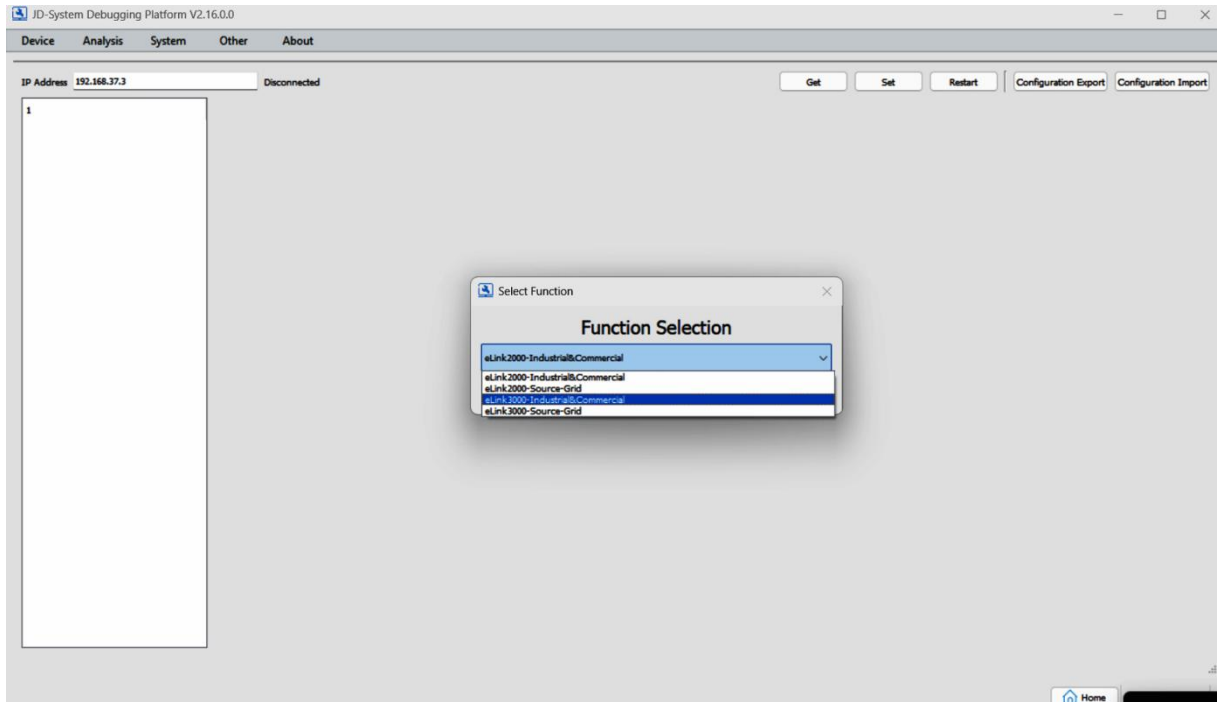

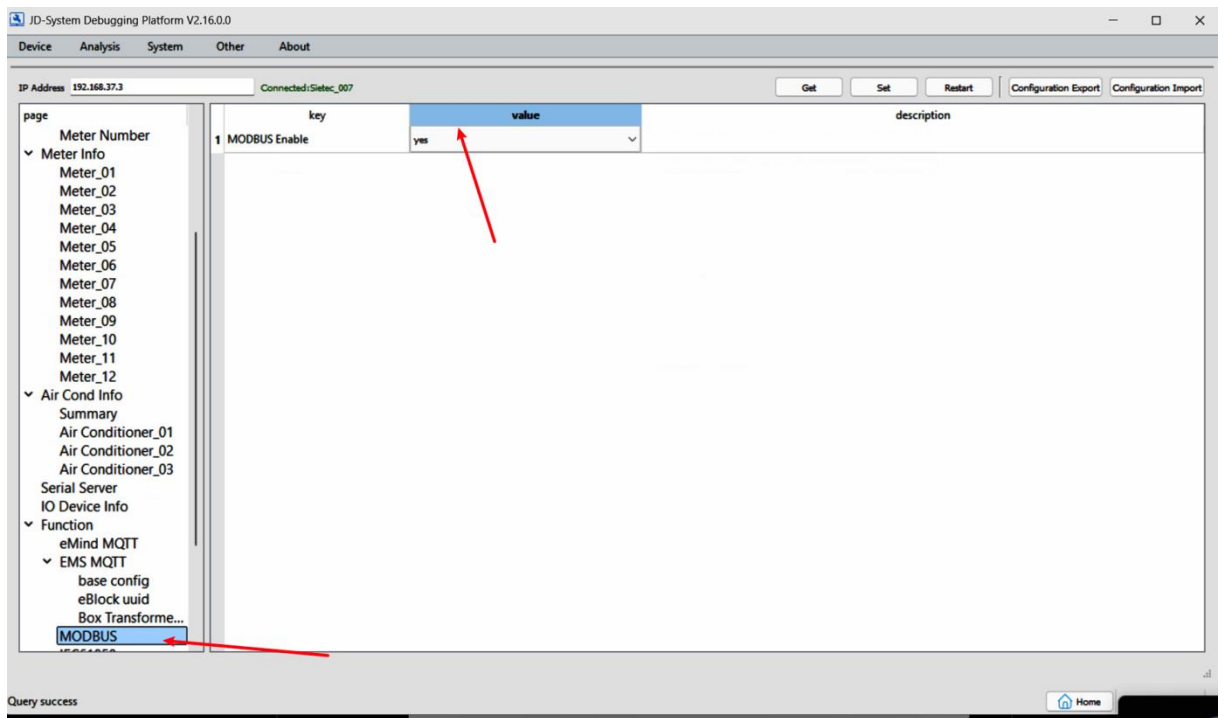



4. Onboarding setting

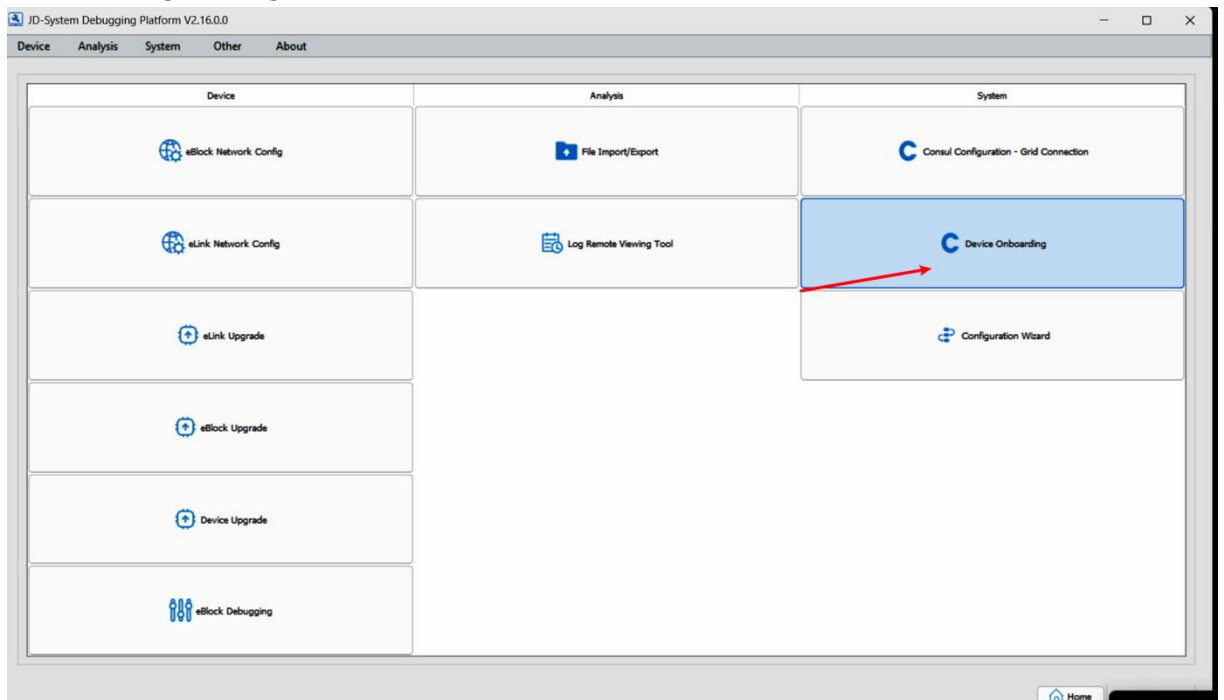

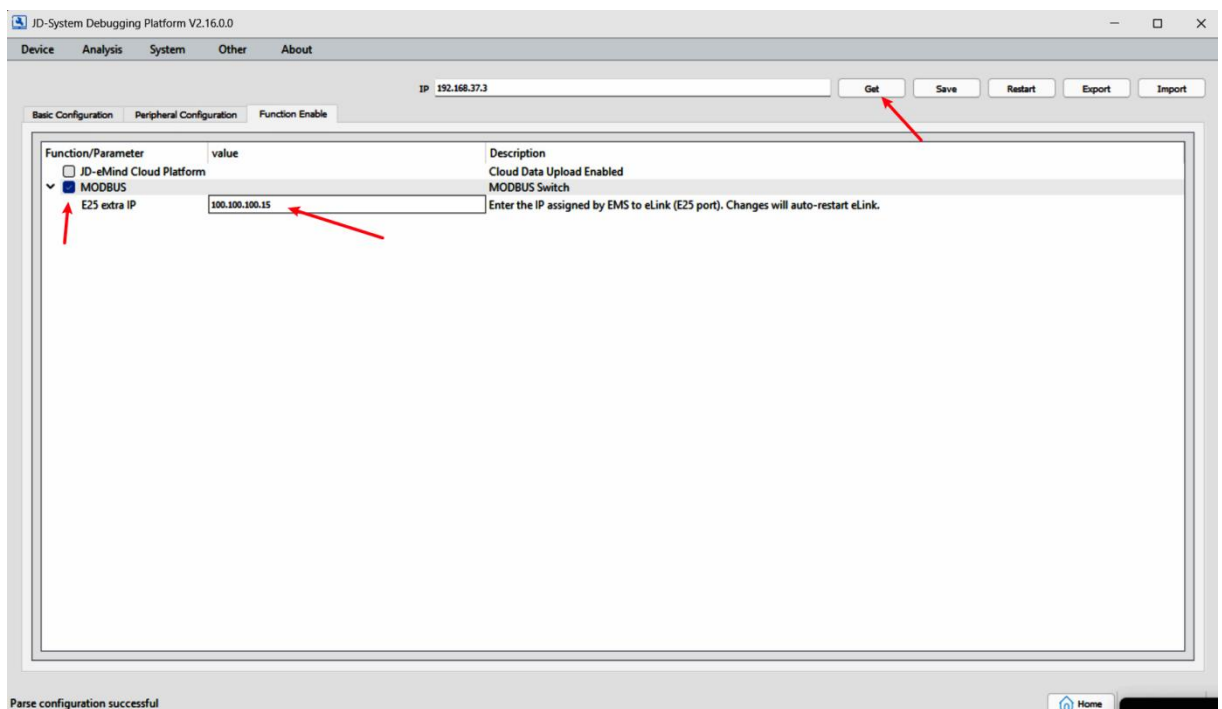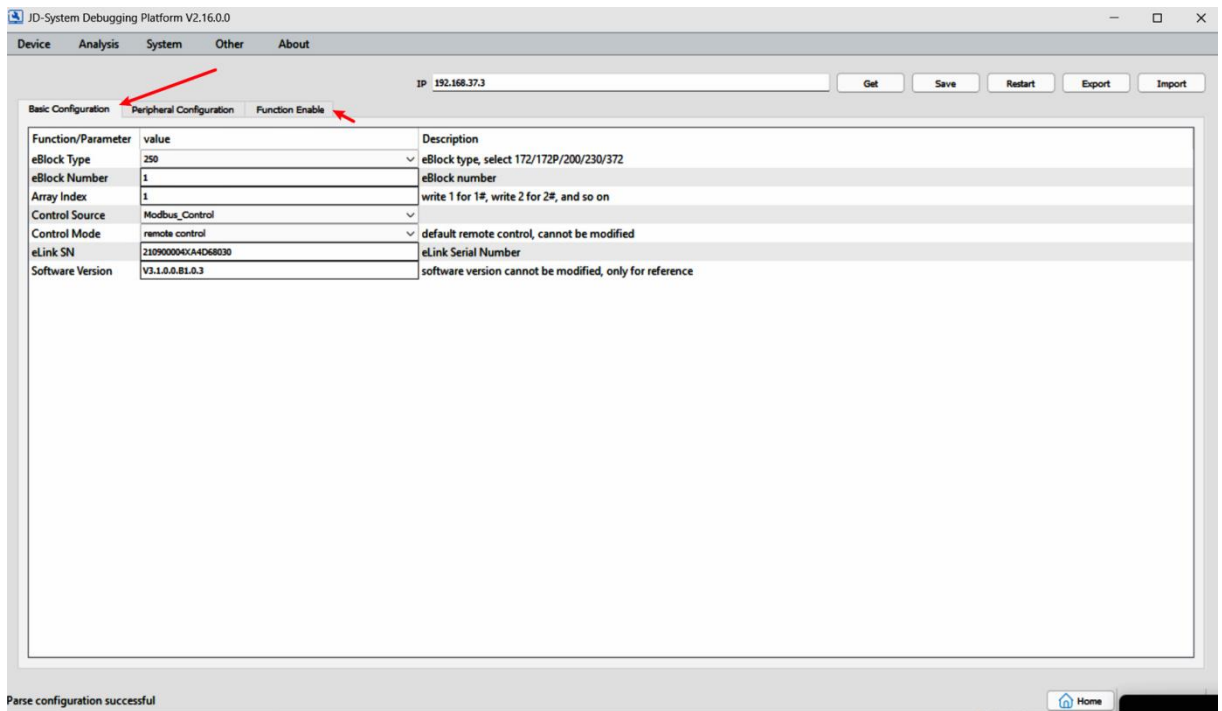



- Update eLink(old) => eblock(transition) => eLink(new) => device update(new)
Add laptop ip 192.168.38.222

5.1 update eLink(old) in eLink Upgrade or Device Upgrade

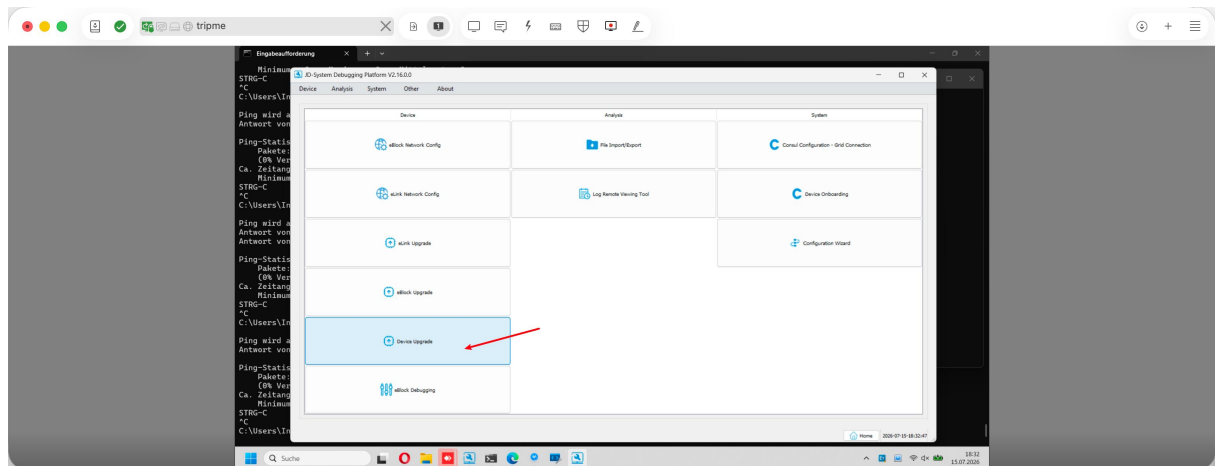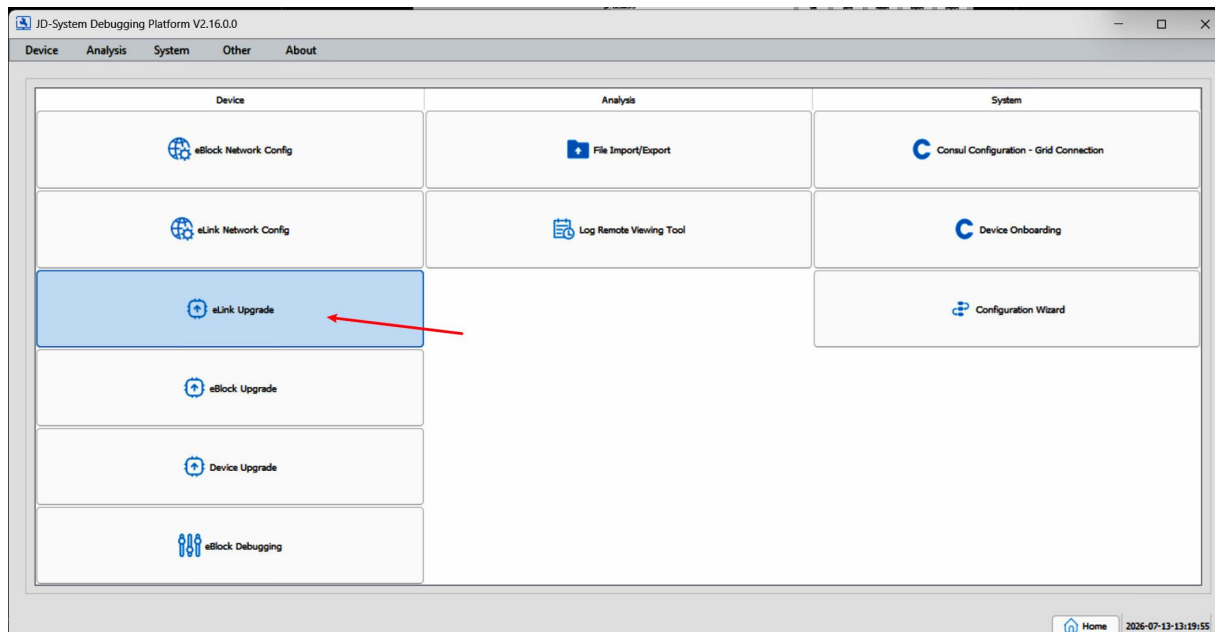


Query eLink version:


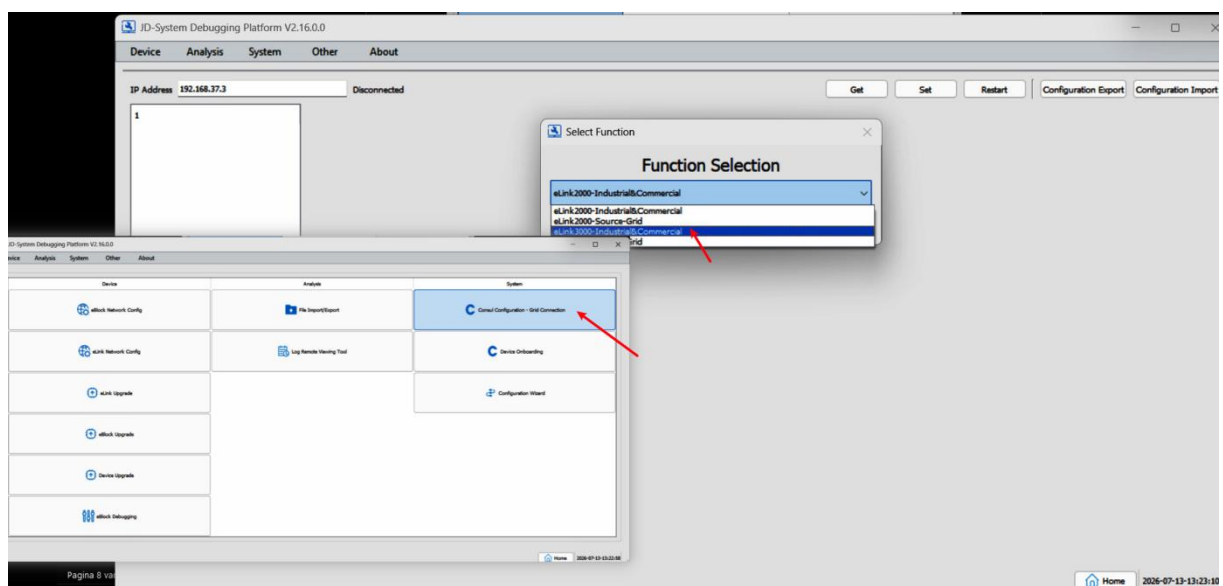


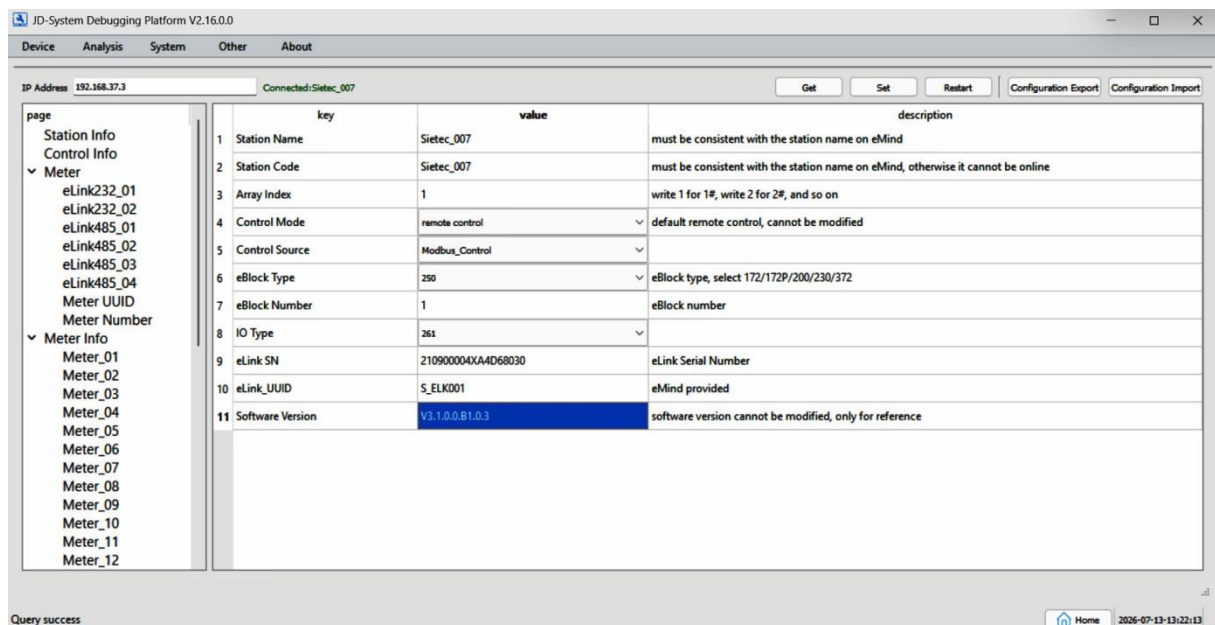

eLink old version: 3.5.0.1.B1.0.0

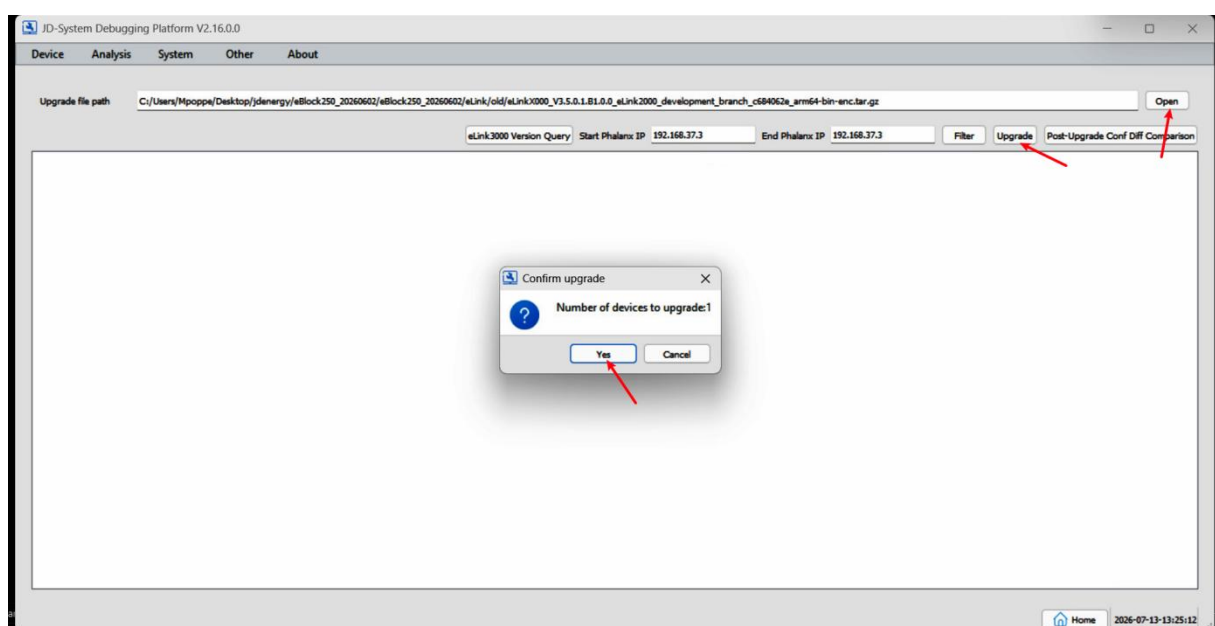



eBlock transaction

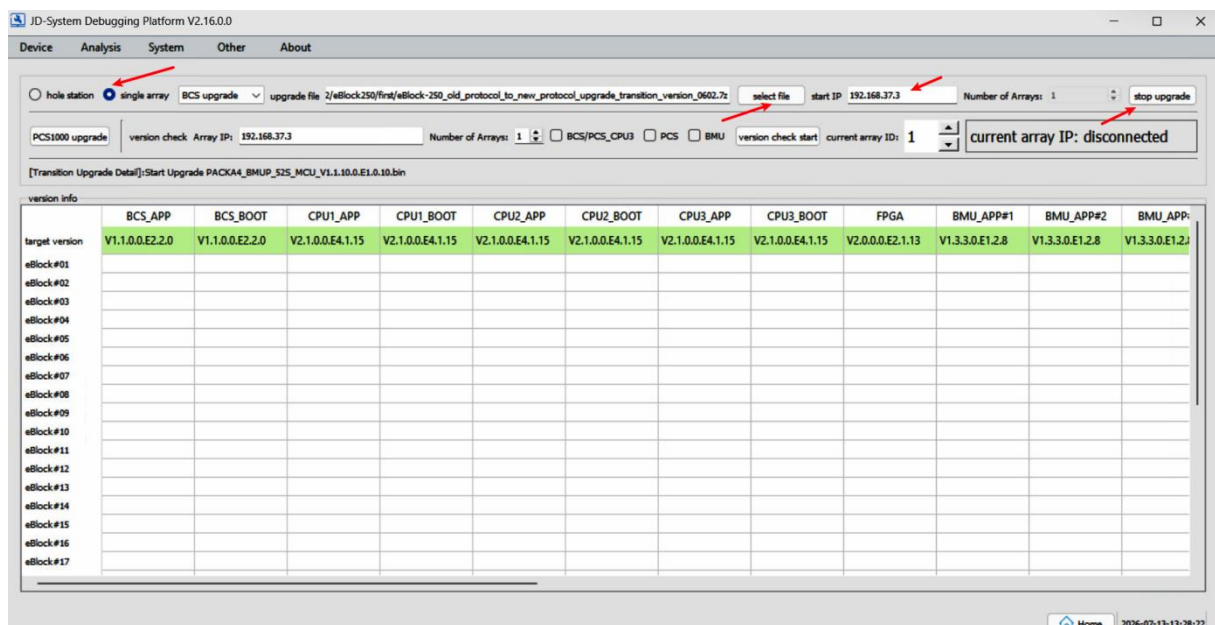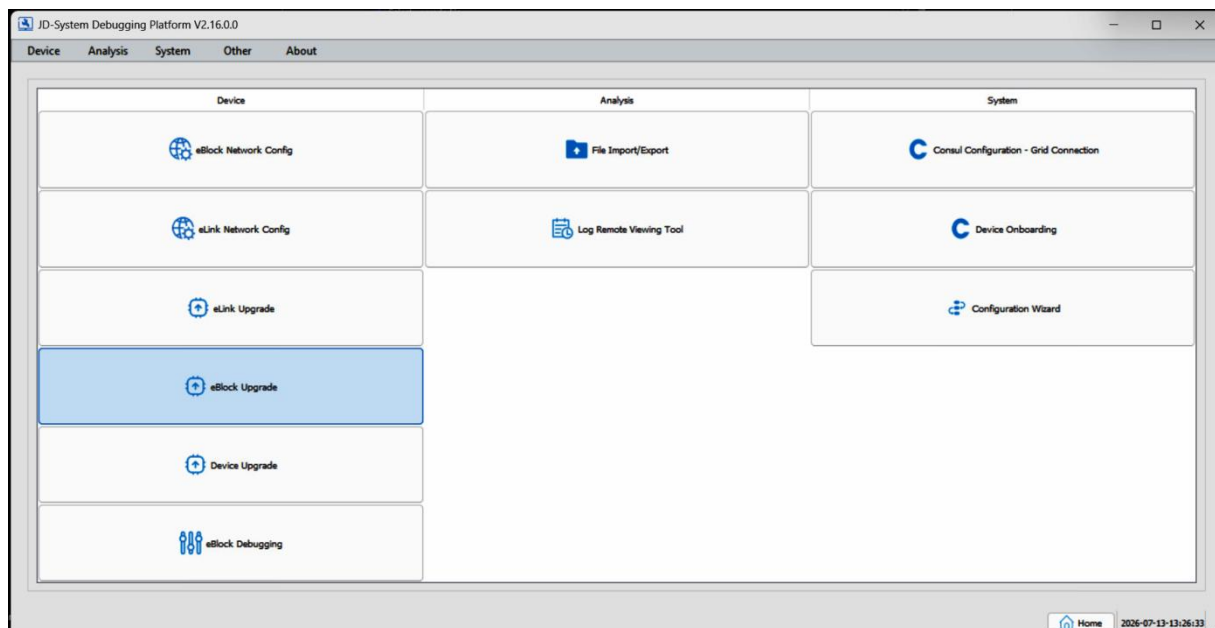


When completed it says ALL PASS.

Then upgrade Elink to new version.

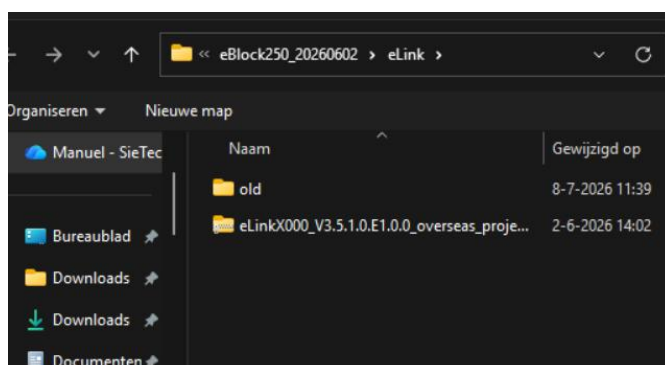

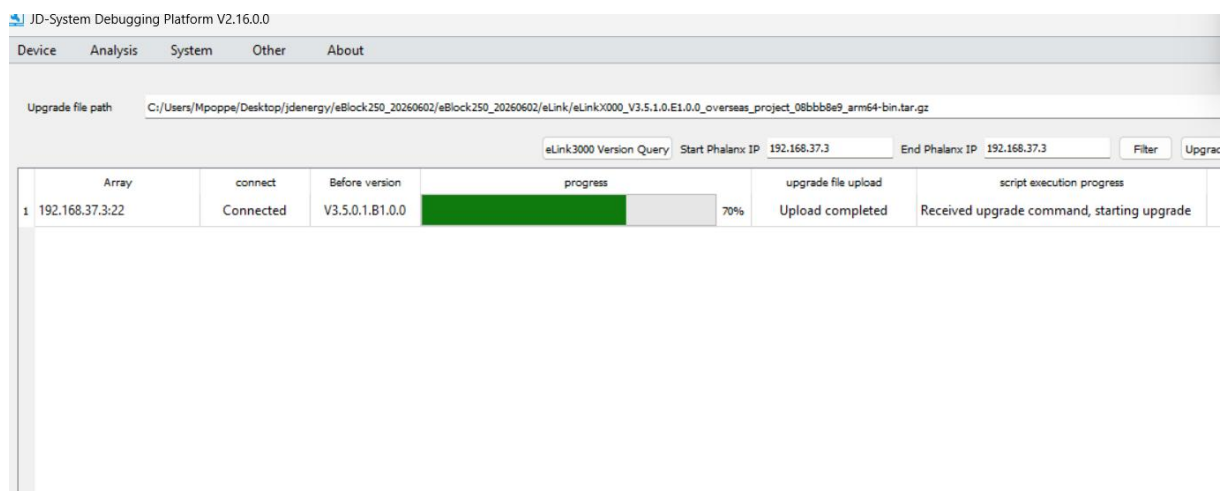

After upgrade successfully, upgrade Device

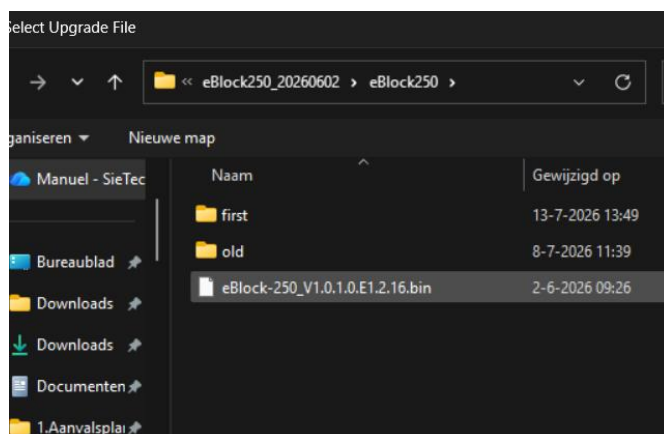

Use direct upgrade

JD-System Debugging Platform V2.16.0.0

Device Analysis System Other About

Device Type eBlock Device Model eBlock-250

Start Array IP Address: 192.168.37.3 Local IP Address: 192.168.37.222 Version Query

☐ All Arrays ☒ Single Array Number of Arrays: 1 select file

Upgrade File: \260602/eBlock250_20260602/eBlock250/eBlock-250_V1.0.1.0.E1.2.16.bin

Please select upgrade method

Detected eBlock-250 upgrade package, please select the upgrade method:

eBlock Direct Upgrade Upgrade via eLink

Then start upgrade

55

Device Model eBlock-250

Local IP Address: 192.168.37.222 Version Query

Number of Arrays: 1 select file Stop Upgrade

260602/eBlock250/eBlock-250_V1.0.1.0.E1.2.16.bin

Connection Status	Before version	Upgrade Progress	Result Details	After version	Status	Upgrade Duration
	-	10%	Device discovered...	V1.0.1.0.E1.2.16		00:00:17

Upgrade Progress	Result Details	After version	Status	Upgrade Duration
100%	Upgrade Result: ...	V1.0.1.0.E1.2.16	PASS	00:01:35