**Applicant Name:** _____

## INITIAL CONDITIONS:

- Salem is in mode 1 at 100%.
- The 22 CFCU has been declared inoperable.
- Tagging has been completed.

## INITIATING CUE:

- You have been directed by the WCCS to determine stay times for entering containment to hang additional tags on 22 CFCU.
- **Assume** the following:
  - Safety has determined the heat stress stay time to be 15 minutes
  - Radiation protection has limited total dose received by individual to 0.002 REM gamma and 0.008 REM Neutron

1. In accordance with the provided survey map perform the following:

   1.1 Calculate the following for the Operator:

   - Gamma dose stay time _____minutes
   - Neutron dose stay time _____minutes

   1.2 Determine most limiting allowable time for containment entry team based on ALARA and Heat Stress:

   - Limiting containment entry time _____minutes

[**Place your response on this cue sheet**]

Salem GENERATING STATION

# Radiological Survey

| MAP # | 2213000 |
|---|---|

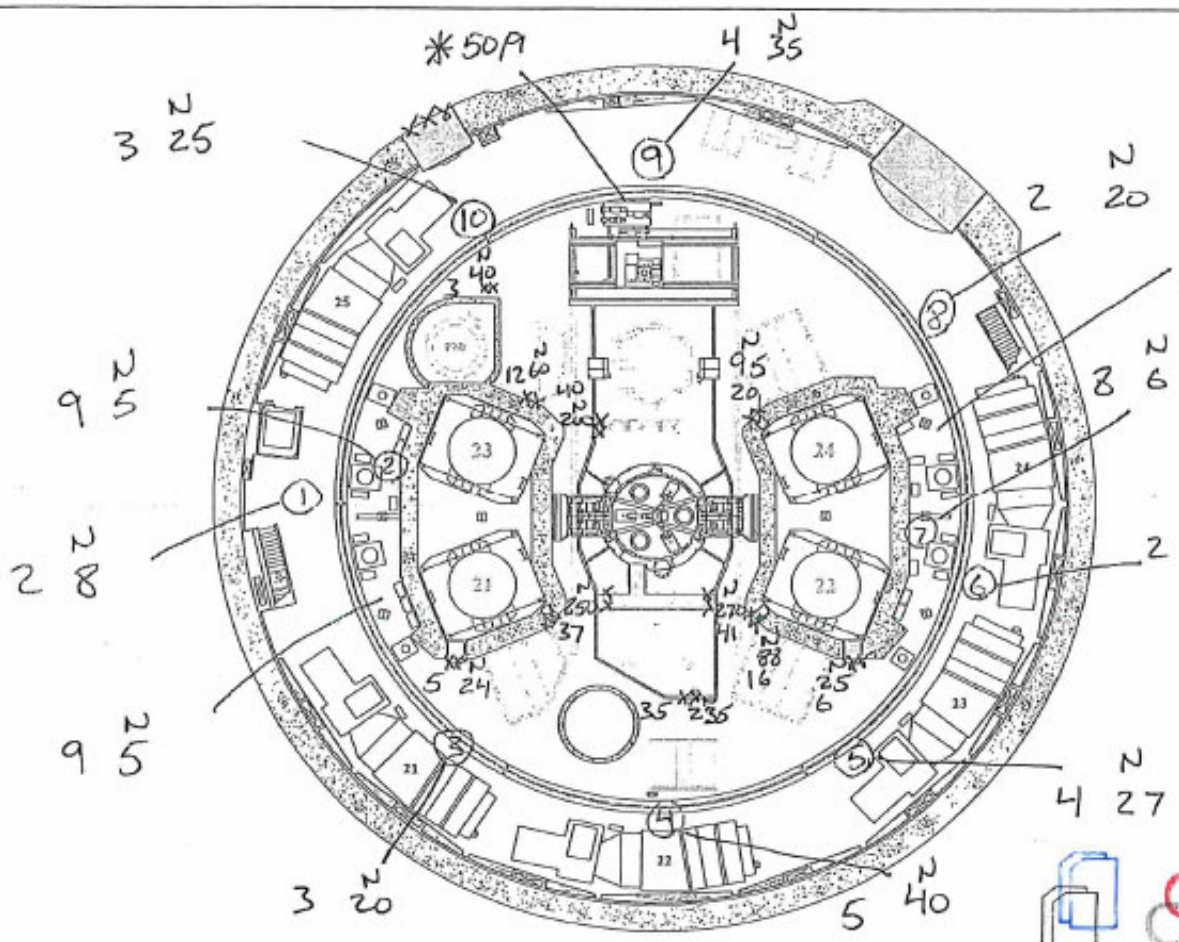


INFORMATION ONLY
COPY

| Location: S2 CTMT 130' GENERAL AREA | | | Date: 8/5/21 | Time: 1340 | RWP: 3 |
|---|---|---|---|---|---|
| Surveyed By: | Radiation Survey | | Contamination Survey | | |
| Print KRUPA / BURDSALL | Instrument TPOLE | Serial# 6610-064 | β,γ | Instrument RM14 | Serial# 8275 |
| Sign | Instrument LUD 30 | Serial# 7003 | α | Instrument N | Serial# A |

| Contamination β,γ | | | | | | | | Contamination α | | |
|---|---|---|---|---|---|---|---|---|---|---|
| LOC | dpm/100cm² | LOC | dpm/100cm² | LOC | dpm/100cm² | LOC | dpm/100cm² | LOC | cpm | dpm/100cm² |
| 1 | <1K | 6 | <1K | N | | | | | | |
| 2 | | 7 | | | | | | | | |
| 3 | | 8 | | | | | | | | |
| 4 | | 9 | | | | | | | | |
| 5 | <1K | 10 | <1K | | | | | | | A |

| | | COMMENTS: CTMT | PZR | 'D' RING | Rx CAVITY | 101°WBGT |
|---|---|---|---|---|---|---|
| n/a | n/a | HRA | LHRA | LHRA | LHRA | |
| X | Routine | NA | NRP | NRP | NRP | |
| N/ | S.O.J. | ARA | (LOCKED) | (LOCKED) | (LOCKED) | |
| /A | Other | CA | | | | |
| | | NRP (LOCKED) | | | Rx Power: 100% | |

Supervisor Review

| Print / Sign | DATE: |
|---|---|
| B. ACHUFF / | 8/5/21 |

# JOB PERFORMANCE MEASURE

**STATION:** SALEM

**SYSTEM:** Conduct of Operations - Administrative

**TASK:** Identify and Isolate Non-Essential Chilled Water Loads IAW S2.OP-SO.CH-0001, Attachment 2

**TASK NUMBER:** 0980020202

**JPM NUMBER:** 20-01 NRC SRO-A1

**ALTERNATE PATH:** [ ]

**K/A NUMBER:** G 2.1.7

**IMPORTANCE FACTOR:** RO: ____ SRO: 4.7

**APPLICABILITY:**

**EO** [ ] **RO** [ ] **STA** [ ] **SRO** [X]

**EVALUATION SETTING/METHOD:** Classroom

**REFERENCES:** S2.OP-SO.CH-0001 Rev. 36 (checked 1-10-22)
Salem 2 Tech Specs

**TOOLS AND EQUIPMENT:** Calculator

**VALIDATED JPM COMPLETION TIME:** 15 min

**TIME PERIOD IDENTIFIED FOR TIME CRITICAL STEPS:** N/A

| | | | |
|---|---|---|---|
| **Developed By:** | **R. Chan**<br>**Instructor** | **Date:** | **1-10-22** |
| **Validated By:** | **M. Protesto**<br>**SME or Instructor** | **Date:** | **1-10-22** |
| **Approved By:** | **M. Wadusky (signature on file)**<br>**Training Department** | **Date:** | **2-10-22** |
| **Approved By:** | **W. Hargrave**<br>**Operations Representative** | **Date:** | **1-10-22** |

**ACTUAL JPM COMPLETION TIME:**

**ACTUAL TIME CRITICAL COMPLETION TIME:**

**PERFORMED BY:** _____

**GRADE:** [ ] **SAT** [ ] **UNSAT**

**REASON, IF UNSATISFACTORY:**

**EVALUATOR'S SIGNATURE:** **DATE:**

## REVISION HISTORY

**JPM NUMBER: 20-01 NRCSRO-A1**

| Rev # | Date | Description | Validation Required |
|---|---|---|---|
| 00 | 10-3-17 | Added revision history and simulator setup pages. Editorial comments from IP 71111.11 FASA. | No |
| 01 | 1-10-22 | Used for 20-01 NRC exam. Incorporated NRC Prep week comments. | Yes |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |

## SIMULATOR SETUP INSTRUCTIONS

**SYSTEM:** Conduct of Operations - Administrative

**TASK:** Identify and Isolate Non-Essential Chilled Water Loads IAW S2.OP-SO.CH-0001

**TASK NUMBER:** 0980020202

**SIMULATOR IC:** **N/A**

**MALFUNCTIONS / REMOTES:** N/A

**OVERRIDES:** N/A

**SPECIAL INSTRUCTIONS:** None