

JOB PERFORMANCE MEASURE

STATION:	SALEM			
SYSTEM:	Administrative			
TASK:	Classify Emergency/Non-Emergency Events - Make a General Emergency Protective Action Recommendation			
TASK NUMBER:	N1240010502			
JPM NUMBER:	13-01 NRC SRO Admin A4			
ALTERNATE PATH:	☐	K/A NUMBER:	2.4.44	
APPLICABILITY:		IMPORTANCE FACTOR:		
EO ☐	RO ☐	STA ☐	SRO ☒	
EVALUATION SETTING/METHOD:	Classroom			
REFERENCES:	Salem ECG			
TOOLS AND EQUIPMENT:	None			
VALIDATED JPM COMPLETION TIME:	<u>10 min</u>			
TIME PERIOD IDENTIFIED FOR TIME CRITICAL STEPS:	<u>15 minutes</u>			
Developed By:	G Gauding Instructor	Date:	9-19-14	
Validated By:	N Salam SME or Instructor	Date:	10-16-14	
Approved By:	 Training Department	Date:	10-23-14	
Approved By:	 Operations Representative	Date:	10-23-14	
ACTUAL JPM COMPLETION TIME:				
ACTUAL TIME CRITICAL COMPLETION TIME:				
PERFORMED BY:				
GRADE:	☐ SAT	☐ UNSAT		
REASON, IF UNSATISFACTORY:				
EVALUATOR'S SIGNATURE:			DATE:	

JOB PERFORMANCE MEASURE

NAME: _____

DATE: _____

SYSTEM: Administrative

TASK: Classify Emergency/Non-Emergency Events - Make a General Emergency Protective Action Recommendation

TASK NUMBER: N1240010502

INITIAL CONDITIONS:

A severe accident has occurred at Salem Unit 2. You have declared a 13 point General Emergency in the Control Room at 1535 hrs for loss of all three fission product barriers under EAL's FB3.L, RB2.L, and CB.1.L

The weather conditions are as follows:

- Wind direction is from 050 degrees at 15 mph.
- Overcast skies with rain showers.
- Ambient temp = 62°F
- 2R41D is reading 2.5 E3 uCi/sec

INITIATING CUE:

Continue performing the provided Salem ECG Attachment 4, General Emergency.

I am the Primary Communicator.

This is a time critical JPM.

Successful Completion Criteria:

1. All critical steps completed.
2. All sequential steps completed in order.
3. All time-critical steps completed within allotted time.
4. JPM completed within validated time. Completion time may exceed the validated time if satisfactory progress is being made.

Task Standard for Successful Completion:

1. Determine correct PAR.
2. Complete ICMF within 15 minutes.

JOB PERFORMANCE MEASURE

System: Administrative

Name:

Task: Classify Emergency/Non-Emergency Events - Make a General Emergency Protective Action Recommendation

*	STEP NO.	STEP (* = Critical Step)	STANDARD	EVAL S / U	COMMENTS (Req'd for UNSAT Evaluation)
		Provide marked up EP-SA-111-F4, Attachment 4, General Emergency, and a blank copy of EP-SA-111-102, Salem Emergency Classification Description Table.			
	Att. 4 B	<u>CAUTION</u> A Protective Action Recommendation (PAR) SHALL be made on the Initial Contact Message Form (ICMF).			
*	Att. 4 B.2	MAKE a PAR as follows: a. REFER to Predetermined PAR Flowchart on Pg. 3 and DETERMINE the appropriate PAR.	Refers to Predetermined PAR Flowchart on Pg. 3 and determines the appropriate PAR is to: Evacuate All sectors 0-5 miles, Evacuate downwind sectors +/- 1 sector. SSW, SW, WSW 5-10 MILES (Shelter) All remaining sectors. Note: Wind is from 050 (NE), and the +/-1 sector is included in sectors for NE wind direction.		

JOB PERFORMANCE MEASURE

System: Administrative

Name:

Task: Classify Emergency/Non-Emergency Events - Make a General Emergency Protective Action Recommendation

*	STEP NO.	STEP (* = Critical Step)	STANDARD	EVAL S / U	COMMENTS (Req'd for UNSAT Evaluation)
	Att. 4 B.2	b. <u>IF</u> a Radiological Based PAR is <u>IMMEDIATELY</u> available, <u>THEN</u> COMPARE the two PARs and CHOOSE the most appropriate for inclusion on the ICMF.	Cue: A radiological PAR is not immediately available.		
*	Att. 4 B.3	COMPLETE/APPROVE the ICMF (last page of this attachment).	Completes the GE ICMF by filling in: • Name • Checking "Control Room" • Time/Date • EALs FB3.L, RB2.L, and CB.1.L • Loss of the Fuel Clad Barrier, Loss of the Reactor Coolant System Barrier, Loss of the Containment Barrier • <u>NOT</u> checking Box IIb for PAR Upgrade. • Checking no radiological release in progress based on 2R41D reading • Filling in Section V with conditions determined in B.2 above. • Initialing the ICMF		

JOB PERFORMANCE MEASURE

System: Administrative

Name:

Task: Classify Emergency/Non-Emergency Events - Make a General Emergency Protective Action Recommendation

*	STEP NO.	STEP (* = Critical Step)	STANDARD	EVAL S / U	COMMENTS (Req'd for UNSAT Evaluation)
	Att. 4 B.4	IF time allows, OBTAIN an accuracy peer check of the completed ICMF.	Cue: A peer check will not be provided.		
	Att. 4 B.5	PROVIDE the ICMF to the Primary Communicator and DIRECT the Communicator to implement ECG Attachment 6.	Provides ICMF to evaluator.		
			State JPM is complete, and mark Stop Time: _____		

page intentionally blank

10/23/14

JOB PERFORMANCE MEASURE

JOB PERFORMANCE MEASURE VALIDATION CHECKLIST

NOTE: All steps of this checklist should be performed upon initial validation. Prior to JPM usage, revalidate JPM using steps 8 and 11 below.

- YH 1. Task description and number, JPM description and number are identified.
- YH 2. Knowledge and Abilities (K/A) references are included.
- YH 3. Performance location specified. (in-plant, control room, or simulator)
- YH 4. Initial setup conditions are identified.
- YH 5. Initiating and terminating Cues are properly identified.
- YH 6. Task standards identified and verified by SME review.
- YH 7. Critical steps meet the criteria for critical steps and are identified with an asterisk (*).
- YH 8. Verify the procedure referenced by this JPM matches the most current revision of that procedure: Procedure Rev. 1 Date 10/24/2012
- YH 9. Pilot test the JPM:
 - a. verify Cues both verbal and visual are free of conflict, and
 - b. ensure performance time is accurate.
- _____ 10. If the JPM cannot be performed as written with proper responses, then revise the JPM.
- _____ 11. When JPM is revalidated, SME or Instructor sign and date JPM cover page.

SME/Instructor: V. Hossain

Date: 10/16/14

SME/Instructor: _____

Date: _____

SME/Instructor: _____

Date: _____

JOB PERFORMANCE MEASURE

INITIAL CONDITIONS:

A severe accident has occurred at Salem Unit 2. You have declared a 13 point General Emergency in the Control Room at 1535 hrs for loss of all three fission product barriers under EAL's FB3.L, RB2.L, and CB.1.L.

The weather conditions are as follows:

- Wind direction is from 050 degrees at 15 mph.
- Overcast skies with rain showers.
- Ambient temp = 62°F
- 2R41D is reading 2.5 E3 uCi/sec

INITIATING CUE:

Continue performing the provided Salem ECG Attachment 4, General Emergency.
I am the Primary Communicator
This is a time critical JPM.

ATTACHMENT 4 GENERAL EMERGENCY

I. EMERGENCY COORDINATOR (EC) LOG SHEET

Initials

A. CLASSIFICATION

1. **CALL** communicators to the Control Room.
2. IF a Security Event is in progress,
THEN, **IMPLEMENT** the prompt actions of NC.EP-EP.ZZ-0102,
EC Response, **Attachment 10**, prior to classification.
3. As time allows, **OBTAIN** Classification Independent Verification
(ensure verifier understands the EAL assessment clock is running);
 - STA or designee performs Independent Verification for SM
 - SM or designee performs Independent Verification for EDO
 - EDO or designee performs Independent Verification for ERM
4. While classification verification is in progress and if time allows,
COMMENCE filling out the INITIAL CONTACT MESSAGE FORM
(ICMF) (last page of this attachment).
5. After classification verification and/or before 15 minute EAL assessment
clock expires, **DECLARE** a **GENERAL EMERGENCY** at
Salem Unit(s) 2

Complete
SM

N/A
SM

Complete
EC

N/A *Time did not allow*
EC

EAL #(s) FB3.L, RB2.L, CBI.L

Declared at (current time) hrs on today
time date

Complete
EC

B. NOTIFICATIONS

1. **ACTIVATE** "ERO Emergency Callout" per posted instructions titled:
"Emergency Callout Activation": (Commitment #EP96-003)

Complete
SM

Notification Section Continued on Next Page:

B. NOTIFICATIONS (cont'd)

Initials**CAUTION**

A Protective Action Recommendation (PAR) SHALL be made on the Initial Contact Message Form (ICMF).

2. **MAKE** a PAR as follows:

- a. **REFER** to Predetermined PAR Flowchart on Pg. 3 and **DETERMINE** the appropriate PAR.
- b. IF a Radiological Based PAR is IMMEDIATELY available, THEN COMPARE the two PARs and **CHOOSE** the most appropriate for inclusion on the ICMF.


ECEC3. **COMPLETE/APPROVE** the ICMF (last page of this attachment).EC4. IF time allows, **OBTAIN** an accuracy peer check of the completed ICMF.EC5. **PROVIDE** the ICMF to the Primary Communicator and **DIRECT** the Communicator to implement **ECG Attachment 6**.EC6. **DIRECT** the Secondary Communicator to implement **ECG Attachment 8** for a GENERAL EMERGENCY.EC7. **VERIFY** the ERO Emergency Callout System is activated per posted instructions titled: "Emergency Callout Verification"SM8. IF Callout Activation or Verification was not satisfactory, THEN, **IMPLEMENT** the "Primary Emergency Callout System – Activation" instructions located in the confidential envelope labeled "BACKUP EMERGENCY CALLOUT", located in the front of the Shift Manager's (SM) copy of the ECG and **RETURN** to this procedure when complete.SM9. **IMPLEMENT** NC.EP-EP.ZZ-0102, EC Response.ERM/EDO/SM

APPENDIX 1

PREDETERMINED PROTECTIVE ACTION RECOMMENDATIONSCAUTION:

IF travel conditions present an extreme hazard (severe ice, snow, wind, flood, quake damage, etc.), THEN, consider sheltering, in place of evacuation, in the below selected PAR.

PAR REQUIRED FOR GENERAL EMERGENCY

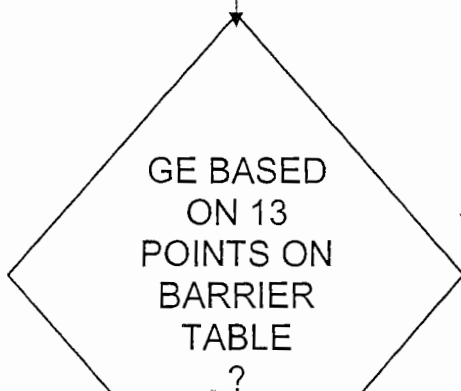

YES

EVACUATE ALL SECTORS 0 - 5 MILES
EVACUATE DOWNWIND $\pm$ 1 SECTOR 5 - 10 MILES
SHELTER ALL REMAINING SECTORS 5 - 10 MILES

(SEE NEXT PAGE TO DETERMINE DOWNWIND SECTORS)

NO


EVACUATE ALL SECTORS 0 - 5 MILES

DEFAULT PAR
(any other GE)

APPENDIX 1 (continued)
RECOMMENDED PROTECTIVE ACTION WORKSHEET

WIND DIRECTION FROM		PAR AFFECTED SECTORS	
DEGREES	COMPASS		DOWNWIND ± 1 SECTORS
349 - 011	N	$\Rightarrow$	SSE - S - SSW
011 - 034	NNE	$\Rightarrow$	S - SSW - SW
034 - 056	NE	$\Rightarrow$	SSW - SW - WSW
056 - 079	ENE	$\Rightarrow$	SW - WSW - W
079 - 101	E	$\Rightarrow$	WSW - W - WNW
101 - 124	ESE	$\Rightarrow$	W - WNW - NW
124 - 146	SE	$\Rightarrow$	WNW - NW - NNW
146 - 169	SSE	$\Rightarrow$	NW - NNW - N
169 - 191	S	$\Rightarrow$	NNW - N - NNE
191 - 214	SSW	$\Rightarrow$	N - NNE - NE
214 - 236	SW	$\Rightarrow$	NNE - NE - ENE
236 - 259	WSW	$\Rightarrow$	NE - ENE - E
259 - 281	W	$\Rightarrow$	ENE - E - ESE
281 - 304	WNW	$\Rightarrow$	E - ESE - SE
304 - 326	NW	$\Rightarrow$	ESE - SE - SSE
326 - 349	NNW	$\Rightarrow$	SE - SSE - S

NOTE: CONSIDER ADDING A SECTOR TO THE PAR IF THE WIND DIRECTION (FROM) IS WITHIN $\pm 3^\circ$ OF A SECTOR DIVIDING LINE.

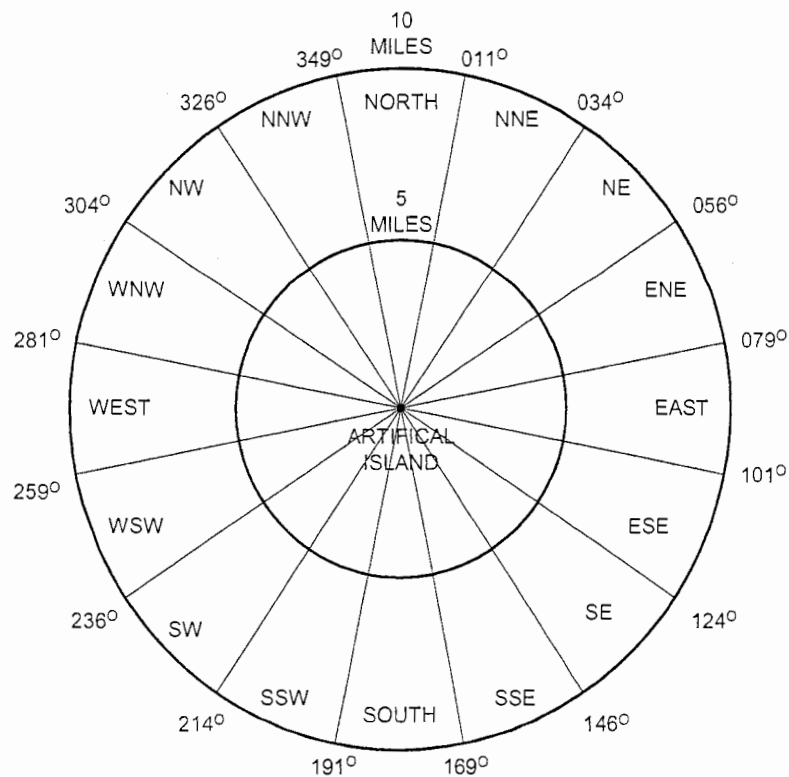

INITIAL CONTACT MESSAGE FORM

I. THIS IS _____, COMMUNICATOR IN THE ☐ CONTROL ROOM
 (NAME) ☐ TSC
☐ EOF
 AT THE SALEM NUCLEAR GENERATING STATION, UNIT(s) NO. _____.

IIa. ☐ THIS IS NOTIFICATION OF A **GENERAL EMERGENCY** WHICH WAS
 DECLARED AT _____ ON _____
 (TIME - 24 HOUR CLOCK) (DATE)

EAL #(s) _____,
 DESCRIPTION OF EVENT: _____

IIb. ☐ THIS IS NOTIFICATION OF A **PROTECTIVE ACTION RECOMMENDATION
 UPGRADE** WHICH WAS MADE AT _____ HRS ON _____
 (24 HOUR CLOCK) (DATE)

Reason for PAR Upgrade: _____

III.

NOTE:

Radiological Release is defined as: Plant Effluent > Federal Limit of 2.42E+05 μ Ci/sec Noble Gas or 2.1E+01 μ Ci/sec I-131.

- ☐ NO RADIOLOGICAL RELEASE IS IN PROGRESS. } see NOTE
☐ THERE IS A RADIOLOGICAL RELEASE IN PROGRESS. } for release
 definition

IV. ☒ 33 FT. LEVEL WIND DIRECTION (From): _____ WIND SPEED: _____
 (From MET Computer /SPDS) (DEGREES) (MPH)

V. ☐ WE RECOMMEND **EVACUATION** AS FOLLOWS Sectors Dist.- Miles

☐ WE RECOMMEND **SHELTERING** AS FOLLOWS _____

☒ WE RECOMMEND THE **USE OF KI** IN ACCORDANCE WITH STATE PROCEDURES

EC Initials (Approval to Transmit ICMF)