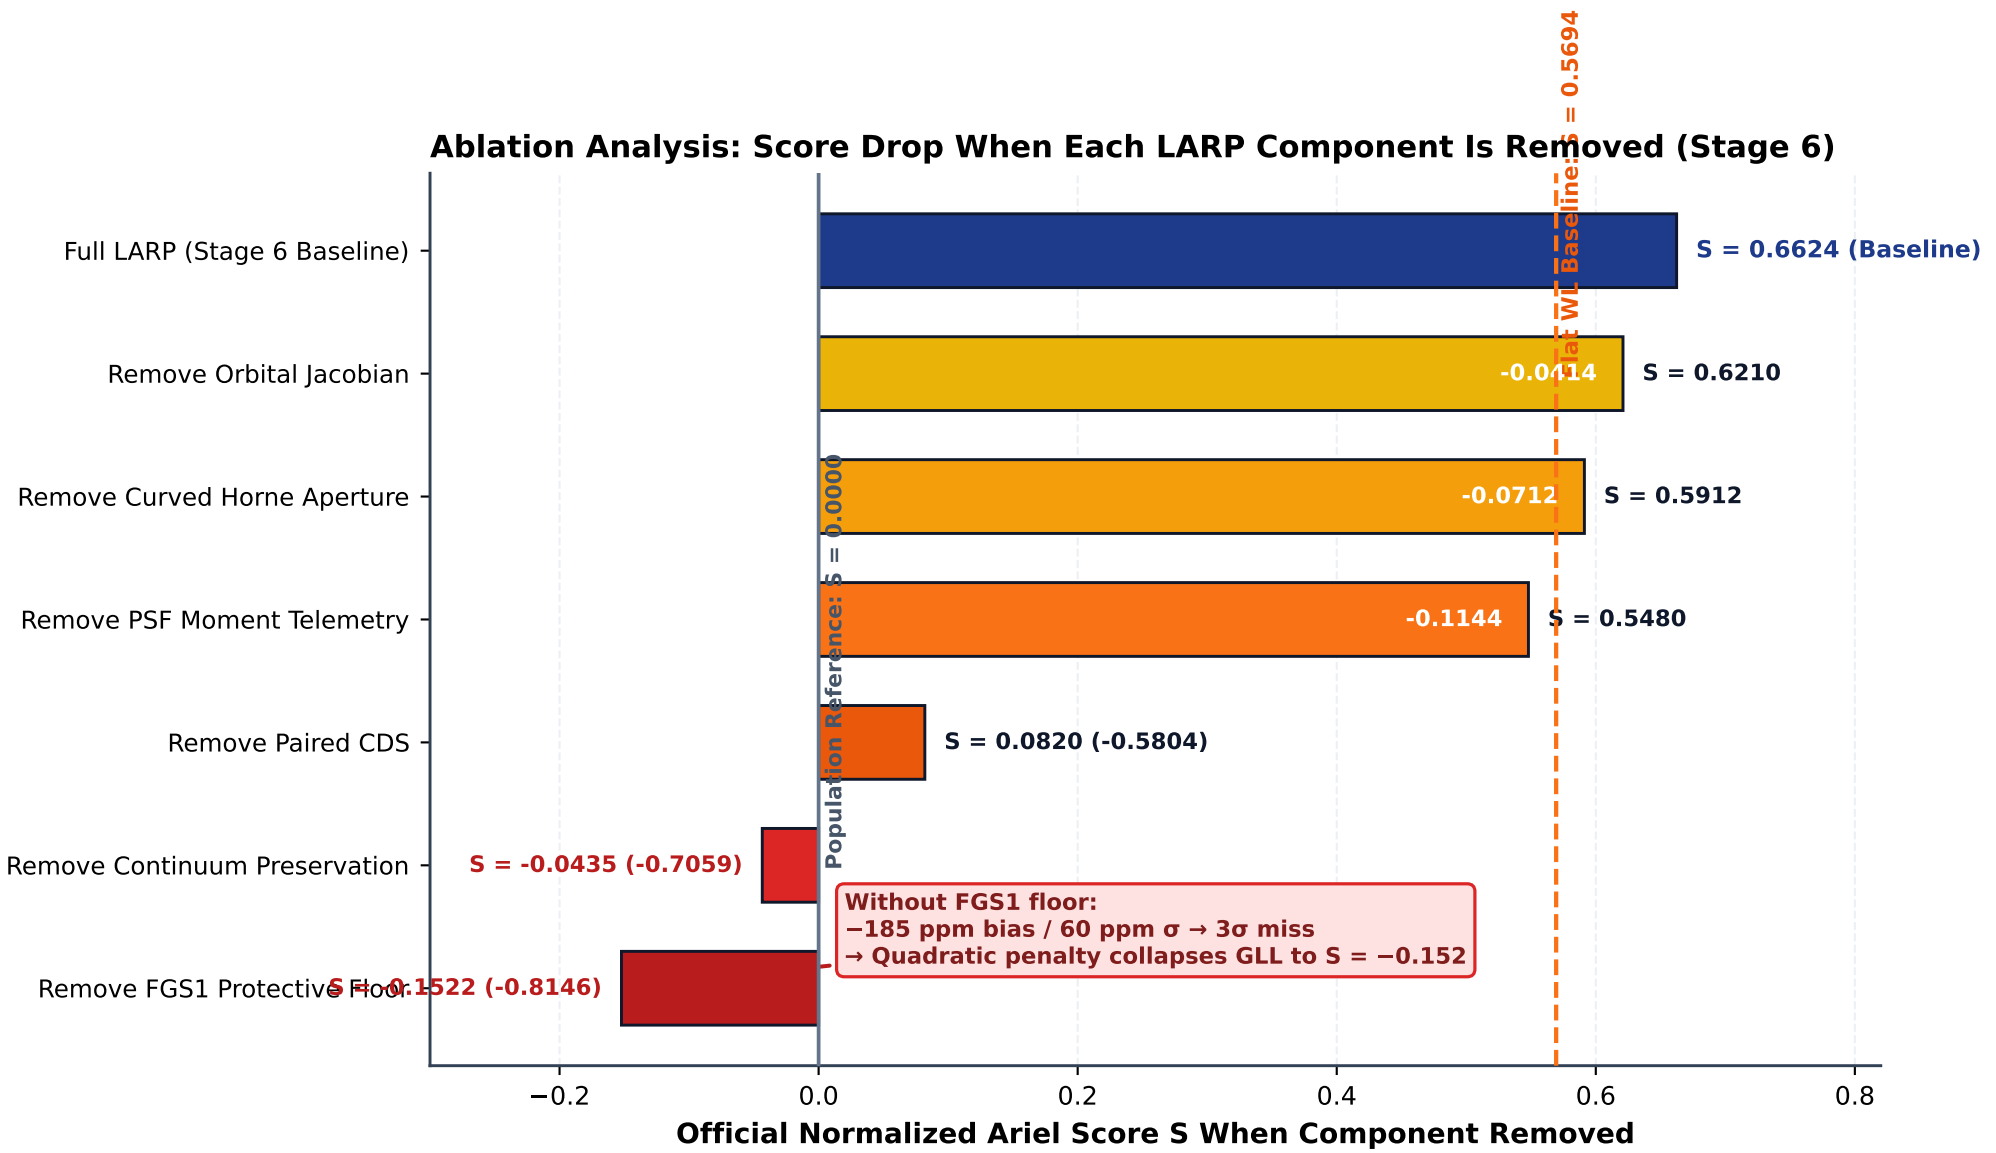
Ablation Analysis: Score Drop When Each LARP Component Is Removed (Stage 6)
Full LARP (Stage 6 Baseline)
Remove Orbital Jacobian
Remove Curved Horne Aperture
Remove PSF Moment Telemetry
Remove Paired CDS
Remove Continuum Preservation
Remove FGS1 Protective Floor
S = 0.6624 (Baseline)
-0.0414
S = 0.6210
-0.0712
S = 0.5912
-0.1144
S = 0.5480
S = 0.0820 (-0.5804)
S = -0.0435 (-0.7059)
S = −0.1522 (-0.8146)
Population Reference: S = 0.0000
Flat WL Baseline: S = 0.5694
Without FGS1 floor:
−185 ppm bias / 60 ppm σ → 3σ miss
→ Quadratic penalty collapses GLL to S = −0.152
−0.2
0.0
0.2
0.4
0.6
0.8
Official Normalized Ariel Score S When Component Removed