


REFER TO ARCHITECTURAL LAYOUT
DMS_DIANI.26-R01-A201

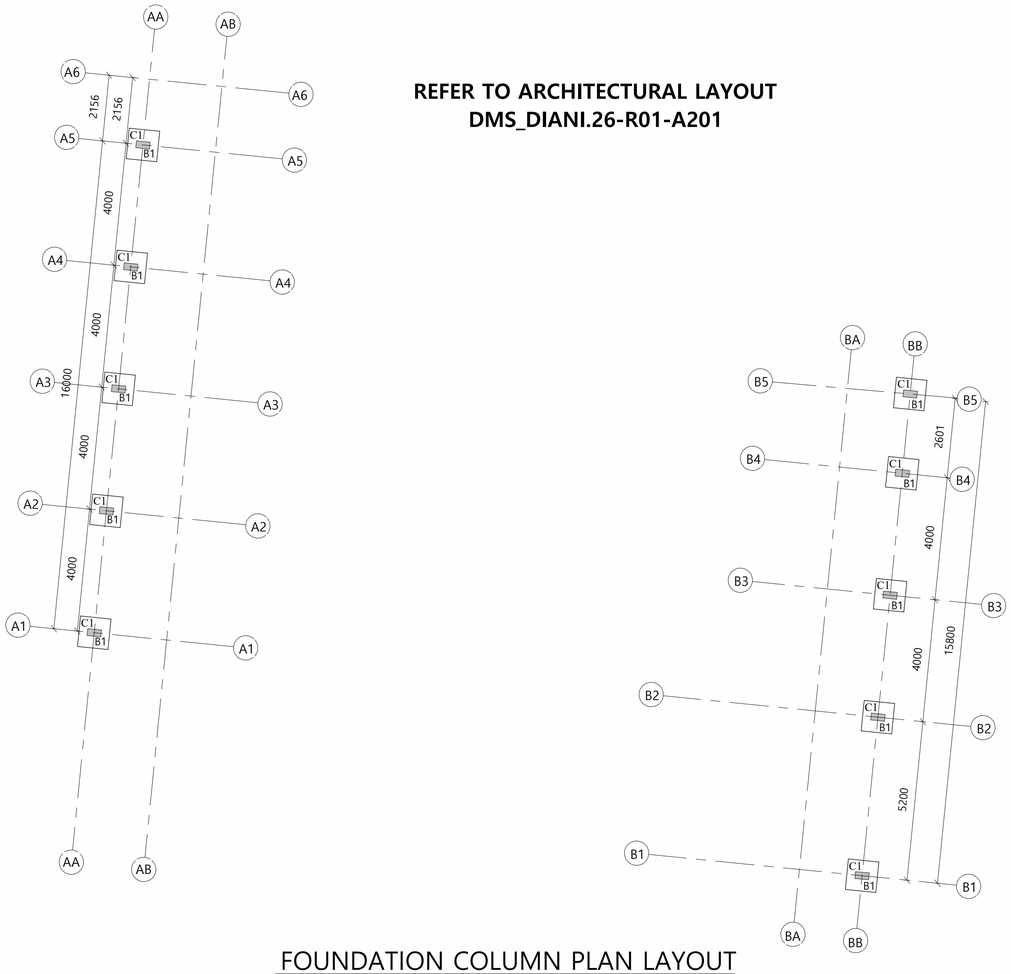


FOUNDATION COLUMN PLAN LAYOUT
1 : 100

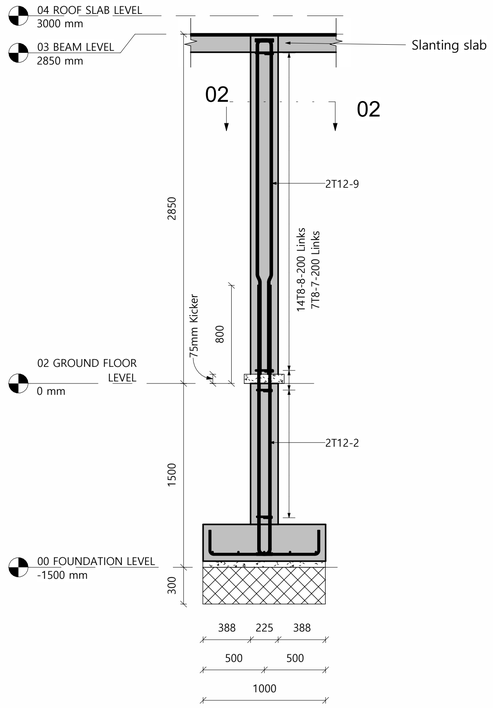


TYPICAL COLUMN 225 X 450 MM
1 : 25



TYPICAL COLUMN SECTION 02-02
1 : 25

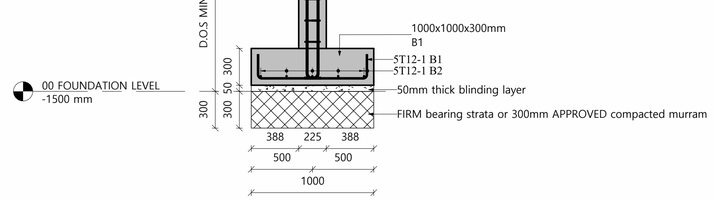

TYPICAL COLUMN BASE
1 : 25



COLUMN BASE PLAN
1 : 25

GENERAL STRUCTURAL NOTES

1. All dimensions in millimeters.
2. Figured dimensions to be taken from the drawing. Do not scale.
3. All structural drawings are to be read in conjunction with their relevant counterparts, including but not limited to architectural, mechanical, electrical and plumbing drawings. Any discrepancy to be reported to the Engineer immediately.
4. All excavations are to be approved by the Civil and Structural Engineer(s).
5. Concrete to be class C20/25 with a minimum cube crushing strength of 18N/mm^2 and 25N/mm^2 at 7 days and 28 days respectively.
6. Blinding concrete to be class C15 with a minimum crushing strength of 15N/mm^2 at 28 days.
7. The minimum cover to reinforcement:
- Foundations : 50mm
- Columns : 40mm
- Beams : 25mm
- Slabs : 25mm
8. Hoop Iron to be placed on every other course of masonry walls and bonded to the reinforced concrete columns
9. All reinforcement works to be inspected and approved by the Engineer before concreting
10. Minimum spacing between longitudinal bars not less than 25mm
11. Minimum spacing between transverse bars not less than 150mm c/c
12. All segment lengths to be rounded up by 5mm and all cutting lengths to be rounded up by 25mm
13. Reinforcement lap lengths to be 50 x Diameter of the smaller lapped bar
14. Masonry crushing strength to be 7 N/mm^2
15. Compaction is to be done in layers not exceeding 150mm in thickness.

General Abbreviations as follows:
1. T - Top Bar
2. B - Bottom Bar
3. T1 - Main Top Bar
4. T2 - Distribution Top Bar
5. B1 - Main Bottom Bar
6. B2 - Distribution Bottom Bar
7. N.F - Near Face
8. F.F - Far Face
9. A/W - Alternating With
10. E.W. - Each Way

Revision	Description	Date

CLIENT
BAOBAB BEACH RESORT
Baobab BEACH RESORT AND SPA - D

PROJECT
PROPOSED ROOMS AND PUBLIC AREAS RENOVATIONS AT BAOBAB BEACH RESORT


ARCHITECT
DMS ARCHITECTURE


TITLE
MARIDADI RESTAURANT
COLUMN BASE, AND COLUMN LAYOUT

DMS ENGINEERING


JOB No. 04	
DRG No. DMS-026-003/STR/01	
Project Date: MAY 2026	
Sheet Issue Date: 05/13/26	
DESIGNED V.N.M	CHECKED BY: ENG. L.O
DRAWN BY V.N.M	SCALE: As indicated

GUTTER- REF. DETAIL SHEET NO. DMS-026-003/STR/03-SLAB, GUTTER LAYOUT AND REINFORCEMENT DETAILS

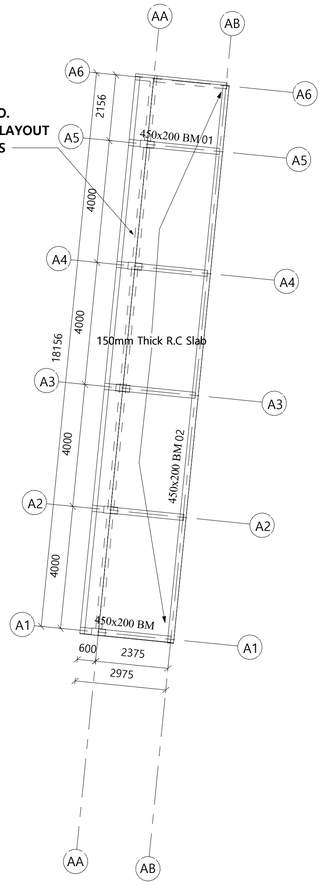


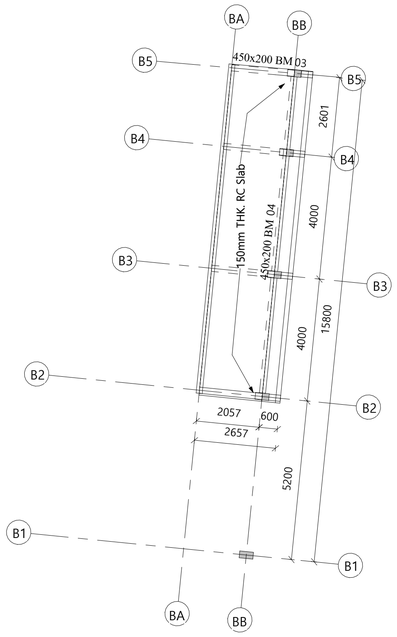


ROOF SLAB AND BEAM LAYOUT
1 : 100

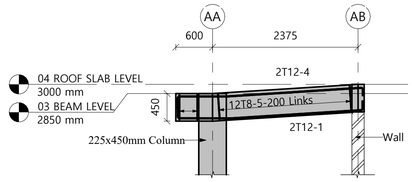


BEAM 01 (450X200MM)
1 : 50

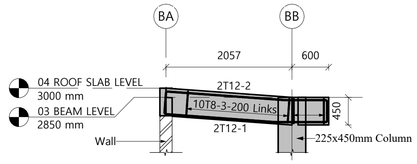


BEAM 03 (450X200MM)
1 : 50

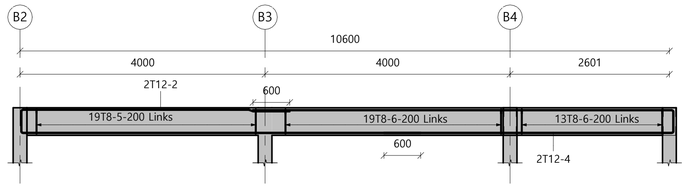

BEAM 04 (450X200MM)
1 : 50

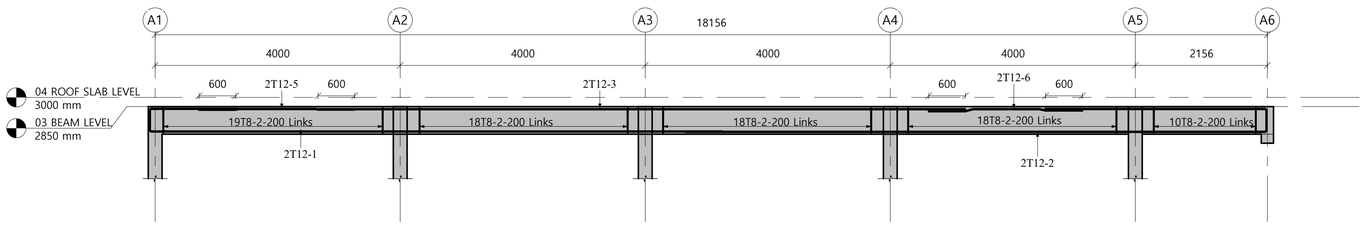

BEAM 02 (450X200MM)
1 : 50



TYPICAL BEAM SECTION 01-01
1 : 25

GENERAL STRUCTURAL NOTES

1. All dimensions in millimeters.
2. Figured dimensions to be taken from the drawing. Do not scale.
3. All structural drawings are to be read in conjunction with their relevant counterparts, including but not limited to architectural, mechanical, electrical and plumbing drawings. Any discrepancy to be reported to the Engineer immediately.
4. All excavations are to be approved by the Civil and Structural Engineer(s).
5. Concrete to be class C20/25 with a minimum cube crushing strength of 18N/mm^2 and 25N/mm^2 at 7 days and 28 days respectively.
6. Blinding concrete to be class C15 with a minimum crushing strength of 15N/mm^2 at 28 days.
7. The minimum cover to reinforcement:
- Foundations : 50mm
- Columns : 40mm
- Beams : 25mm
- Slabs : 25mm
8. Hoop Iron to be placed on every other course of masonry walls and bonded to the reinforced concrete columns
9. All reinforcement works to be inspected and approved by the Engineer before concreting
10. Minimum spacing between longitudinal bars not less than 25mm
11. Minimum spacing between transverse bars not less than 150mm c/c
12. All segment lengths to be rounded up by 5mm and all cutting lengths to be rounded up by 25mm
13. Reinforcement lap lengths to be 50 x Diameter of the smaller lapped bar
14. Masonry crushing strength to be 7 N/mm^2
15. Compaction is to be done in layers not exceeding 150mm in thickness.

General Abbreviations as follows:
1. T - Top Bar
2. B - Bottom Bar
3. T1 - Main Top Bar
4. T2 - Distribution Top Bar
5. B1 - Main Bottom Bar
6. B2 - Distribution Bottom Bar
7. N.F - Near Face
8. F.F - Far Face
9. A/W - Alternating With
10. E.W. - Each Way

Revision	Description	Date

CLIENT: BAOBAB BEACH RESORT


PROJECT: PROPOSED ROOMS AND PUBLIC AREAS RENOVATIONS AT BAOBAB BEACH RESORT

ARCHITECT: DMS ARCHITECTURE

TITLE: SLAB AND BEAM LAYOUT OF MARIDADI RESTAURANT

DMS ENGINEERING


JOB No. 04	
DRG No. DMS-026-003/STR/02	
Project Date: MAY 2026	
Sheet Issue Date: 05/13/26	
DESIGNED V.N.M	CHECKED BY: ENG. L.O
DRAWN BY V.N.M	SCALE: As indicated

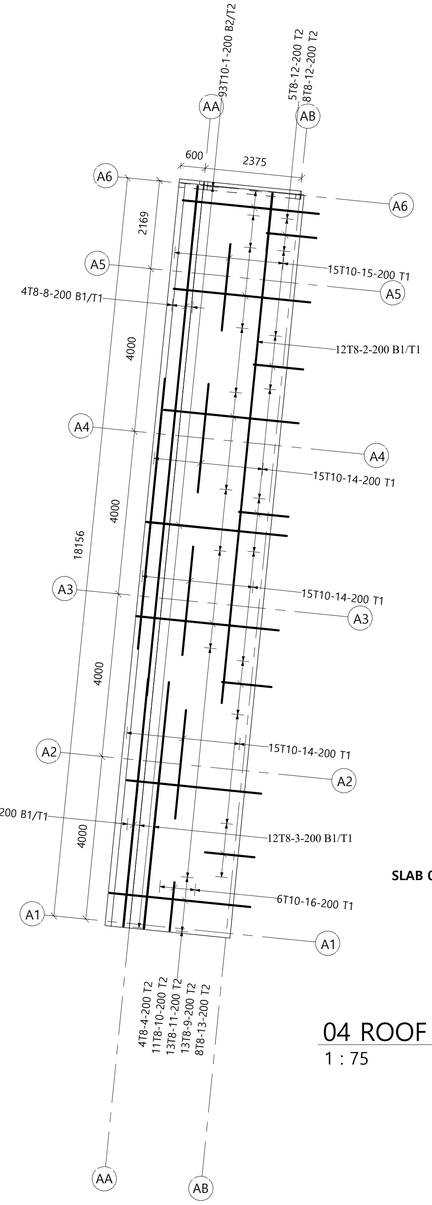

SLAB 01

04 ROOF SLAB LEVEL REINFORCEMENT

1 : 75

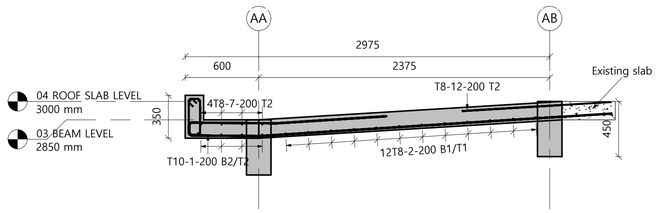

SLAB, GUTTER SECTION DETAIL 1

1 : 25

Slab 1 Rebar Schedule

Partition	Rebar Number	Type	Bend Diameter	Bar Diameter	Quantity	Total no. of Bars	Bar Length	Shape	Tonnage
SLAB 01	1	T10	40 mm	10 mm	93	93	5151 mm	Rebar Shape 40	295.40 kg
SLAB 01	2	T8	32 mm	8 mm	12	12	14011 mm	21	66.35 kg
SLAB 01	3	T8	32 mm	8 mm	12	12	10080 mm	Rebar Shape 35	47.74 kg
SLAB 01	4	T8	32 mm	8 mm	4	4	3418 mm	Rebar Shape 41	5.40 kg
SLAB 01	5	T8	32 mm	8 mm	14	14	3362 mm	Rebar Shape 41	18.57 kg
SLAB 01	6	T8	32 mm	8 mm	3	3	10111 mm	21	11.97 kg
SLAB 01	7	T8	32 mm	8 mm	4	4	6640 mm	00	10.48 kg
SLAB 01	8	T8	32 mm	8 mm	4	4	13946 mm	21	22.01 kg
SLAB 01	9	T8	32 mm	8 mm	13	13	3627 mm	Rebar Shape 41	18.61 kg
SLAB 01	10	T8	32 mm	8 mm	11	11	3419 mm	Rebar Shape 41	14.84 kg
SLAB 01	11	T8	32 mm	8 mm	13	13	3363 mm	Rebar Shape 41	17.25 kg
SLAB 01	12	T8	32 mm	8 mm	37	37	6085 mm	00	17.77 kg
SLAB 01	13	T8	32 mm	8 mm	8	8	3525 mm	Rebar Shape 41	11.13 kg
SLAB 01	14	T10	40 mm	10 mm	45	45	8000 mm	00	73.99 kg
SLAB 01	15	T10	40 mm	10 mm	15	15	2127 mm	00	19.67 kg
SLAB 01	16	T10	40 mm	10 mm	6	6	1232 mm	11	4.56 kg


Slab 2 Rebar Schedule

Partition	Rebar Number	Type	Bend Diameter	Bar Diameter	Quantity	Total no. of Bars	Bar Length	Shape	Tonnage
SLAB 02	1	T8	32 mm	8 mm	22	22	3315 mm	00	9.59 kg
SLAB 02	2	T8	32 mm	8 mm	3	3	11885 mm	21	14.07 kg
SLAB 02	3	T8	32 mm	8 mm	10	10	12060 mm	21	47.59 kg
SLAB 02	4	T8	32 mm	8 mm	37	37	13212 mm	Rebar Shape 41	48.23 kg
SLAB 02	5	T10	40 mm	10 mm	14	14	2664 mm	00	23.00 kg
SLAB 02	6	T10	40 mm	10 mm	14	14	2170 mm	00	18.74 kg


GENERAL STRUCTURAL NOTES

1. All dimensions in millimeters.
2. Figured dimensions to be taken from the drawing. Do not scale.
3. All structural drawings are to be read in conjunction with their relevant counterparts, including but not limited to architectural, mechanical, electrical and plumbing drawings. Any discrepancy to be reported to the Engineer immediately.
4. All excavations are to be approved by the Civil and Structural Engineer(s).
5. Concrete to be class C20/25 with a minimum cube crushing strength of 18N/mm^2 and 25N/mm^2 at 7 days and 28 days respectively.
6. Blinding concrete to be class C15 with a minimum crushing strength of 15N/mm^2 at 28 days.
7. The minimum cover to reinforcement:
- Foundations : 50mm
- Columns : 40mm
- Beams : 25mm
- Slabs : 25mm
8. Hoop Iron to be placed on every other course of masonry walls and bonded to the reinforced concrete columns
9. All reinforcement works to be inspected and approved by the Engineer before concreting
10. Minimum spacing between longitudinal bars not less than 25mm
11. Minimum spacing between transverse bars not less than 150mm c/c
12. All segment lengths to be rounded up by 5mm and all cutting lengths to be rounded up by 25mm
13. Reinforcement lap lengths to be 50 x Diameter of the smaller lapped bar
14. Masonry crushing strength to be 7 N/mm^2
15. Compaction is to be done in layers not exceeding 150mm in thickness.

General Abbreviations as follows:
1. T - Top Bar
2. B - Bottom Bar
3. T1 - Main Top Bar
4. T2 - Distribution Top Bar
5. B1 - Main Bottom Bar
6. B2 - Distribution Bottom Bar
7. N.F - Near Face
8. F.F - Far Face
9. A/W - Alternating With
10. E.W. - Each Way

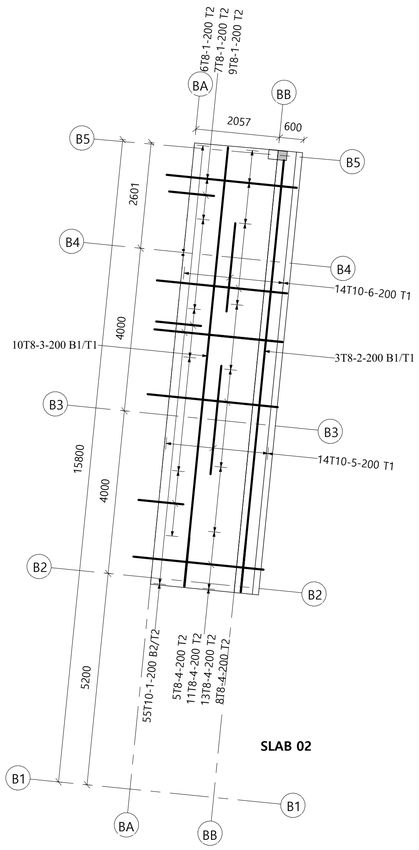

SLAB 02

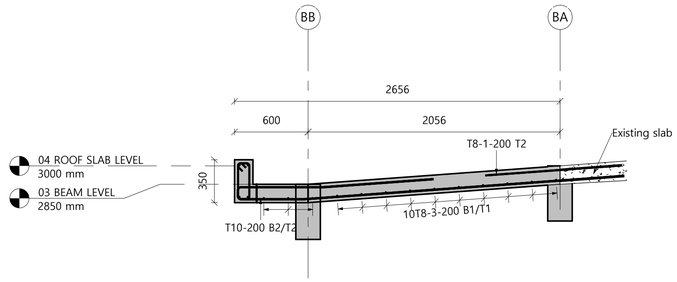

SLAB, GUTTER SECTION DETAIL 2

1 : 25

Revision	Description	Date

CLIENT: BAOBAB BEACH RESORT


PROJECT: PROPOSED ROOMS AND PUBLIC AREAS RENOVATIONS AT BAOBAB BEACH RESORT

ARCHITECT: DMS ARCHITECTURE


TITLE: SLAB, GUTTER LAYOUT, AND SECTION REINFORCEMENT DETAILS OF MARIDADI RESTAURANT

DMS ENGINEERING


JOB No.	04
DRG No.	DMS-026-003/STR/03
Project Date:	MAY 2026
Sheet Issue Date:	05/13/26
DESIGNED V.N.M	CHECKED BY: ENG. L.O
DRAWN BY V.N.M	SCALE: As indicated

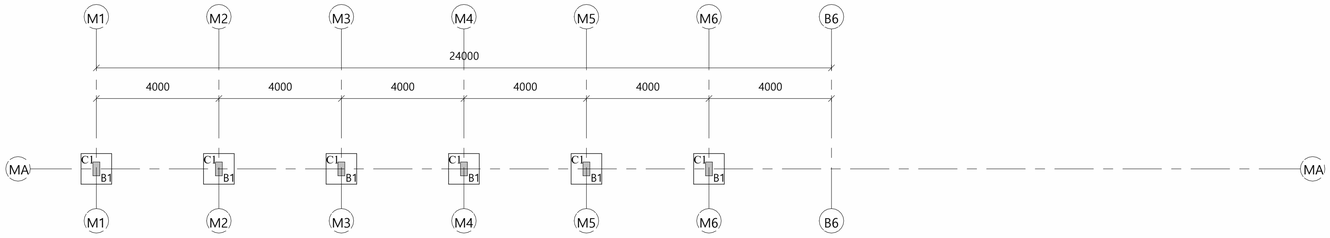


COLUMN FOUNDATION PLAN LAYOUT
1 : 100

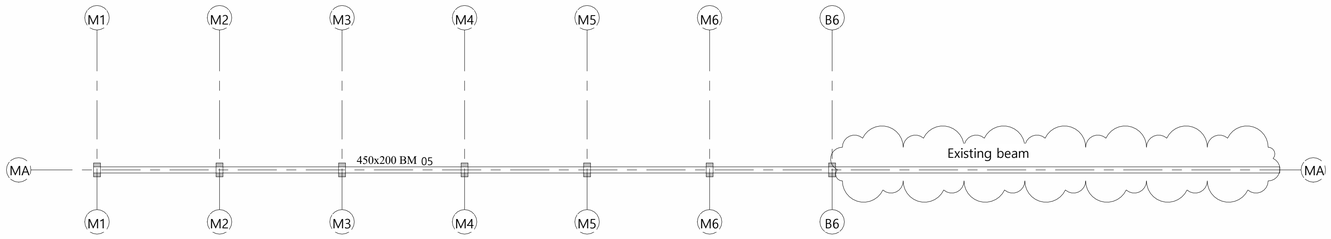

BEAM LAYOUT
1 : 100

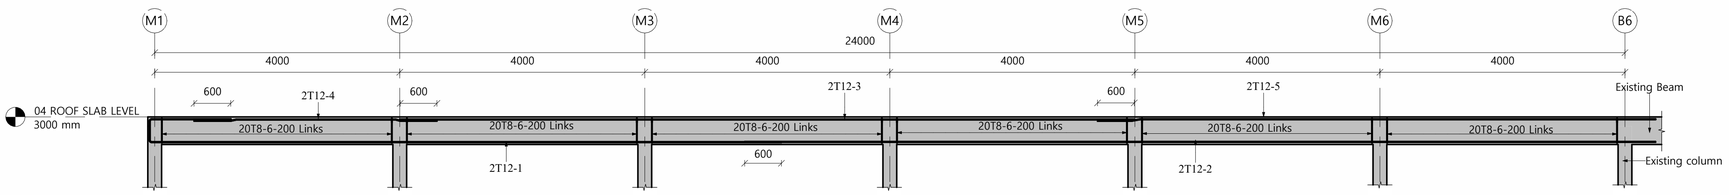

BEAM 05 (450X200MM)
1 : 50



TYPICAL BEAM SECTION 01-01
1 : 25

GENERAL STRUCTURAL NOTES

1. All dimensions in millimeters.
2. Figured dimensions to be taken from the drawing. Do not scale.
3. All structural drawings are to be read in conjunction with their relevant counterparts, including but not limited to architectural, mechanical, electrical and plumbing drawings. Any discrepancy to be reported to the Engineer immediately.
4. All excavations are to be approved by the Civil and Structural Engineer(s).
5. Concrete to be class C20/25 with a minimum cube crushing strength of 18N/mm^2 and 25N/mm^2 at 7 days and 28 days respectively.
6. Blinding concrete to be class C15 with a minimum crushing strength of 15N/mm^2 at 28 days.
7. The minimum cover to reinforcement:
- Foundations : 50mm
- Columns : 40mm
- Beams : 25mm
- Slabs : 25mm
8. Hoop Iron to be placed on every other course of masonry walls and bonded to the reinforced concrete columns
9. All reinforcement works to be inspected and approved by the Engineer before concreting
10. Minimum spacing between longitudinal bars not less than 25mm
11. Minimum spacing between transverse bars not less than 150mm c/c
12. All segment lengths to be rounded up by 5mm and all cutting lengths to be rounded up by 25mm
13. Reinforcement lap lengths to be 50 x Diameter of the smaller lapped bar
14. Masonry crushing strength to be 7 N/mm^2
15. Compaction is to be done in layers not exceeding 150mm in thickness.

General Abbreviations as follows:
1. T - Top Bar
2. B - Bottom Bar
3. T1 - Main Top Bar
4. T2 - Distribution Top Bar
5. B1 - Main Bottom Bar
6. B2 - Distribution Bottom Bar
7. N.F - Near Face
8. F.F - Far Face
9. A/W - Alternating With
10. E.W. - Each Way

Revision	Description	Date

CLIENT

BAOBAB BEACH RESORT

PROJECT

PROPOSED ROOMS AND PUBLIC AREAS RENOVATIONS AT BAOBAB BEACH RESORT

ARCHITECT

DMS ARCHITECTURE

TITLE

BEAM REINFORCEMENT LAYOUT OF MARIDADI RESTAURANT

DMS ENGINEERING

JOB No. 04	
DRG No. DMS-026-003/STR/04	
Project Date: MAY 2026	
Sheet Issue Date: 05/13/26	
DESIGNED V.N.M	CHECKED BY: ENG. L.O
DRAWN BY V.N.M	SCALE: As indicated