

WaterSafe60 Titration Test Data

DOCUMENT ID	MAS-VK-WS60-TITRATION
DISTRIBUTION REVISION	1.1
EFFECTIVE DATE	2026-09-26
SUPERSEDED STATUS	Current
OWNER	MASEST Consulting LLC
APPROVAL	Released for customer review
APPLICABLE SKU(S)	VK-WS60

AUTOMATED CLAIM SCREEN: NO CONFIGURED FLAGS

Review boundary. This cover controls MASEST website distribution only. It does not certify technical, regulatory, legal, safety, performance, or customer-specific claims. Branding and shelf-life corrections are owner-authorized. Technical measurements, study methods, results, and source revision dates are retained.



Approval scope: Distribution approval only; technical and legal claim approval is not asserted.

MASEST WS60 Titration Curve

Sigma Sample

Date
10/28/24

Initial pH 8
Initial EC 3.700

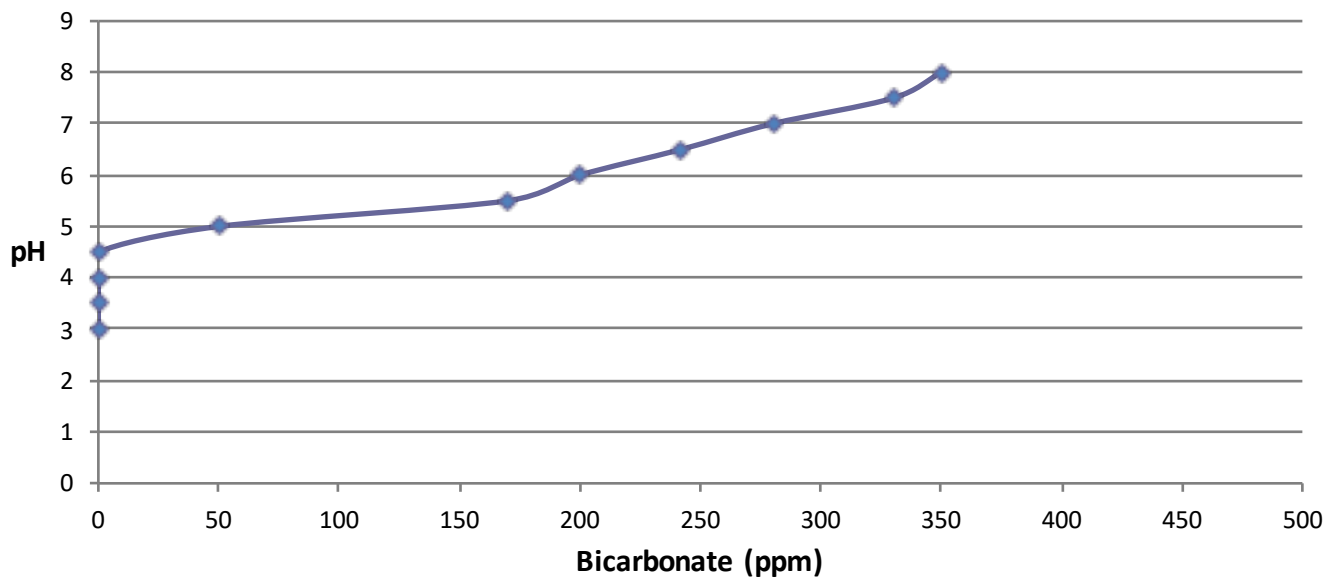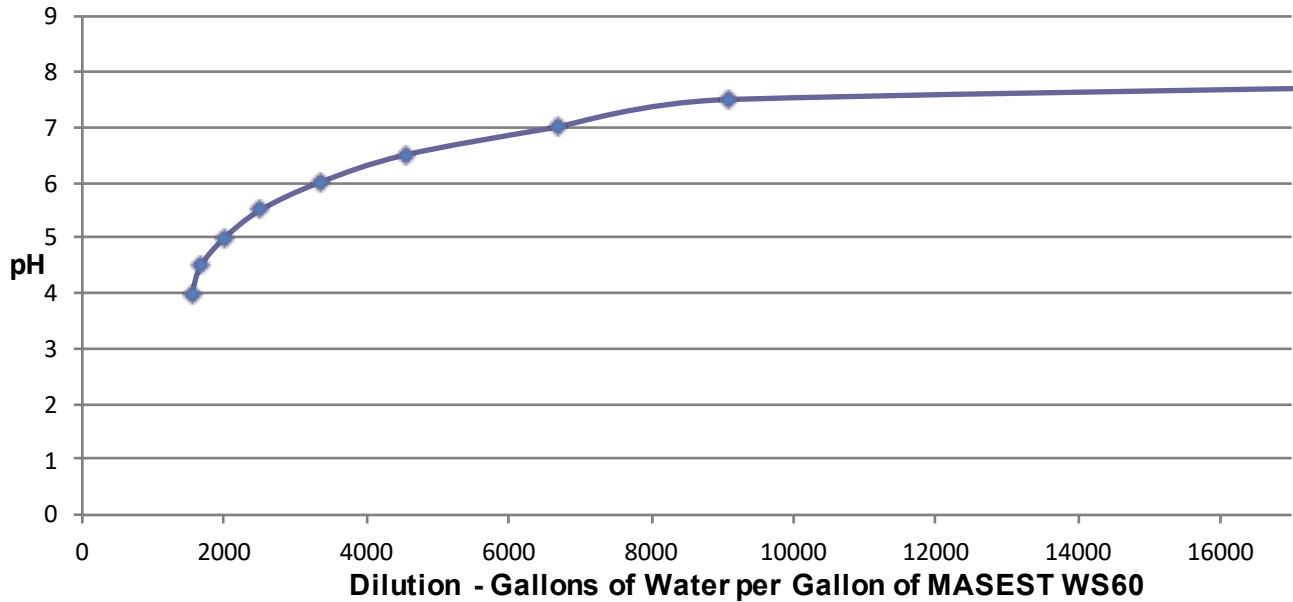

Estimated Buffer Requirements for WS60

Desired pH	oz/1000 gal	gal WS60: gals. water
7.0	14.08	1: 9,091
6.5	19.20	1: 6,667
6.0	28.16	1: 4,545
5.5	38.40	1: 3,333