
Maintenance Deck Equipment Overview and Loads


TBH Maintenance - Deck Equipment - Load					
No	Item Name	Weight (kg)	Qty	Total (kg)	Remarks
1	Main Power Terminal Box	550	3	1,650	refer page 2
2	Aux. Power and Control Terminal Box	120	3	360	refer page 3
4	Cooling Water Main Pipe	1,800	1	1,800	refer page 4
5	Cable Carrier	1,300	3	3,900	refer page 4
6	Cable Carrier Support Frame	270	3	810	refer page 4
			Total	8,520	

Main Power Terminal Box

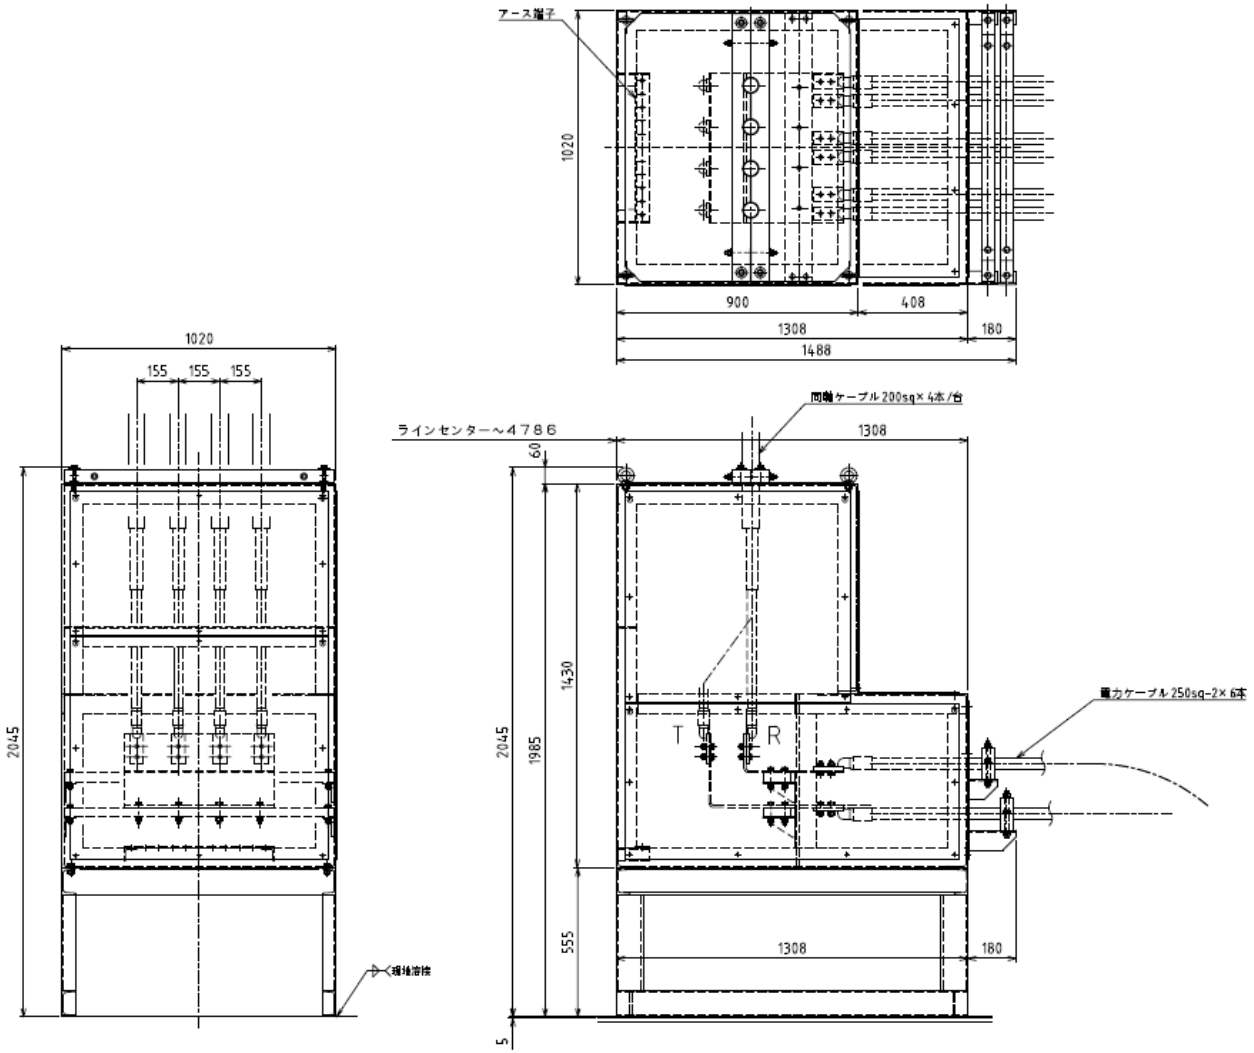


No.1 TBH : 1 Unit
No.2 TBH : 1 Unit
No.3 TBH : 1 Unit

550 kg/Unit

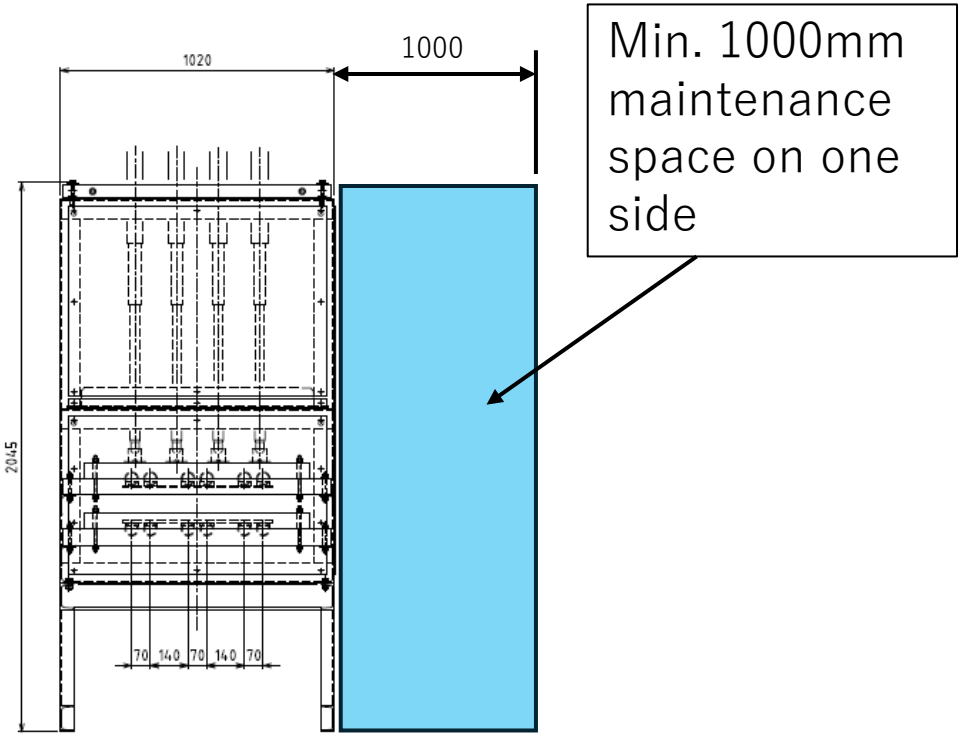

Auxiliary Power and Control Terminal Box

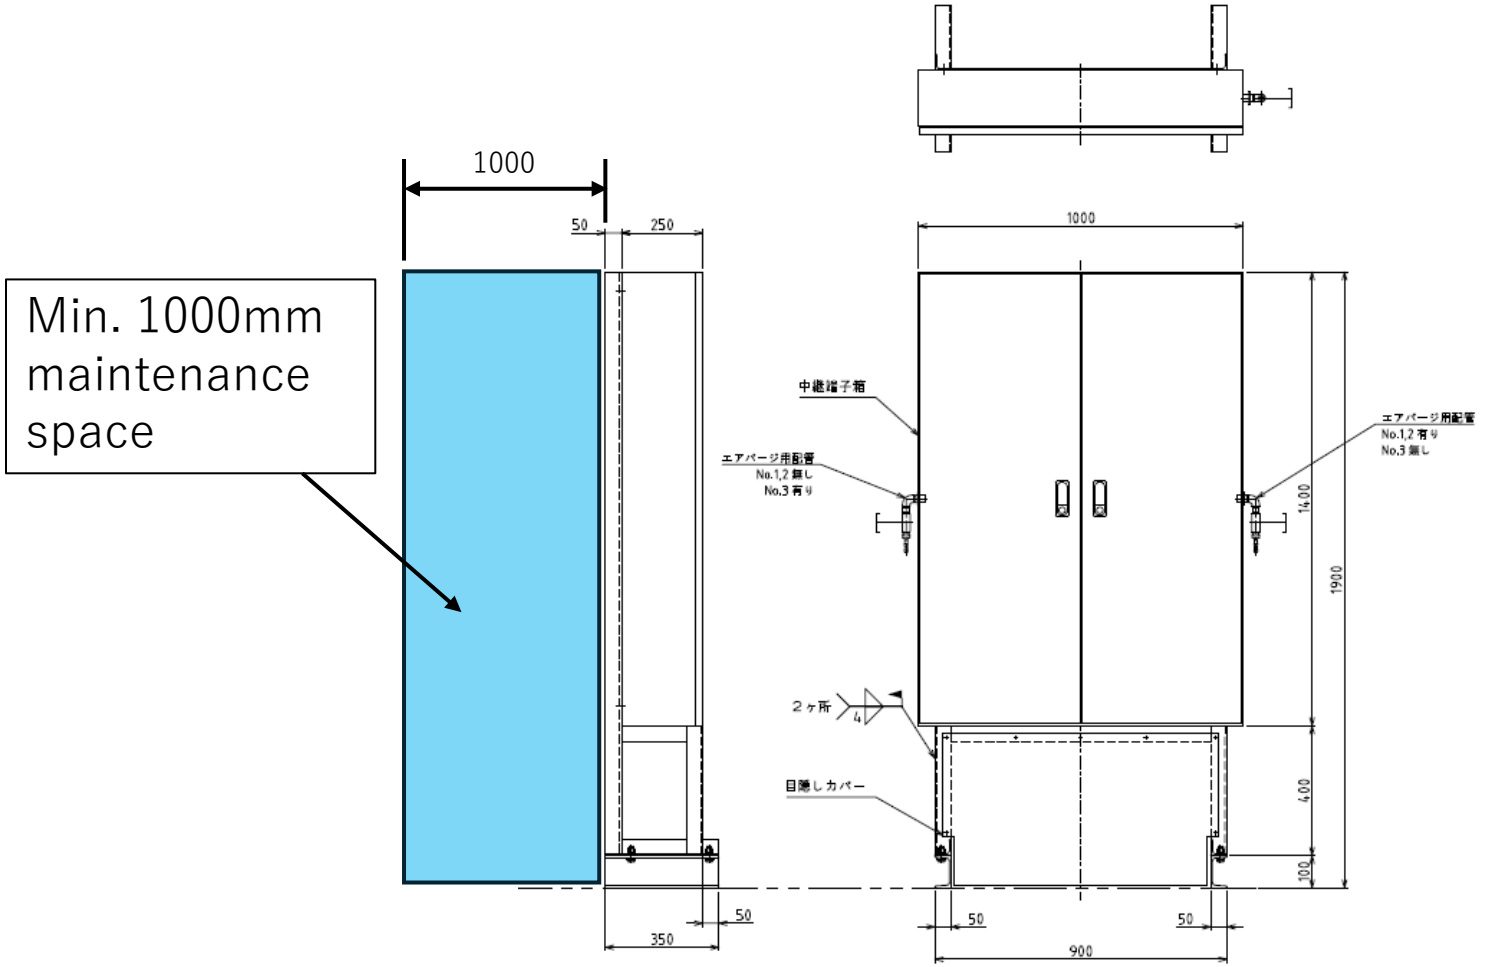


No.1 TBH : 1 Unit
No.2 TBH : 1 Unit
No.3 TBH : 1 Unit

550 kg/Unit

Other Maintenance Deck Equipment


Cable Carrier Support Frame
Total: 810 kg

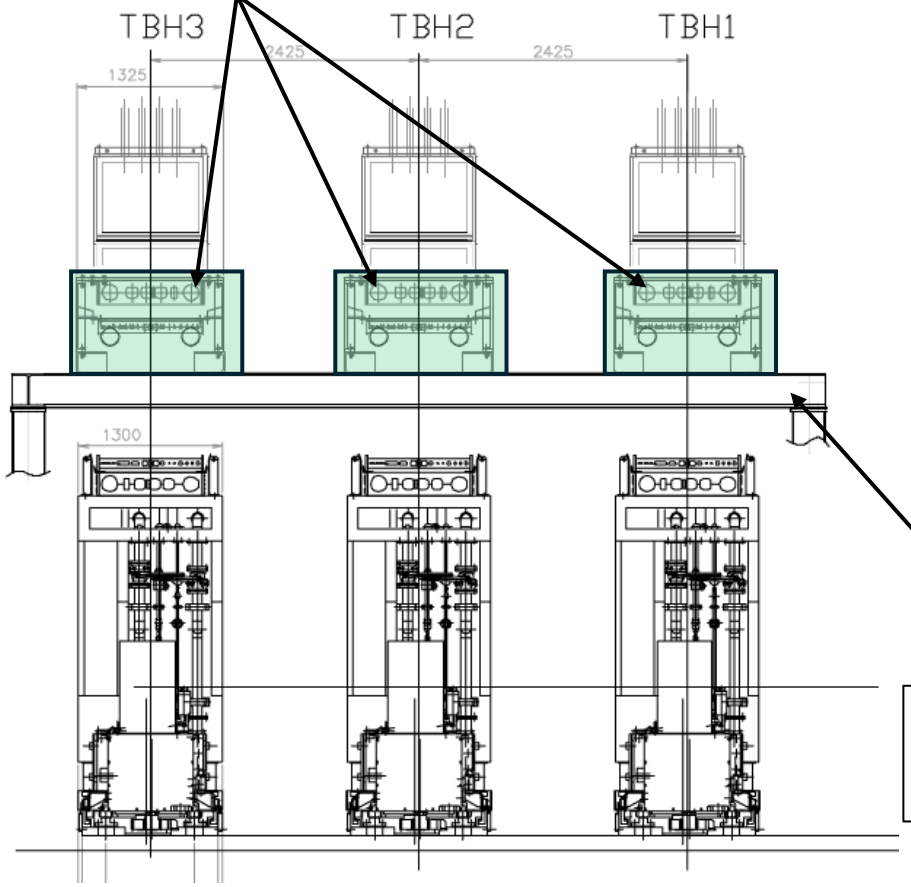

Main Powre Terminal Box

Cooling Water Main Pipe
3sets Total :1800 kg

Cable Carrier Support Frame
3sets Total :810 kg

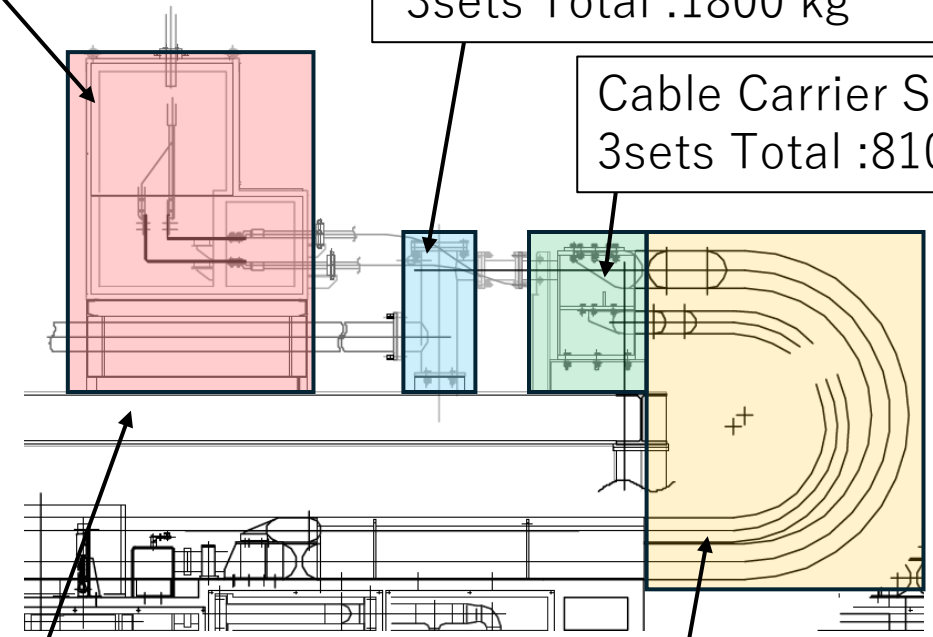


Maintenance Deck
Customer Supply


Cable Carrier
3sets Total :3900 kg

Proposed Layout Above Maintenance Deck

1. The TBH inductors must be lifted out for overhaul maintenance. Therefore, a minimum clearance of **2,590 mm from the line center** is required for the maintenance deck.

2. To maintain this clearance, the intermediate cooling water piping route shown in the reference outline drawing has been revised. The piping will be routed vertically upward from the cooling water header.

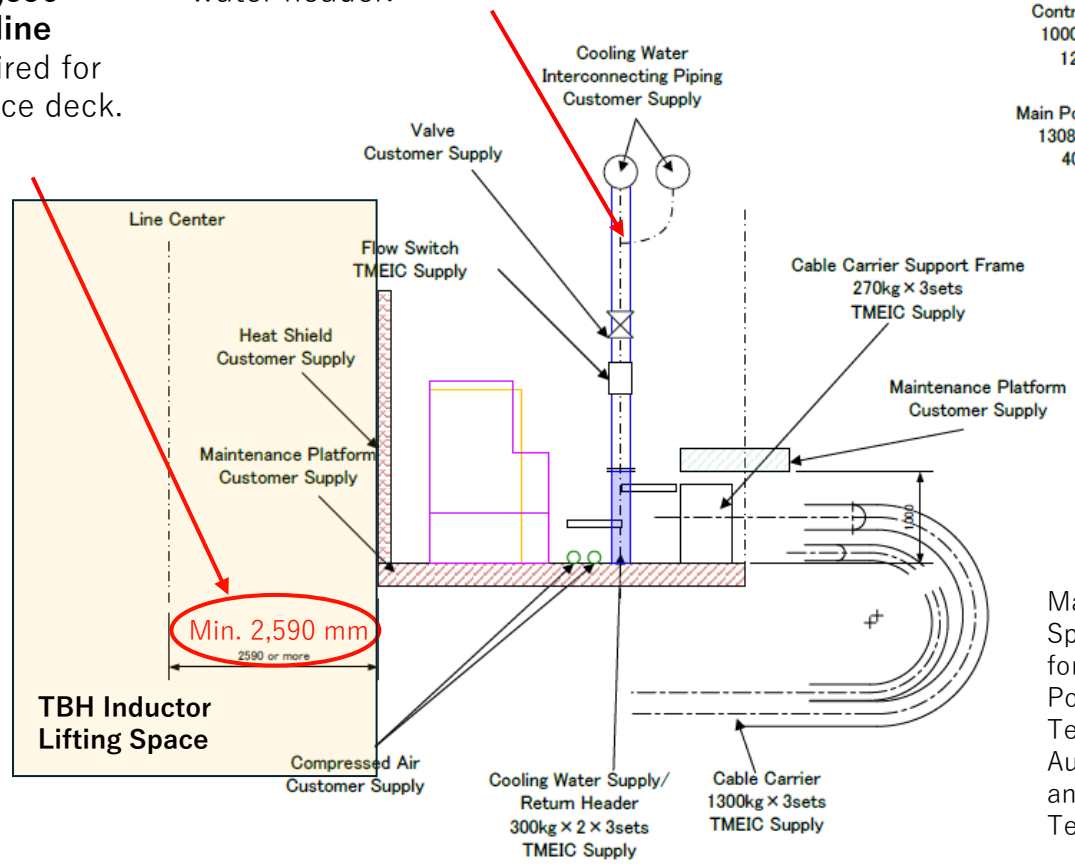

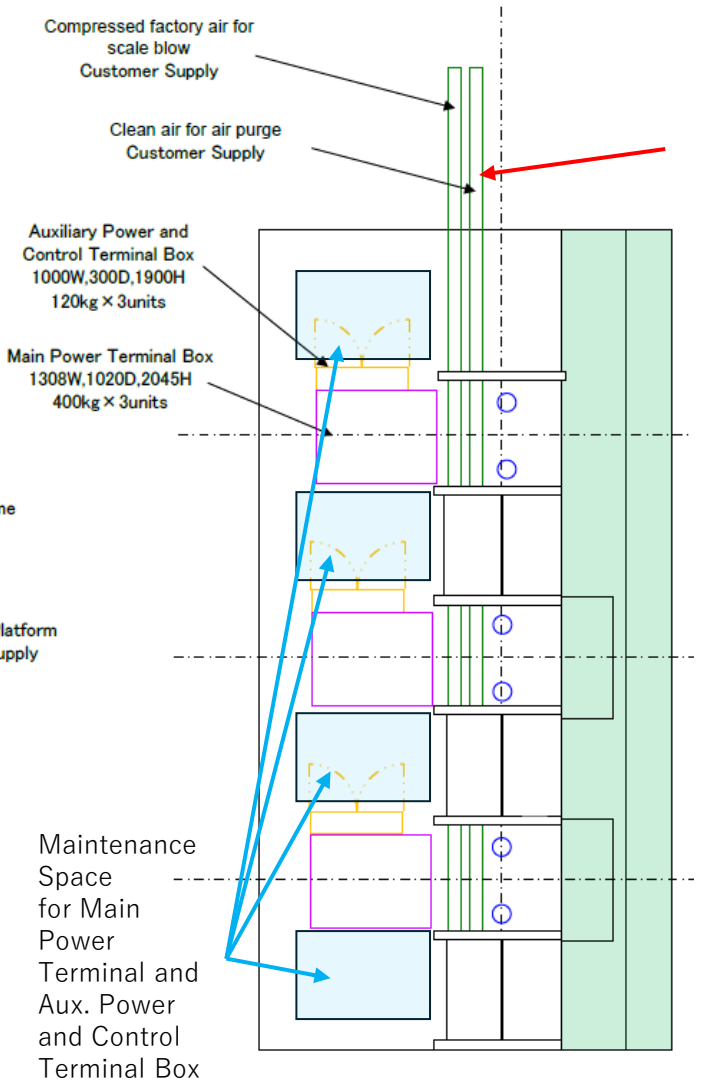

3. Compressed air connections for both the scale blow-off system (plant air) and the air purge system (clean air) are planned to be provided on the maintenance deck. Since this layout arrangement is being adopted for the first time, the locations of the take-off points (TOP) will be finalized through discussion with USS prior to completion of the maintenance deck design.

As a preliminary arrangement, the air header piping is planned to be installed beneath the Main Power Terminal Box.