Optimizer integration and scientific admission

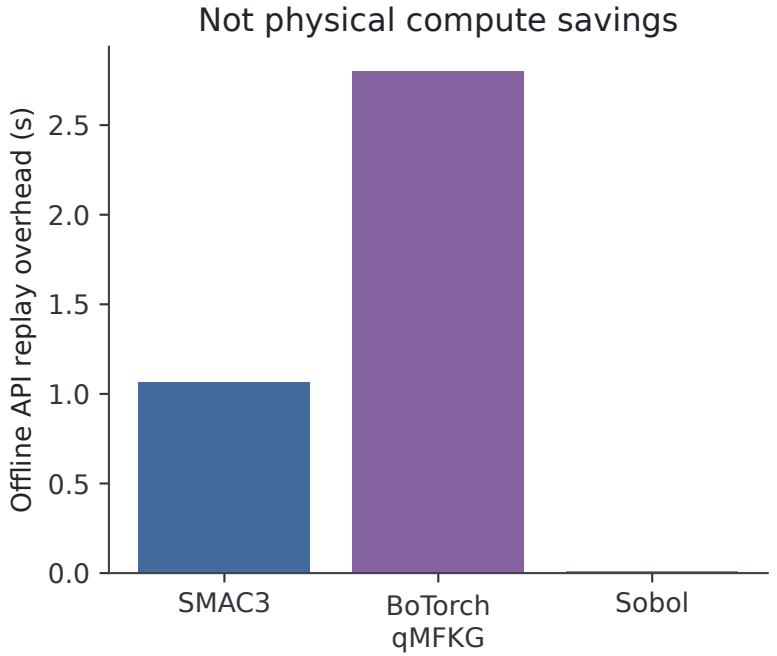

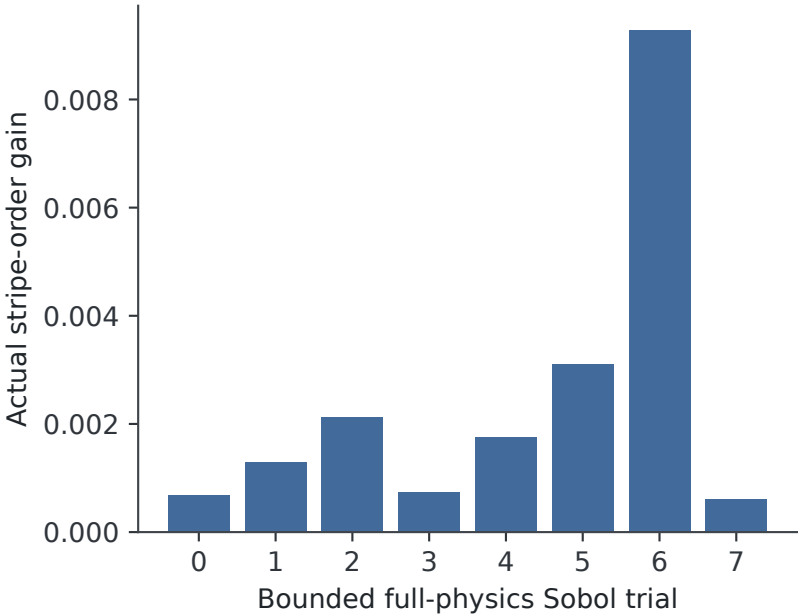

Formal multi-fidelity search: NOT_RUN
No HF-positive pattern yet
False-negative sensitivity unidentifiable

Official APIs executed on frozen data
No new physics from replay
No aggressive early stopping

CMA-MAE superiority: NOT ESTABLISHED

EXPLORATORY | Homogeneous water | No flow or streaming | Uncalibrated physics and electrical mapping