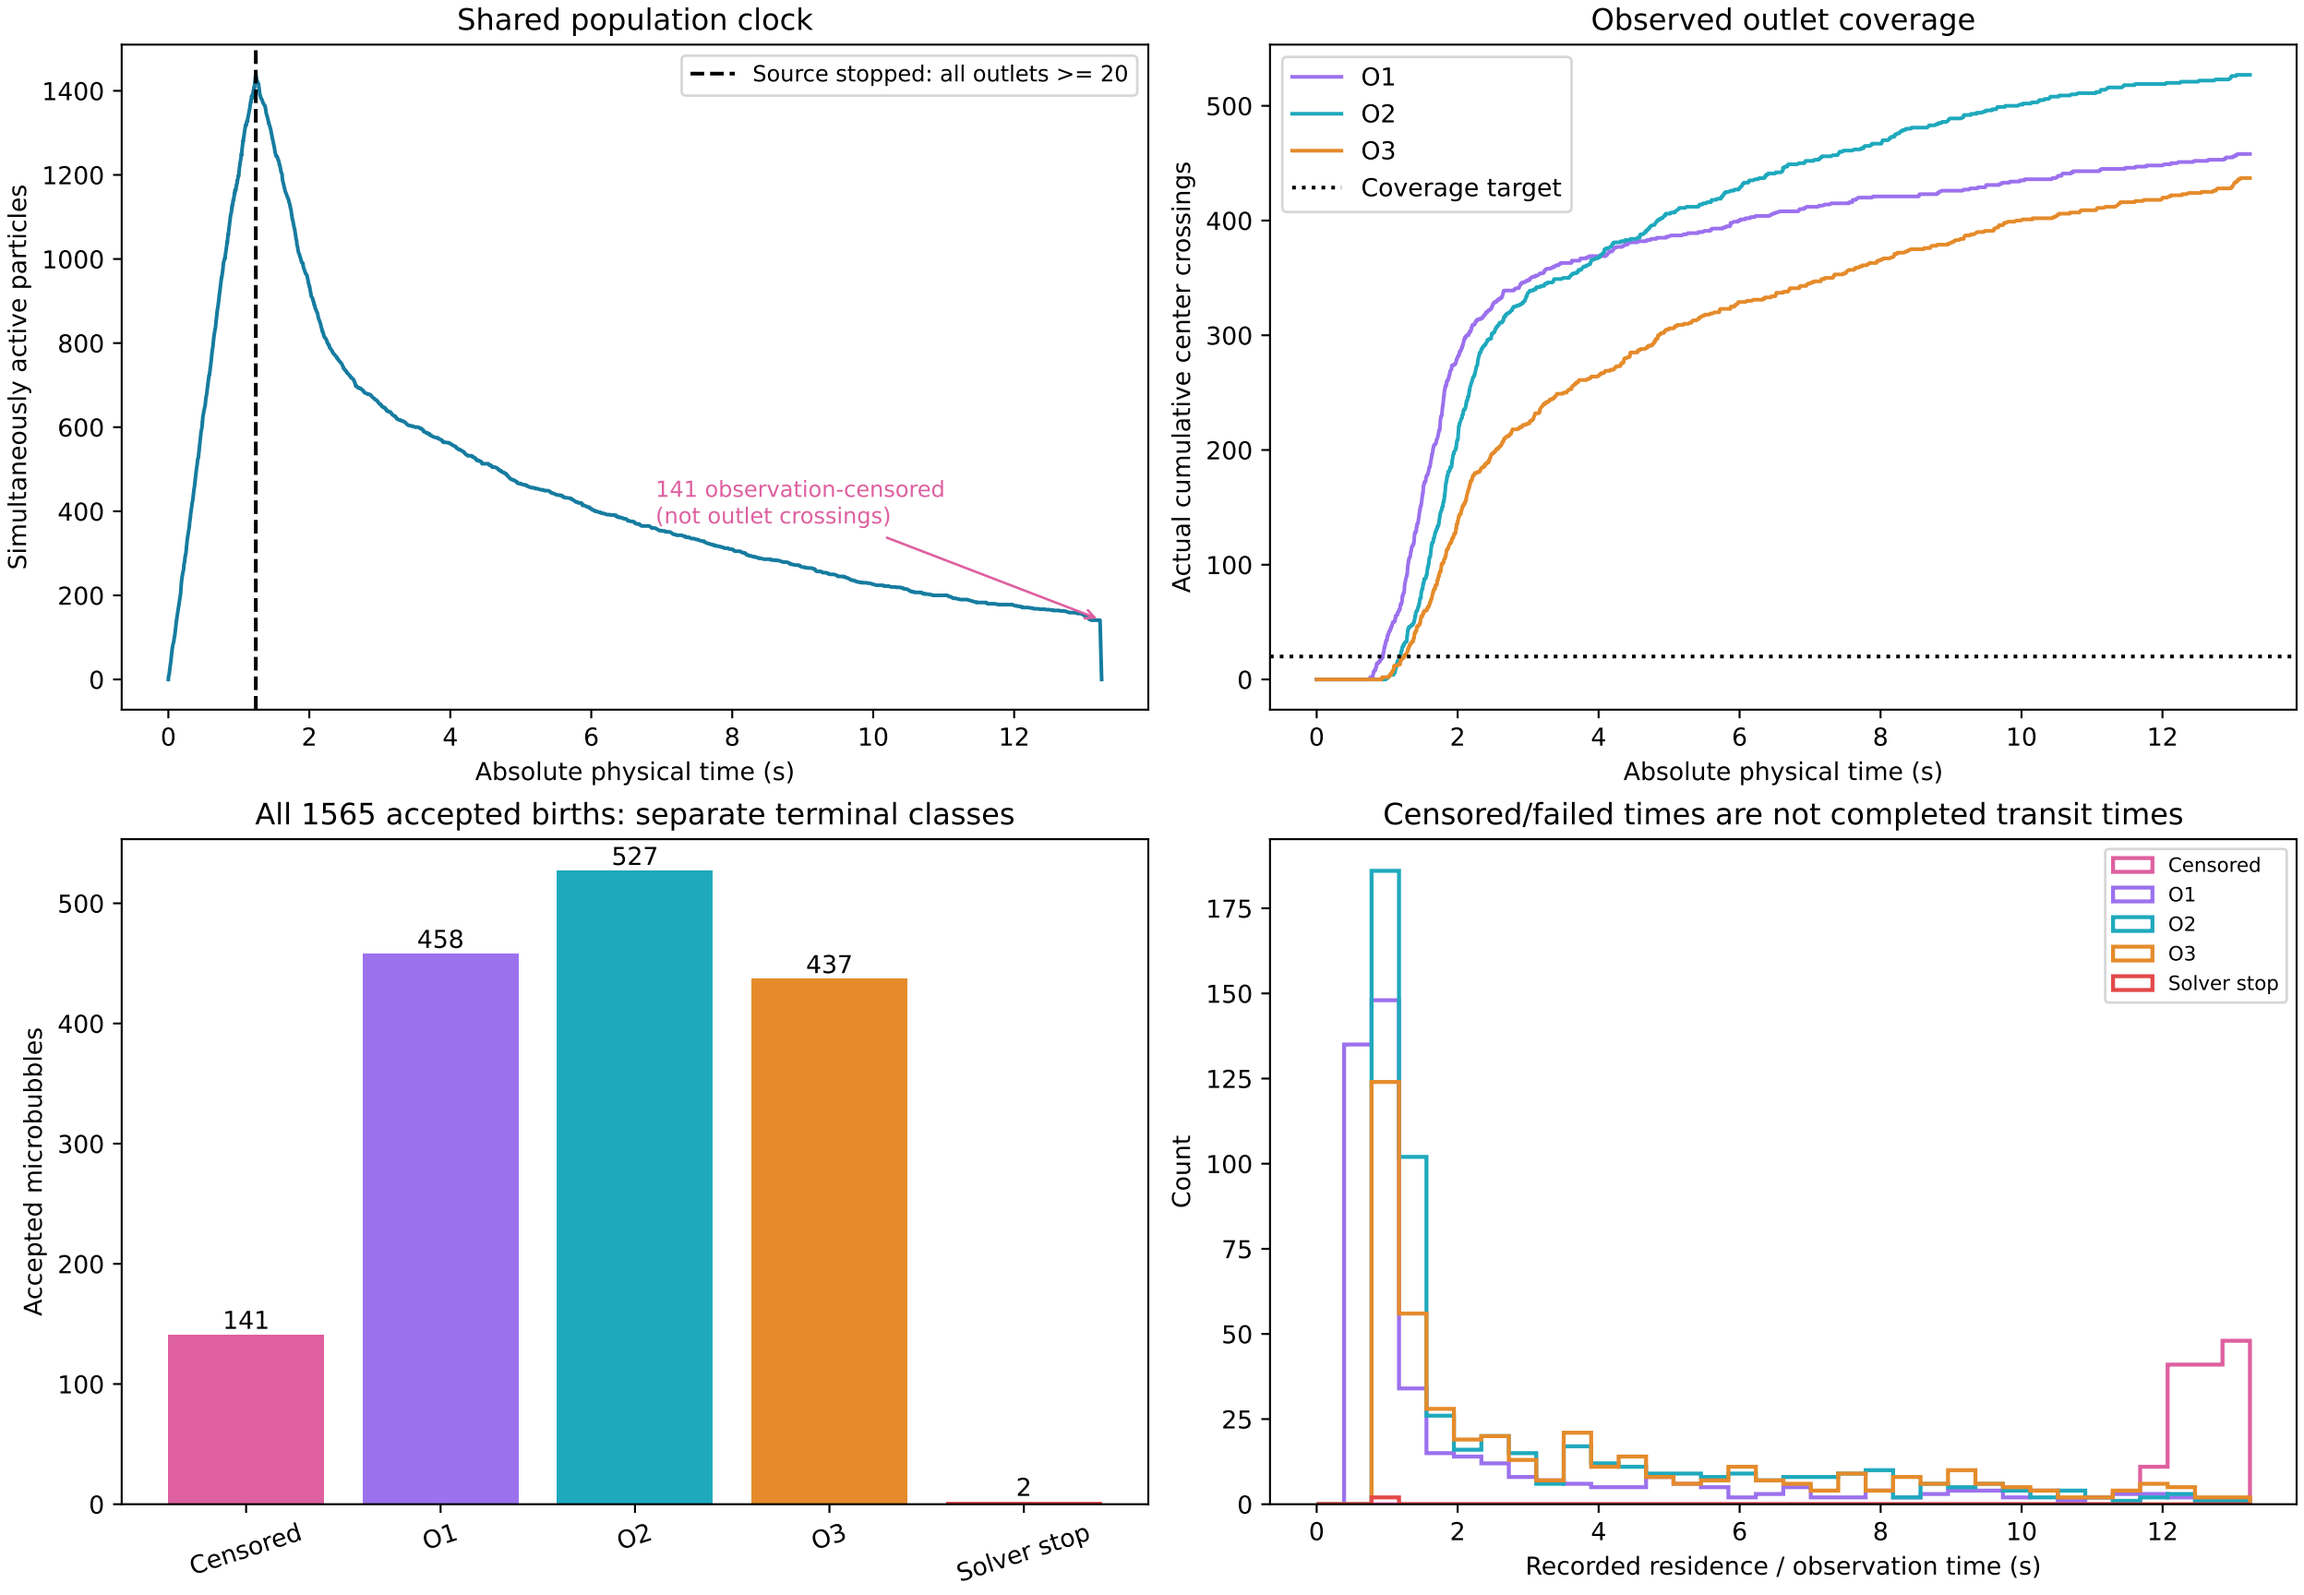
Shared population clock
Source stopped: all outlets >= 20
141 observation-censored
(not outlet crossings)
Simultaneously active particles
Absolute physical time (s)
Observed outlet coverage
O1
O2
O3
Coverage target
Actual cumulative center crossings
Absolute physical time (s)
All 1565 accepted births: separate terminal classes
Accepted microbubbles
141
458
527
437
2
Censored
O1
O2
O3
Solver stop
Censored/failed times are not completed transit times
Censored
O1
O2
O3
Solver stop
Count
Recorded residence / observation time (s)