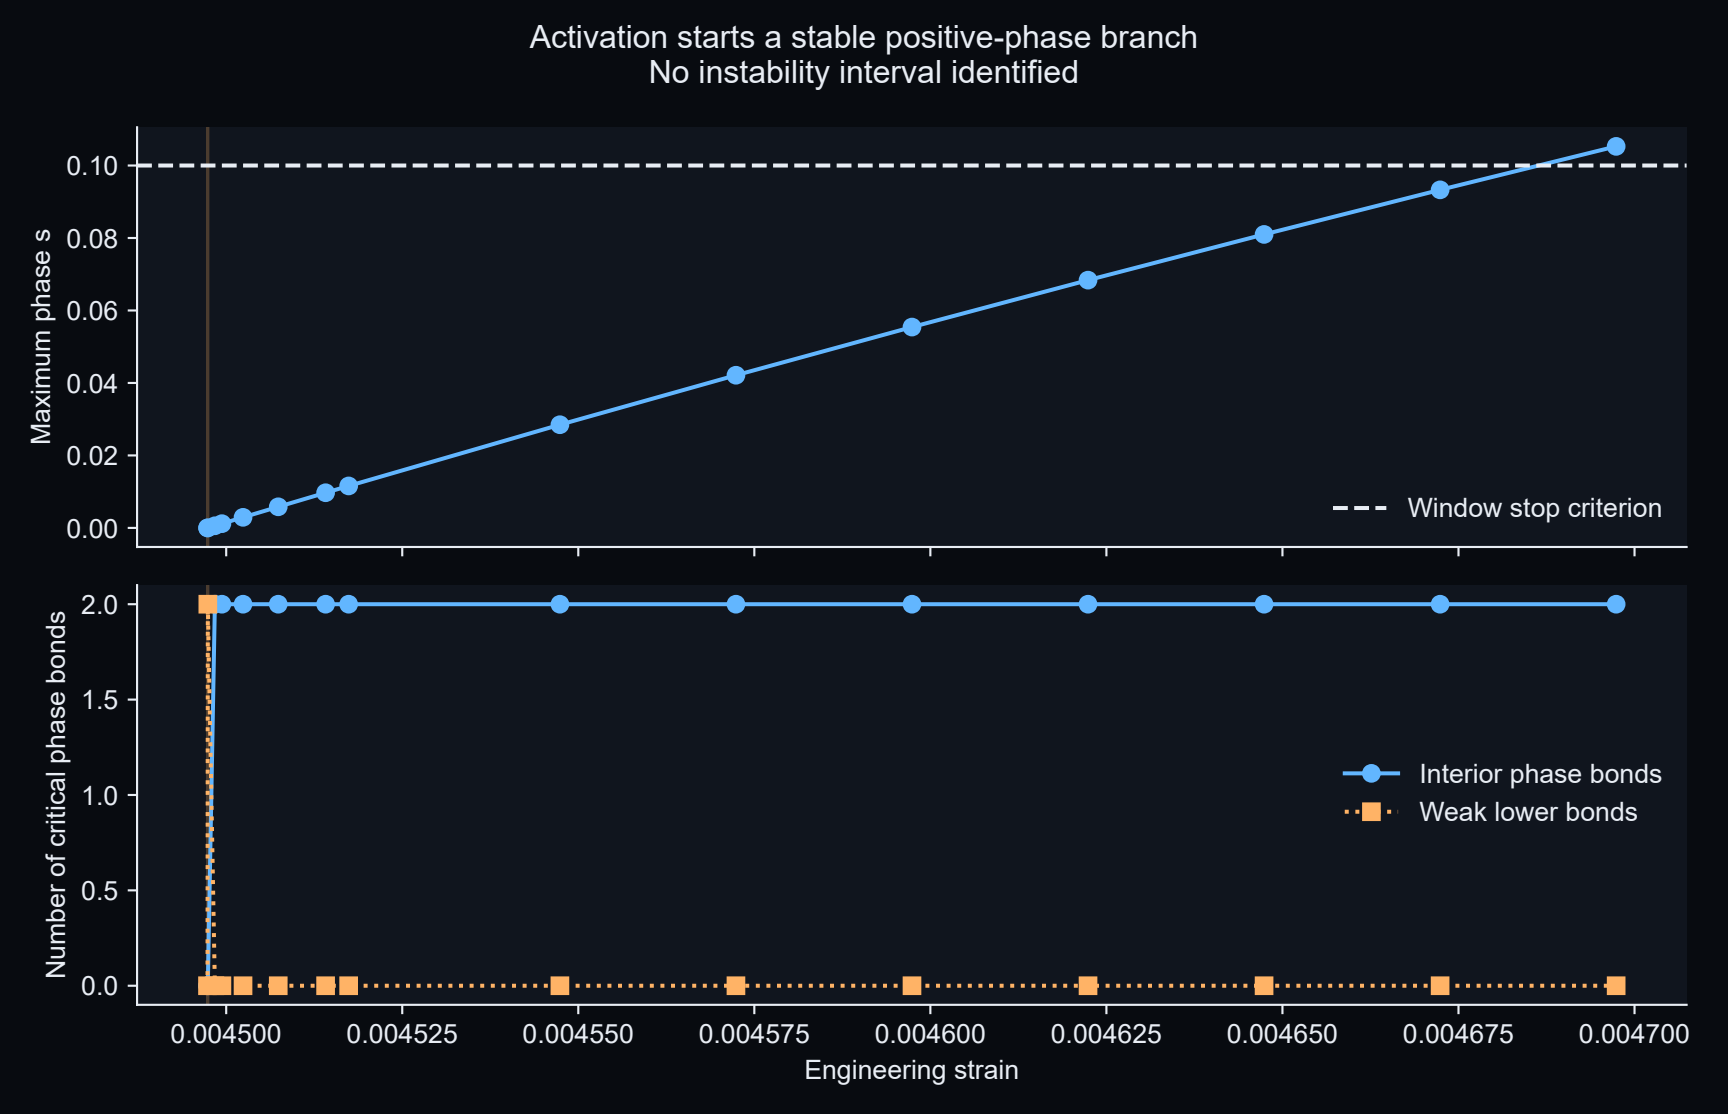
Activation starts a stable positive-phase branch
No instability interval identified
Maximum phase s
0.10
0.08
0.06
0.04
0.02
0.00
Window stop criterion
Number of critical phase bonds
2.0
1.5
1.0
0.5
0.0
Interior phase bonds
Weak lower bonds
0.004500
0.004525
0.004550
0.004575
0.004600
0.004625
0.004650
0.004675
0.004700
Engineering strain