
CHG LTR	REVISION	DATE	APVD
A	SEE ECN - 7623	3/99	

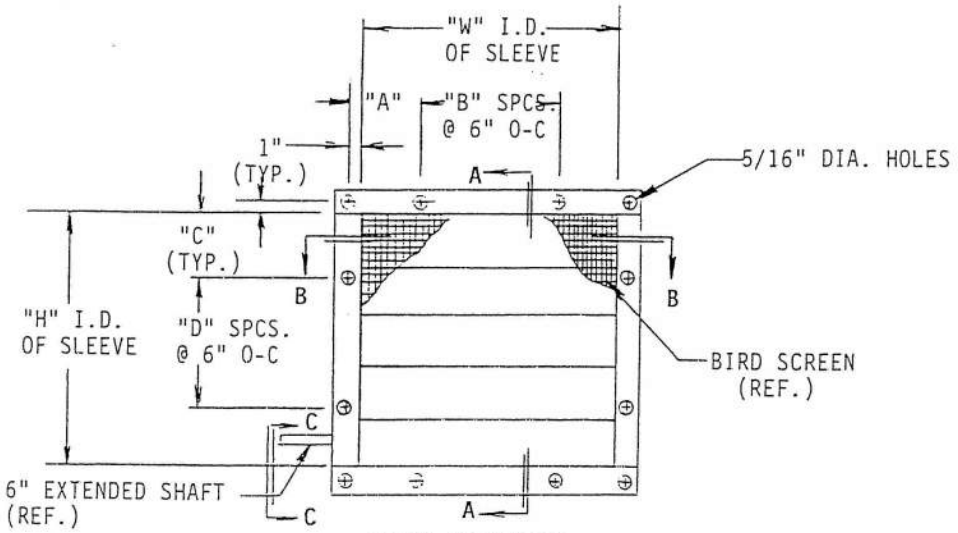

FRONT ELEVATION

ITEM	QTY	"W" I.D.	"H" I.D.	"A"	"B"	"C"	"D"
A		48"	36"	4"	7	3"	5
B		42"	34"	4"	6	3"	4
C		60"	36"	4"	9	3"	5
D		60"	48"	4"	9	3"	7


NOTES:
1. FINISH: MILL.
2. DAMPER GREATER THAN 48" WIDE ARE MADE IN (2) SECTIONS AND DRIVEN BY ONE DRIVE SHAFT

ARROW UNITED INDUSTRIES
A Divison of Mestek, Inc.
314 Riverside Drive - P.O. Box 69 - Wyalusing, PA 18853

AGENT:

CUST. STROBIC AIR		FS-401-HF LOUVER & OBDAF-207 IN SLEEVE	
CONTR.			
ARCH.			
P.O.		PROJECT	
DWN. T.B.	DATE 1/18/99	ARROW JOB NO. E-3000	DWG. NO. 35914
CKD.	EDR. 11118		SHT 1 OF 4

CHG LTR	REVISION	DATE	APVD
A	SEE ECN - 7623	3/99	

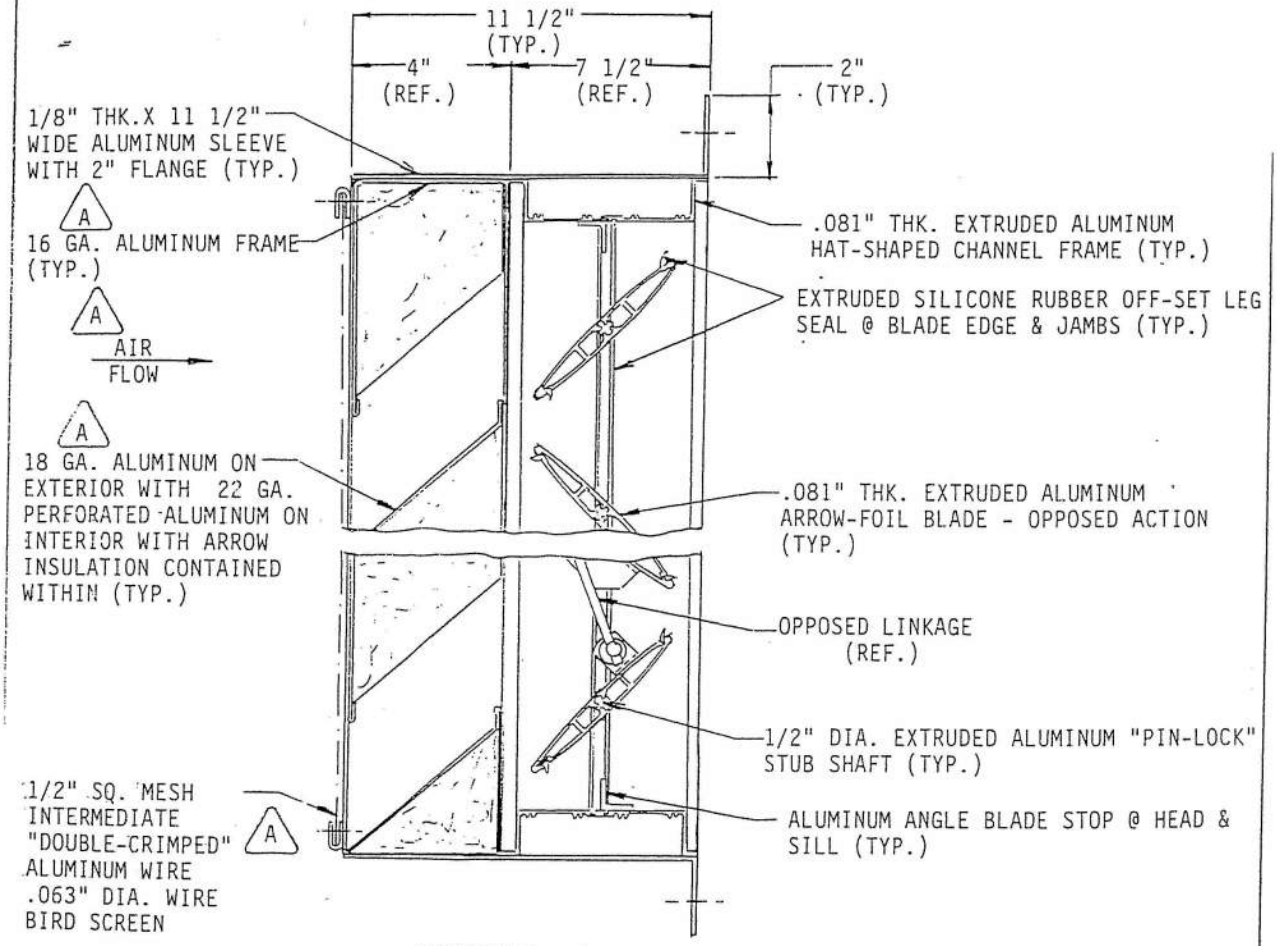


SECTION A - A

ARROW UNITED INDUSTRIES
A Divison of Mestek, Inc.
314 Riverside Drive - P.O. Box 69 - Wyalusing, PA 18853

AGENT:

CUST. STROBIC AIR		FS-401-HF LOUVER & OBDAF-207 IN SLEEVE	
CONTR.			
ARCH.			
P.O.		PROJECT	
DWN. T.B.	DATE 1/18/99	ARROW JOB NO. E-3000	DWG. NO. 35914
CKD.	EDR. 11118		SHT 2 OF 4

CHG LTR	REVISION	DATE	APVD
A	SEE ECN - 7623	3/99	

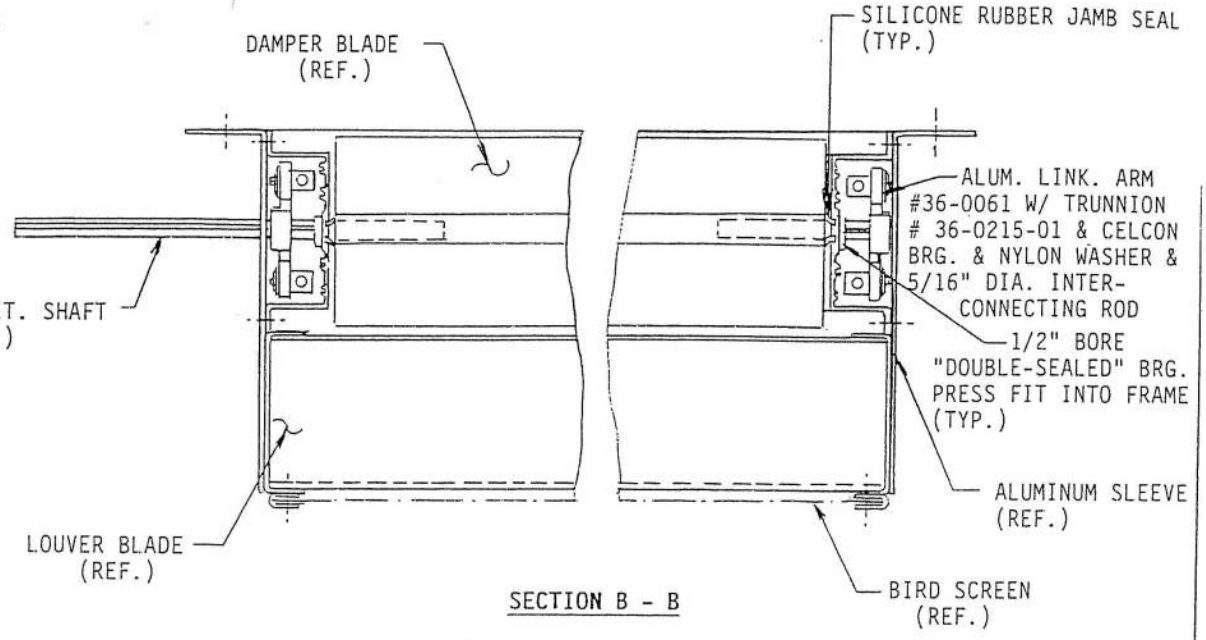

SECTION B - B

ARROW UNITED INDUSTRIES
A Divison of Mestek, Inc.
314 Riverside Drive - P.O. Box 69 - Wyalusing, PA 18853


AGENT:

CUST. STROBIC AIR		FS-401-HF LOUVER & OBDAF-207 IN SLEEVE	
CONTR.			
ARCH.			
P.O.		PROJECT	
DWN. T.B.	DATE 1/19/99	ARROW JOB NO. E-3000	DWG. NO. 35914
CKD.	EDR. 11118		SHT 3 OF 4


CHG LTR	REVISION	DATE	APVD
A	SEE ECN - 7623	3/99	

A

OPTIONAL DRIVE DETAIL

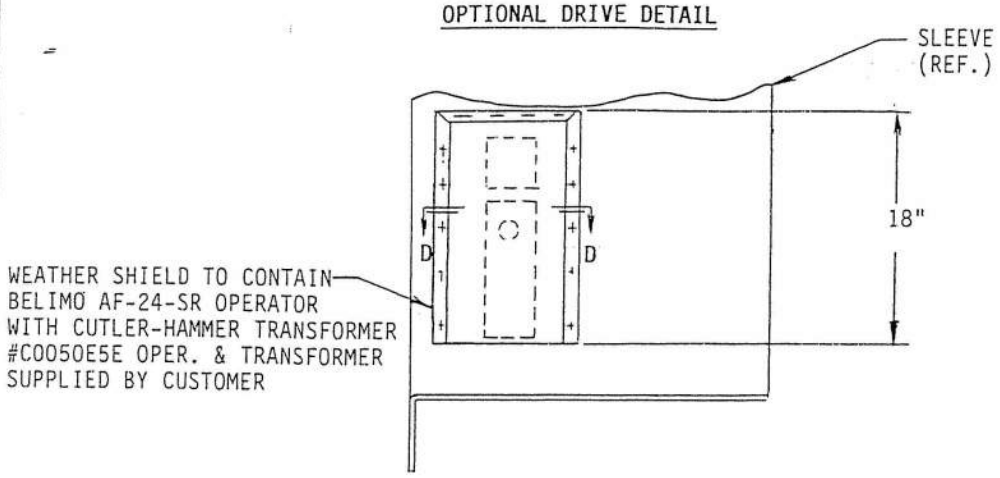

SECTION C - C

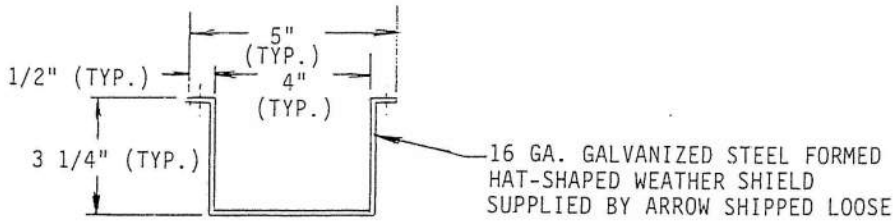

SECTION D - D

ARROW UNITED INDUSTRIES
A Divison of Mestek, Inc.
314 Riverside Drive - P.O. Box 69 - Wyalusing, PA 18853

AGENT:


CUST. STROBIC AIR		FS-401-HF LOUVER & OBDAF-207 IN SLEEVE	
CONTR.			
ARCH.			
P.O.		PROJECT	
DWN. T.B.	DATE 1/19/99	ARROW JOB NO. E-3000	DWG. NO. 35914
CKD.	EDR. 11118		SHT 4 OF 4

ARROW ACOUSTICAL LOUVER 4" DEEP


TYPE FS-401-(LF/HF)

FORMED STEEL - 45° STATIONARY

THE ARROW MODEL FS-401 IS A NARROW DEPTH LOUVER, ONLY 4" DEEP.

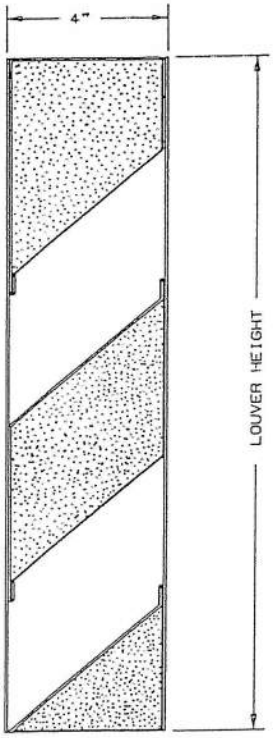

NOT TO SCALE

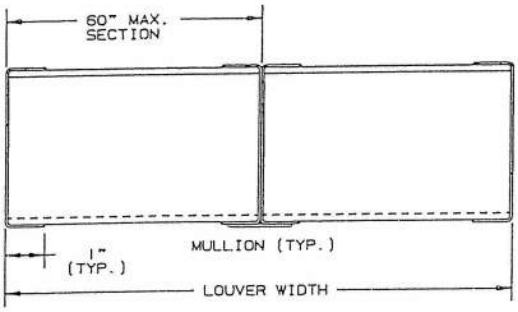

SPECIFICATIONS

FRAME: 16 GA. GALVANIZED STEEL
BLADE: 18 GA. GALVANIZED STEEL ON EXTERIOR WITH 22 GA. GALVANIZED PERFORATED STEEL ON INTERIOR SURFACE. APPROXIMATE BLADE CENTERS 7 1/2"
INSULATION: ARROW SOUND INSULATION
SCREEN: 1/2" SQ. MESH, 19 GA. GALVANIZED (.041"), WHEN INDICATED
CONSTRUCTION: RIVETED AND OR WELDED, WITH HEAD, SILL AND BLADES CONTAINED WITHIN JAMBS

FINISH: MILL, OTHER _____
MINIMUM PANEL SIZE: 12"x18"
MAXIMUM SINGLE PANEL SIZE: 60"x96"

FOR PERFORMANCE DATA
- SEE REVERSE SIDE

LOUVERS WILL BE FABRICATED 1/2" SMALLER THAN OPENING SIZE UNLESS OTHERWISE SPECIFIED.

ITEM	QTY.	OPENING SIZE WIDTH	OPENING SIZE HEIGHT	LOUVER SIZE WIDTH	LOUVER SIZE HEIGHT	MULL	SCREENS TYPE	SCREENS LOC

UNION MADE

ARROW UNITED INDUSTRIES
A DIVISION OF MESTEK, INC.
314 RIVERSIDE DRIVE
WYALUSING, PA 18853
TEL: (717)746-1888 FAX: (717)746-9286

AGENT: _____

ARCH./ENG.: _____
CONTR.: _____
PROJECT: _____
EDR: _____ ECN: _____ JOB: _____
DATE: _____ DWN.: _____ DWG.: _____


LOUVER MODEL FS-401
ACOUSTICAL LOUVER
FORMED STEEL - STATIONARY

PERFORMANCE DATA


TESTS OF A 48" x 48" SAMPLE BY AN *AMCA REGISTERED LABORATORY ACCORDING TO AMCA STANDARD 500 SHOWS WATER PENETRATION TO BE LESS THAN .02 OZ. PER SQ. FT. WATER PENETRATION AT 787 FPM (FREE AREA VELOCITY) WITH LESS THAN .11" W.G. PRESSURE DROP (INTAKE), AND .12" W.G. PRESSURE DROP (EXHAUST).

RATINGS DO NOT INCLUDE EFFECTS OF BIRDSCREEN.

PRESSURE DROP

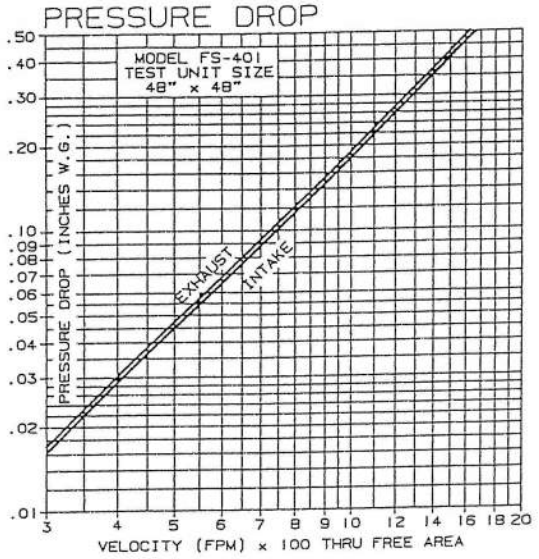

WATER PENETRATION

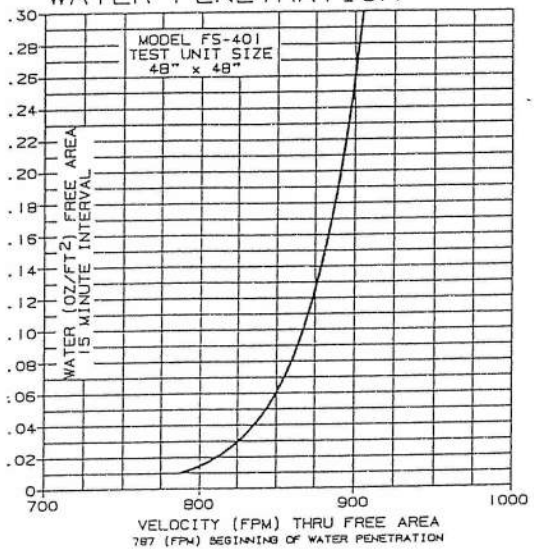

FREE AREA

FREE AREA (SQ. FT.)									
	WIDTH								
HEIGHT	12"	18"	24"	30"	36"	42"	48"	54"	60"
12"	.17	.27	.37	.48	.58	.68	.78	.89	.99
24"	.47	.75	1.03	1.32	1.60	1.88	2.16	2.24	2.72
36"	.68	1.09	1.50	1.91	2.32	2.73	3.13	3.54	3.95
48"	1.02	1.63	2.24	2.85	3.46	4.07	4.51	5.29	5.91
60"	1.19	1.91	2.62	3.34	4.05	4.77	5.48	6.20	6.91
72"	1.53	2.45	3.37	4.29	5.21	6.13	7.05	7.97	8.89
84"	1.72	2.76	3.79	4.83	5.86	6.90	7.93	8.96	10.00
96"	2.04	3.27	4.50	5.72	6.95	8.18	9.40	10.63	11.85

* AMCA REGISTERED LABORATORY IS A LABORATORY EQUIPPED AND STAFFED TO CONDUCT TESTS ACCORDING TO THE APPROPRIATE AMCA TEST METHOD AND WHICH HAS BEEN LICENSED AS A AMCA REGISTERED LABORATORY.

THE ARROW MODEL FS-401 ACOUSTICAL LOUVER LOW FREQUENCY AND HIGH FREQUENCY SOUND PERFORMANCE DATA IS PRESENTED IN TWO SEPERATE TABLES. REVIEW THE APPROPRIATE TABLE AND SELECT THE ATTENUATION VALUE FOR THE DESIGN NOISE CRITERIA CORRECTIVE ACTION REQUIRED.

MODEL FS-401-LF (LOW FREQUENCY)

OCTIVE BAND / FREQUENCY	1 / 63	2 / 125	3 / 250	4 / 500	5 / 1000	6 / 2000	7 / 4000	8 / 8000
FREE FIELD OF NOISE REDUCTION (db)	12	14	12	12	9	11	13	15

MODEL FS-401-HF (HIGH FREQUENCY)

OCTIVE BAND / FREQUENCY	1 / 63	2 / 125	3 / 250	4 / 500	5 / 1000	6 / 2000	7 / 4000	8 / 8000
FREE FIELD OF NOISE REDUCTION (db)	8	7	9	10	14	16	16	18