SLN[X] / SL[X] Duct Mounted Lamp Support Bracket
GENERAL INSTALLATION NSTRUCTIONS

CAUTION! Never Expose Eyes or Skin to UV-C - Read all Materials before Starting

SAFETY CONSIDERATIONS



Improper installation, adjustment, alteration, service, maintenance, or use can cause fire, electrical shock, or other conditions which may cause personal injury or property damage. Consult a qualified installer, service agency, or your supplier for information or assistance. The qualified installer or agency must use factory kits or accessories when installing this product. Refer to the individual instructions packaged with kits or accessories when installing them. Follow all safety codes, wear safety glasses and work gloves. Read all instructions thoroughly and follow any warnings or cautions attached to any accessed area. Consult local building codes and the National Electrical Code (NEC) for special requirements.



Understand the signal words **DANGER**, **WARNING**, or **CAUTION**. These words are universally used for overall safety. **DANGER** identifies the most serious hazards, which will result in severe personal injury or death. **WARNING** signifies hazards, which could result in personal injury or death. **CAUTION** is used to identify unsafe practices, which would result in minor personal injury or product and property damage.



WARNING: Before installing or servicing this unit, turn off or disconnect all power, there may be more than one (1) switch.

CAUTION-UV Exposure Precautions:

1. Doors, covers, lamp mounting brackets, access panels, and removable components that give direct access to Ultraviolet (UV) lamp systems shall be equipped with an interlocking mechanism that removes power from the Ultraviolet (UV) lamp system.
2. There should be no openings, holes or joints that allow UV light leakage.
3. Drain pans shall be metallic.
4. Some UV installations may require protective barriers (not supplied) to protect users, service personnel and non-metallic parts from UV energy.

WARNING: Eye damage may result from directly viewing the light produced by these lamps. To reduce the risk of exposure to UV radiation, take UV-radiation protective measures for personnel during servicing.

WARNING: This fixture is designed for use with germicidal UV-C lamps and must be installed in compliance with competent technical directions so that the user's eyes and bare skin will not be subjected to injurious rays.

WARNING: There shall not be any supply or return air openings or any other openings that are in direct line of sight of the UV bulb.

WARNING: There shall not be any openings in the duct that would emit light.

WARNING: UV Light Hazard. To Prevent exposure to ultraviolet light, be sure the ultraviolet air treatment system is disconnected before servicing any part of the HVAC system or removing any access panel or the equivalent.

CAUTION: Personal Injury Hazard. Power supply can cause electrical shock. Disconnect power supply before servicing or beginning installation.

CAUTION: Risk of exposure to excessive ultraviolet (UV) radiation - Do not operate without complete lamp enclosure in place or if sight lens is damaged.



BARRIERS (if required, not supplied):

a. Barrier should be constructed of a material that will not be affected by UV energy (e.g. metal)

b. Non-Metallic materials may be protected by directly attached barriers such as aluminum coated tape.
c. Both the unit inlet and outlet should be considered as possible Ultraviolet (UV) radiation paths when determining barrier locations.
d. The unit filters are not considered Ultraviolet (UV) radiation barriers.
e. Inorganic materials such as glass, glass fibers, and metal are not affected by UV-C exposure.
f. *Removable barriers shall be marked with the words "Caution" and the following or equivalent:*

"UV LIGHT SOURCE - KEEP PROTECTIVE BARRIER IN PLACE"

INCLUDED:

- **Lamp Support Bracket**
- **Lamp Support Bracket Installation Kit**
- **Installation Operation Manual (IOM)**
- **Self-Drilling Mounting Screws (x4)**

INSTALLATION PROCESS (STRUCTURAL SURFACES ONLY):

SLN[X]

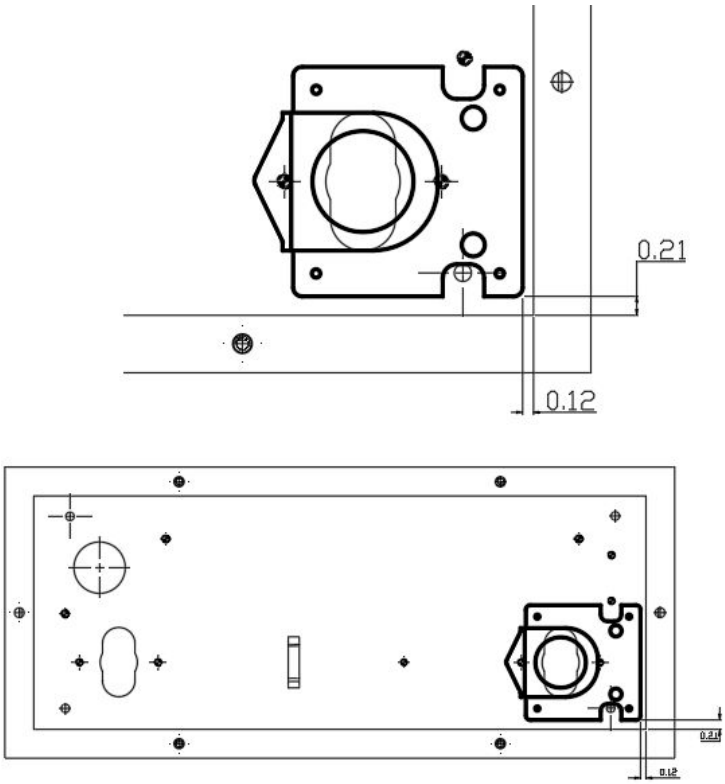


FIGURE 1

SL[X]

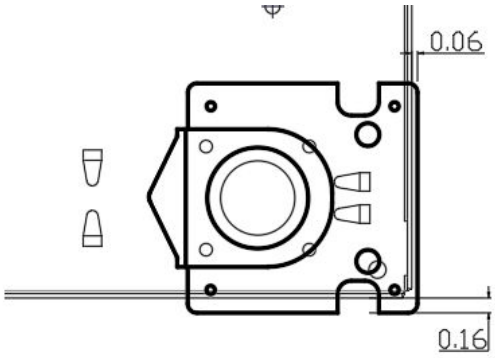


FIGURE 2

1. Determine the fixture location.


NOTE: Need to drill a hole ∅ 2 inches. Make sure there is not any interference or cause damage to the HVAC system.


NOTE: Notice the bracket orientation. The dimple side should face the coil surface for maximum UVC effect.


2. Lay over the SLN[X] or SL[X] fixture to determine the orientation of the fixture. Mark lamp penetration location using fixture lamp hole as template.


3. Drill a hole ∅ 2 inches. Insert the lamp support bracket. Align the drilled hole on the duct wall and the lamp support bracket hole to be concentric.

4. Use self-tapping metal screws to fix the Support Bracket.

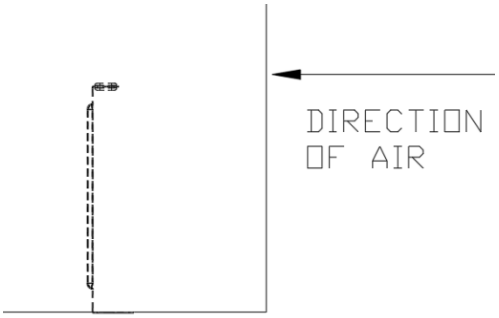

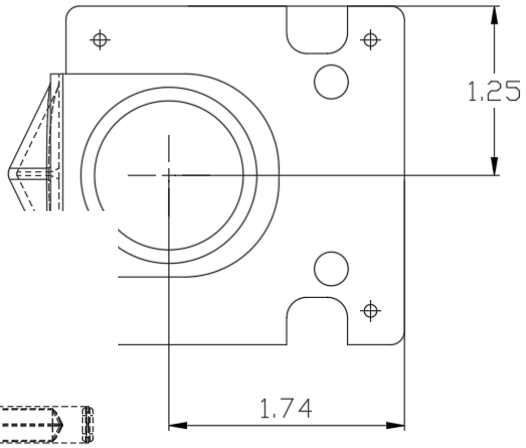

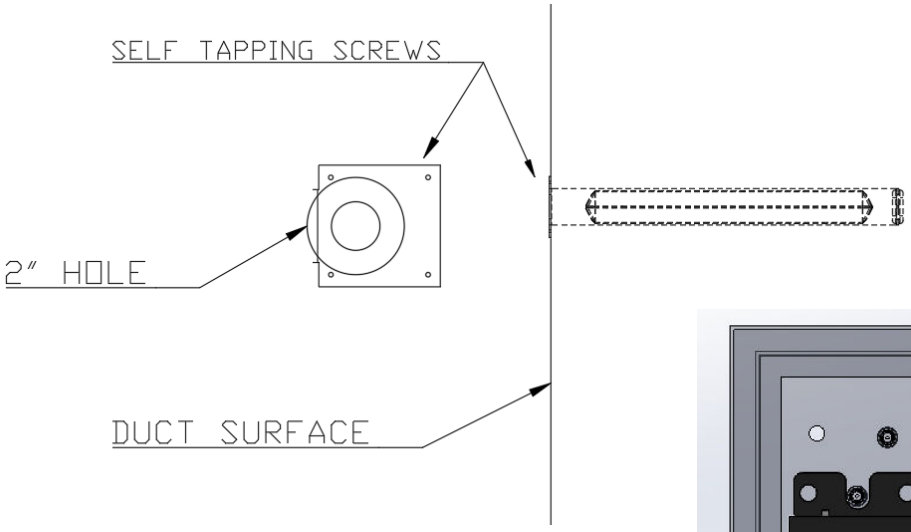

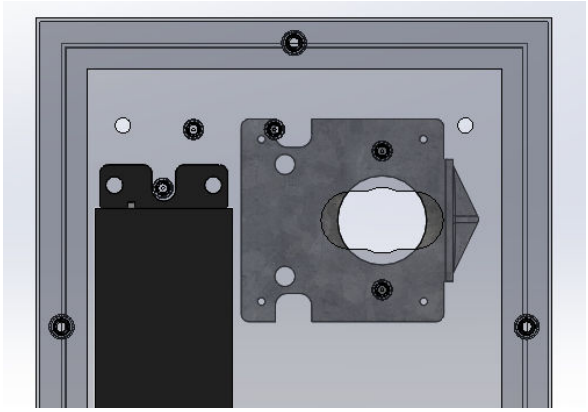

EXAMPLE OF SUPPORT BRACKET MOUNT

LIMITED EQUIPMENT WARRANTY

FOR DETAILED INFORMATION, VISIT https://uvresources/warranty

RANCHO CUCAMONGA, CA 91730 Phone: 877.884.4822
Uvresources.com
Specifications subject to change without notice - © 2025, all rights reserved.