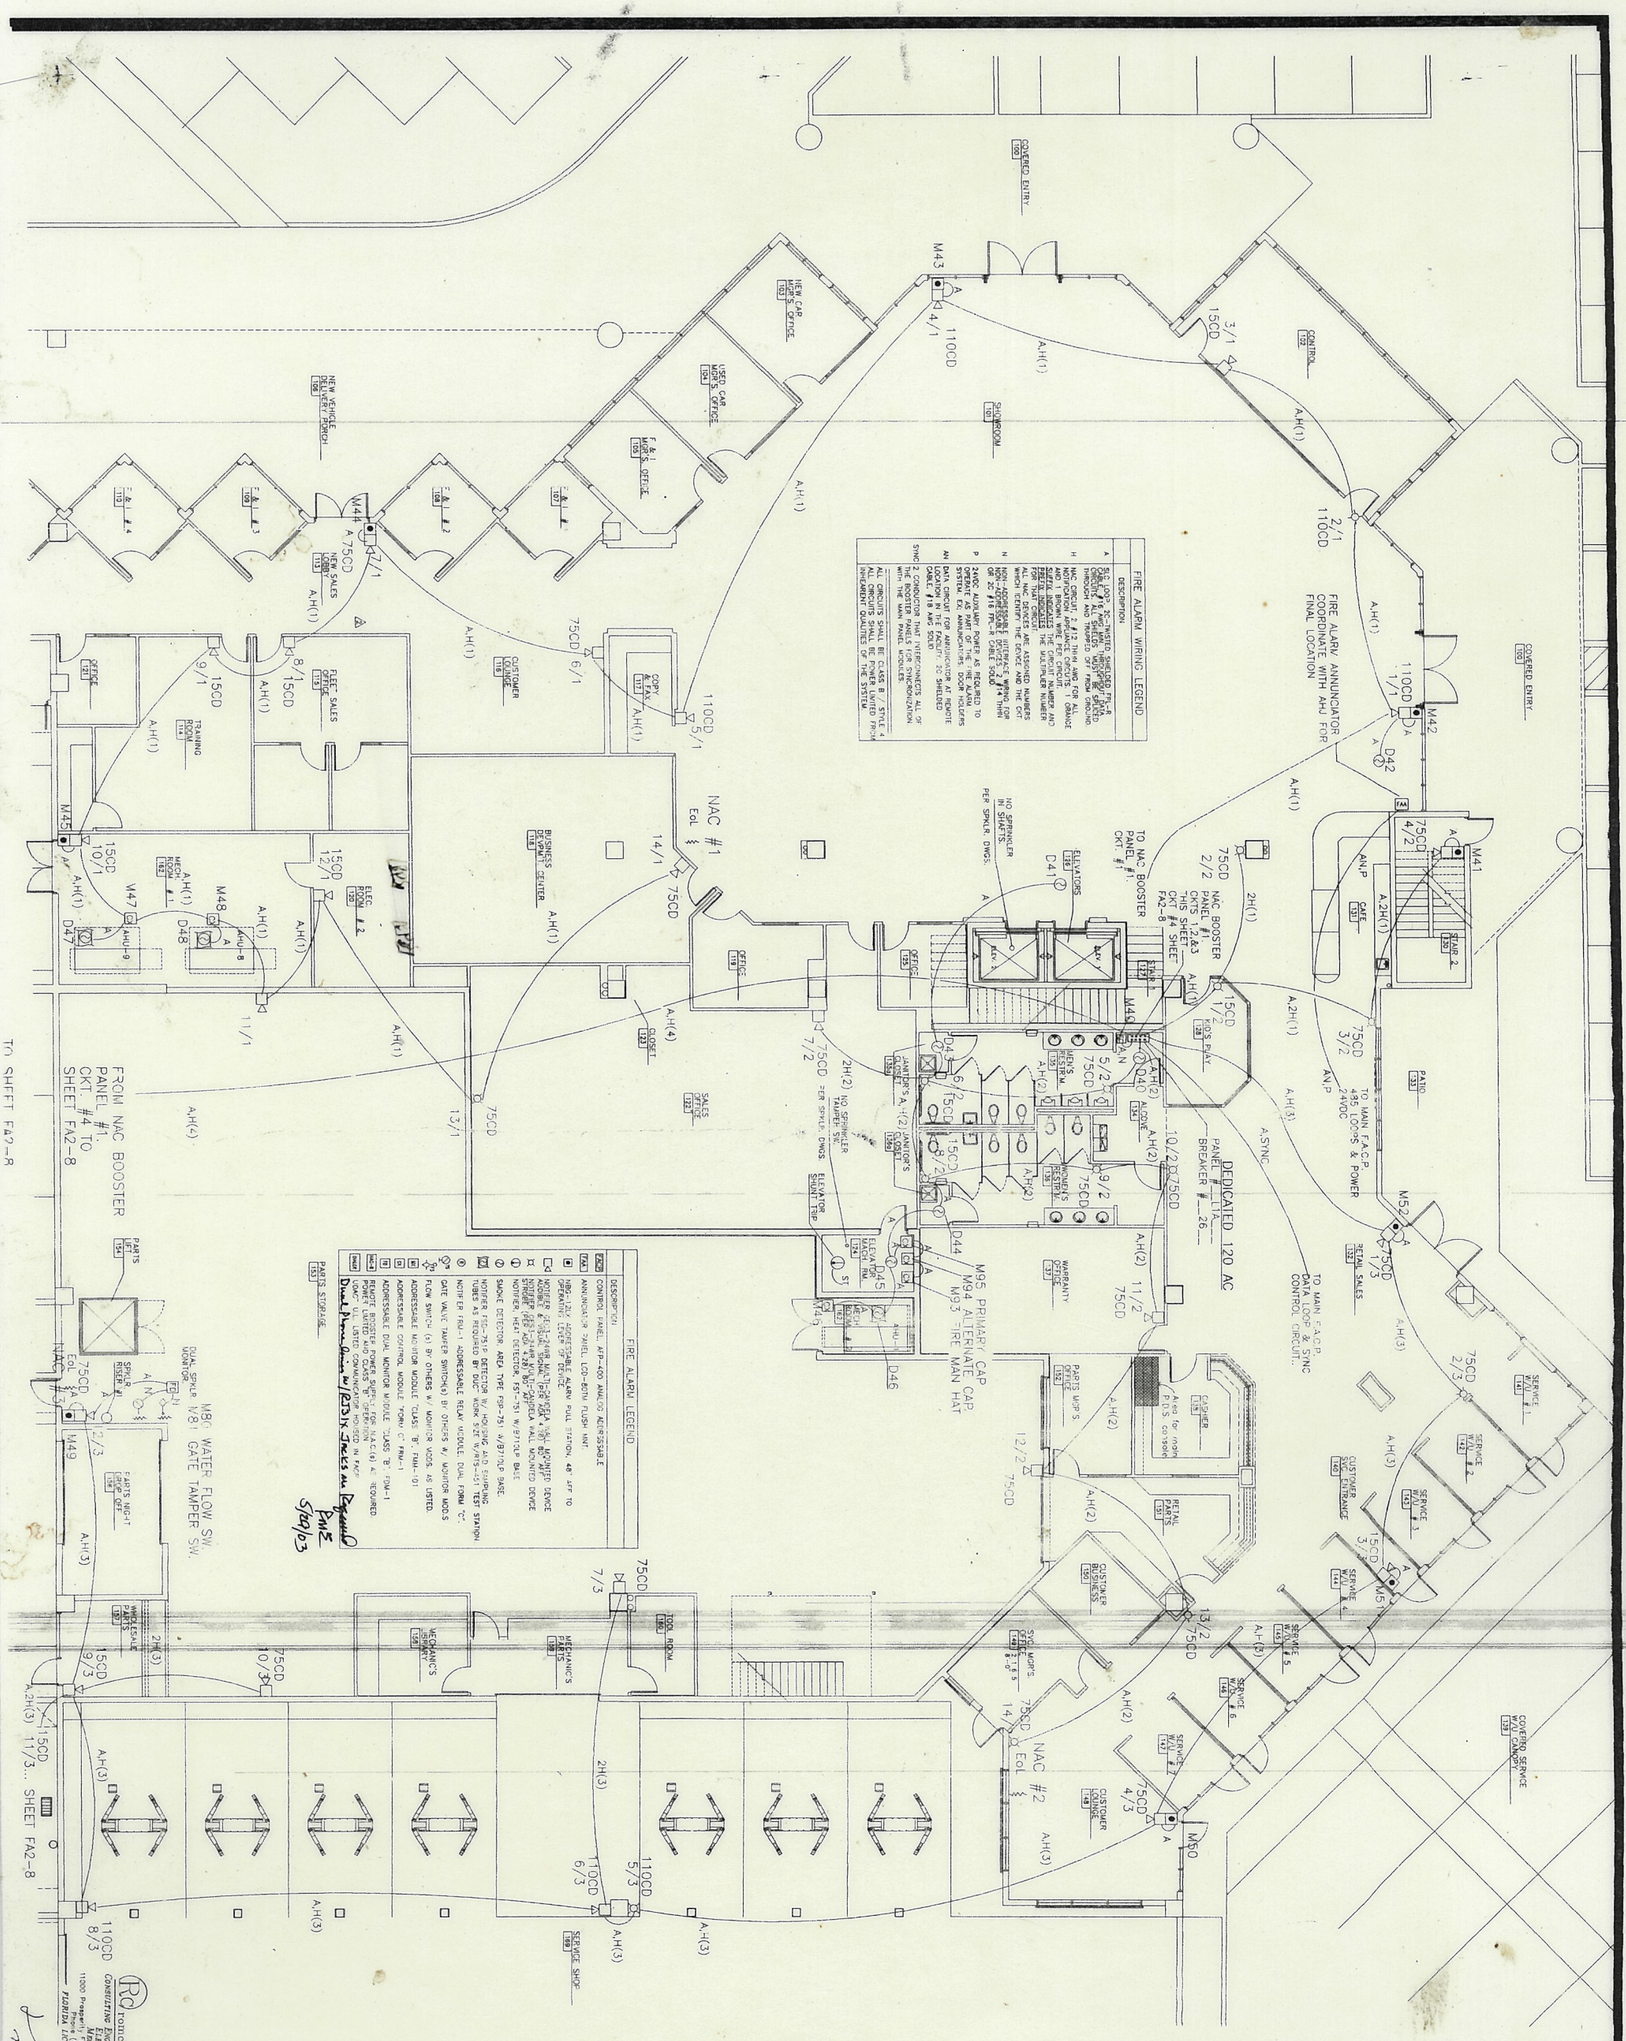



roncsko coburn engineering, co.
CONSULTING ENGINEERS
DAVID ROUCHE
FLORIDA REG. NO. 50241
MECHANICAL
11000 Prosperity Farms Road, Suite 102, P.B. Gardens, FL 33410
Phone: (561) 694-0270 Fax: (561) 694-1393
FLORIDA LICENSED ENGINEERS EB 0007830

drawing FA1-8
of
date 02/25/03
comm no 0003628

revision
4/23/02 DLR
6/13/02 DLR
10/01/02 DLR

A NEW AUTOMOBILE DEALERSHIP FOR:
FAIRBANKS SAWGRASS
CHRYSLER / JEEP / DODGE
WESTPOINT CENTRE,
5607 STATE STREET, TAMARAC, FL 33321

SECURITY NETWORKS L.L.C.
5800 CORPORATE WAY, WEST PALM BEACH FL.
FULL SERVICE FIRE ALARM, SECURITY COMPANY
C.C.T.V., ACCESS CONTROL, NURSE CALL SYSTEMS
FLORIDA ALARM CONTRACTOR EF[illegible]
TEL (561) 697-9997
FAX (561) 683-5522

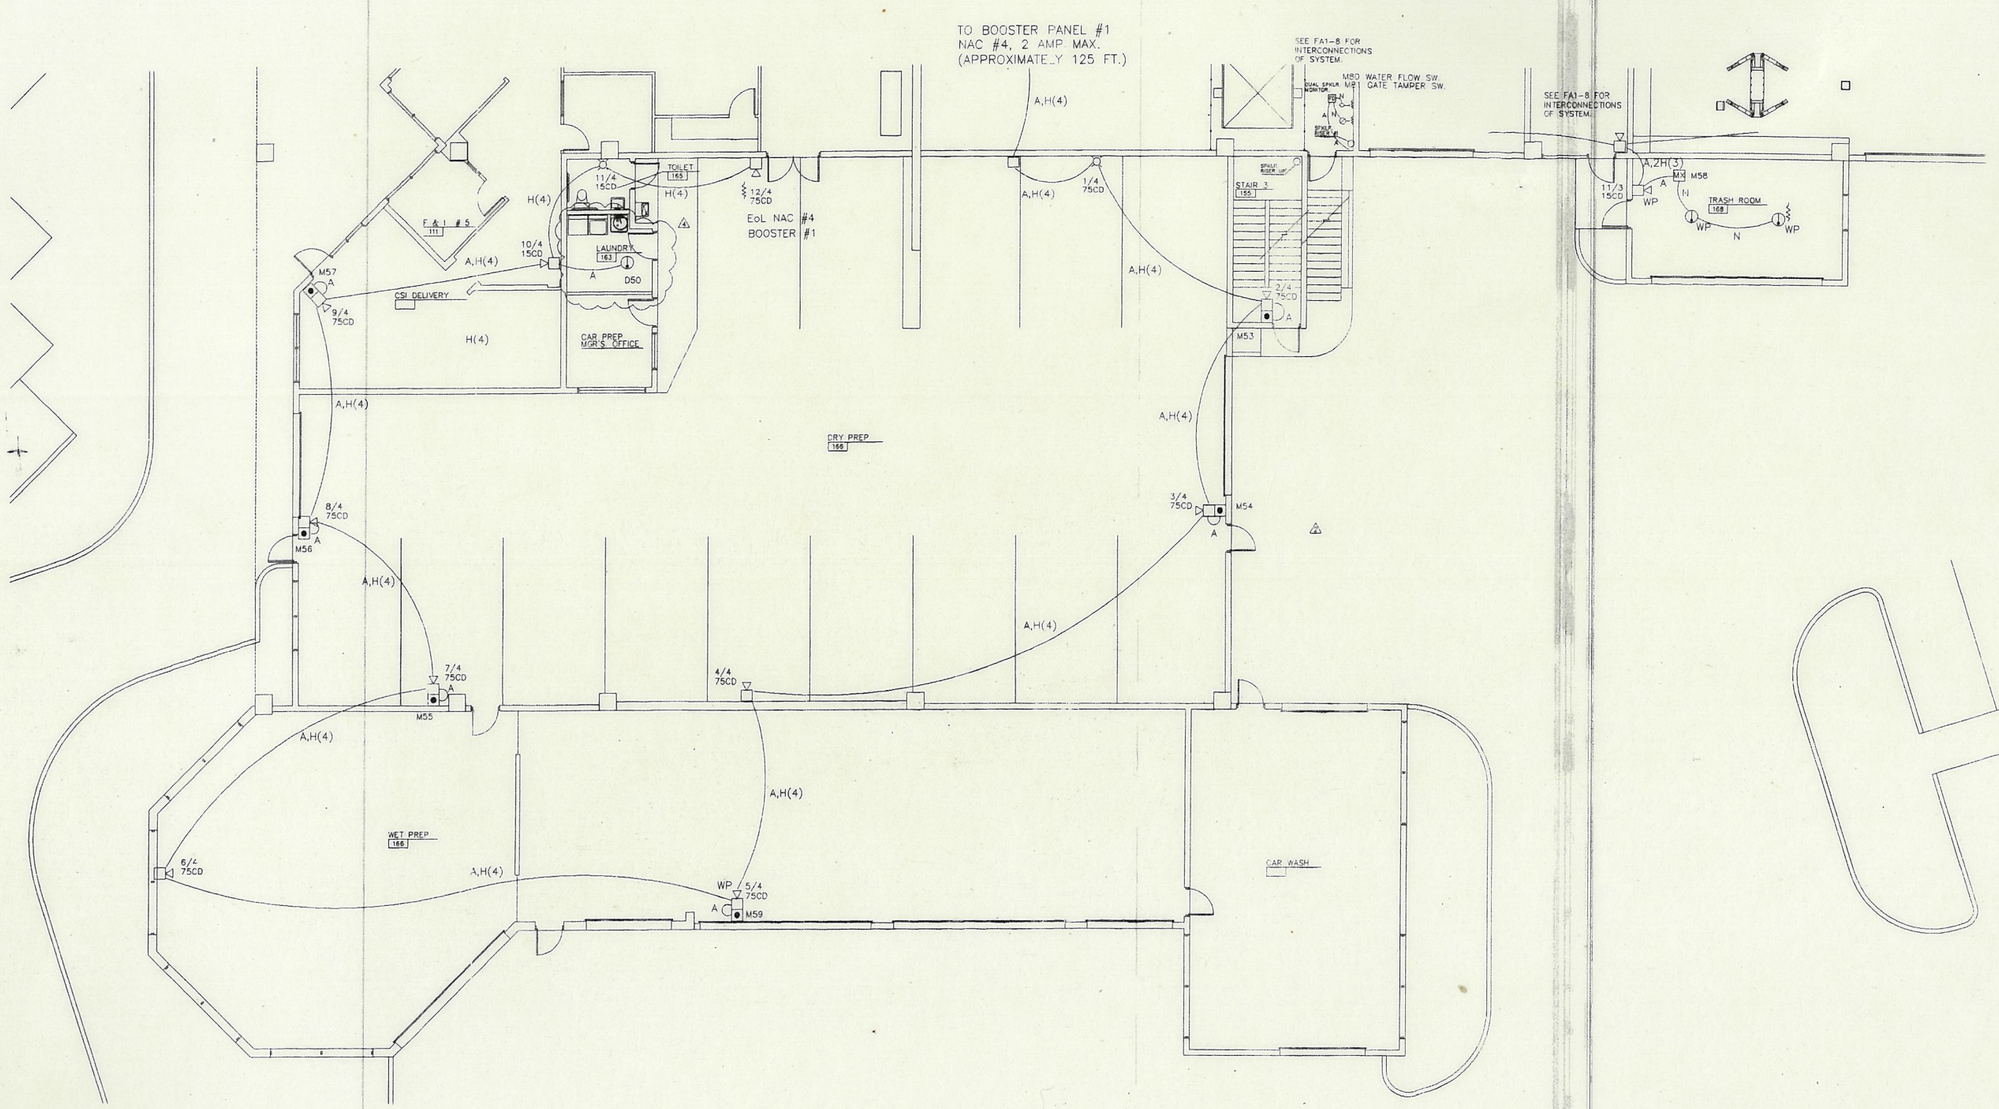

1 / E-4.2 PARTIAL GROUND FLOOR PREP SYSTEMS PLAN

SCALE: 1/8" = 1'-0"

FIRE ALARM LEGEND	
	DESCRIPTION
FACP	CONTROL PANEL, AFP-400 ANALOG ADDRESSABLE
FAA	ANNUNCIATOR PANEL, LCD-80TM FLUSH MNT.
	NBG-12LX ADDRESSABLE ALARM PULL STATION, 48" AFF TO OPERATING LEVER OF DEVICE.
	NOTIFIER GEC3-24WR MULTI-CANDELA WALL MOUNTED DEVICE AUDIBLE & VISUAL SIGNAL (PER ADA 4.28) 80" AFF.
	NOTIFIER GES3-24WR MULTI-CANDELA WALL MOUNTED DEVICE STROBE (PER ADA 4.28) 80" AFF.
	NOTIFIER, HEAT DETECTOR, FST-751 W/B710LP BASE.
	SMOKE DETECTOR, AREA TYPE FSP-751 W/B710LP BASE.
	NOTIFIER FSD-751P DETECTOR W/ HOUSING AND SAMPLING TUBES AS REQUIRED BY DUCT WORK SIZE W/RTS-451 TEST STATION.
R	NOTIFIER FRM-1 ADDRESSABLE RELAY MODULE, DUAL FORM "C".
TS	GATE VALVE TAMPER SWITCH(s) BY OTHERS W/ MONITOR MOD'S
FS	FLOW SWITCH (s) BY OTHERS W/ MONITOR MODS. AS LISTED.
M	ADDRESSABLE MONITOR MODULE "CLASS "B", FMM-101
C	ADDRESSABLE CONTROL MODULE "FORM C" FRM-1
I	ADDRESSABLE DUAL MONITOR MODULE "CLASS "B", FDM-1
NAC-B	REMOTE BOOSTER POWER SUPPLY FOR N.A.C.(s) AS REQUIRED. POWER LIMITED AND CLASS "B" OPERATION
DACT	UDACT U.L. LISTED COMMUNICATOR HOUSED IN FACP

Dual Phone Lines w/ RJ31X Jacks are Required

FIRE ALARM WIRING LEGEND	
	DESCRIPTION
A	SLC LOOP, 2C-TWISTED SHIELDED FPL-R CABLE, #16 AWG MIN. THROUGHOUT DATA CIRCUITS. ALL SHIELDS "MUST" BE SPLICED THROUGH AND TRAPPED OFF FROM GROUND.
H	NAC CIRCUIT, 2 #12 THHN AWG FOR ALL NOTIFICATION APPLIANCE CIRCUITS. 1 ORANGE AND 1 BROWN WIRE PER CIRCUIT. SUFFIX INDICATES THE CIRCUIT NUMBER AND PREFIX INDICATES THE MULTIPLIER NUMBER FOR THAT CIRCUIT. ALL NAC DEVICES ARE ASSIGNED NUMBERS WHICH IDENTIFY THE DEVICE AND THE CKT.
N	NON-ADDRESSABLE INTERFACE WIRING FOR NON-ADDRESSABLE DEVICES. 2 #14 THHN OR 2C #16 FPL-R CABLE SOLID.
P	24VDC AUXILIARY POWER AS REQUIRED TO OPERATE AS PART OF THE FIRE ALARM SYSTEM. EX.: ANNUNCIATORS, DOOR HOLDERS
AN	DATA CIRCUIT FOR ANNUNCIATOR AT REMOTE LOCATION IN THE FACILITY. 2C SHIELDED CABLE, #18 AWG SOLID.
SYNC	2 CONDUCTOR THAT INTERCONNECTS ALL OF THE BOOSTER PANELS FOR SYNCRONIZATION. WITH THE MAIN PANEL MODULES.

ALL CIRCUITS SHALL BE CLASS B / STYLE 4
ALL CIRCUITS SHALL BE POWER LIMITED FROM INHEARENT QUALITIES OF THE SYSTEM.

romcke coburn engineering, co.
CONSULTING ENGINEERS DAVID ROMCKE
ELECTRICAL NO. 50841
MECHANICAL
11000 Prosperity Farms Rd. Suite 102 P.B. Gardens Fl. 33410
Phone (561) 694-0770 Fax (561) 694-1293
FLORIDA LICENSED ENGINEERS EB 0007830

SECURITY NETWORKS L.L.C.
5800 CORPORATE WAY, WEST PALM BEACH FL.
FULL SERVICE FIRE ALARM, SECURITY COMPANY
C.C.T.V., ACCESS CONTROL, NURSE CALL SYSTEMS
TEL (561) 697-9997 FAX (561) 683-5522
FLORIDA ALARM CONTRACTOR EF0000123

A NEW AUTOMOBILE DEALERSHIP FOR:
FAIRBANKS SAWGRASS
CHRYSLER / JEEP / DODGE
WESTPOINT CENTRE,
5607 STATE STREET, TAMARAC, FL 33321

revision
⚠ 4/23/02 DLR
⚠ 6/13/02 DLR
⚠ 10/01/02 DLR

comm no
0003628

date
02/25/03

drawing
FA2-8
of

pull's # 2.0

FIRE ALARM LEGEND

	DESCRIPTION
FACP	CONTROL PANEL, AFP-400 ANALOG ADDRESSABLE
FAA	ANNUNCIATOR PANEL, LCD-80TM FLUSH MNT.
	NBG-12LX ADDRESSABLE ALARM PULL STATION, 48" AFF TO OPERATING LEVER OF DEVICE.
	NOTIFIER GEC3-24WR MULTI-CANDELA WALL MOUNTED DEVICE AUDIBLE & VISUAL SIGNAL (PER ADA 4.28) 80" AFF.
	NOTIFIER GES3-24WR MULTI-CANDELA WALL MOUNTED DEVICE STROBE (PER ADA 4.28) 80" AFF.
	NOTIFIER, HEAT DETECTOR, FST-751 W/B710LP BASE
	SMOKE DETECTOR, AREA TYPE FSP-751 W/B710LP BASE.
	NOTIFIER FSD-751P DETECTOR W/ HOUSING AND SAMPLING TUBES AS REQUIRED BY DUCT WORK SIZE W/RTS-451 TEST STATION.
	NOTIFIER FRM-1 ADDRESSABLE RELAY MODULE, DUAL FORM "C".
	GATE VALVE TAMPER SWITCH(s) BY OTHERS W/ MONITOR MOD.S
	FLOW SWITCH (s) BY OTHERS W/ MONITOR MODS. AS LISTED.
M	ADDRESSABLE MONITOR MODULE "CLASS "B", FMM-101
C	ADDRESSABLE CONTROL MODULE "FORM C" FRM-1
D	ADDRESSABLE DUAL MONITOR MODULE "CLASS "B", FDM-1
BOOSTER	REMOTE BOOSTER POWER SUPPLY FOR N.A.C.(s) AS REQUIRED. POWER LIMITED AND CLASS "B" OPERATION
DACT	UDACT, U.L. LISTED COMMUNICATOR HOUSED IN FACP

Dual Phone Line w/ RJ31X Jack are Required

Rev 2 5/25/03

FIRE ALARM WIRING LEGEND

	DESCRIPTION
A	SLC LOOP, 2C-TWISTED, SHIELDED FPL-R CABLE, #18 AWG MIN. THROUGHOUT DATA CIRCUITS. ALL SHIELDS "MUST" BE SPLICED THROUGH AND TRAPPED OFF FROM GROUND.
H	NAC CIRCUIT, 2 #12 THHN AWG FOR ALL NOTIFICATION APPLIANCE CIRCUITS. 1 ORANGE AND 1 BROWN WIRE PER CIRCUIT. SUFFIX INDICATES THE CIRCUIT NUMBER AND PREFIX INDICATES THE MULTIPLIER NUMBER FOR THAT CIRCUIT. ALL NAC DEVICES ARE ASSIGNED NUMBERS WHICH IDENTIFY THE DEVICE AND THE CKT.
N	NON-ADDRESSABLE INTERFACE WIRING FOR NON-ADDRESSABLE DEVICES. 2 #14 THHN OR 2C #16 FPL-R CABLE SOLID.
P	24VDC AUXILIARY POWER AS REQUIRED TO OPERATE AS PART OF THE FIRE ALARM SYSTEM. EX: ANNUNCIATORS, DOOR HOLDERS
AN	DATA CIRCUIT FOR ANNUNCIATOR AT REMOTE LOCATION IN THE FACILITY, 2C SHIELDED CABLE, #18 AWG SOLID.
SYNC	2 CONDUCTOR THAT INTERCONNECTS ALL OF THE BOOSTER PANELS FOR SYNCRONIZATION, WITH THE MAIN PANEL MODULES.

ALL CIRCUITS SHALL BE CLASS B / STYLE 4
ALL CIRCUITS SHALL BE POWER LIMITED FROM INHERENT QUALITIES OF THE SYSTEM.

QUICK LUBE 170

UP TO 2ND FL. GARAGE LEVEL NAC#4, FAS-8

HOME RUN, FACP FROM SHEET FA4-8

MECHANIC'S BREAKROOM 173

MECHANIC'S TOILET 175

MECHANIC'S PHC TOILET 174

STAIR 4 171

BOOSTER #4

DEDICATED 120VAC PANEL # L1G1 BREAKER # 38

FROM SHEET FA4-8

CORRIDOR 174

SERVICE SHOP 169

BODY SHOP 181

FROM SHEET FA1-8 DEVICE # STB. 5/3

EoL FOR NAC #1 BOOSTER #4

EoL FOR NAC #2 BOOSTER #4

SEE MECHANICAL PLANS FOR EXACT LOCATIONS

SCALE: 1/8" = 1'-0"

1 F-4.3 PARTIAL GROUND FLOOR SYSTEMS PLAN :

SECURITY NETWORKS L.L.C.
5800 CORPORATE WAY, WEST PALM BEACH FL.
FULL SERVICE FIRE ALARM, SECURITY COMPANY
C.C.T.V., ACCESS CONTROL, NURSE CALL SYSTEMS
TEL (561) 697-9997 FAX (561) 683-5522
FLORIDA ALARM CONTRACTOR I2W0000123

A NEW AUTOMOBILE DEALERSHIP FOR:
FAIRBANKS SAWGRASS
CHRYSLER / JEEP / DODGE
WESTPOINT CENTRE,
5607 STATE STREET, TAMARAC, FL 33321

revision
⚠ 4/23/02 DLR

comm no
0003628


date
02/25/03

drawing
FA3-8

of

romcke coburn engineering, co.
CONSULTING ENGINEERS ELECTRICAL MECHANICAL
DAVID ROMCKE NO. 50841
11000 Prosperity Farms Rd. Suite 102 P.B. Gardens Fl. 33410
Phone (561) 694-0770 Fax (561) 694-1293
FLORIDA LICENSED ENGINEERS EB 0007830

5/21/03

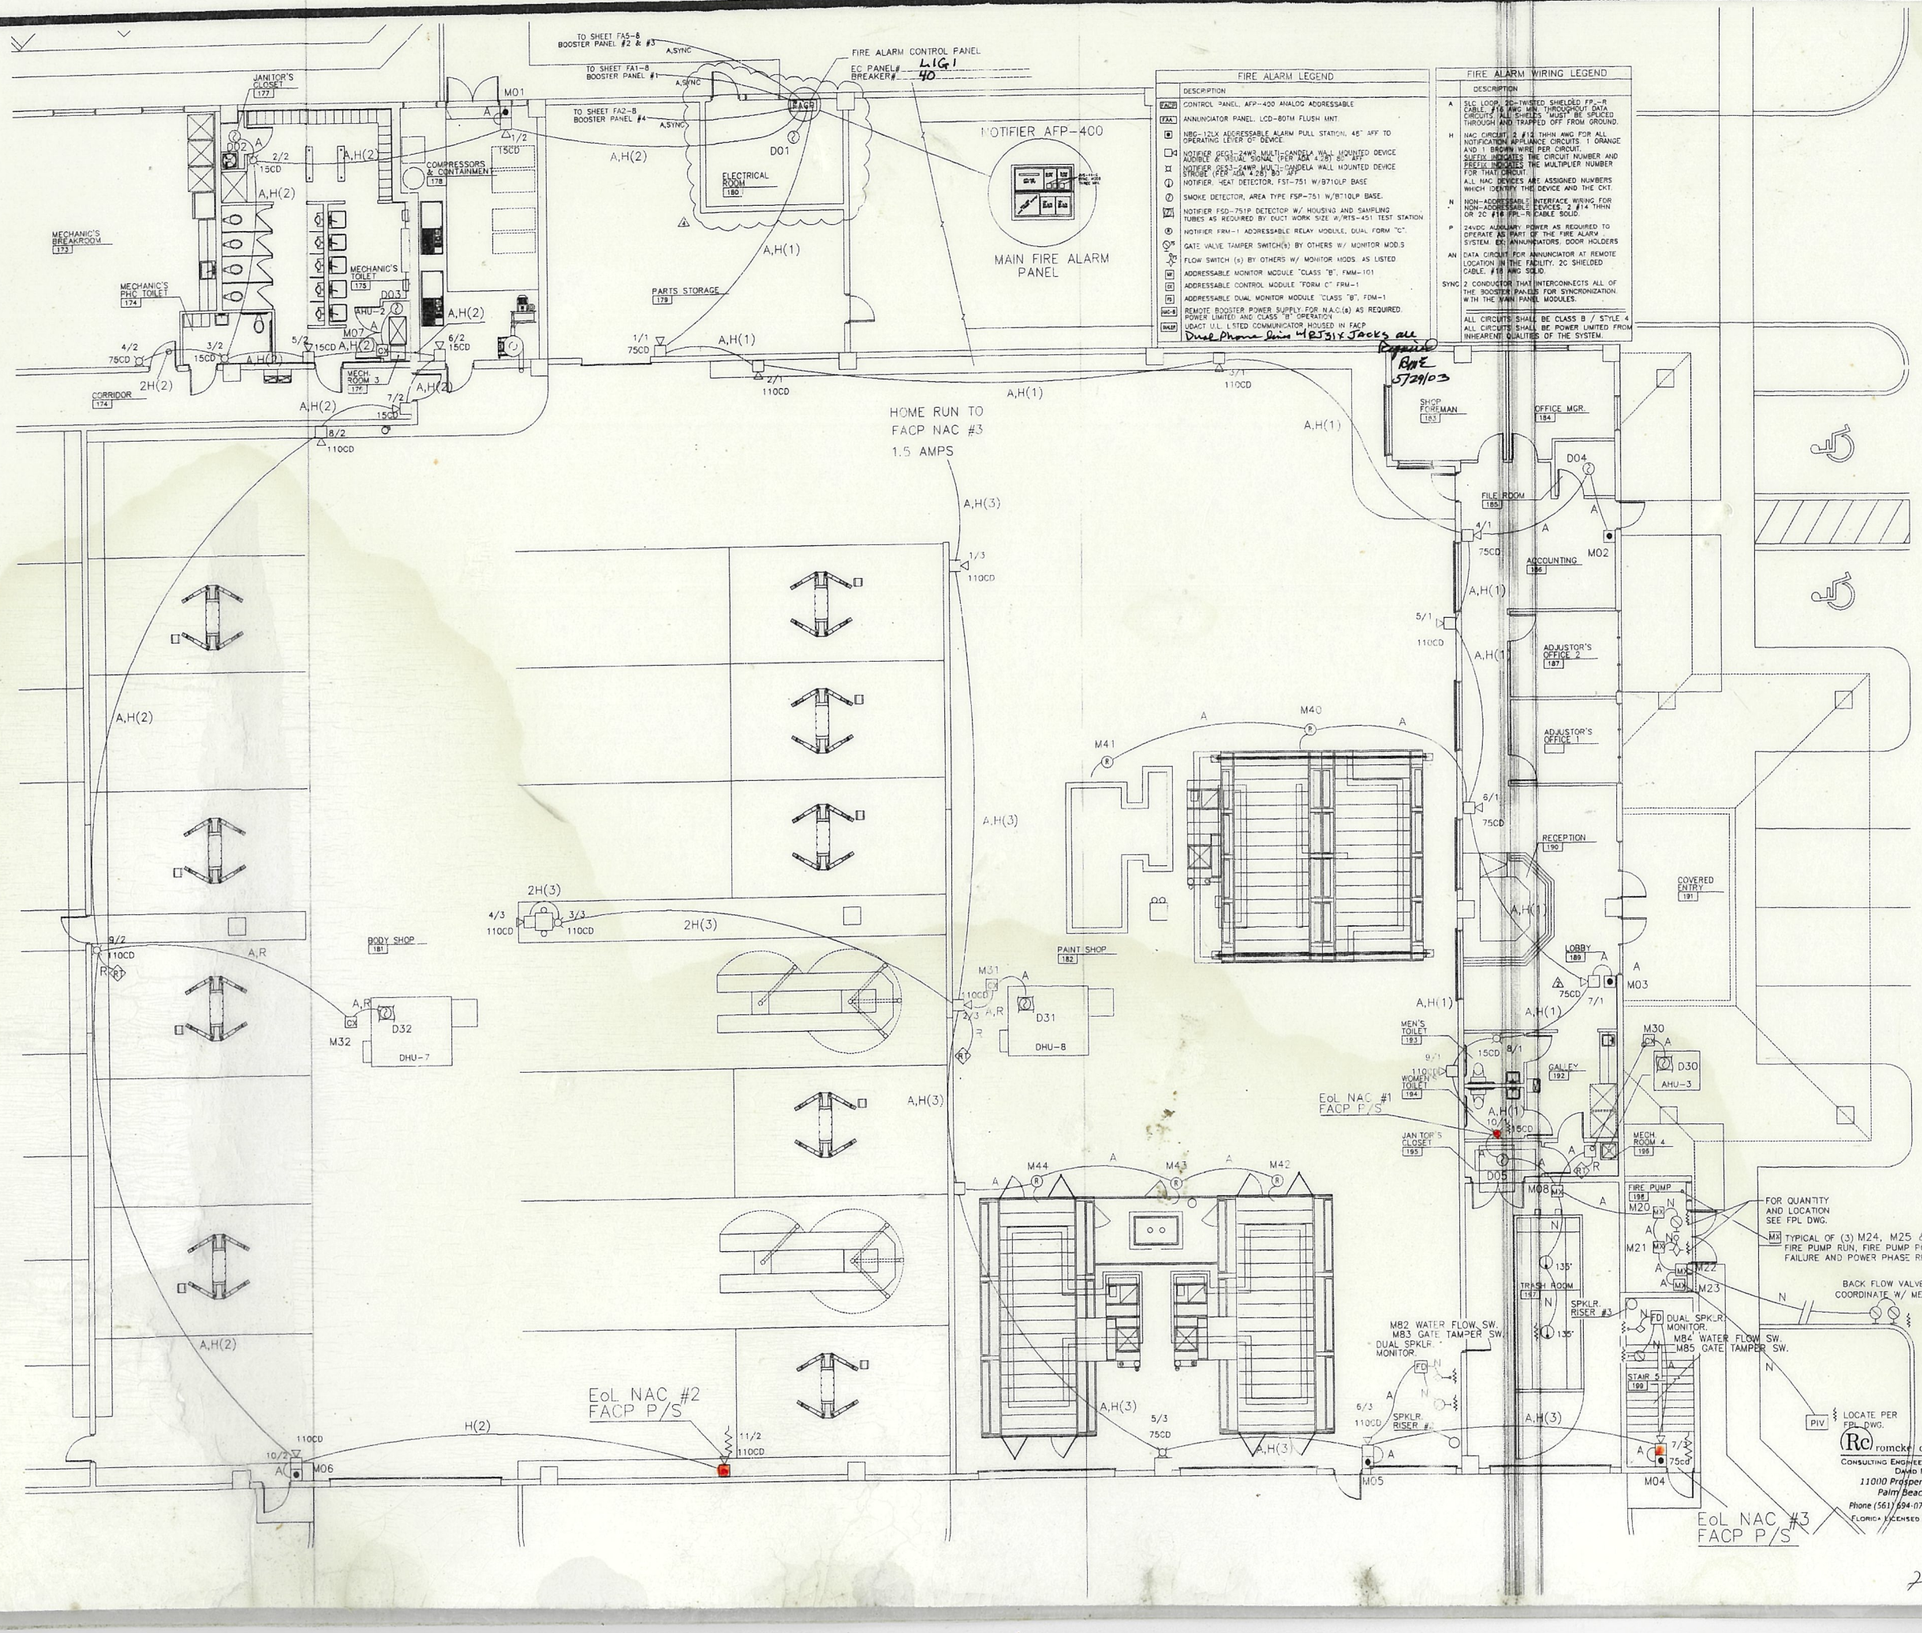

FIRE ALARM LEGEND

	DESCRIPTION
FACP	CONTROL PANEL, AFP-400 ANALOG ADDRESSABLE
FAA	ANNUNCIATOR PANEL, LCD-80TM FLUSH MNT.
	NBG-12LX ADDRESSABLE ALARM PULL STATION, 48" AFF TO OPERATING LEVER OF DEVICE
	NOTIFIER (FCI)-24WP-MULTI-CANDELA WALL MOUNTED DEVICE AUDIBLE & VISUAL SIGNAL (PER ADA 4.28) 80" AFF
	NOTIFIER (FCI)-24WP-WCM-CANDELA WALL MOUNTED DEVICE STROBE (PER ADA 4.28) 80" AFF
	NOTIFIER -HEAT DETECTOR, FST-751 W/B710LP BASE
	SMOKE DETECTOR, AREA TYPE FSP-751 W/B710LP BASE.
	NOTIFIER FSD-751P DETECTOR W/ HOUSING AND SAMPLING TUBES AS REQUIRED BY DUCT WORK SIZE W/NTS-451 TEST STATION
	NOTIFIER FRM-1 ADDRESSABLE RELAY MODULE, DUAL FORM "C".
GVS	GATE VALVE TAMPER SWITCH(S) BY OTHERS W/ MONITOR MOD.S
FS	FLOW SWITCH (S) BY OTHERS W/ MONITOR MODS. AS LISTED
IM	ADDRESSABLE MONITOR MODULE "CLASS "B", FMM-101
CM	ADDRESSABLE CONTROL MODULE "FORM C" FRM-1
FDM	ADDRESSABLE DUAL MONITOR MODULE "CLASS "B", FDM-1
RPS-6	REMOTE BOOSTER POWER SUPPLY FOR N.A.C.(s) AS REQUIRED. POWER LIMITED AND CLASS "B" OPERATION
UACT	U.L. LISTED COMMUNICATOR HOUSED IN FACP. Dual Phone Lines w/RJ31x Jacks all Required Rae 5/29/03

FIRE ALARM WIRING LEGEND

	DESCRIPTION
A	SLC LOOP, 2C-TWISTED, SHIELDED FPL-R CABLE, #16 AWG MIN. THROUGHOUT. DATA CIRCUITS' ALL SHIELDS MUST BE SPLICED THROUGH AND TRAPPED OFF FROM GROUND.
H	NAC CIRCUIT, 2 #12 THHN AWG FOR ALL NOTIFICATION APPLIANCE CIRCUITS 1 ORANGE AND 1 BROWN WIRE PER CIRCUIT. SUFFIX INDICATES THE CIRCUIT NUMBER AND PREFIX INDICATES THE MULTIPLIER NUMBER FOR THAT CIRCUIT. ALL NAC DEVICES ARE ASSIGNED NUMBERS WHICH IDENTIFY THEIR DEVICE AND THE CKT.
N	NON-ADDRESSABLE INTERFACE WIRING FOR NON-ADDRESSABLE DEVICES. 2 #14 THHN OR 2C #16 FPL-R CABLE SOLID
P	24VDC AUXILIARY POWER AS REQUIRED TO OPERATE AS PART OF THE FIRE ALARM SYSTEM. EX: ANNUNCIATORS, DOOR HOLDERS
AN	DATA CIRCUIT FOR ANNUNCIATOR AT REMOTE LOCATION IN THE FACILITY, 2C SHIELDED CABLE, #18 AWG SOLID
SYNC	2 CONDUCTOR THAT INTERCONNECTS ALL OF THE BOOSTER PANELS FOR SYNCHRONIZATION WITH THE MAIN PANEL MODULES.

ALL CIRCUITS SHALL BE CLASS B / STYLE 4
ALL CIRCUITS SHALL BE POWER LIMITED FROM INHEARENT QUALITIES OF THE SYSTEM.

1 PARTIAL GROUND FLOOR SERVICE/PAINT SYSTEMS PLAN
E-4.4

SCALE: 1/8" = 1'-0"

romcke/coburn engineering, co.
CONSULTING ENGINEERS, ELECTRICAL - MECHANICAL
DAVID ROMCKE 50841
11010 Prosperity Farms Rd. Suite 102
Palm Beach Gardens FL 33410
Phone (561) 694-0770 Fax (561) 694-1293
FLORIDA LICENSED ENGINEERS EB 0000783O

SECURITY NETWORKS, L.L.C.
5900 CORPORATE WAY, WEST PALM BEACH FL.
FULL SERVICE FIRE / ALARM, SECURITY COMPANY
C.C.T.V., ACCESS CONTROL, NURSE CALL SYSTEMS
TEL (561) 697-9997 FAX (561) 683-5522
FLORIDA ALARM CONTRACTOR LICENSE#

A NEW AUTOMOBILE DEALERSHIP FOR:
FAIRBANKS SAWGRASS
CHRYSLER / JEEP / DODGE
WESTPOINT CENTRE,
5607 STATE STREET, TAMARAC, FL 33321


revision
- 4/23/02 DLR
- 6/13/02 DLR
- 10/01/02 DLR

comm no 0003628

date 02/25/03

drawing FA4-8

of

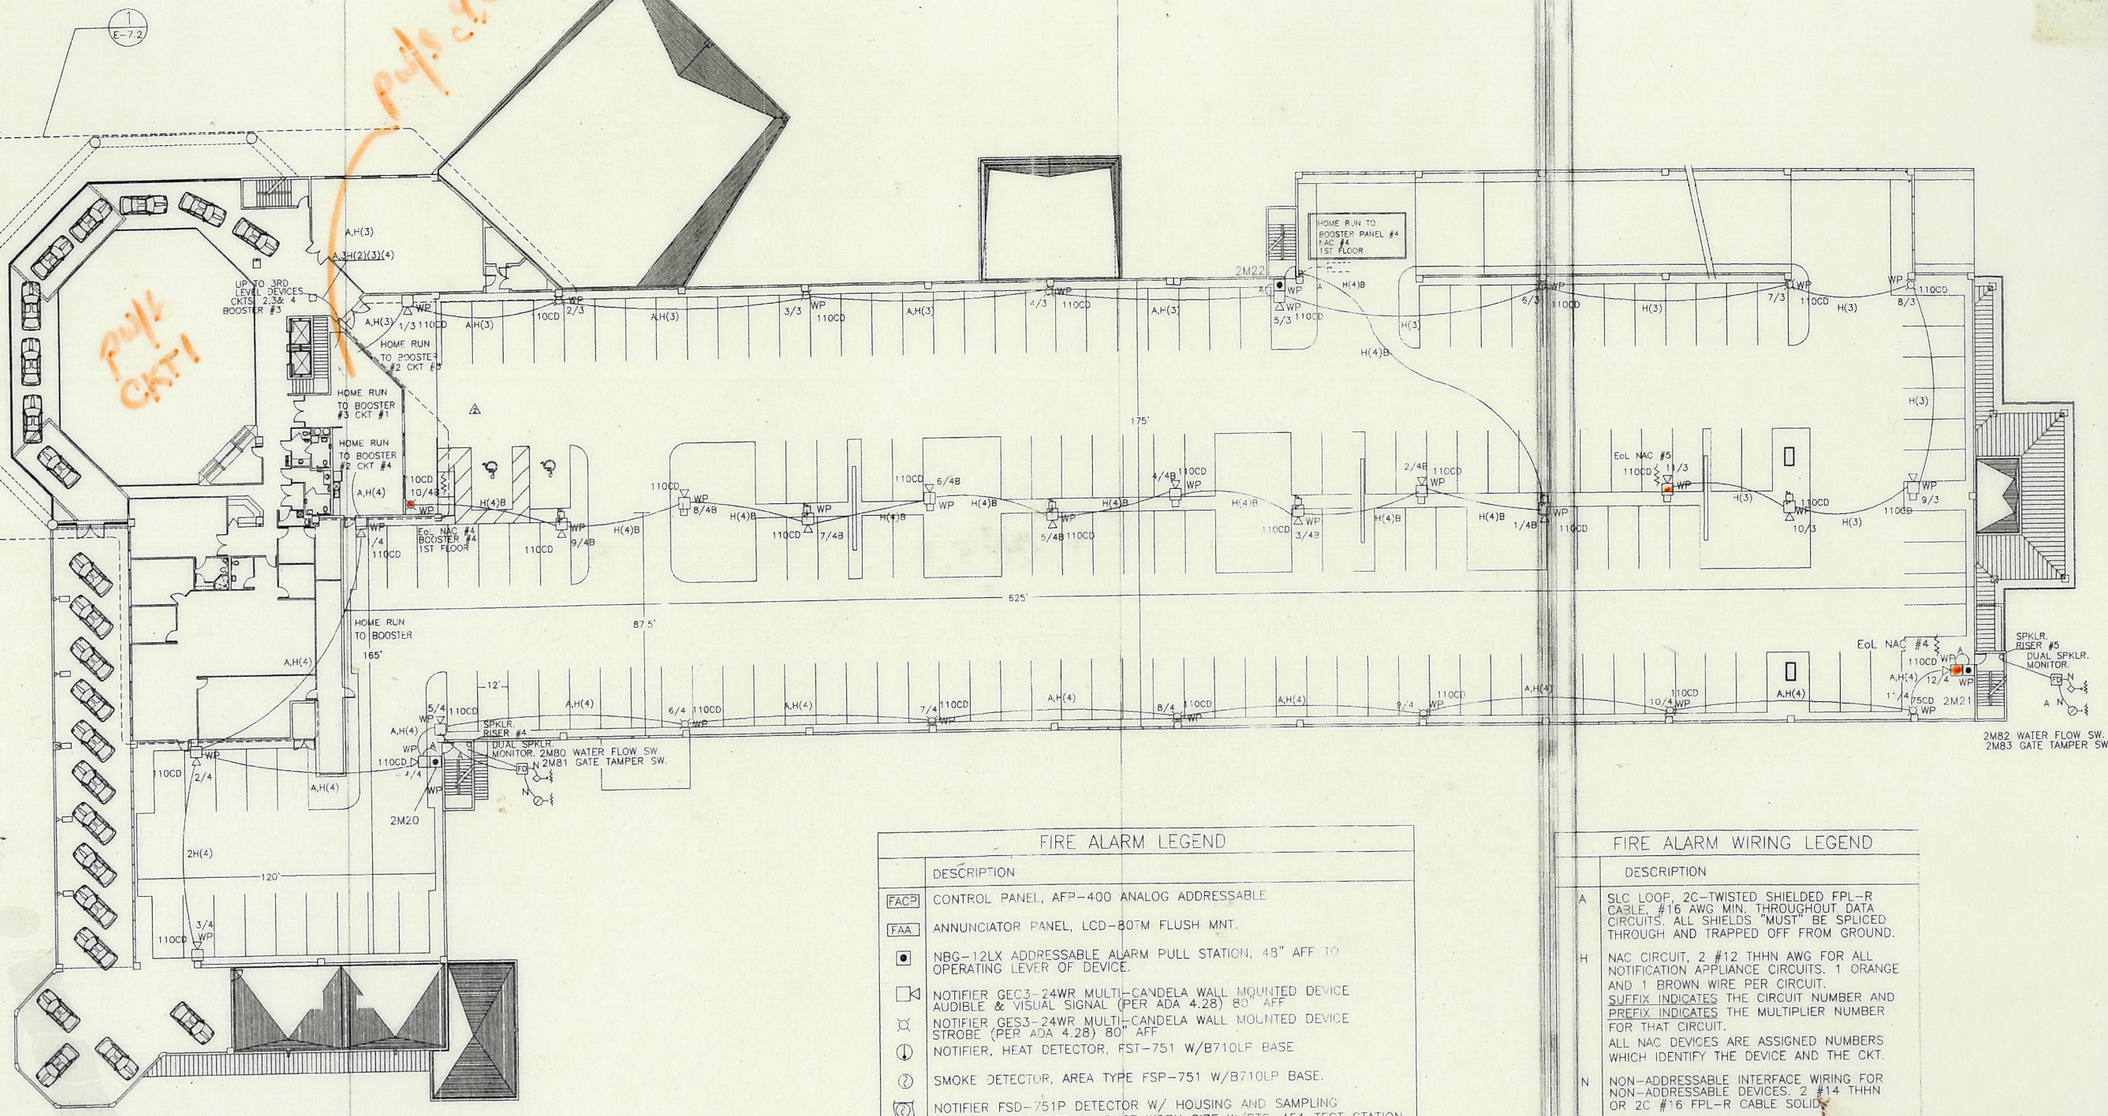

1 / E-7.1 2ND FLOOR PARKING FIRE ALARM SYSTEMS PLAN

SCALE: 1" = 20'-0"

FIRE ALARM LEGEND

	DESCRIPTION
FACP	CONTROL PANEL, AFP-400 ANALOG ADDRESSABLE
FAA	ANNUNCIATOR PANEL, LCD-80TM FLUSH MNT.
	NBG-12LX ADDRESSABLE ALARM PULL STATION, 48" AFF TO OPERATING LEVER OF DEVICE.
	NOTIFIER GEC3-24WR MULTI-CANDELA WALL MOUNTED DEVICE AUDIBLE & VISUAL SIGNAL (PER ADA 4.28) 80" AFF
	NOTIFIER GES3-24WR MULTI-CANDELA WALL MOUNTED DEVICE STROBE (PER ADA 4.28) 80" AFF
	NOTIFIER, HEAT DETECTOR, FST-751 W/B710LP BASE
	SMOKE DETECTOR, AREA TYPE FSP-751 W/B710LP BASE.
	NOTIFIER FSD-751P DETECTOR W/ HOUSING AND SAMPLING TUBES AS REQUIRED BY DUCT WORK SIZE W/RTS-451 TEST STATION.
R	NOTIFIER FRM-1 ADDRESSABLE RELAY MODULE, DUAL FORM "C".
TS	GATE VALVE TAMPER SWITCH(s) BY OTHERS W/ MONITOR MOD.S
FS	FLOW SWITCH (s) BY OTHERS W/ MONITOR MODS. AS LISTED.
MX	ADDRESSABLE MONITOR MODULE "CLASS "B", FMM-101
CX	ADDRESSABLE CONTROL MODULE "FORM C" FRM-1
FD	ADDRESSABLE DUAL MONITOR MODULE "CLASS "B", FDM-1
NAC-B	REMOTE BOOSTER POWER SUPPLY FOR N.A.C.(s) AS REQUIRED. POWER LIMITED AND CLASS "B" OPERATION
DIALER	UDACT U.L. LISTED COMMUNICATOR HOUSED IN FACP

Dual Phone lines W/RJ31X Jacks are Required
PME
5/29/03

FIRE ALARM WIRING LEGEND

	DESCRIPTION
A	SLC LOOP, 2C-TWISTED SHIELDED FPL-R CABLE, #16 AWG MIN. THROUGHOUT DATA CIRCUITS. ALL SHIELDS "MUST" BE SPLICED THROUGH AND TRAPPED OFF FROM GROUND.
H	NAC CIRCUIT, 2 #12 THHN AWG FOR ALL NOTIFICATION APPLIANCE CIRCUITS. 1 ORANGE AND 1 BROWN WIRE PER CIRCUIT. SUFFIX INDICATES THE CIRCUIT NUMBER AND PREFIX INDICATES THE MULTIPLIER NUMBER FOR THAT CIRCUIT. ALL NAC DEVICES ARE ASSIGNED NUMBERS WHICH IDENTIFY THE DEVICE AND THE CKT.
N	NON-ADDRESSABLE INTERFACE WIRING FOR NON-ADDRESSABLE DEVICES. 2 #14 THHN OR 2C #16 FPL-R CABLE SOLID
P	24VDC AUXILIARY POWER AS REQUIRED TO OPERATE AS PART OF THE FIRE ALARM . SYSTEM. EX; ANNUNCIATORS, DOOR HOLDERS
AN	DATA CIRCUIT FOR ANNUNCIATOR AT REMOTE LOCATION IN THE FACILITY. 2C SHIELDED CABLE, #18 AWG SOLID.
SYNC	2 CONDUCTOR THAT INTERCONNECTS ALL OF THE BOOSTER PANELS FOR SYNCRONIZATION. WITH THE MAIN PANEL MODULES.

ALL CIRCUITS SHALL BE CLASS B / STYLE 4
ALL CIRCUITS SHALL BE POWER LIMITED FROM INHEARENT QUALITIES OF THE SYSTEM.

SECURITY NETWORKS L.L.C.
5800 CORPORATE WAY, WEST PALM BEACH FL.
FULL SERVICE FIRE ALARM, SECURITY COMPANY
C.C.T.V., ACCESS CONTROL, NURSE CALL SYSTEMS
TEL (561) 697-9997 FAX (561) 683-5522
FLORIDA ALARM CONTRACTOR SP0000213

A NEW AUTOMOBILE DEALERSHIP FOR:
FAIRBANKS SAWGRASS
CHRYSLER / JEEP / DODGE
WESTPOINT CENTRE,
5607 STATE STREET, TAMARAC, FL 33321

revision
- 4/23/02 DLR
- 6/13/02 DLR
- 10/01/02 DLR

comm no 0003628


date 02/25/03

drawing FA5-

of

romcke coburn engineering, co.
CONSULTING ENGINEERS ELECTRICAL MECHANICAL
DAVID ROMCKE NO. 50841
11000 Prosperity Farms Rd. Suite 102 P.B. Gardens Fl 33410
Phone (561) 694-0770 Fax (561) 694-1293
FLORIDA LICENSED ENGINEERS EB 0007830

12/29
3/12/03

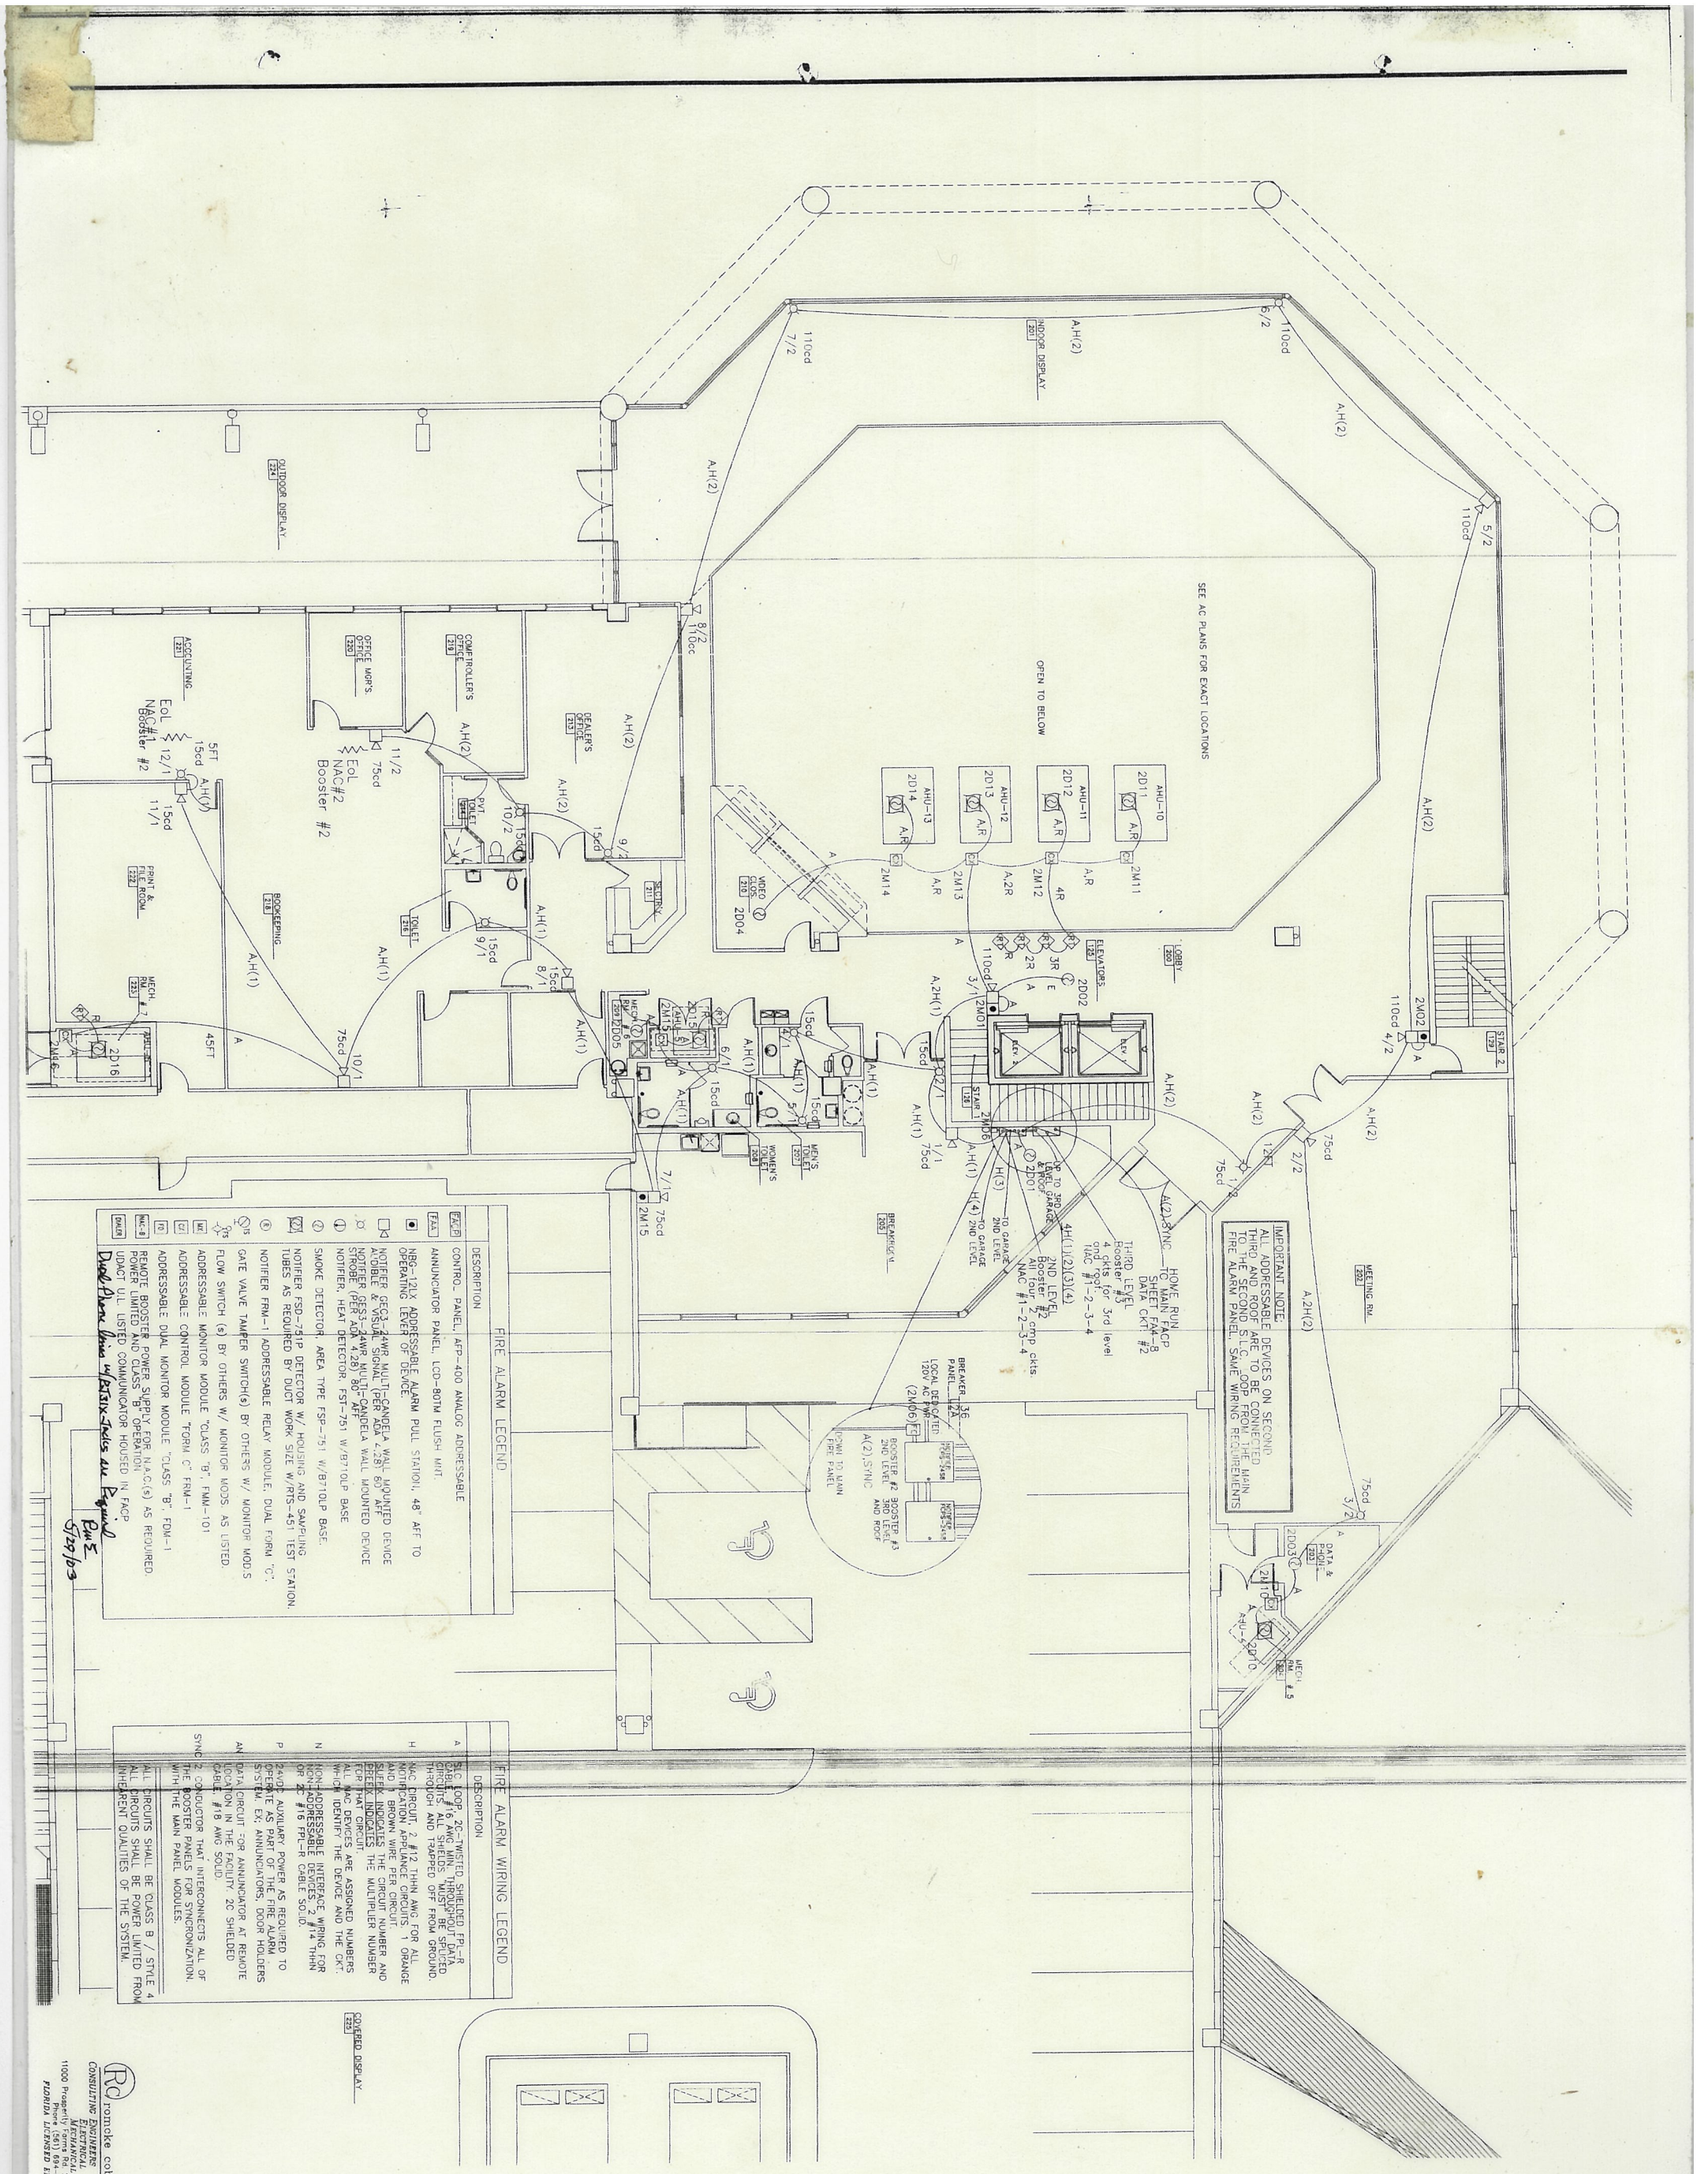

FIRE ALARM LEGEND	
FACP	CONTROL PANEL, AFP-400 ANALOG ADDRESSABLE
FAPS	ANNUNCIATOR PANEL, LCD-80TM FLUSH MNT.
	NBG-12LX ADDRESSABLE ALARM PULL STATION, 48 AFF TO OPERATING LEVER OF DEVICE.
	NOTIFIER SEGS-24WR-MULTI-CANDELA WALL MOUNTED DEVICE ADDRESSABLE, 15-110 CANDELA WALL MOUNTED DEVICE
	NOTIFIER SEGS-24WR-MULTI-CANDELA WALL MOUNTED DEVICE STROBE PER ADA 4.28) 80" AFF.
	NOTIFIER, HEAT DETECTOR, FST-751 W/B710LP BASE.
	SMOKE DETECTOR AREA TYPE FSP-751 W/B710LP BASE.
	NOTIFIER FSD-751P DETECTOR W/ HOUSING AND SAMPLING TUBES AS REQUIRED BY DUCT WORK SIZE W/RTS-451 TEST STATION.
	NOTIFIER FRM-1 ADDRESSABLE RELAY MODULE, DUAL FORM "C".
	GATE VALVE TAMPER SWITCH(S) BY OTHERS W/ MONITOR MODS
FS	FLOW SWITCH (S) BY OTHERS W/ MONITOR MODS AS LISTED
MI	ADDRESSABLE MONITOR MODULE "CLASS "B", FMM-101
CI	ADDRESSABLE CONTROL MODULE "FORM C" FRM-1
DUAL	ADDRESSABLE DUAL MONITOR MODULE "CLASS "B", FDM-1
BACK-UP	REMOTE BOOSTER POWER SUPPLY FOR N.A.C.(s) AS REQUIRED. POWER LIMITED AND CLASS "B" OPERATION
BMCR	UDACT U.L. LISTED COMMUNICATOR HOUSED IN FACP

FIRE ALARM WIRING LEGEND	
A	S.L.C. LOOP, 2C-TWISTED, SHIELDED FPL-LR CABLE AS MANUFACTURED BY ALPHA WIRE CORP. ALL SHIELDS MUST BE SPLICED THROUGH AND TRAPPED OFF FROM GROUND.
H	NAC CIRCUIT, 2-#12 THHN AWG FOR ALL NOTIFICATION APPLIANCE CIRCUITS 1 ORANGE AND 1 BROWN WIRE PER CIRCUIT
	ALL DEVICES ARE ASSIGNED NUMBERS SUCH AS 2M01 WHICH IDENTIFY THE DEVICE AND THE CKT.
N	NON-ADDRESSABLE INTERFACE WIRING FOR NOTIFICATION APPLIANCES #14 THHN OR #12 THHN FPL-LR CABLE SOLID
P	120 VOLT AUXILIARY POWER AS REQUIRED TO OPERATE AS PART OF THE FIRE ALARM SYSTEM EX ANNUNCIATORS, DOOR HOLDERS
	AN RS485 CIRCUIT FOR ANNUNCIATOR AT REMOTE LOCATION IN THE FACILITY 2C SHIELDED CABLE #18 AWG SOLID
	2 CONDUCTOR THAT INTERCONNECTS ALL OF ADDRESSABLE MODULES FOR SYNCHRONIZATION. SYNC. WITH THE MAIN PANEL MODULES
	ALL CIRCUITS SHALL BE CLASS B / STYLE 4
	ALL CIRCUITS SHALL BE POWER LIMITED FROM INHERENT QUALITIES OF THE SYSTEM


Dual Phone lines w/Basix Stats as Required
Ron E. 5/29/03

romcke coburn engineering, co.
CONSULTING ENGINEERS
ELECTRICAL
MECHANICAL
11000 Prosperity Farms Rd., Suite 102, P.B. Gardens, FL 33410
Phone (561) 694-0770 Fax (561) 694-1293
FLORIDA LICENSED ENGINEERS EB 0007859
DAVID L. ROMCKE
No. 50841
STATE OF FLORIDA

drawing	FA6 8
date	02/25/03
comm no	0003628
revision	⚠ 4/23/03 DLR ⚠ 6/13/03 DLR

A NEW AUTOMOBILE DEALERSHIP FOR:
FAIRBANKS SAWGRASS
CHRYSLER / JEEP / DODGE
WESTPOINT CENTRE,
5607 STATE STREET, TAMARAC, FL 33321

SECURITY NETWORKS L.L.C.
5800 CORPORATE WAY, WEST PALM BEACH FL.
FULL SERVICE FIRE ALARM, SECURITY COMPANY
C.C.T.V., ACCESS CONTROL, NURSE CALL SYSTEMS
FLORIDA ALARM CONTRACTOR EF#0000123
TEL (561) 697-9997
FAX (561) 683-5522

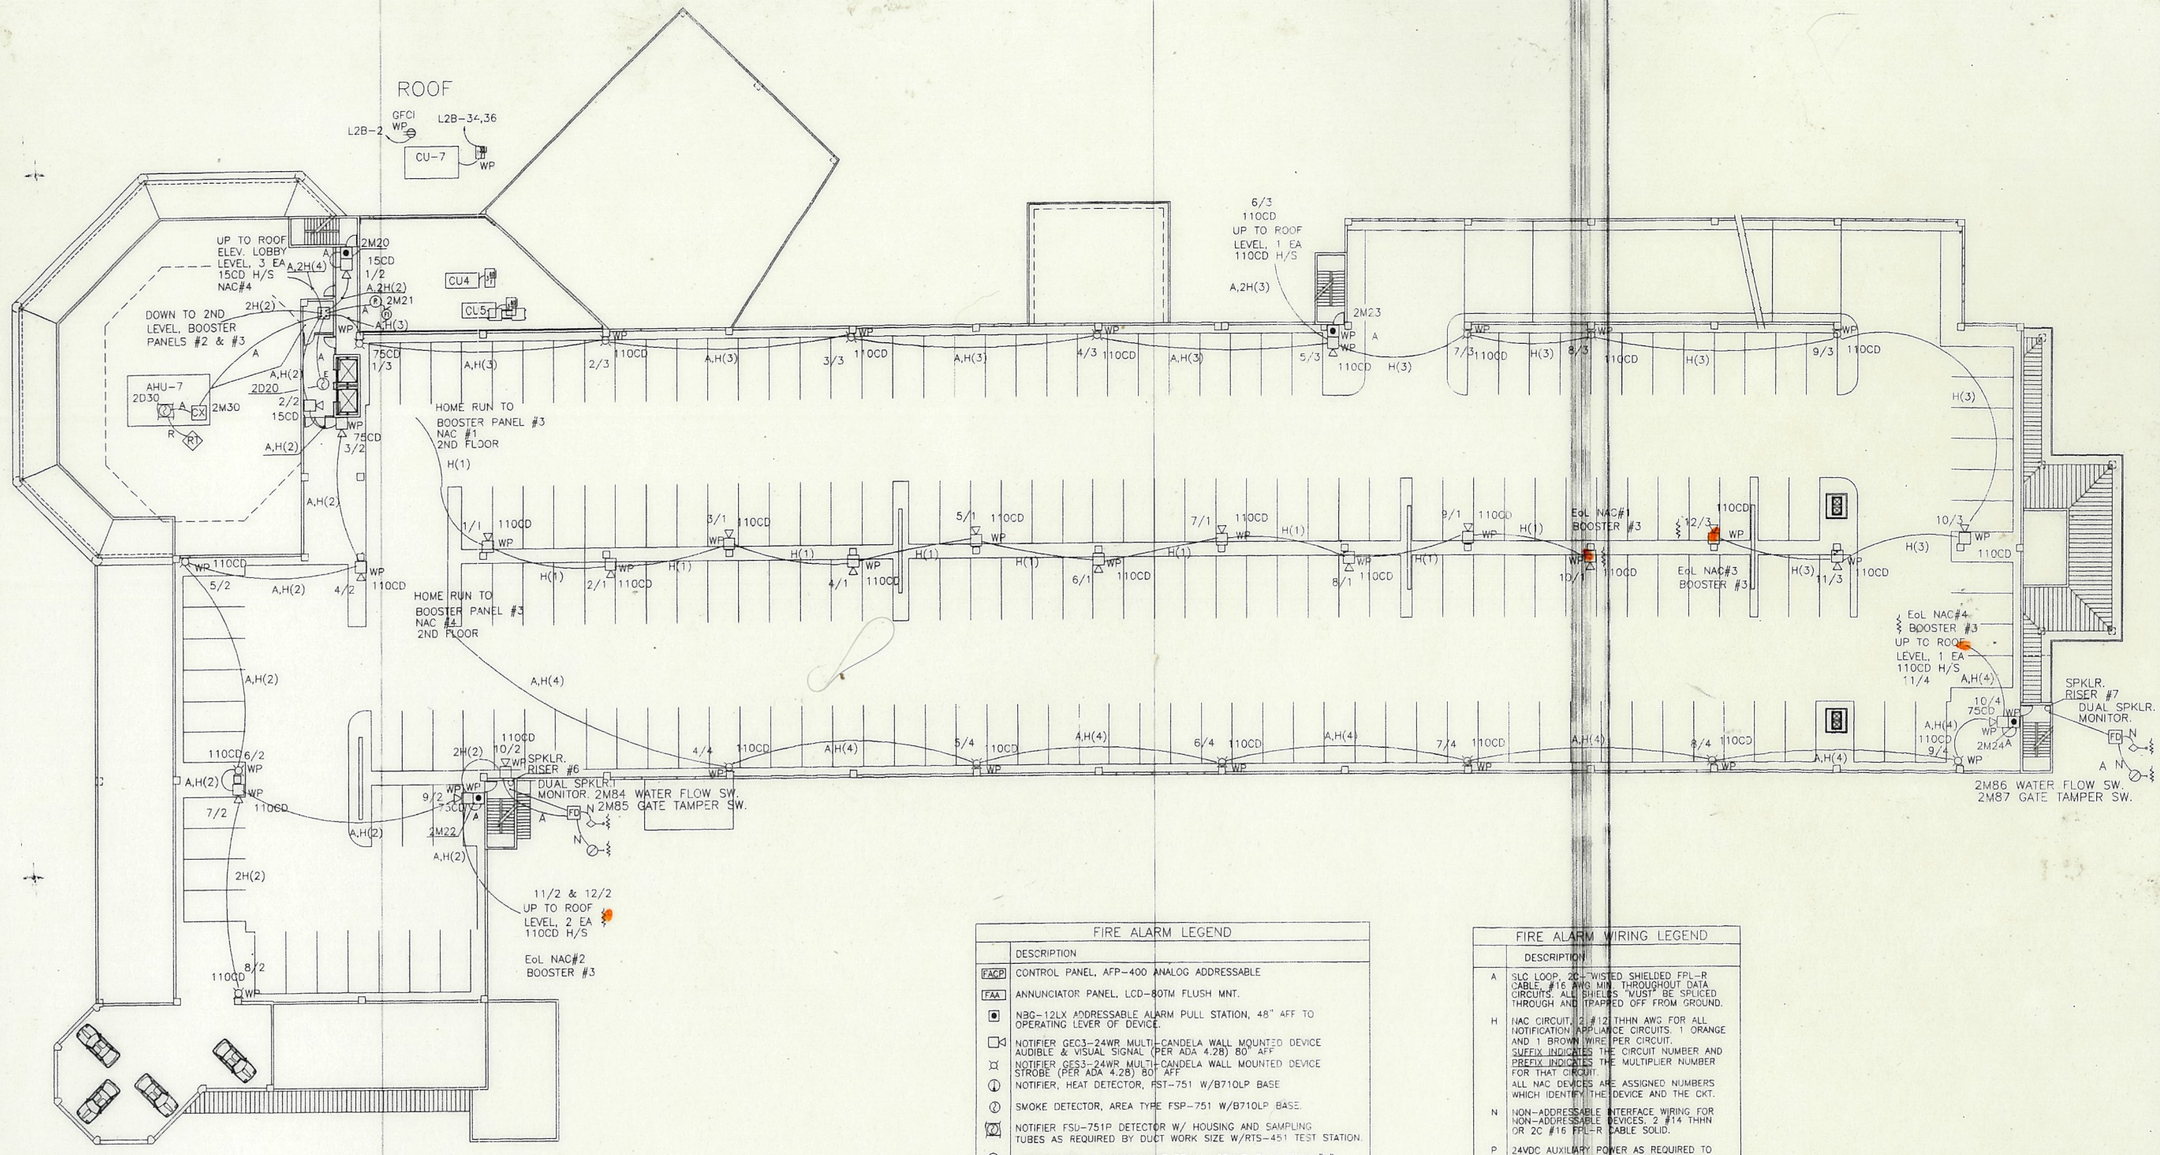

1 / E-8.1 THIRD FLOOR FIRE ALARM SYSTEM PLAN

SCALE: 1 " = 20'-0"

FIRE ALARM LEGEND	
	DESCRIPTION
FACP	CONTROL PANEL, AFP-400 ANALOG ADDRESSABLE
FAA	ANNUNCIATOR PANEL, LCD-80TM FLUSH MNT.
	NBG-12LX ADDRESSABLE ALARM PULL STATION, 48" AFF TO OPERATING LEVER OF DEVICE.
	NOTIFIER GEC3-24WR MULTI-CANDELA WALL MOUNTED DEVICE AUDIBLE & VISUAL SIGNAL (PER ADA 4.28) 80" AFF
	NOTIFIER GES3-24WR MULTI-CANDELA WALL MOUNTED DEVICE STROBE (PER ADA 4.28) 80" AFF
	NOTIFIER, HEAT DETECTOR, FST-751 W/B710LP BASE
	SMOKE DETECTOR, AREA TYPE FSP-751 W/B710LP BASE.
	NOTIFIER FSD-751P DETECTOR W/ HOUSING AND SAMPLING TUBES AS REQUIRED BY DUCT WORK SIZE W/RTS-451 TEST STATION.
	NOTIFIER FRM-1 ADDRESSABLE RELAY MODULE, DUAL FORM "C".
TS	GATE VALVE TAMPER SWITCH(s) BY OTHERS W/ MONITOR MOD.S
FS	FLOW SWITCH (s) BY OTHERS W/ MONITOR MODS. AS LISTED.
M1	ADDRESSABLE MONITOR MODULE "CLASS "B", FMM-101
C7	ADDRESSABLE CONTROL MODULE "FORM C" FRM-1
FD	ADDRESSABLE DUAL MONITOR MODULE "CLASS "B", FDM-1
NAC-B	REMOTE BOOSTER POWER SUPPLY FOR N.A.C.(s) AS REQUIRED. POWER LIMITED AND CLASS "B" OPERATION
UACT	UDACT U.L. LISTED COMMUNICATOR HOUSED IN FACP

Dual Phone Lines w/ RJ31X Jacks are Required
PM E
5/29/03

FIRE ALARM WIRING LEGEND	
	DESCRIPTION
A	SLC LOOP, 2C-TWISTED SHIELDED FPL-R CABLE, #16 AWG MIN. THROUGHOUT DATA CIRCUITS. ALL SHIELDS "MUST" BE SPLICED THROUGH AND TRAPPED OFF FROM GROUND.
H	NAC CIRCUIT, 2 #12 THHN AWG FOR ALL NOTIFICATION APPLIANCE CIRCUITS. 1 ORANGE AND 1 BROWN WIRE PER CIRCUIT. SUFFIX INDICATES THE CIRCUIT NUMBER AND PREFIX INDICATES THE MULTIPLIER NUMBER FOR THAT CIRCUIT. ALL NAC DEVICES ARE ASSIGNED NUMBERS WHICH IDENTIFY THE DEVICE AND THE CKT.
N	NON-ADDRESSABLE INTERFACE WIRING FOR NON-ADDRESSABLE DEVICES. 2 #14 THHN OR 2C #16 FPL-R CABLE SOLID.
P	24VDC AUXILIARY POWER AS REQUIRED TO OPERATE AS PART OF THE FIRE ALARM SYSTEM. Ex: ANNUNCIATORS, DOOR HOLDERS
AN	DATA CIRCUIT FOR ANNUNCIATOR AT REMOTE LOCATION IN THE FACILITY. 2C SHIELDED CABLE, #18 AWG SOLID.
SYNC	2 CONDUCTOR THAT INTERCONNECTS ALL OF THE BOOSTER PANELS FOR SYNCRONIZATION, WITH THE MAIN PANEL MODULES.
	ALL CIRCUITS SHALL BE CLASS B / STYLE 4 ALL CIRCUITS SHALL BE POWER LIMITED FROM INHEARENT QUALITIES OF THE SYSTEM.

romcke coburn engineering, co.
CONSULTING ENGINEERS
ELECTRICAL
MECHANICAL
DAVID ROMCKE
NO. 50841
11000 Prosperity Farms Rd. Suite 102 P B Gardens Fl 33410
Phone (561) 694-0770 Fax (561) 694-1293
FLORIDA LICENSED ENGINEERS EB 0007830

SECURITY NETWORKS L.L.C.
5800 CORPORATE WAY, WEST PALM BEACH FL.
FULL SERVICE FIRE ALARM, SECURITY COMPANY
C.C.T.V., ACCESS CONTROL, NURSE CALL SYSTEMS
TEL (561) 697-9997 FAX (561) 683-5522
FLORIDA ALARM LICENSE CONTRACTOR EF0C00123

A NEW AUTOMOBILE DEALERSHIP FOR:
FAIRBANKS SAWGRASS
CHRYSLER / JEEP / DODGE
WESTPOINT CENTRE,
5607 STATE STREET, TAMARAC, FL 33321

revision
- 4/23/02 DLR
- 6/13/02 DLR
- 10/01/02 DLR

comm no
0003628

date
02/25/03

drawing
FA7-8

of

STAIR #4

DOWN TO THIRD FLOOR DEVICE BOX FOR DATA & NAC EXTENTION.

A,2H(3)

2M51 DOWN

2H(3) WP 6/3 110CD

D E-10.1

CONNECT TO NEAREST DATA CIRCUIT FOR ADDRESSABLE DEVICES. ⚠

RTU3 2D40 WP A 2M40 A,3R A,2R

2R R

RTU2 2D41 2M41 WP A,R

RTU1 2D42 WP 2M42

SEE AC PLANS FOR LOCATIONS

H4A-34,36

EoL FOR NAC #2 BOOSTER #3

12/2 H(2) WP 110CD

11/2 WP 110CD 2M50 A,H(2) DOWN

DOWN TO THIRD FLOOR DEVICE BOX FOR DATA & NAC EXTENTION.

A,H(2)

STAIR #3

10/2

DOWN TO THIRD FLOOR JUNCTION BOX FOR DATA & NAC EXTENTION.

2M45 A 15CD 2/2

A,2H(2)

A,2H(2)

2D46

2D45 E

2D47

2H(2) 15CD 3/2

WP

2H(2) 15CD 4/2

STAIR #2 & ELEVATOR

SCALE: 1/8" = 1'-0"

EoL FOR NAC #4 BOOSTER #3

8/4 H(4) 110CD WP 2M52 DOWN A,H(4)

DOWN TO THIRD FLOOR JUNCTION BOX FOR DATA & NAC EXTENTION.

STAIR #5

FIRE ALARM LEGEND

	DESCRIPTION
FACP	CONTROL PANEL, AFP-400 ANALOG ADDRESSABLE
FAA	ANNUNCIATOR PANEL, LCD-80TM FLUSH MNT.
	NBG-12LX ADDRESSABLE ALARM PULL STATION, 48" AFF TO OPERATING LEVER OF DEVICE.
	NOTIFIER GEC3-24WR MULTI-CANDELA WALL MOUNTED DEVICE AUDIBLE & VISUAL SIGNAL (PER ADA 4.28) 80" AFF
	NOTIFIER GES3-24WR MULTI-CANDELA WALL MOUNTED DEVICE STROBE (PER ADA 4.28) 80" AFF
	NOTIFIER, HEAT DETECTOR, FST-751 W/B710LP BASE
	SMOKE DETECTOR, AREA TYPE FSP-751 W/B710LP BASE.
	NOTIFIER FSD-751P DETECTOR W/ HOUSING AND SAMPLING TUBES AS REQUIRED BY DUCT WORK SIZE W/RTS-451 TEST STATION.
E	NOTIFIER FRM-1 ADDRESSABLE RELAY MODULE, DUAL FORM "C".
TS	GATE VALVE TAMPER SWITCH(s) BY OTHERS W/ MONITOR MOD.S
FS	FLOW SWITCH (s) BY OTHERS W/ MONITOR MODS. AS LISTED.
M	ADDRESSABLE MONITOR MODULE "CLASS "B", FMM-101
C	ADDRESSABLE CONTROL MODULE "FORM C" FRM-1
FD	ADDRESSABLE DUAL MONITOR MODULE "CLASS "B", FDM-1
NAC-B	REMOTE BOOSTER POWER SUPPLY FOR N.A.C.(s) AS REQUIRED. POWER LIMITED AND CLASS "B" OPERATION.
DIALER	UDACT U.L. LISTED COMMUNICATOR HOUSED IN FACP

Dual Phone Lines w/RJ31X Jacks are Required

RM E 5/29/03

FIRE ALARM WIRING LEGEND

	DESCRIPTION
A	SLC LOOP, 2C-TWISTED SHIELDED FPL-R CABLE, #16 AWG MIN. THROUGHOUT DATA CIRCUITS. ALL SHIELDS "MUST" BE SPLICED THROUGH AND TRAPPED OFF FROM GROUND.
H	NAC CIRCUIT, 2 #12 THHN AWG FOR ALL NOTIFICATION APPLIANCE CIRCUITS. 1 ORANGE AND 1 BROWN WIRE PER CIRCUIT. SUFFIX INDICATES THE CIRCUIT NUMBER AND PREFIX INDICATES THE MULTIPLIER NUMBER FOR THAT CIRCUIT. ALL NAC DEVICES ARE ASSIGNED NUMBERS WHICH IDENTIFY THE DEVICE AND THE CKT.
N	NON-ADDRESSABLE INTERFACE WIRING FOR NON-ADDRESSABLE DEVICES. 2 #14 THHN OR 2C #16 FPL-R CABLE SOLID.
P	24VDC AUXILIARY POWER AS REQUIRED TO OPERATE AS PART OF THE FIRE ALARM SYSTEM. EX; ANNUNCIATORS, DOOR HOLDERS
AN	DATA CIRCUIT FOR ANNUNCIATOR AT REMOTE LOCATION IN THE FACILITY. 2C SHIELDED CABLE, #18 AWG SOLID.
SYNC	2 CONDUCTOR THAT INTERCONNECTS ALL OF THE BOOSTER PANELS FOR SYNCRONIZATION. WITH THE MAIN PANEL MODULES.

ALL CIRCUITS SHALL BE CLASS B / STYLE 4
ALL CIRCUITS SHALL BE POWER LIMITED FROM INHEARENT QUALITIES OF THE SYSTEM.

1 E-10.1 ROOF POWER, LIGHTING AND SYSTEMS PLAN

SCALE: 1" = 20'-0"

SECURITY NETWORKS L.L.C.
5800 CORPORATE WAY, WEST PALM BEACH FL.
FULL SERVICE FIRE ALARM, SECURITY COMPANY
C.C.T.V., ACCESS CONTROL, NURSE CALL SYSTEMS
TEL (561) 697-9997 FLORIDA ALARM CONTRACTOR EF9000123 FAX (561) 683-5522

A NEW AUTOMOBILE DEALERSHIP FOR:
FAIRBANKS SAWGRASS
CHRYSLER / JEEP / DODGE
WESTPOINT CENTRE
5607 STATE STREET, TAMARAC, FL 33321

revision
⚠ 04/23/02 DLR
⚠ 06/13/02 DLR
⚠ 10/01/02 DLR

comm no
0003628

date
02/25/03

drawing
FA8-8

of

romcke coburn engineering, co.
CONSULTING ENGINEERS DAVID ROMCKE
ELECTRICAL NO. 50841
MECHANICAL
11000 Prosperity Farms Rd. Suite 102 P.B. Gardens Fl. 33410
Phone (561) 694-0770 Fax (561) 694-1293
FLORIDA LICENSED ENGINEERS EB 0007830

JANITOR'S CLOSET

COMPRESSORS & CONTAINMENT

ELECTRICAL ROOM

FACP

EXISTING FACP

MECHANIC'S PHC TOILET

MECHANIC'S TOILET

MECH. ROOM 3

PS-A

INSTALL NEW NAC POWER BOOSTER PS-A ADJACENT TO EXISTING POWER BOOSTERS LOCATED IN THIS ROOM

NEW BODY SHOP MNGR OFFICE

NEW OFFICE

AHU3A

EXIST OFFICE

EXIST OFFICE

BODY SHOP OFFICES

R-01

P-01

D-01

PSAN1-1

PSAN1-2

PSAN1-3

PSAN1-4

75CD

ER

DH

20215

EXISTING BODY SHOP

SHOIWROOM

DESIGN CENTER

7833

PSAN1-5

STYLE DESK

PSAN1-6

P-02

12582

WOMEN

MEN

15CD

PSAN1-7

PSAN1-8

AHU3

R-02

D-02

CLOSET

PSAN1-9

EXIST PUMP ROOM

OFFICE

OFFICE

PSAN1-10

P-03

AREA OF WORK

THE VALUE OF WORK UNDER THIS PERMIT IS LESS THAN $5000

TROPICAL FIRE & SECURITY SYSTEMS, INC

BY: _____
Kenneth A. Vollbracht
Lic. No. EF0000310

Sworn to me this ____ of ____ 2011

NOTARY STAMP:

Signature of Notary: _____

tropical
fire + security systems inc

CONTRACTOR: TROPICAL FIRE + SECURITY SYSTEMS INC
8145 WEST 28 AVE SUITE 220
HIALEAH, FLORIDA 33016
TEL 305.819.3223 FAX 305.819.3230
LIC EF0000310

A NEW AUTOMOBILE FACILITY FOR SAWGRASS FIAT

WEST POINT CENTRE - 5901 MADISON AVE
TAMARAC, FLORIDA 33321

PLAN DATE: 6-23-11
PERMIT SET: 6-23-11

NO.	DESCRIPTION	DATE

SHEET
FA-01