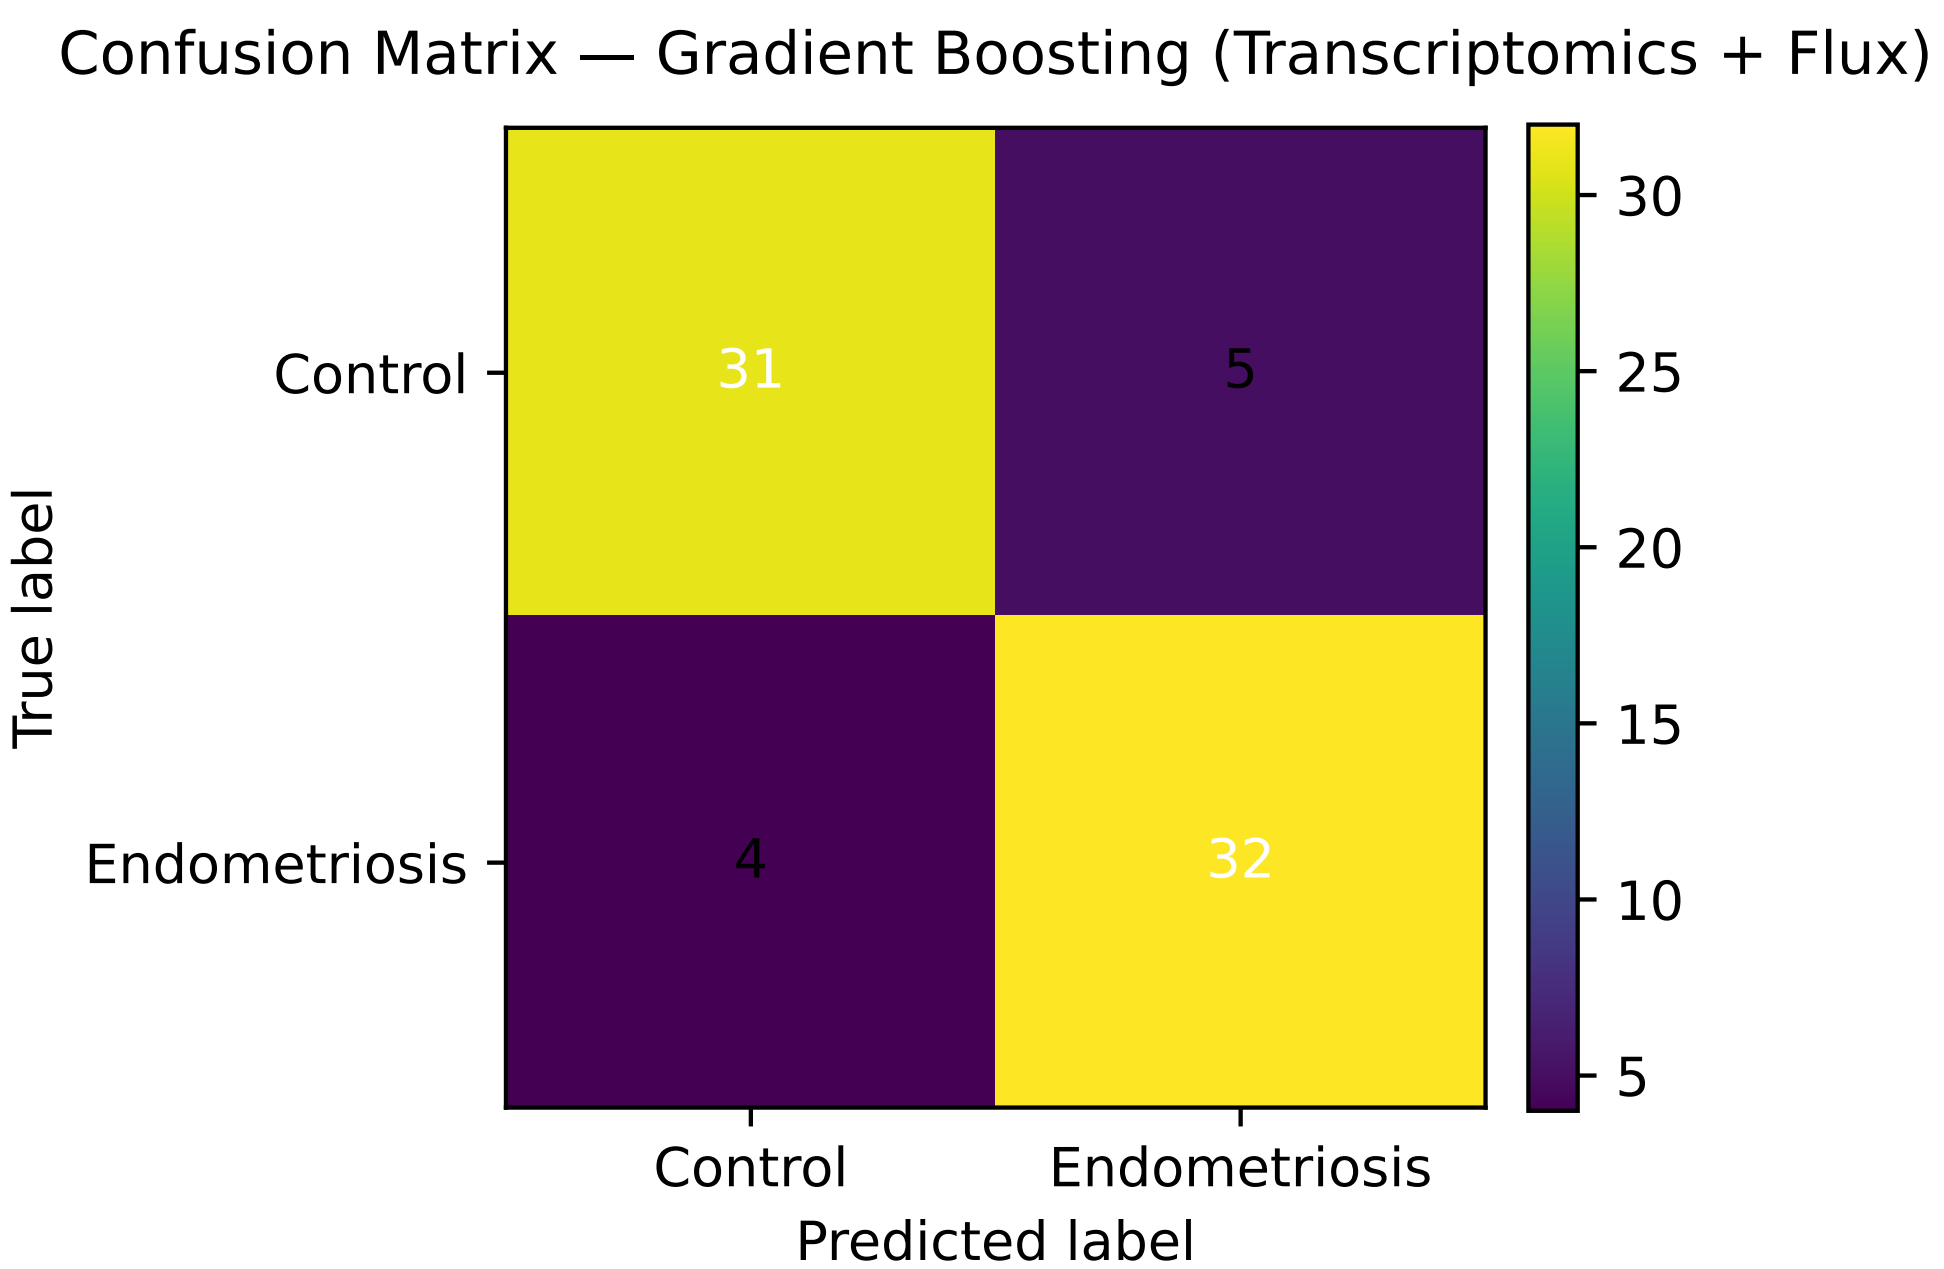
Confusion Matrix — Gradient Boosting (Transcriptomics + Flux)
Control
Endometriosis
True label
31
5
4
32
Control
Endometriosis
Predicted label
30
25
20
15
10
5