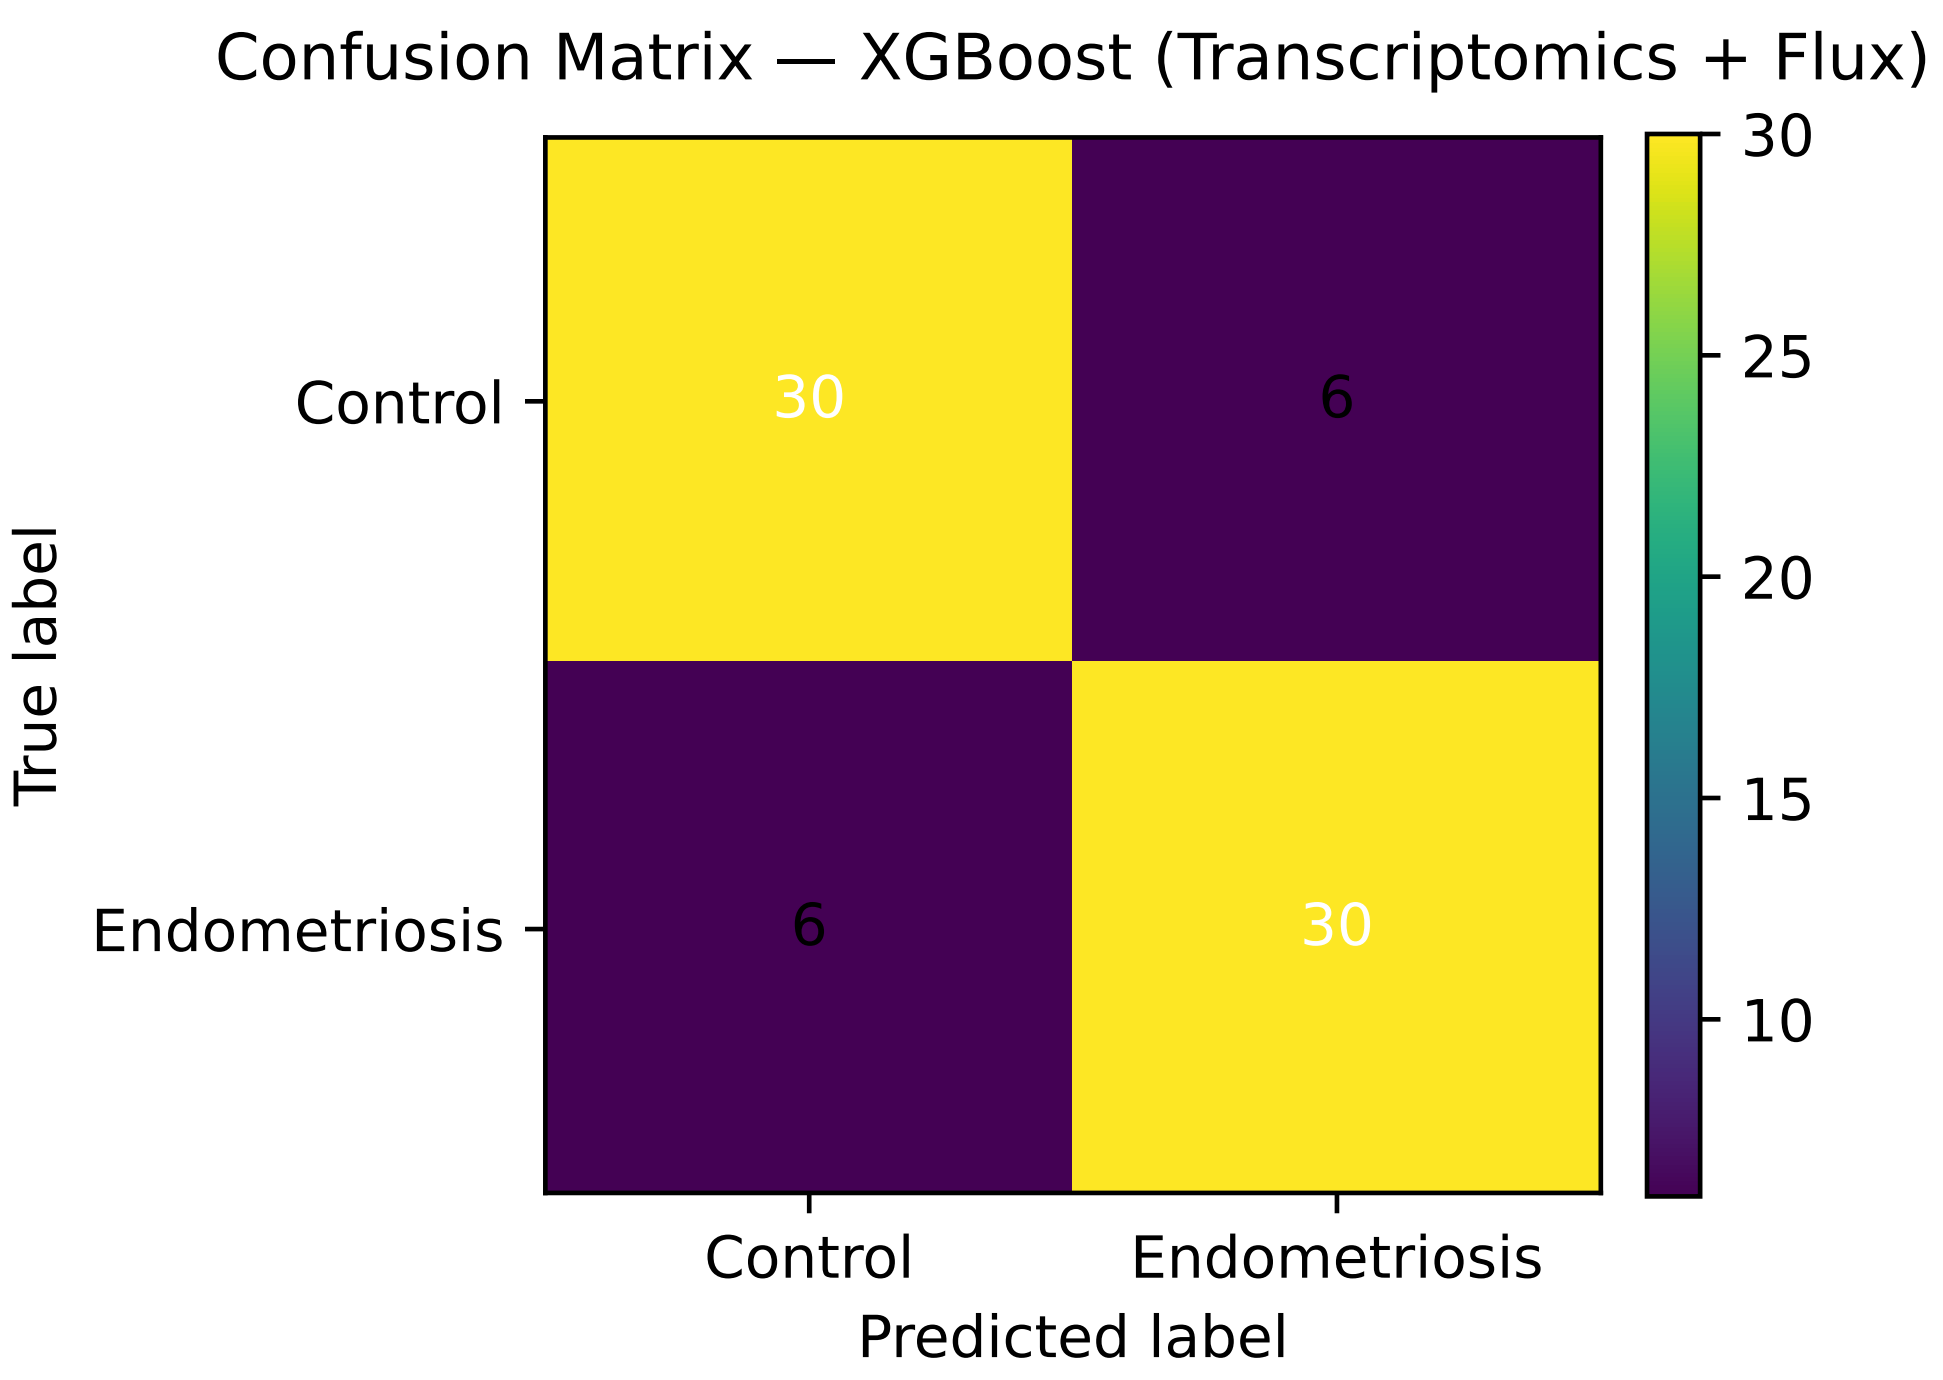
Confusion Matrix — XGBoost (Transcriptomics + Flux)
Control
Endometriosis
True label
30
6
6
30
Control
Endometriosis
Predicted label
30
25
20
15
10