
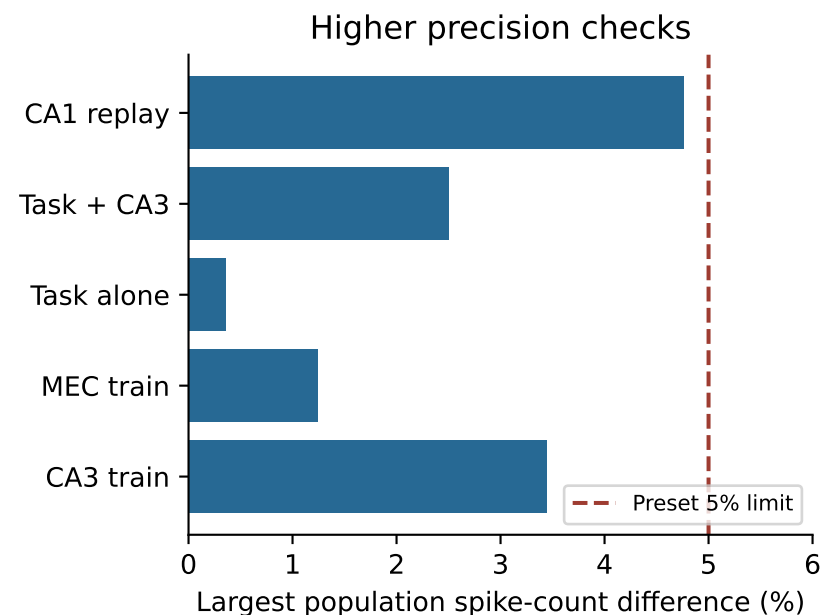
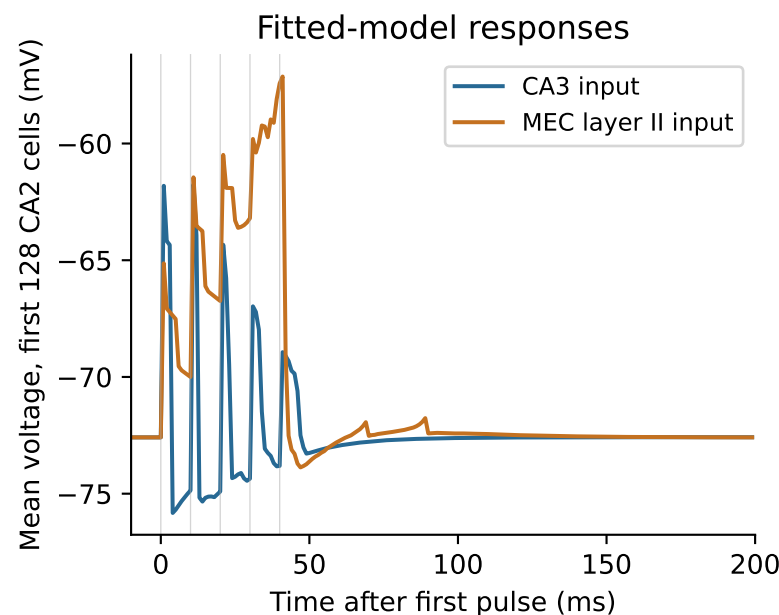


Validation checks for the revised CA2-centered model

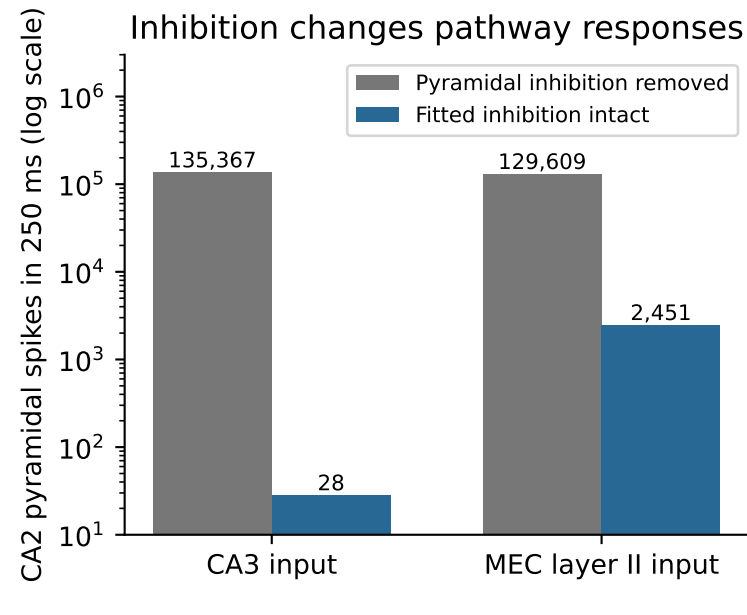

Model seed 20; core traces/counts at 20 substeps/ms; five pulses at 100 Hz. GABA_A reversal assumed -77.8 mV; fitted inhibitory-to-pyramidal gain 100. Core checks: RK4 20 versus 40 substeps/ms. CA1 check: 40 versus 80. These checks support numerical use, not biological validation.