
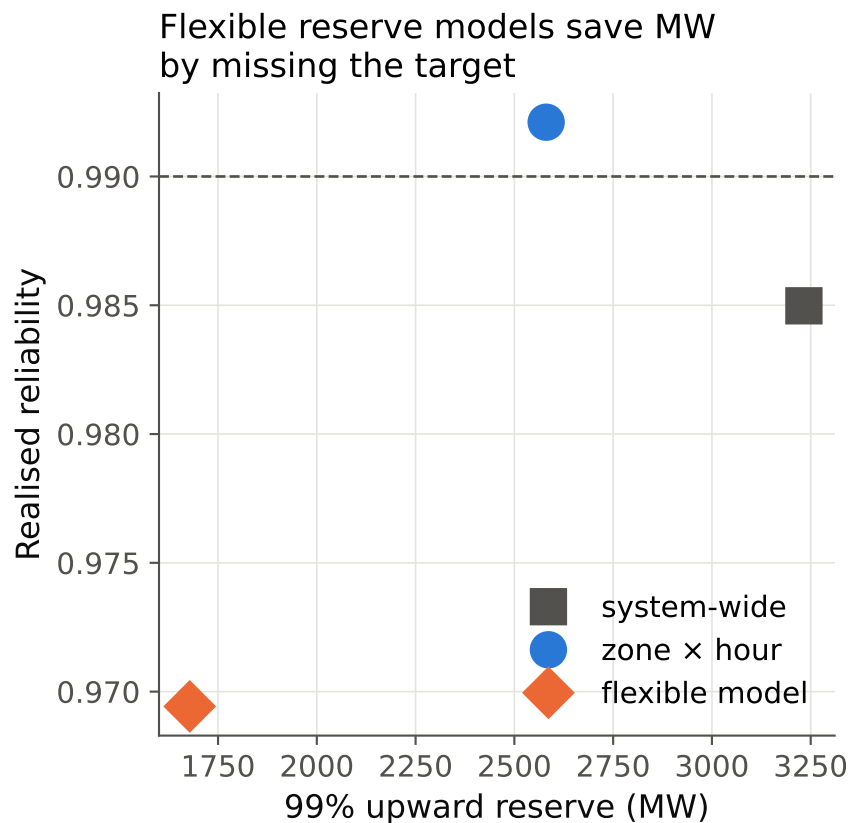


When does adaptive correction of load forecasts pay?

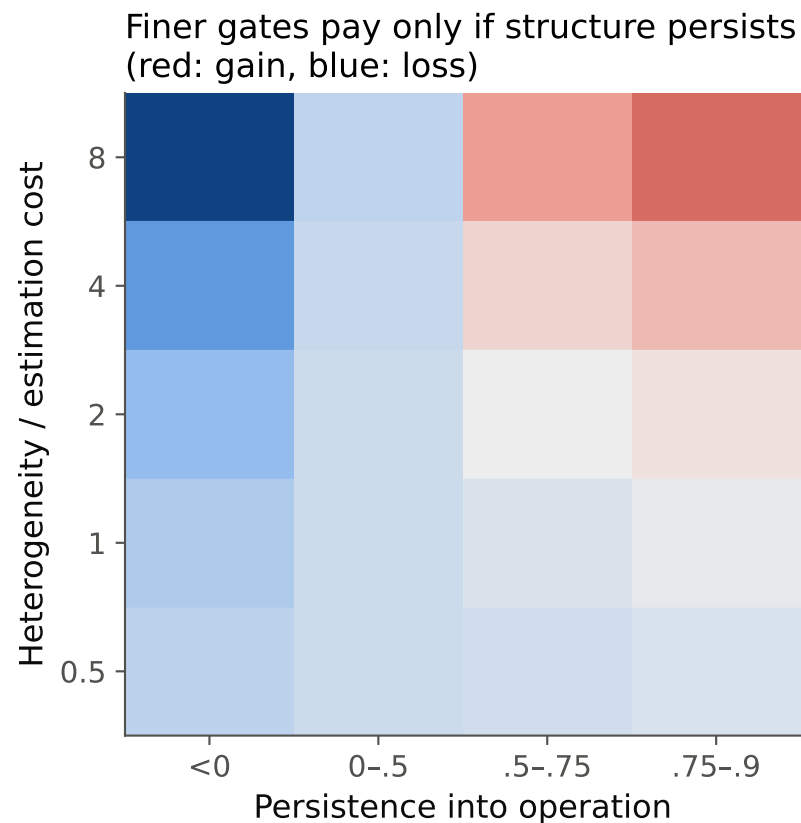

One gate per zone, NYISO 2026

-854 GWh/yr

deviation energy

-234 MW

99% reserve (reliability 99.2%

vs 99.3% before)

Finer and rolling gates: no further gain

Imbalance cost did not fall

(day-ahead price premium)