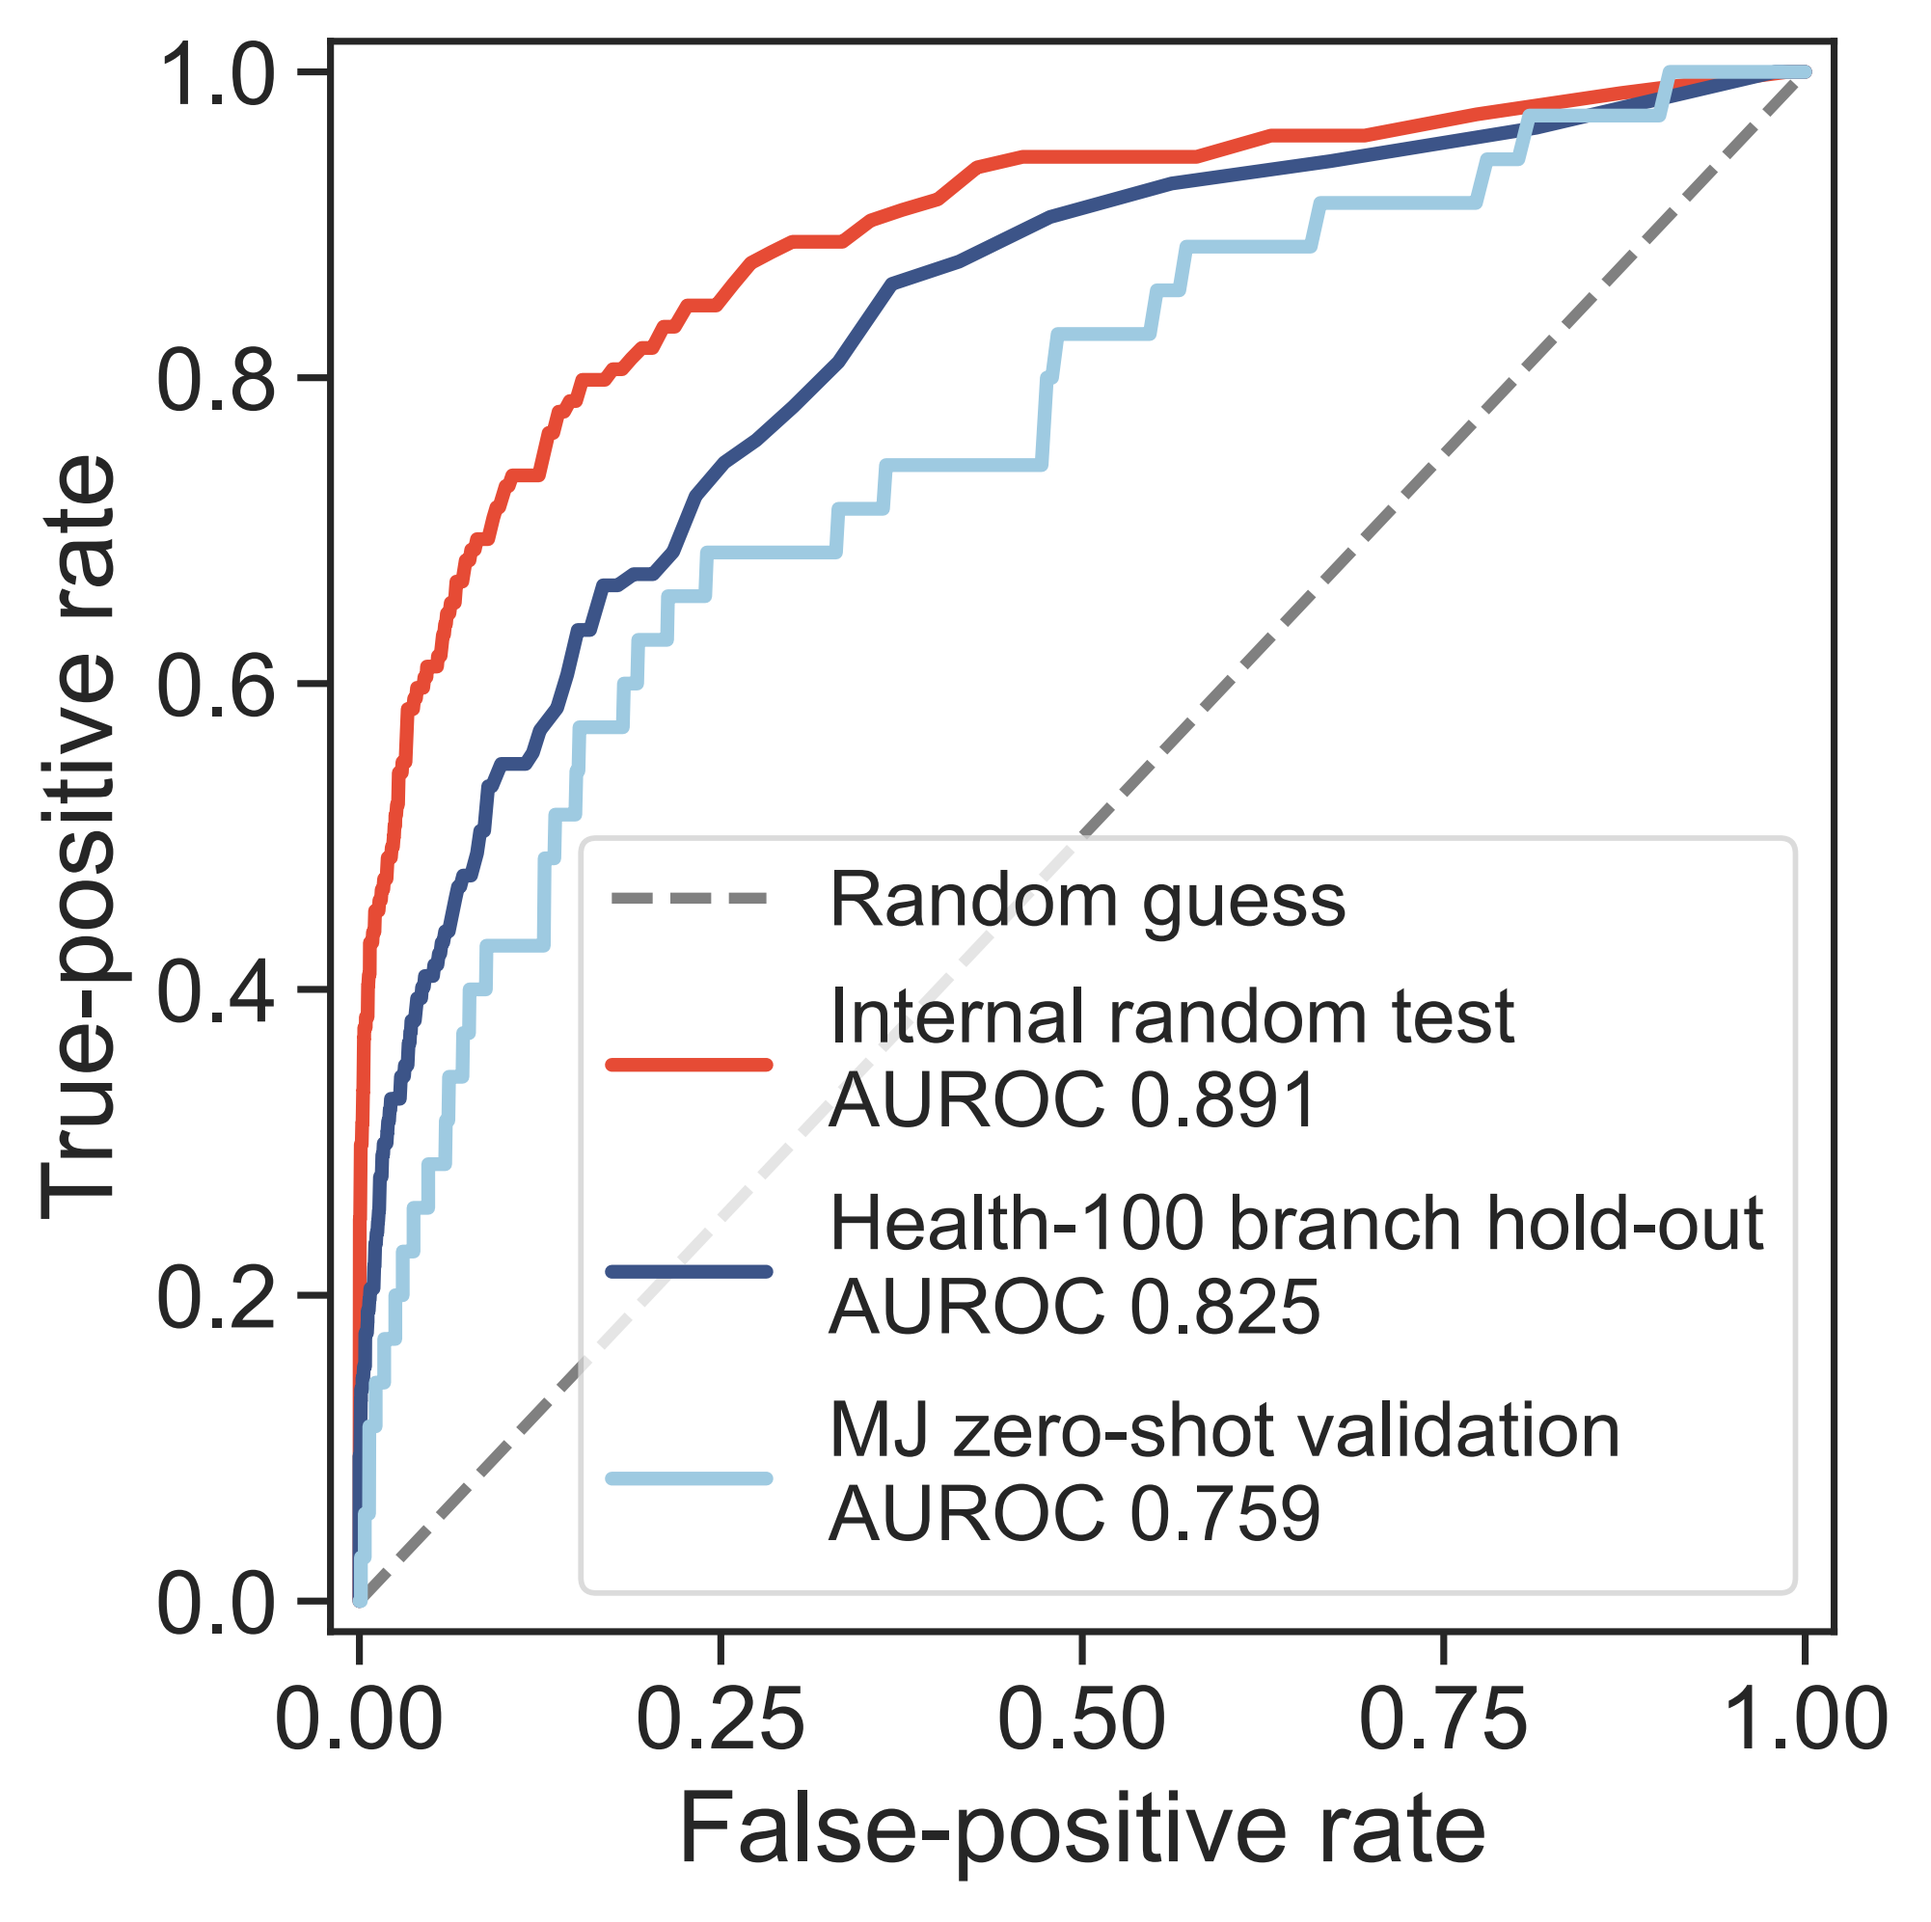
True-positive rate
False-positive rate
0.0
0.2
0.4
0.6
0.8
1.0
0.00
0.25
0.50
0.75
1.00
Random guess
Internal random test
AUROC 0.891
Health-100 branch hold-out
AUROC 0.825
MJ zero-shot validation
AUROC 0.759