

ZAVA TELECOM
DATA CENTER PLANT DIAGRAM

Lower Ridge Edge Facility -- Floor 1
DWG: DC-PLT-TR-001 REV: E
SCALE: 1:100 DATE: 2026-04-28
ENG: K. Nakamura, PE SHEET: 1 of 1

MEET-ME ROOM (MMR)

ODF-A 34/48 active

ODF-B 28/48 active

ODF-C 12/48 active

ODF-D 8/48 active

ODF-E 0/48 active

ODF-F 0/48 active

CARRIER DEMARC

AT&T Lumen Zayo

Crown Cogent DarkFiber

UPS / POWER ROOM

UPS-A (500kVA)

UPS-B (500kVA)

ATS-1

ATS-2

PDU Bank



NETWORK OPERATIONS


WS-1 WS-2 WS-3 WS-4

MONITORING DISPLAYS (6x 55")

NOC SWITCH: 10GbE x 48

MECHANICAL / COOLING

CRAC-1 CRAC-2 CRAC-3 Chiller Pump

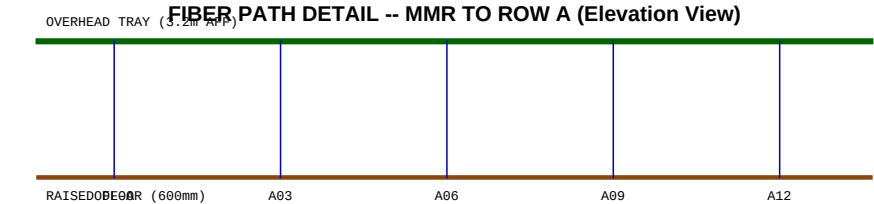

NOTE (05/01): FIBER: ODF-A/B fed via Sec 3-5 (42 cust). C05-C08 hot. CRAC-2 issue. If conduit fails, ODF-A+B down.
Ref: FRD-2026-04-28, FSE-2026-0041. --Sharma

APPROVED:
K. Nakamura, PE 2026-04-28
M. Webb, Ops Mgr 2026-04-29