



ENVIRONMENTAL MONITORING REPORT

Report Type: MONTHLY | Generated: 3/26/2026, 8:48:34 AM

1. Executive Summary

This report presents environmental monitoring data collected from the EBA System over the period of 3/25/2026 to 3/25/2026. A total of 26 data points were recorded and analyzed. During this period, the average temperature was 22.0°C, with a maximum of 23.3°C and a minimum of 0.0°C. Relative humidity averaged 73.5%, while CO₂ levels averaged 2415 ppm. CO₂ levels exceeded recommended thresholds, indicating poor air quality that requires ventilation.

Data Overview

Total Records: 26

Date Range: 3/25/2026 to 3/25/2026

Parameters: Temperature, Humidity, CO₂, Soil Moisture, Water Level

2. Detailed Sensor Data

Timestamp	CO ₂ , (ppm)
3/25/2026, 9:11:25 PM	3731
3/25/2026, 9:13:25 PM	3790
3/25/2026, 9:15:25 PM	3770
3/25/2026, 9:15:54 PM	3665
3/25/2026, 9:19:54 PM	3645
3/25/2026, 9:27:54 PM	3545
3/25/2026, 9:29:56 PM	0
3/25/2026, 9:35:54 PM	3399
3/25/2026, 9:43:54 PM	3319
3/25/2026, 9:47:54 PM	3245
3/25/2026, 9:51:53 PM	3152
3/25/2026, 9:55:54 PM	3138
3/25/2026, 9:59:54 PM	2914
3/25/2026, 10:03:53 PM	2784
3/25/2026, 10:25:44 PM	781
3/25/2026, 10:29:44 PM	983
3/25/2026, 10:33:44 PM	1177
3/25/2026, 10:37:44 PM	1372
3/25/2026, 10:41:44 PM	1503

3. Statistical Analysis

This section provides statistical analysis of all monitored environmental parameters. For Temperature, values ranged from 22.2 to 23.3 °C, with an average of 22.8 °C and a standard deviation of 0.4 °C. For Humidity, values ranged from 75.7 to 77.8 %, with an average of 76.4 % and a standard deviation of 0.7 %. For CO₂, values ranged from 781.0 to 3790.0 ppm, with an average of 2511.9 ppm and a standard deviation of 981.6 ppm. For Soil Moisture, values ranged from 0.0 to 0.0 %, with an average of 0.0 % and a standard deviation of 0.0 %. CO₂ levels exceed recommended thresholds, indicating poor indoor air quality that requires immediate ventilation.

Temperature Analysis

Min: 22.2°C	Max: 23.3°C	Avg: 22.8°C	Std Dev: 0.4°C
-------------	-------------	-------------	----------------

Humidity Analysis

Min: 75.7%	Max: 77.8%	Avg: 76.4%	Std Dev: 0.7%
------------	------------	------------	---------------

CO₂ Analysis

Min: 781.0ppm	Max: 3790.0ppm	Avg: 2511.9ppm	Std Dev: 981.6ppm
---------------	----------------	----------------	-------------------

Soil Moisture Analysis

Min: 0.0%	Max: 0.0%	Avg: 0.0%	Std Dev: 0.0%
-----------	-----------	-----------	---------------

4. Data Visualizations

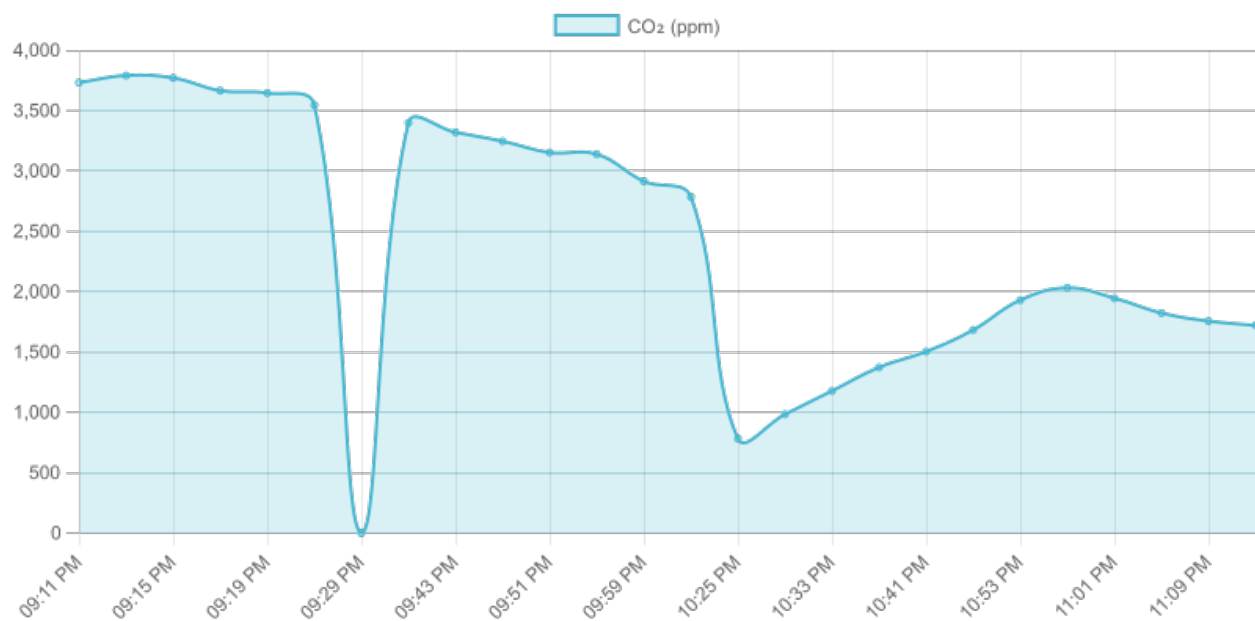


Figure 1: Time series analysis of environmental parameters

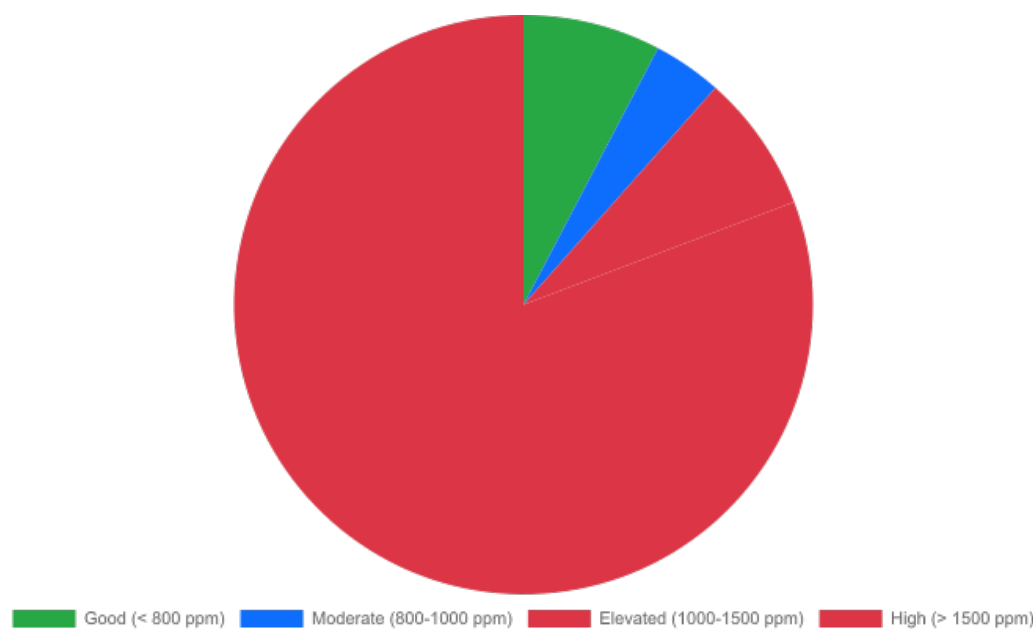


Figure 2: CO₂ Level Distribution

5. Recommendations

Based on the collected data, the following actions are recommended:

- CRITICAL: CO₂ levels exceed safety thresholds. Implement immediate ventilation protocols and consider HVAC system inspection.
-

