

1. Executive Summary

This report presents environmental monitoring data collected by the EBA System over the period 4/6/2026 – 4/6/2026. A total of 80 records were retrieved; 80 contained valid sensor readings (0 heartbeat-only records excluded). Average temperature was 24.9°C (range: 24.0 – 25.8°C). Relative humidity averaged 62.0%. CO2 averaged 1116.0 ppm. CO2 levels exceeded safe thresholds, requiring immediate ventilation. Soil moisture averaged 9.5%. Water level averaged 13.5%.

TEMPERATURE

24.9 °C

Min 24.0 / Max 25.8

HUMIDITY

62.0%

Min 60.0 / Max 64.0

CO2

1116.0 ppm

Min 800.0 / Max 1432.0

SOIL MOISTURE

9.5%

Min 0.0 / Max 19.0

WATER LEVEL

13.5%

Min 10.0 / Max 17.0

Records: 80

| Date Range: 4/6/2026 – 4/6/2026

| Params: Temperature | Humidity | CO2 | Soil | Water

2. Detailed Sensor Data

Timestamp	Temp (°C)	Humidity (%)	CO2 (ppm)	Soil (%)	Water (%)	Interval
4/6/2026, 12:00:00 PM	24.0°C	60.0%	800	0%	10%	--
4/6/2026, 12:05:00 PM	24.3°C	61.0%	808	1%	11%	--
4/6/2026, 12:10:00 PM	24.6°C	62.0%	816	2%	12%	--
4/6/2026, 12:15:00 PM	24.9°C	63.0%	824	3%	13%	--
4/6/2026, 12:20:00 PM	25.2°C	64.0%	832	4%	14%	--
4/6/2026, 12:25:00 PM	25.5°C	60.0%	840	5%	15%	--
4/6/2026, 12:30:00 PM	25.8°C	61.0%	848	6%	16%	--
4/6/2026, 12:35:00 PM	24.0°C	62.0%	856	7%	17%	--
4/6/2026, 12:40:00 PM	24.3°C	63.0%	864	8%	10%	--
4/6/2026, 12:45:00 PM	24.6°C	64.0%	872	9%	11%	--
4/6/2026, 12:50:00 PM	24.9°C	60.0%	880	10%	12%	--
4/6/2026, 12:55:00 PM	25.2°C	61.0%	888	11%	13%	--
4/6/2026, 1:00:00 PM	25.5°C	62.0%	896	12%	14%	--
4/6/2026, 1:05:00 PM	25.8°C	63.0%	904	13%	15%	--
4/6/2026, 1:10:00 PM	24.0°C	64.0%	912	14%	16%	--
4/6/2026, 1:15:00 PM	24.3°C	60.0%	920	15%	17%	--
4/6/2026, 1:20:00 PM	24.6°C	61.0%	928	16%	10%	--

Timestamp	Temp (°C)	Humidity (%)	CO2 (ppm)	Soil (%)	Water (%)	Interval
4/6/2026, 1:25:00 PM	24.9°C	62.0%	936	17%	11%	--
4/6/2026, 1:30:00 PM	25.2°C	63.0%	944	18%	12%	--
4/6/2026, 1:35:00 PM	25.5°C	64.0%	952	19%	13%	--
4/6/2026, 1:40:00 PM	25.8°C	60.0%	960	0%	14%	--
4/6/2026, 1:45:00 PM	24.0°C	61.0%	968	1%	15%	--
4/6/2026, 1:50:00 PM	24.3°C	62.0%	976	2%	16%	--
4/6/2026, 1:55:00 PM	24.6°C	63.0%	984	3%	17%	--
4/6/2026, 2:00:00 PM	24.9°C	64.0%	992	4%	10%	--
4/6/2026, 2:05:00 PM	25.2°C	60.0%	1000	5%	11%	--
4/6/2026, 2:10:00 PM	25.5°C	61.0%	1008	6%	12%	--
4/6/2026, 2:15:00 PM	25.8°C	62.0%	1016	7%	13%	--
4/6/2026, 2:20:00 PM	24.0°C	63.0%	1024	8%	14%	--
4/6/2026, 2:25:00 PM	24.3°C	64.0%	1032	9%	15%	--
4/6/2026, 2:30:00 PM	24.6°C	60.0%	1040	10%	16%	--
4/6/2026, 2:35:00 PM	24.9°C	61.0%	1048	11%	17%	--
4/6/2026, 2:40:00 PM	25.2°C	62.0%	1056	12%	10%	--
4/6/2026, 2:45:00 PM	25.5°C	63.0%	1064	13%	11%	--
4/6/2026, 2:50:00 PM	25.8°C	64.0%	1072	14%	12%	--
4/6/2026, 2:55:00 PM	24.0°C	60.0%	1080	15%	13%	--
4/6/2026, 3:00:00 PM	24.3°C	61.0%	1088	16%	14%	--
4/6/2026, 3:05:00 PM	24.6°C	62.0%	1096	17%	15%	--
4/6/2026, 3:10:00 PM	24.9°C	63.0%	1104	18%	16%	--
4/6/2026, 3:15:00 PM	25.2°C	64.0%	1112	19%	17%	--
4/6/2026, 3:20:00 PM	25.5°C	60.0%	1120	0%	10%	--
4/6/2026, 3:25:00 PM	25.8°C	61.0%	1128	1%	11%	--
4/6/2026, 3:30:00 PM	24.0°C	62.0%	1136	2%	12%	--
4/6/2026, 3:35:00 PM	24.3°C	63.0%	1144	3%	13%	--
4/6/2026, 3:40:00 PM	24.6°C	64.0%	1152	4%	14%	--
4/6/2026, 3:45:00 PM	24.9°C	60.0%	1160	5%	15%	--
4/6/2026, 3:50:00 PM	25.2°C	61.0%	1168	6%	16%	--
4/6/2026, 3:55:00 PM	25.5°C	62.0%	1176	7%	17%	--
4/6/2026, 4:00:00 PM	25.8°C	63.0%	1184	8%	10%	--
4/6/2026, 4:05:00 PM	24.0°C	64.0%	1192	9%	11%	--
4/6/2026, 4:10:00 PM	24.3°C	60.0%	1200	10%	12%	--
4/6/2026, 4:15:00 PM	24.6°C	61.0%	1208	11%	13%	--
4/6/2026, 4:20:00 PM	24.9°C	62.0%	1216	12%	14%	--
4/6/2026, 4:25:00 PM	25.2°C	63.0%	1224	13%	15%	--
4/6/2026, 4:30:00 PM	25.5°C	64.0%	1232	14%	16%	--
4/6/2026, 4:35:00 PM	25.8°C	60.0%	1240	15%	17%	--

Timestamp	Temp (°C)	Humidity (%)	CO2 (ppm)	Soil (%)	Water (%)	Interval
4/6/2026, 4:40:00 PM	24.0°C	61.0%	1248	16%	10%	--
4/6/2026, 4:45:00 PM	24.3°C	62.0%	1256	17%	11%	--
4/6/2026, 4:50:00 PM	24.6°C	63.0%	1264	18%	12%	--
4/6/2026, 4:55:00 PM	24.9°C	64.0%	1272	19%	13%	--
4/6/2026, 5:00:00 PM	25.2°C	60.0%	1280	0%	14%	--
4/6/2026, 5:05:00 PM	25.5°C	61.0%	1288	1%	15%	--
4/6/2026, 5:10:00 PM	25.8°C	62.0%	1296	2%	16%	--
4/6/2026, 5:15:00 PM	24.0°C	63.0%	1304	3%	17%	--
4/6/2026, 5:20:00 PM	24.3°C	64.0%	1312	4%	10%	--
4/6/2026, 5:25:00 PM	24.6°C	60.0%	1320	5%	11%	--
4/6/2026, 5:30:00 PM	24.9°C	61.0%	1328	6%	12%	--
4/6/2026, 5:35:00 PM	25.2°C	62.0%	1336	7%	13%	--
4/6/2026, 5:40:00 PM	25.5°C	63.0%	1344	8%	14%	--
4/6/2026, 5:45:00 PM	25.8°C	64.0%	1352	9%	15%	--
4/6/2026, 5:50:00 PM	24.0°C	60.0%	1360	10%	16%	--
4/6/2026, 5:55:00 PM	24.3°C	61.0%	1368	11%	17%	--
4/6/2026, 6:00:00 PM	24.6°C	62.0%	1376	12%	10%	--
4/6/2026, 6:05:00 PM	24.9°C	63.0%	1384	13%	11%	--
4/6/2026, 6:10:00 PM	25.2°C	64.0%	1392	14%	12%	--
4/6/2026, 6:15:00 PM	25.5°C	60.0%	1400	15%	13%	--
4/6/2026, 6:20:00 PM	25.8°C	61.0%	1408	16%	14%	--
4/6/2026, 6:25:00 PM	24.0°C	62.0%	1416	17%	15%	--
4/6/2026, 6:30:00 PM	24.3°C	63.0%	1424	18%	16%	--
4/6/2026, 6:35:00 PM	24.6°C	64.0%	1432	19%	17%	--

3. Statistical Analysis

This section summarises statistical analysis across all monitored environmental parameters. Temperature ranged from 24.0 to 25.8 °C (avg 24.9 °C, <0 = 0.6). Humidity ranged from 60.0 to 64.0 % (avg 62.0 %, <0 = 1.4). CO2 ranged from 800.0 to 1432.0 ppm (avg 1116.0 ppm, <0 = 184.7). Soil Moisture ranged from 0.0 to 19.0 % (avg 9.5 %, <2 Ò Ră,à Water Level ranged from 10.0 to 17.0 % (avg 13.5 %, <2 Ò "ă2'ă

TEMPERATURE

MIN	MAX	AVERAGE	STD DEV	SAMPLES
24.0 °C	25.8 °C	24.9 °C	0.6 °C	80

HUMIDITY

MIN	MAX	AVERAGE	STD DEV	SAMPLES
60.0 %	64.0 %	62.0 %	1.4 %	80

CO2

MIN	MAX	AVERAGE	STD DEV	SAMPLES
800.0 ppm	1432.0 ppm	1116.0 ppm	184.7 ppm	80

SOIL MOISTURE

MIN	MAX	AVERAGE	STD DEV	SAMPLES
0.0 %	19.0 %	9.5 %	5.8 %	80

WATER LEVEL

MIN	MAX	AVERAGE	STD DEV	SAMPLES
10.0 %	17.0 %	13.5 %	2.3 %	80

4. Data Visualizations

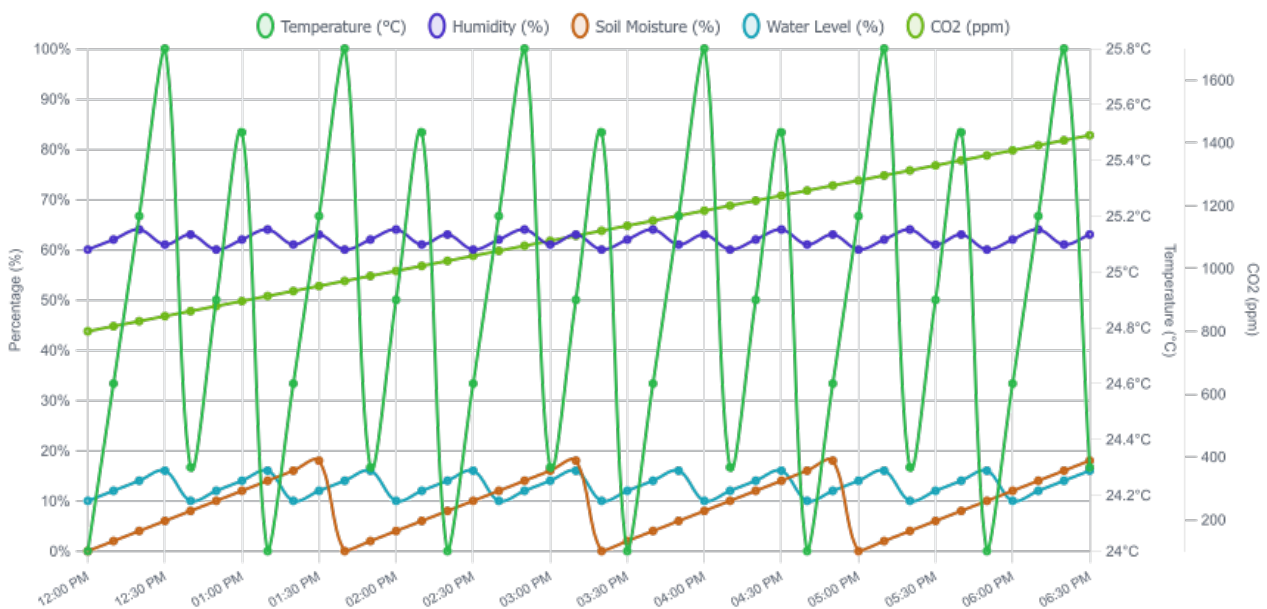


Figure 1: Environmental parameter trends over time (percent on left where applicable; temperature and CO2 on right scales).

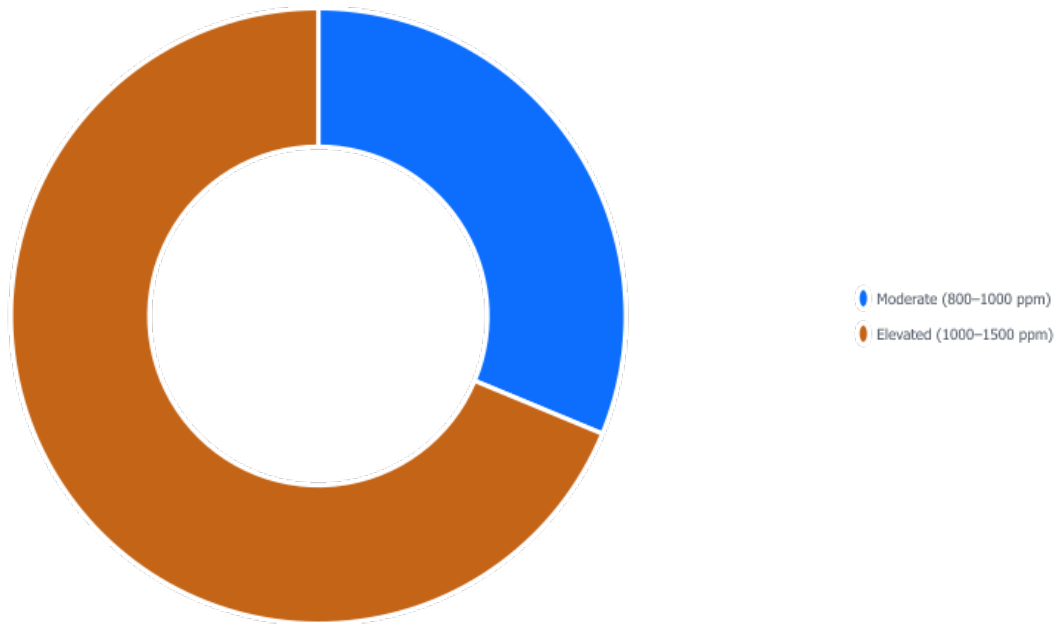


Figure 2: CO2 level distribution across all recorded readings

5. Recommendations

Based on collected data, the following actions are recommended:

- Temperature is within the optimal 18–28°C range. Continue regular monitoring.
- Humidity levels are within the recommended 30–75% range.
- CRITICAL: CO2 exceeds 1000 ppm. Implement immediate ventilation protocols.
- Soil moisture is critically low. Review irrigation scheduling.
- Water level is critically low (< 20%). Refill reservoir promptly.