

Program blocks

MHJ-PLC-Lab-Function-S71500 [FC9000]

MHJ-PLC-Lab-Function-S71500 Properties					
General					
Name	MHJ-PLC-Lab-Function-S71500	Number	9000	Type	FC
Language	SCL	Numbering	Manual		
Information					
Title		Author		Comment	
Family		Version	0.1	User-defined ID	

Name	Data type	Default value	Comment
Input			
Output			
InOut			
▼ Temp			
Value	Byte		
ForCounter	Int		
▼ Constant			
Value_01_DW	DWord	16#1223_5486	
Value_02_DW	DWord	16#A6C9_D1F5	
▼ Return			
MHJ-PLC-Lab-Function-S71500	Void		

```
0001
0002 #Value:=PEEK(area := 16#82,
0003     dbNumber := 0,
0004     byteOffset := 511);
0005 #Value := #Value + 1;
0006
0007 POKE(area := 16#82,
0008     dbNumber := 0,
0009     byteOffset := 511,
0010     value := #Value);
0011
0012 POKE(area := 16#82,
0013     dbNumber := 0,
0014     byteOffset := 1016,
0015     value := #Value_01_DW);
0016 POKE(area := 16#82,
0017     dbNumber := 0,
0018     byteOffset := 1020,
0019     value := #Value_02_DW);
0020
0021 FOR #ForCounter := 0 TO 63 DO
0022     #Value:=PEEK(area := 16#1,
0023         dbNumber := 0,
0024         byteOffset := #ForCounter);
0025     POKE(area := 16#81,
0026         dbNumber := 0,
0027         byteOffset := #ForCounter,
0028         value := #Value);
```

Totally Integrated Automation Portal																							
0029 END_FOR; 0030 #Value := PEEK(area := 16#1, 0031 dbNumber := 0, 0032 byteOffset := 512); 0033 POKE(area := 16#82, 0034 dbNumber := 0, 0035 byteOffset := 512, 0036 value := #Value); 0037 0038																							
<table><tr><th>Symbol</th><th>Address</th><th>Type</th><th>Comment</th></tr><tr><td>#ForCounter</td><td></td><td>Int</td><td></td></tr><tr><td>#Value</td><td></td><td>Byte</td><td></td></tr><tr><td>#Value_01_DW</td><td>16#1223_5486</td><td>DWord</td><td></td></tr><tr><td>#Value_02_DW</td><td>16#A6C9_D1F5</td><td>DWord</td><td></td></tr></table>				Symbol	Address	Type	Comment	#ForCounter		Int		#Value		Byte		#Value_01_DW	16#1223_5486	DWord		#Value_02_DW	16#A6C9_D1F5	DWord	
Symbol	Address	Type	Comment																				
#ForCounter		Int																					
#Value		Byte																					
#Value_01_DW	16#1223_5486	DWord																					
#Value_02_DW	16#A6C9_D1F5	DWord																					

Totally Integrated Automation Portal		
--------------------------------------	--	--

Program blocks

Main [OB1]

Main Properties

General

Name	Main	Number	1	Type	OB
Language	LAD	Numbering	Automatic		

Information

Title	"Main Program Sweep (Cycle)"	Author		Comment	
Family		Version	0.1	User-defined ID	

Name	Data type	Default value	Comment
▼ Input			
Initial_Call	Bool		Initial call of this OB
Remanence	Bool		=True, if remanent data are available
Temp			
Constant			

Network 1: This network is for connecting TIA V-16 with Factory I/O, do not delete.

%FC9000

"MHJ-PLC-Lab-Function-S71500"

EN

ENO

Network 2: Switch ON/OFF

%FC1

"Start/Stop"

EN

ENO

Network 3: Loop States

%FC2

"States"

EN

ENO

Network 4: Actuators define

%FC3

"Actuators"

EN

ENO


Program blocks

Start/Stop [FC1]


Start/Stop Properties					
General					
Name	Start/Stop	Number	1	Type	FC
Language	LAD	Numbering	Automatic		
Information					
Title		Author		Comment	
Family		Version	0.1	User-defined ID	

Name	Data type	Default value	Comment
Input			
Output			
InOut			
Temp			
Constant			
▼ Return			
Start/Stop	Void		

Network 1: Start System

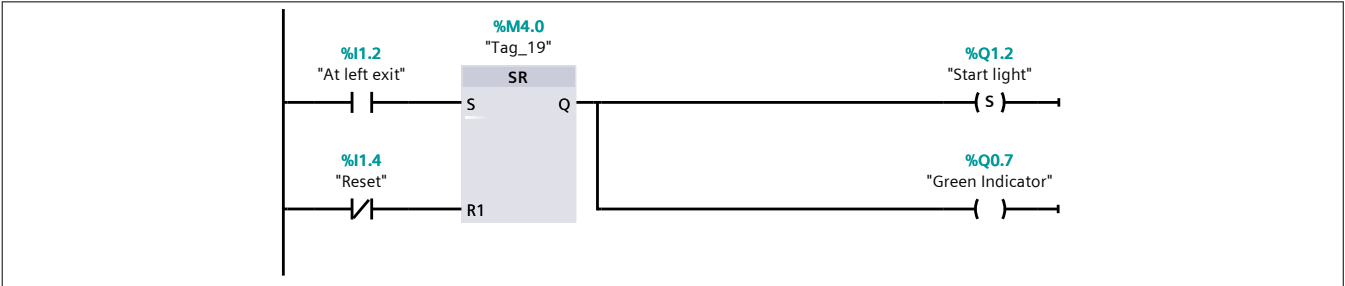

Network 2: Stop System

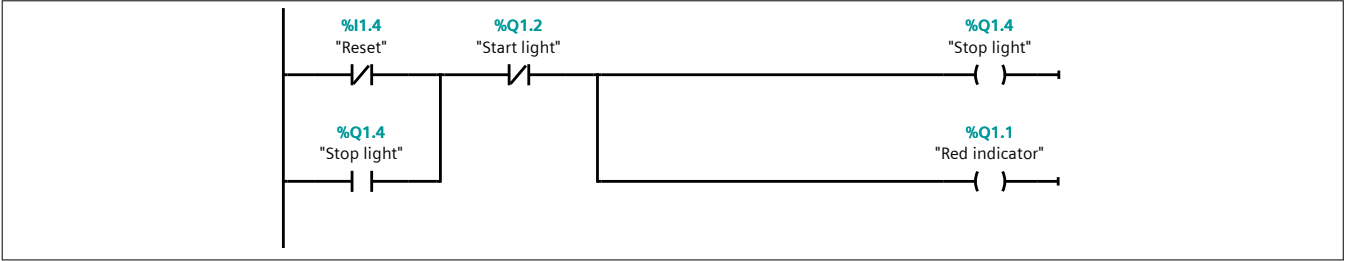


Program blocks

States [FC2]


States Properties					
General					
Name	States	Number	2	Type	FC
Language	LAD	Numbering	Automatic		
Information					
Title	States of the	Author		Comment	In this Programm, we will make every actuator is a state, and we will focus on Set Reset conditions, POV : we will not consider which first and which after because it isn't re-current
Family		Version	0.1	User-defined ID	

Name	Data type	Default value	Comment
Input			
Output			
InOut			
Temp			
Constant			
▼ Return			
States	Void		


Network 1: Reset Loop

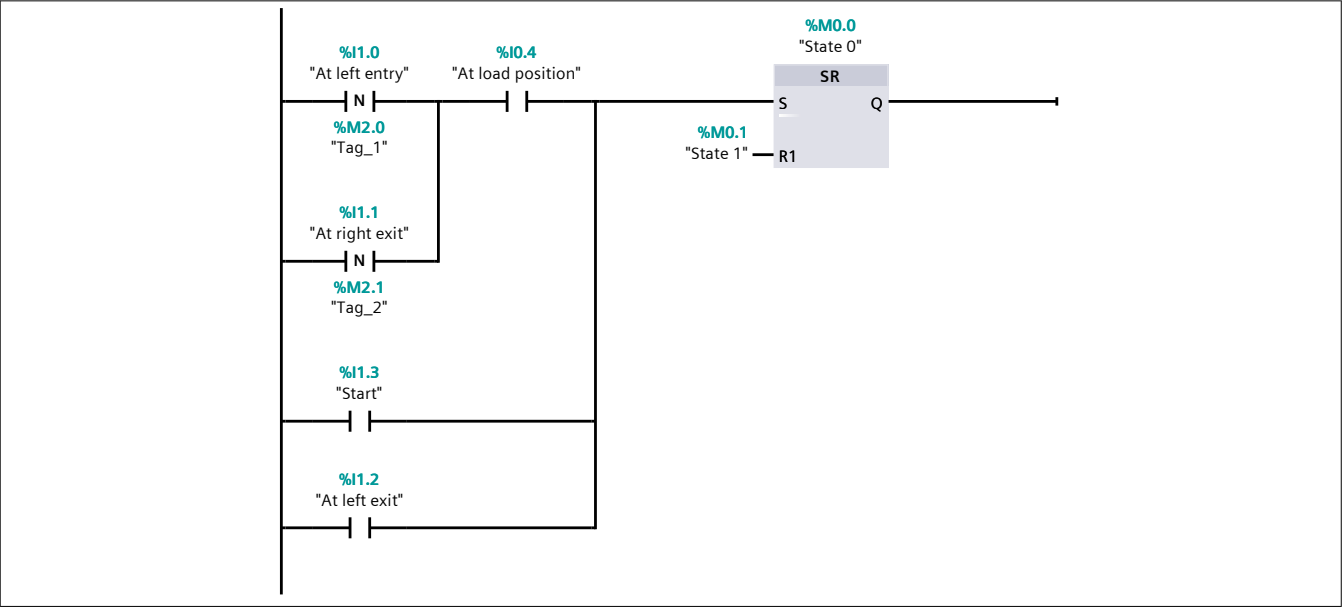


Network 2: Feeding Conveyor

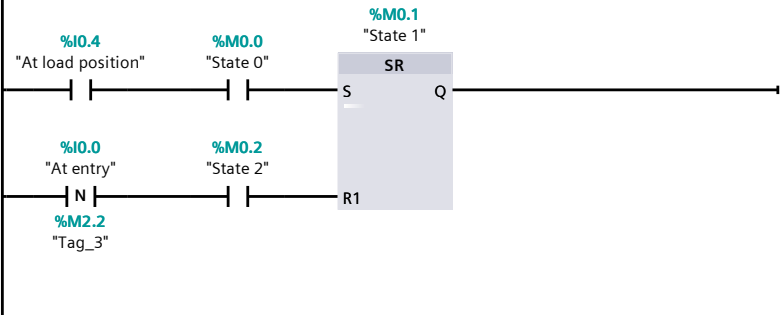


Network 3: Entry conveyor

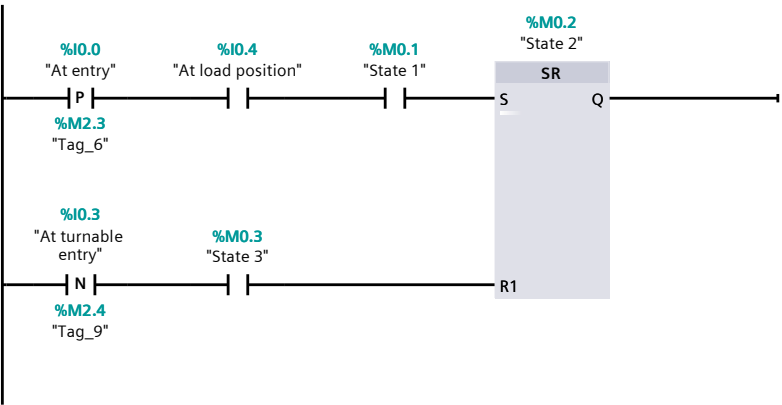


Network 4: Load on table + transfer to left

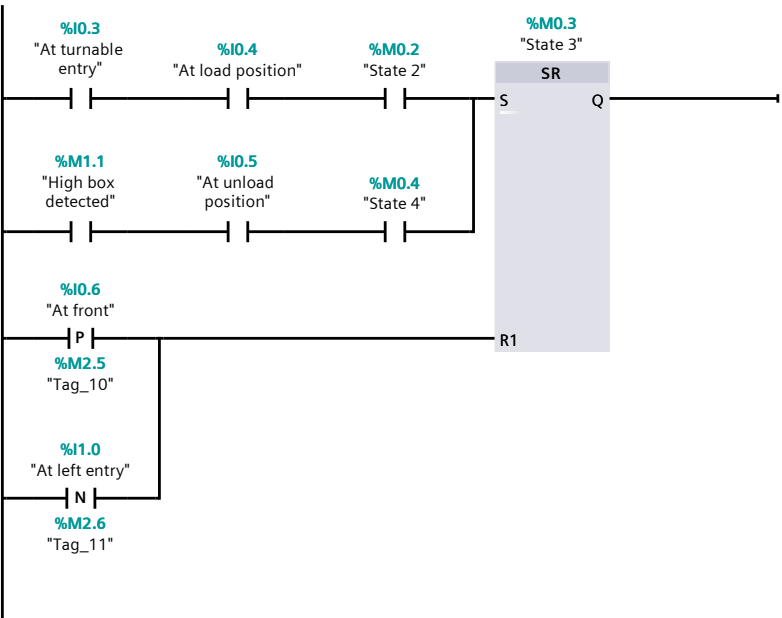


Network 5: Turn Table

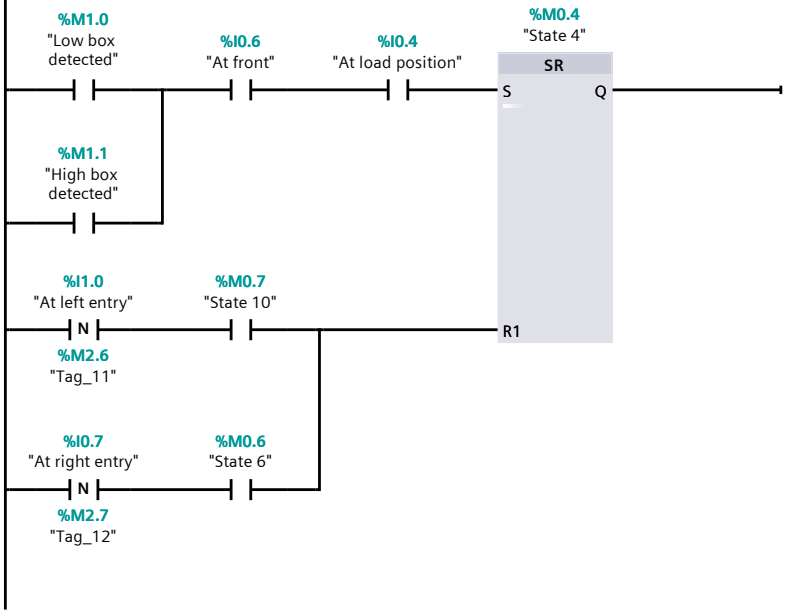


Network 6: Transfer Low box to the right

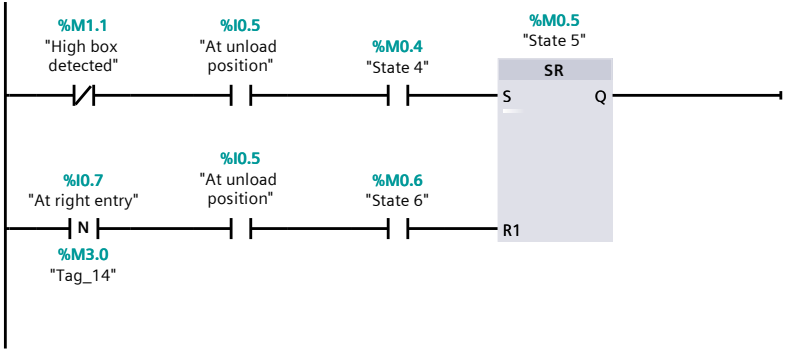


Network 7: Right conveyor

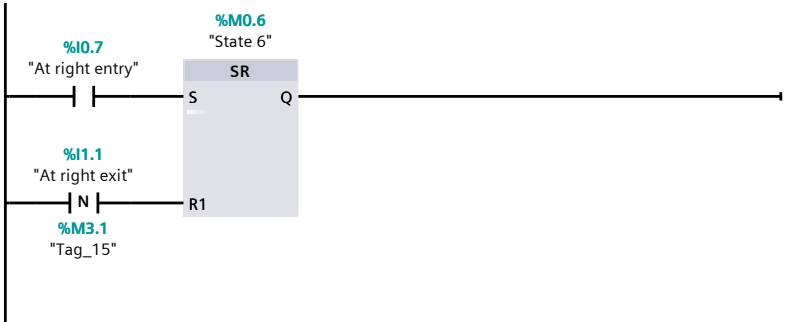


Network 8: Left Conveyor

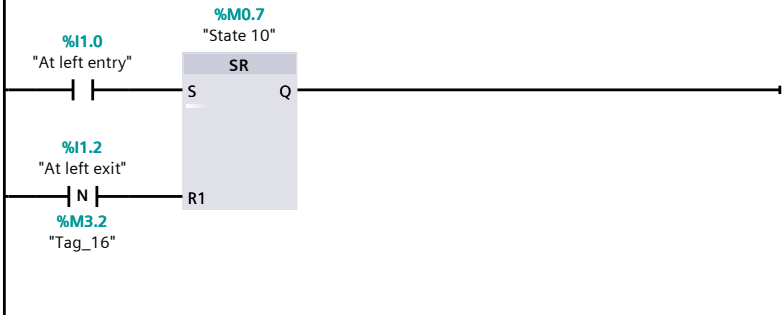

Network 9: Sensing Low box

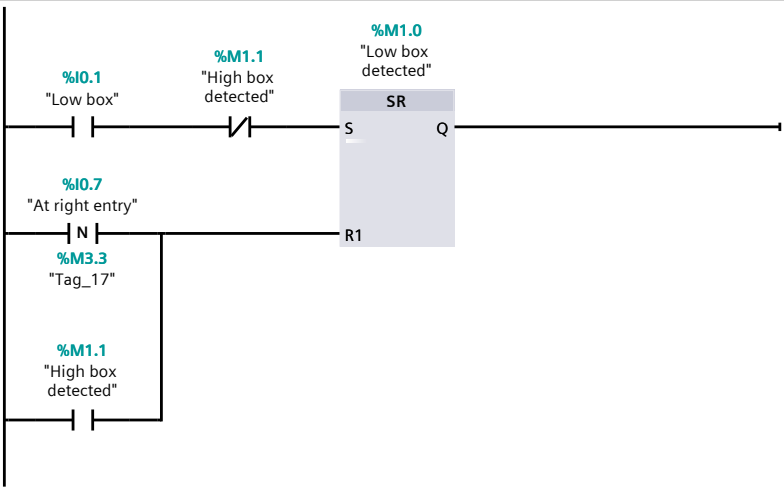

Network 10: Sensing Large box

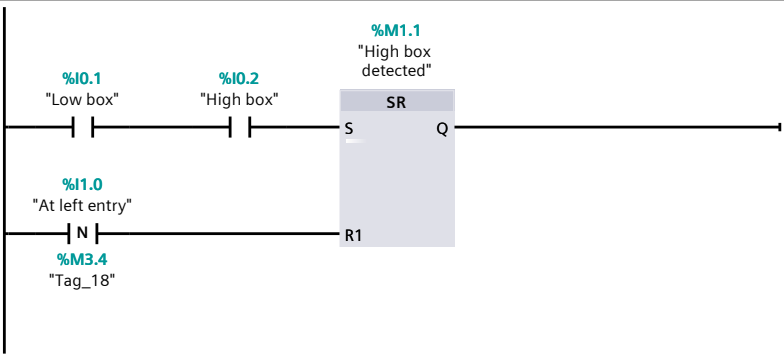


Program blocks

Actuators [FC3]

Actuators Properties					
General					
Name	Actuators	Number	3	Type	FC
Language	LAD	Numbering	Automatic		
Information					
Title		Author		Comment	
Family		Version	0.1	User-defined ID	

Name	Data type	Default value	Comment
Input			
Output			
InOut			
Temp			
Constant			
▼ Return			
Actuators	Void		

Network 1: State 0

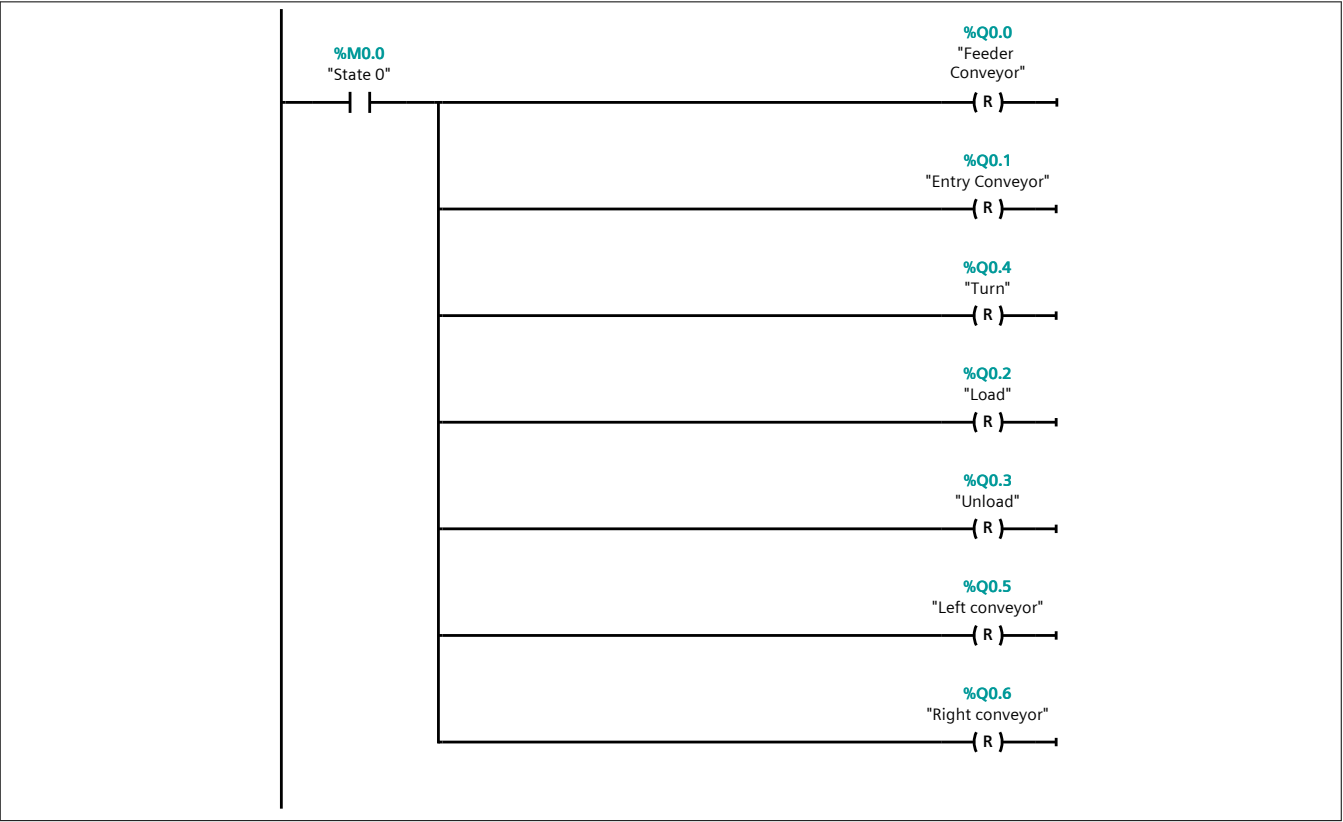

Network 2:

Totally Integrated Automation Portal		
	%M0.1 "State 1" %Q0.0 "Feeder Conveyor" %Q1.0 "Yellow indicator"	
Network 3:		
	%M0.2 "State 2" %Q0.1 "Entry Conveyor"	
Network 4:		
	%M0.3 "State 3" %Q0.2 "Load"	
Network 5:		
	%M0.4 "State 4" %Q0.4 "Turn"	
Network 6:		
	%M0.5 "State 5" %Q0.3 "Unload"	
Network 7:		
	%M0.6 "State 6" %Q0.6 "Right conveyor"	
Network 8:		

Program blocks

Startup [OB100]

Startup Properties					
General					
Name	Startup	Number	100	Type	OB
Language	LAD	Numbering	Automatic		
Information					
Title	"Complete Restart"	Author		Comment	
Family		Version	0.1	User-defined ID	

Name	Data type	Default value	Comment
▼ Input			
LostRetentive	Bool		True if retentive data are lost
LostRTC	Bool		True if date and time are lost
Temp			
Constant			

Network 1:

